

TOWN OF CHESHIRE, CONNECTICUT

INVITATION TO BID



HVAC UPGRADES TO ADMINISTRATION BUILDING

ITB #2526-11

MARCH 18, 2026

LEGAL NOTICE

TOWN OF CHESHIRE, CONNECTICUT
INVITATION TO BID

HVAC UPGRADES TO ADMINISTRATION BUILDING
ITB #2526-11
February 25, 2026

The Town of Cheshire is seeking competitive bids from qualified and responsible vendors for furnishing HVAC upgrades to the Administration Building located at the Cheshire Water Pollution Control Plant. Sealed bids are due by **11:00 AM on Wednesday, March 18, 2026** at the Cheshire Town Hall, Room 213 (Department of Public Works and Engineering), 84 South Main Street, Cheshire, CT 06410. At that time, bids will be opened in public and read aloud.

The documents comprising the Invitation to Bid ("ITB") may be obtained on the Town's website, www.cheshirect.gov under "Bids and RFPs".

The Town of Cheshire reserves its rights to amend or terminate this Invitation to Bid, accept all or any part of a bid, reject all bids, waive any informalities or non-material deficiencies in a bid, and award the bid to the bidder that, in the Town's sole discretion and judgment, will be in the Town's best interests.

OUTLINE OF BID DOCUMENTS

Description:	Included in Contents of Bid Document	Documents required for bid submittal
Outline of Bid Documents	X	
Invitation to Bid	X	
Standard Instruction to Bidders	X	
Payment Bond & Performance Bond Requirements	X	
General Specifications	X	
Special Provisions (if any)	X	
Technical Specifications (if any)	X	
Insurance Requirements	X	
Bid Submission Documents:	X	
• Bid Form	X	X
• Bidder's Legal Status Disclosure Form	X	X
• Bidder's Certification concerning Equal Employment Opportunities & Affirmative Action Policy	X	X
• Bidder's Non-Collusion Affidavit	X	X
• Bidder's Statement of References	X	X
• Bidder's Contact Information	X	X
Contract (Draft):	X	
• The Contract in the form attached		
• AIA Document A101-2017 (Standard Agreement)	X	
• AIA Document A201-2017 (General Conditions)	X	
Prevailing Wage Information (if applicable)	X	
CHRO Notification to Bidders (if applicable)		
Permits (if any)		
Design Plans (if any)	X	
Attachments (if any)		
Addenda (if any)		

INVITATION TO BID

Bid Number:	Bid Issue Date:	Date of Bid Opening:	Time of Bid Opening:
ITB #2526-11	February 25, 2026	March 18, 2026	11:00 AM
Location of Bid Opening:			
Cheshire Town Hall, Room 213, 84 South Main Street - Cheshire, Connecticut 06410			

The Town of Cheshire is seeking competitive bids from qualified and responsible vendors for furnishing HVAC upgrades to the Administration Building located at the Cheshire Water Pollution Control Plant (WPCP).

Lowest responsible and qualified bidder means the bidder whose bid is the lowest of those responsive bidders possessing the skill, responsibility, experience, qualifications, and demonstrated ability from past performance, necessary to faithfully perform the work.

One (1) original, one (1) copy, and one (1) electronic copy (on USB drive) of sealed bids must be received in the Cheshire Town Hall, Room 213 (Department of Public Works and Engineering), 84 South Main Street, Cheshire, CT 06410 by the date and time noted above. The Town of Cheshire (the "Town") will not accept submissions by e-mail or fax. The Town will reject bids received after the date and time noted above.

The documents comprising the Invitation to Bid ("ITB") may be obtained on the Town's website, www.cheshirect.org under "Bids and ITBs". **Each bidder is responsible for checking the Town's website to determine if the Town has issued any addenda and, if so, to complete its bid in accordance with the ITB as modified by the addenda.**

Bids must be held firm and cannot be withdrawn for sixty (60) calendar days after the opening date.

The Town reserves the right to amend or terminate this Invitation to Bid, accept all or any part of a bid, reject all bids, waive any informalities or non-material deficiencies in a bid, and award the bid to the bidder that, in the Town's sole discretion and judgment, will be in the Town's best interests. Consideration will be given to such matters as contractor responsibility, qualifications, compliance with laws, record of past performance, and financial and technical resources.

STANDARD INSTRUCTIONS TO BIDDERS

1. INTRODUCTION

The Town of Cheshire (the "Town") is soliciting sealed bids for:

ITB #2526-11	HVAC UPGRADES TO ADMINISTRATION BUILDING

This ITB is not a contract offer, and no contract will exist unless and until a written contract is signed by the Town and the successful bidder.

Interested parties should submit a bid in accordance with the requirements and directions contained in this ITB. **Bidders are prohibited from contacting any Town employee, officer or official concerning this ITB, except as set forth in Section 7, below. A bidder's failure to comply with this requirement may result in disqualification.**

If there are any conflicts between the provisions of these Standard Instructions to Bidders and any other documents comprising this ITB, these Standard Instructions to Bidders shall prevail.

2. OBTAINING THE ITB

All documents that are a part of this Request for Bid may be obtained on the Town's website, www.cheshirect.gov, under "Bids and RFPs."

3. RIGHT TO AMEND OR TERMINATE THE ITB OR CONTRACT

The Town may, before or after bid opening and in its sole discretion, clarify, modify, amend or terminate this ITB if the Town determines it is in the Town's best interest. Any such action shall be effectuated by a posting on the Town's website, www.cheshirect.gov, under "Bids and RFPs." The Town may also reject all bids.

Each bidder is responsible for checking the Town's website to determine if the Town has issued any addenda and, if so, to complete its bid in accordance with the ITB as modified by the addenda.

4. PRE-BID CONFERENCE

Pre-Bid Conference:	☒ YES	Mandatory:	☐ YES*
	☐ NO		☒ NO
*Any bidder who intends to submit a bid proposal in response to this solicitation must have its designated representative attend the mandatory pre-bid conference. Representatives must register at the pre-bid conference and disclose the identity of the firm they represent. Because attendance at the pre-bid conference is mandatory, a bidder's failure to attend and register at the pre-bid conference shall result in disqualification of the bidders proposal as non-responsive to the solicitation.			
Date	Time	Location	
By 3/4/26	N/A	Make Appointment (See General Specifications for Details)	

5. KEY DATES

The tentative schedule associated with this ITB will be as follows:

ITB Issue Date	February 25, 2026	
Pre-Bid Site Visit	See Pre-Bid Conference (Section 4)	
Deadline for Bidder's Questions	Seven (7) business days before bid opening (See Section 7)	
Final Addenda posting	Four (4) calendar days prior to bid opening (See Section 7)	
Bid Opening	March 18, 2026	11:00 AM
Preliminary Notice of Award*	April 1, 2026	
Contract Execution*	April 8, 2026	

*The Preliminary Notice of Award and Contract Execution dates shown above are anticipated, not certain, dates.

6. BID SUBMISSION INSTRUCTIONS

Bids must be received in the Cheshire Town Hall, **Department of Public Works and Engineering, Room 213, 84 South Main Street, Cheshire, CT 06410** by no later than the date and time the bids are scheduled to be opened publicly. Postmarks prior to the opening date and time do **NOT** satisfy this condition. The Town will not accept submissions by e-mail or fax. Bidders are solely responsible for ensuring timely delivery. The Town will **NOT** accept late bids.

One (1) original, one (1) copy, and one (1) electronic copy (on USB drive) of all bid documents must be submitted in sealed, opaque envelopes clearly labeled with the bidder's name, the bidder's address, the words "**BID DOCUMENTS,**" and the **Bid Title, Bid Number** and **Bid Opening Date**. The Town may decline to accept bids submitted in unmarked envelopes that the Town opens in its normal course of business. The Town may, but shall not be required to, return such bid documents and inform the bidder that the bid documents may be resubmitted in a sealed envelope properly marked as described above.

Bid prices must be submitted on the Bid Form included in this ITB. All blank spaces for bid prices must be completed in ink or be typewritten; bid prices must be stated in both words and figures. The person signing the Bid Form must initial any errors, alterations or corrections on that form. Ditto marks or words such as "SAME" shall not be used in the Bid Form.

Bids may be withdrawn personally or in writing provided that the Town receives the withdrawal prior to the time and date the bids are scheduled to be opened. Bids are considered valid, and may not be withdrawn, cancelled or modified, for sixty (60) days after the opening date, to give the Town sufficient time to review the bids, investigate the bidders' qualifications, secure any required municipal approvals, and execute a binding contract with the successful bidder.

An authorized person representing the legal entity of the bidder must sign the Bid Form and all other forms included in this ITB.

7. QUESTIONS AND AMENDMENTS

Questions and requests for information concerning the ITB Documents are to be submitted **in writing** (including by e-mail or fax) and directed **only to**:

Name:	Marek L. Kement, P.E.,L.S.
Department:	Department of Engineering
E-mail:	mkement@cheshirect.org
Fax:	203-271-6659

Bidders are prohibited from contacting any other Town employee, officer or official concerning this ITB. A bidder's failure to comply with this requirement may result in disqualification.

The appropriate Town representative listed above must receive any questions from bidder no later than seven (7) business days before the bid opening date. Questions received after the foregoing deadline will not be answered. That representative will confirm receipt of a bidder's questions by e-mail. The Town will answer all written questions by issuing one or more addenda, which shall be a part of this ITB and the resulting Contract, containing all questions received as provided for above and decisions regarding same.

At least four (4) calendar days prior to bid opening, the Town will post any addenda on the Town's website, www.cheshirect.org, under "Bids and RFPs." **Each bidder is responsible for checking the website to determine if the Town has issued any addenda and, if so, to complete its bid in accordance with the ITB as modified by the addenda.**

No oral statement of the Town, including oral statements by the Town representative(s) listed above, shall be effective to waive, change or otherwise modify any of the provisions of this ITB, and no bidder shall rely on any alleged oral statement.

8. ADDITIONAL INFORMATION

- 8.1 **DELIVERY/TIME FOR PERFORMANCE:** TIME IS OF THE ESSENCE with regard to the performance of the services procured through this ITB and the Contract to be entered into by the Town with the selected bidder, if any. Strict compliance with and adherence to the schedule for the services and the Contract is mandatory. If, in the sole opinion of the Town, the selected bidder is not adhering to the contract schedule, upon forty-eight (48) hours written notice from the Town to the selected bidder, the Town shall have the right to direct the bidder to increase its manpower to meet the established project schedule (including any milestones) without additional compensation. Any and all such additional labor or supervision shall be at bidder's sole cost and expense and may include, but shall not be limited to, the Town directing the selected bidder to work overtime, work weekends, or any combination thereof, without any additional compensation being due to bidder for such additional personnel. In addition, the Town shall have the right but not the obligation to supplement the bidder's forces with that of another vendor in order to achieve compliance with the project schedule. All costs attributable to the supplemental labor and supervision of same shall be the sole obligation and responsibility of the selected bidder. Failure to strictly adhere to the schedule (including any milestones) and the provisions of this paragraph 8.1 shall constitute a material default of bidder's contractual obligations and entitle the Town, in its discretion, to all remedies for default set forth in the contract.

- 8.2 **TERMINATION OF CONTRACT:** Contracts shall remain in force for the period within which the selected bidder must perform as set forth in the bid, unless (a) an extension has been agreed upon as evidenced by a contract extension executed in writing by both the selected bidder and the Town or (b) the Town has issued a termination of the contract.
- 8.3 **ASSIGNMENT:** Bidder shall not assign, transfer or subcontract this contract or its obligations hereunder without the prior written consent of the Town, which consent may be withheld in the Town's sole discretion.
- 8.4 **DEFAULT:** The contract may be terminated by the Town by written notice of default to the upon non-performance or breach of the contract terms. The awarded bidder shall be obligated to pay the Town for all losses, damages, costs and expenses, including the cost of re-procurement, and attorney's fees incurred defending claims arising from such default and in seeking recovery of all such costs and expenses from bidder and/or its surety. Upon a termination for cause, the Town shall have no further obligation to issue payments to the bidder until resolution of the dispute.
- 8.5 **CONFLICT:** To the extent any of the contract terms set forth herein conflict with the terms of the form Contract entered into by the parties, the Contract terms shall control.
- 8.6 **SUPPLY CHAIN DISRUPTIONS/TARIFFS:** Bidders shall anticipate and incorporate into their bids all potential costs and delays related to any supply chain disruptions or tariffs. In no event shall the Town be liable for any such costs and/or delays.
- 8.7 **COMPLIANCE with Requirements of Funding Source:**

Project Funded (in whole or in part) by state or federal funds:	☐ YES	☒ NO
Funding Source:	Town of Cheshire	

The successful bidder shall comply with all federal, state and local laws, ordinances, regulations and municipal Charter requirements, as well as all guidelines and requirements for the funding source noted above, if applicable.

- 8.8 **ACKNOWLEDGEMENT of Market Conditions:** Bidders acknowledge, by submitting a bid, that inflationary market conditions exist, including potential impacts of federal government imposed tariffs. Bidder has priced increased and escalated labor, equipment, and material costs into its bid, and taken into consideration the market conditions when pricing the work. No equitable adjustment or change order will be granted for increased labor, equipment or material costs during the duration of the Project.
- 8.9 **CLARIFICATION:** The Town reserves the right, either before or after the opening of bids, to ask any bidder to clarify its bid or to submit any additional information that the Town in its sole discretion deems desirable.

9. COSTS FOR PREPARING BID

Each bidder's costs incurred in developing its bid are its sole responsibility, and the Town shall have no liability for such costs.

10. OWNERSHIP OF BIDS

All bids submitted become the Town's property and will not be returned to bidders.

11. FREEDOM OF INFORMATION ACT

All information submitted in a bid or in response to a request for additional information is subject to disclosure under the Connecticut Freedom of Information Act as amended and judicially interpreted. A bidder's responses may contain financial, trade secret or other data that it claims should not be public (the "Confidential Information"). A bidder must identify specifically the pages and portions of its bid or additional information that contain the claimed Confidential Information by visibly marking all such pages and portions. Provided that the bidder cooperates with the Town as described in this section, the Town shall, to the extent permitted by law, protect from unauthorized disclosure such Confidential Information.

If the Town receives a request for a bidder's Confidential Information, it will promptly notify the bidder in writing of such request and provide the bidder with a copy of any written disclosure request. The bidder may provide written consent to the disclosure or may object to the disclosure by notifying the Town in writing to withhold disclosure of the information, identifying in the notice the basis for its objection, including the statutory exemption(s) from disclosure. The bidder shall be responsible for defending any complaint brought in connection with the nondisclosure, including but not only appearing before the Freedom of Information Commission, and providing witnesses and documents as appropriate.

12. REQUIRED DISCLOSURES

In its Bid Form each bidder must disclose, if applicable:

- Its inability or unwillingness to meet any requirement of this ITB, including but not limited to any of the Contract Terms contained in Section 28, below;
- If it is listed on the State of Connecticut's or United States Government (including any agency thereof) Debarment List;
- If it is ineligible, pursuant to Conn. Gen. Stat. § 31-57b, to be awarded the Contract because of occupational safety and health law violations;
- All resolved and pending arbitration and litigation matters in which the bidder or any of its principals (regardless of place of employment) has been involved within the last seven (7) years;
- All criminal proceedings in which the bidder or any of its principals (regardless of place of employment) has ever been the subject; and
- Each instance in which it or any of its principals (regardless of place of employment) has ever been found to have violated any state or local ethics law, regulation, ordinance, code, policy

or standard, or to have committed any other offense arising out of the submission of bids or bids or the performance of work on public works projects or contracts.

A bidder's acceptability based on these disclosures lies solely in the Town's discretion. A failure to disclose or an inaccurate response shall, in the Town's sole discretion, be grounds for disqualification.

13. **REFERENCES**

Each bidder must complete and submit the Bidder's Statement of References form included in this ITB.

14. **LEGAL STATUS**

If a bidder is a corporation, limited liability company, or other business entity that is required to register with the Connecticut Secretary of the State's Office, it must have a current registration on file with that office. The Town may, in its sole discretion, request acceptable evidence of any bidder's legal status.

15. **PROPOSAL (BID) SECURITY ("BID BOND")**

Proposal (Bid) Security Required:	☒ YES	☐ NO

Each bid must be accompanied by a certified check of the bidder or a proposal (bid) bond with a surety acceptable to the Town in an amount of equal to at least **FIVE PERCENT (5%)** of the bid amount for all contracts exceeding \$50,000. The proposal (bid) bond shall be written by a company or companies licensed to issue bonds in the State of Connecticut, which company or companies shall have at least an "A-" VIII policyholders rating as reported in the latest edition of Best Publication's Key Rating Guide. The successful bidder, upon its refusal or failure to execute and deliver the Contract, certificate(s) of insurance, W-9 form, performance security or other documents required by this ITB within **ten (10) business days** of written notification of preliminary award, unless the Town otherwise agrees in writing, shall forfeit to the Town, as liquidated damages for such failure or refusal, the security submitted with its bid.

Upon the successful bidder's execution of the Contract in the form enclosed with this ITB, the Town shall return the proposal (bid) security to the successful bidder and to all other bidders. By submitting a bid, the bidder expressly agrees that if awarded a contract for the Project, the bidder shall, within five (5) business days of receipt of notice of award, sign the contract provided by the Town without alteration or modification by the bidder.

16. **PRESUMPTION OF BIDDER'S FULL KNOWLEDGE**

Each bidder is responsible for having read and understood each document in this ITB and any addenda issued by the Town. A bidder's failure to have reviewed all information that is part of or applicable to this ITB, including but not limited to any addenda posted on the Town's website, shall in no way relieve it from any aspect of its bid or the obligations related thereto.

Each bidder is deemed to be familiar with and is required to comply with all federal, state and local laws, regulations, ordinances, codes and orders that in any manner relate to this ITB or the performance of the work described herein.

By submitting a bid, each bidder represents that it has thoroughly examined and become familiar with the scope of work outlined in this ITB, and it is capable of performing the work to achieve the Town's objectives. If applicable, each bidder shall visit the site, examine the areas and thoroughly familiarize itself with all conditions of the property before preparing its bid.

17. SUBSTITUTIONS

(THIS ITEM IS NOT APPLICABLE TO THIS ITB)

18. TAX EXEMPTIONS

The Town is exempt from the payment of federal excise taxes and Connecticut sales and use taxes. Federal Tax Exempt #066-001971. Exemption from State sales tax per Conn. Gen. Stat. Chapter 219, § 12-412(1). No exemption certificates are required, and none will be issued.

19. INSURANCE

The successful bidder shall, at its own expense and cost, obtain and keep in force at least the insurance listed in the Insurance Requirements that are a part of this ITB. The Town reserves the right to require from the successful bidder a complete, certified copy of any required insurance policy.

20. PERFORMANCE SECURITY

Performance Bond Required:	☒ YES	☐ NO
Payment Bond Required:	☒ YES	☐ NO

The successful bidder shall furnish security covering the faithful performance of the Contract (the "Performance Security"). The Performance Security shall be in the form of a surety bond for the full amount of the contract, and in a form reasonably acceptable to the Town. The Performance Security shall be issued by a company licensed by the State of Connecticut that is a T List surety and has at least an "A-" VIII policyholders rating according to Best Publication's latest edition Key Rating Guide. The cost of the Performance Security shall be included in the bid price.

In addition to the Performance Security, the successful bidder shall furnish a bond covering the successful bidder's payment to its subcontractors and suppliers of all obligations arising under the Contract (the "Payment Bond").

The Payment Bond shall be (a) in the full amount of the Contract price; (b) in a form reasonably acceptable to the Town; and (c) issued by a company licensed by the State of Connecticut that has at least an "A-" VIII policyholders rating according to Best Publication's latest edition Key Rating Guide and is on the T List. The cost of the Payment Bond shall be included in the bid price.

The Payment Bond and Performance Bond shall be provided to the Town no later than the execution of the contract and in, all cases, PRIOR to the commencement of work.

21. DELIVERY ARRANGEMENTS

The successful bidder shall deliver the items that are the subject of the ITB, at its sole cost and expense, to the location(s) listed in the Specifications.

22. AWARD CRITERIA / SELECTION / CONTRACT EXECUTION

Bid to be publicly opened:	☒ YES	☐ NO

Unless otherwise noted above, all proposals will be acknowledged in public or be publicly opened and read aloud as received on the date, at the time, and at the place identified in this RFP. Proposers may be present at the opening.

The Town reserves the right to correct, after bidder verification, any mistake in a bid that is a clerical error, such as a price extension, decimal point error or FOB terms. If an error exists in an extension of prices, the unit price shall prevail. In the event of a discrepancy between the price quoted in words and in figures, the words shall control.

The Town reserves the rights to accept all or any part of a bid, reject all bids, and waive any informalities or non-material deficiencies in a bid. The Town also reserves the right, if applicable, to award the purchase of individual items under this ITB to any combination of separate bids or bidders.

The Town will accept the bid that, all things considered, the Town determines is in its best interests. Although price will be an important factor in most ITBs, it will not be the only basis for award. Due consideration may also be given to a bidder's experience, references, service, ability to respond promptly to requests, past performance, and other criteria relevant to the Town's interests, including compliance with the procedural requirements stated in this ITB.

The Town will not award the bid to any business that or person who is in arrears or in default to the Town with regard to any tax, debt, charge, contract, security or any other obligation.

If the lowest bidder meets all specifications, is responsive, and, if applicable, qualified, but the bid is not acceptable to the Town Manager or, if applicable, the Public Building Commission or the Board of Education, the matter must be referred to the Town Council for its decision on whether to reject all bids, to accept a higher bid, or to take such other action as may be in the Town's best interests.

The Town will select the bid that it deems to be in the Town's best interest and issue a Preliminary Notice of Award to the successful bidder. The award may be subject to further discussions with the bidder.

The making of a preliminary award to a bidder does not provide the bidder with any rights and does not impose upon the Town any obligations. The Town is free to withdraw a preliminary award at any time and for any reason. A bidder has rights, and the Town has obligations, only if and when a Contract is fully executed by the Town and the bidder.

If the bidder does not execute the Contract within five (5) business days of the date of the Preliminary Notice of Award, unless extended by the Town, the Town may call any bid security provided by the bidder and may enter into discussions with another bidder.

The Key Dates for the Preliminary Notice of Award and Contract Execution dates noted in Section 5 are anticipated, not certain, dates.

23. AFFIRMATIVE ACTION AND EQUAL OPPORTUNITY

Each bidder must submit a completed Bidder's Certification Concerning Equal Employment Opportunities and Affirmative Action Policy form included with this ITB. Bidders with fewer than ten (10) employees should indicate that fact on the form and return the form with their bids. Bidders are solely responsible for researching and familiarizing themselves with current federal and state laws and regulations, including Presidential Executive Orders, and complying with same in all respects at all times. Any bidder who violated federal or state law shall indemnify, defend, and hold the Town harmless from and against any penalties, fines or other damages incurred by the Town as a result of such non-compliance.

24. NONRESIDENT REAL PROPERTY CONSTRUCTION CONTRACTORS

If the successful bidder is a "nonresident contractor" as defined in Conn. Gen. Stat. § 12-430(7)(A) as amended, it shall comply fully with the provisions of § 12-430(7) and, prior to execution of the Contract, shall furnish the Town with a copy of the requisite certificate of compliance set forth in § 12-430(7)(E).

The successful bidder agrees to defend, indemnify, and hold harmless the Town, its employees, officers, officials, agents, volunteers and independent contractors, including any of the foregoing sued as individuals (collectively, the "Town Indemnified Parties"), from any and all taxes, interest and penalties that the State of Connecticut asserts are due with respect to the successful bidder's activities under the Contract.

The successful bidder shall also be required to pay any and all attorney's fees incurred by the Town Indemnified Parties in enforcing any of the successful bidder's obligations under this section, whether or not a lawsuit or other proceeding is commenced, which obligations shall survive the termination or expiration of the Contract.

25. COMPLIANCE WITH IMMIGRATION LAWS

By submitting a bid, each bidder confirms that it has complied, and during the term of the Contract will comply, with the Immigration Reform and Control Act ("IRCA") and that each person it provides under the Contract will at all times be authorized for employment in the United States of America. Each bidder confirms that it has a properly completed Employment Eligibility Verification, Form I-9, for each person who will be assigned under the Contract and that it will require each subcontractor, if any, to confirm that it has a properly completed Form I-9 for each person who will be assigned under the Contract.

The successful bidder shall defend, indemnify, and hold harmless the Town, its employees, officers, officials, agents, volunteers and independent contractors, including any of the foregoing sued as individuals (collectively, the "Town Indemnified Parties"), against any and all proceedings, suits, actions, claims, damages, injuries, awards, judgments, losses or expenses, including fines, penalties, punitive damages, attorney's fees and costs, brought or assessed against, or incurred by, the Town Indemnified Parties related to or arising from the obligations under IRCA imposed upon the successful bidder or its subcontractor.

The successful bidder shall also be required to pay any and all attorney's fees and costs incurred by the Town Indemnified Parties in enforcing any of the successful bidder's obligations under this

provision, whether or not a lawsuit or other proceeding is commenced, which obligations shall survive the termination or expiration of the Contract.

26. NON COLLUSION AFFIDAVIT

Each bidder shall submit a completed Bidder's Non-Collusion Affidavit that is part of this ITB.

27. MUNICIPAL PUBLIC WORKS CONTRACT REQUIREMENTS

(THIS ITEM IS NOT APPLICABLE TO THIS ITB).

28. CONTRACT TERMS

A contract template has been provided with this Request for Bid. By submitting a bid, the Bidder acknowledges and agrees that it will execute the contract submitted to it for execution by the Town, without alteration or modification by the Bidder, within five (5) days of receipt of notice of award.

The following provisions are among the mandatory terms of the Town's Contract with the successful bidder. If a bidder is unwilling or unable to meet any of these Contract Terms, it must disclose that inability or unwillingness in its Bid Form (see Section 12 of these Standard Instructions to Bidders):

a. **DEFENSE, HOLD HARMLESS AND INDEMNIFICATION**

The successful bidder agrees, to the fullest extent permitted by law, to defend, indemnify, and hold harmless the Town, its employees, officers, officials, agents, volunteers, boards, commissions, committees, and independent contractors, including any of the foregoing sued as individuals (collectively, the "Town Indemnified Parties"), from and against all proceedings, suits, actions, claims, damages, injuries, awards, judgments, losses or expenses, including attorney's fees, arising out of or relating, directly or indirectly, to the successful bidder's performance of the contract, including but not limited to bidder's malfeasance, misconduct, negligence or failure to meet its obligations under the ITB or the Contract.

The successful bidder's obligations under this section shall not be limited in any way by any limitation on the amount or type of the successful bidder's insurance. Nothing in this section shall obligate the successful bidder to indemnify the Town Indemnified Parties against liability for damage arising out of bodily injury to persons or damage to property caused by or resulting from the negligence of the Town Indemnified Parties.]

In any and all claims against the Town Indemnified Parties made or brought by any employee of the successful bidder, or anyone directly or indirectly employed or contracted with by the successful bidder, or anyone for whose acts or omissions the successful bidder is or may be liable, the successful bidder's obligations under this section shall not be limited by any limitation on the amount or type of damages, compensation or benefits payable by the successful bidder under workers' compensation acts, disability benefit acts, or other employee benefits acts.

The successful bidder shall also be required to pay any and all attorney's fees incurred by the Town Indemnified Parties in enforcing any of the successful bidder's obligations under this section, which obligations shall survive the termination or expiration of this ITB and the Contract.

As a municipal agency of the State of Connecticut, the Town will NOT defend, indemnify, or hold harmless the successful bidder.

b. ADVERTISING

The successful bidder shall not name the Town in any advertising, news releases, or promotional efforts without the Town's prior written approval.

If it chooses, the successful bidder may list the Town in a Statement of References or similar document required as part of its response to a public procurement. The Town's permission to the successful bidder to do so is not a statement about the quality of the successful bidder's work or the Town's endorsement of the successful bidder.

c. W-9 FORM

The successful bidder must provide the Town with a completed W-9 form before Contract execution.

d. PAYMENTS

Bidders are encouraged to offer discounts for early payment. All other payments are to be made 30 days after the appropriate Town employee receives and approves the invoice, unless otherwise specified in the Specifications or Contract.

"In each of its contracts with subcontractors or materials suppliers, the successful bidder shall agree to pay any amounts due for labor performed or materials furnished not later than thirty (30) days after the date the successful bidder receives payment from the Town that encompasses the labor performed or materials furnished by such subcontractor or material supplier. The successful bidder shall also require in each of its contracts with subcontractors that such subcontractor shall, within thirty (30) days of receipt of payment from the successful bidder, pay any amounts due any sub-subcontractor or material supplier, whether for labor performed or materials furnished.

Each payment application or invoice shall be accompanied by a statement showing the status of all pending change orders, pending change directives and approved changes to the Contract. Such statement shall identify the pending change orders and pending change directives and shall include the date such change orders and change directives were initiated, additional cost and/or time associated with their performance and a description of any work completed. The successful bidder shall require each of its subcontractors and suppliers to include a similar statement with each of their payment applications or invoices."

e. TOWN INSPECTION OF WORK/PRODUCTS

The Town may inspect the successful bidder's work at all reasonable times. This right of inspection is solely for the Town's benefit and does not transfer to the Town the responsibility for discovering patent or latent defects. The successful bidder has the sole and exclusive responsibility for performing in accordance with the Contract.

Work shall conform with the State of Connecticut Department of Transportation Form 819, as amended and the Town of Cheshire Guidelines and Specifications for Public Improvements which are available on the Town's website at: www.cheshirect.org

Should an apparent conflict between these two specifications arise then the Contractor shall submit a request for resolution of the discrepancy in writing and the Town shall respond in writing as to which better satisfies the intent of the design and will take precedence.

f. REJECTED WORK OR MATERIALS

The successful bidder, at its sole cost and expense, shall remove from the Town's property rejected items, commodities and/or work within 48 hours of the Town's notice of rejection. Immediate removal may be required when safety or health issues are present.

g. MAINTENANCE AND AVAILABILITY OF RECORDS

The successful bidder shall maintain all records related to the work described in the ITB for a period of five (5) years after final payment under the Contract or until all pending Town, state and federal audits are completed, whichever is later. Such records shall be available for examination and audit by Town, state and federal representatives during that time.

h. SUBCONTRACTING

Prior to entering into any subcontract agreement(s) for the work described in the Contract, the successful bidder shall provide the Town with written notice of the identity (full legal name street address, mailing address (if different from street address), and telephone number) of each proposed subcontractor. The Town shall have the right to object to any proposed subcontractor by providing the successful bidder with written notice thereof within seven (7) business days of receipt of all required information about the proposed subcontractor. If the Town objects to a proposed subcontractor, the successful bidder shall not use that subcontractor for any portion of the work described in the Contract.

All permitted subcontracting shall be subject to the same terms and conditions as are applicable to the successful bidder. The successful bidder shall remain fully and solely liable and responsible to the Town for performance of the work described in the Contract.

The successful bidder also agrees to promptly pay each of its subcontractors within thirty (30) days of receipt of payment from the Town or otherwise in accordance with law. The successful bidder shall assure compliance with all requirements of the Contract. The successful bidder shall also be fully and solely responsible to the Town for the acts and omissions of its subcontractors and of persons employed, whether directly or indirectly, by its subcontractor(s).

i. PREVAILING WAGES

State law requires that wages paid on an hourly basis to any person performing the work of any mechanic, laborer or worker under the Contract and the amount of payment or contribution paid or payable on behalf of each such person to any employee welfare fund, as defined in Conn. Gen. Stat. § 31-53, as amended, shall be at a rate equal to the rate customary or prevailing for the same work in the same trade or occupation in the Town.

A successful bidder who is not obligated by agreement to make payment or contribution on behalf of such persons to any such employee welfare fund shall pay to each mechanic, laborer or worker as part of such person's wages the amount of payment or contribution for such person's classification on each pay day.

Upon Contract award, the successful bidder must certify under oath to the State Labor Commissioner the pay scale to be used by the successful bidder and its subcontractors. The applicable prevailing wage rates are included with this ITB.

j. PREFERENCES

The successful bidder shall comply with the requirements of Conn. Gen. Stat. § 31-52(b), as amended. Specifically, the successful bidder agrees that in the employment of labor to perform the work under the Contract, preference shall be given to citizens of the United States who are, and have been continuously for at least three (3) months prior to the date of the Contract, residents of the labor market area (as established by the State of Connecticut Labor Commissioner) in which such work is to be done, and if no such qualified person is available, then to citizens who have continuously resided in New Haven County for at least three (3) months prior to the date hereof, and then to citizens of the State who have continuously resided in the State at least three (3) months prior to the date of the Contract.

k. WORKERS COMPENSATION

Prior to commencing work on the Project, the successful bidder shall furnish to the Town (1) sufficient evidence of compliance with the workers' compensation insurance and self-insurance requirements of subsection (b) of Conn. Gen. Stat. section 31-284, and (2) a current statement from the State Treasurer that, to the best of his knowledge and belief, as of the date of the statement, the particular party was not liable to the state for any workers' compensation payments made pursuant to section 31-355. Contact the State Treasurer's Office for such statements.

Prior to Contract execution, the Town will require the tentative successful bidder to provide a current statement from the State Treasurer that, to the best of her knowledge and belief, as of the date of the statement, the tentative successful bidder was not liable to the State for any workers' compensation payments made pursuant to Conn. Gen. Stat. § 31-355.

l. SAFETY

The successful bidder and each of its permitted subcontractors shall furnish proof that each employee performing the work of a mechanic, laborer or worker under the Contract has completed a course of at least ten (10) hours in construction safety and health approved by the federal Occupational Safety and Health Administration or has completed a new miner training program approved by the Federal Mine Safety and Health Administration.

Such proof shall be provided with the certified payroll submitted for the first week each such employee, mechanic, laborer, or worker begins work under the Contract.

m. COMPLIANCE WITH LAWS

The successful bidder shall comply with all applicable laws, regulations, ordinances, codes and orders of the United States, the State of Connecticut and the Town related to its bid and the performance of the Contract, including but not limited to:

1. **Non-Discrimination and Affirmative Action.** Bidder, in performing under this contract, shall not discriminate against any worker, employee or applicant, or any member of the public, because of race, creed, color, age, marital status, sexual orientation, national origin, ancestry, sex, mental retardation or physical disability, including but not limited to blindness, unless it is shown by the Bidder that such disability prevents performance of the work involved in any manner prohibited by the laws of the United States or the State of Connecticut, nor otherwise commit an unfair employment practice. Bidder further agrees

that this article, (and any additional provisions required by law), will be incorporated by Bidder in all contracts entered into with suppliers of materials or services contractors and sub-contractors and all labor organizations, furnishing skilled, unskilled and craft union skilled labor or who may perform any such labor or services in connection with this contract.

2. **Executive Orders.** The contract may be subject to the provisions of Executive Order No. Three of Governor Thomas J. Meskill, promulgate June 16, 1971, concerning labor employment practices, Executive Order No. Seventeen of Governor Thomas J. Meskill, promulgate February 15, 1973, concerning the listing of employment opening and Executive Order No. Sixteen of Governor John G. Rowland promulgated August 4, 1999, concerning violence in the workplace, all of which are incorporated into and are made a part of the contract as if they had been fully set forth in it.

The contract may also be subject to Executive Order No. 7C of Governor M. Jodi Rell, promulgated July 13, 2006, concerning contracting reforms and Executive Order No. 14 of Governor M. Jodi Rell, promulgate April 17, 2006, concerning procurement of cleaning products and services, in accordance with their respective terms and conditions.

3. **Connecticut's Prevailing Wage Law Provision.** The successful Bidder must comply with CGS Section 31-53 and 31-53(a), which apply to each contract for the construction, remodeling, refinishing, refurbishing, rehabilitation, alteration, or repair of any public works project by the state or its agents, or by any political subdivision of the State. In accordance with CGS Section 31-53, projects are subject to the payment of minimum prevailing wages where the total cost of all work to be performed by all contractors and subcontractors in connection with new construction of any public works project is \$1,000,000 or more and where the total cost of all work to be performed by all contractors and subcontractors in connection with any remodeling, refinishing, refurbishing, rehabilitation, alteration or repair of any public works project is \$100,000 or more. The wages paid on an hourly basis to any person performing the work of any mechanic, laborer or worker on the work herein contracted to be done and the amount of payment or contribution paid or payable on behalf of each such person to any employee welfare fund, as defined in subsection (i) of section 31-53 of the Conn. Gen. Stat., shall be at a rate equal to the rate customary or prevailing for the same work in the same trade or occupation in the Town of Cheshire. If the contractor is not obligated by agreement to make payment or contribution on behalf of such persons to any such employee welfare fund, it shall pay to each mechanic, laborer or worker as part of such person's wages the amount of payment or contribution for such person's classification on each pay day.

All contractors and subcontractors shall submit to the Finance Department certified weekly payrolls for all contracts meeting the stated monetary limits. The certified payrolls shall be submitted to the Finance Department with the Bidder's monthly certificate for payment. The Bidders should familiarize themselves with all aspects of the provisions under state law in order to ensure full compliance.

4. Contractor shall also furnish proof to the Town's Finance Department, beginning with the weekly certified payroll form for the first week each employee begins work on this project, that any person performing the work of a mechanic, laborer or worker pursuant to the classifications of labor under section 31-53 of the Conn. Gen. Stat. on this project, has completed a course of at least ten hours in duration in construction safety and health approved by the federal Occupational Safety and Health Administration or, has completed a new miner training program approved by the Federal Mine Safety and Health Administration in accordance with 30 CFR 48 or, in the case of telecommunications employees, has completed at least ten hours of training in accordance with 29 CFR 1910.268.
5. **Occupational Safety and Health Administration Requirements.** According to CGS, Section 31-53b (a) each contract entered into on or after July 1, 2007, for the construction, remodeling, refinishing, refurbishing, rehabilitation, alteration or repair of any public building project by the state or any of its agents, or by a political subdivision of the state or any of its agents, where the total cost of all work to be performed by all contractors and subcontractors in connection with the contract is at least \$100,000 shall contain a provision requiring that, not later than thirty days after the date such contract is awarded, each contractor furnish proof to the Labor Commissioner that all employees performing manual labor on or in such public building, pursuant to such contract, have completed a course of at least ten hours in duration in construction safety and health approved by the federal Occupational Safety and Health Administration or, in the case of telecommunications employees, have completed at least ten hours of training in accordance with 29 CFR 1910.268. The aforesaid provisions shall be deemed to be incorporated into the Contract with the Town. The contractors should familiarize themselves with all aspects of state law and any applicable regulations pertaining to these requirements in order to ensure full compliance.
6. **Payment Bond/Performance Bond State Law Requirements.** CGS Section 49-41, known as the Little Miller Act, requires that the Town ensure that payment bonds a/k/a labor and materials bond in the amount of the contract are provided for public works projects over \$100,000.

When a contract for construction, alteration, remodeling, repair or demolition of any public building is estimated to cost more than \$500,000 additional laws/requirements apply. The contractors should familiarize themselves with all aspects of state law and any applicable regulations pertaining to these requirements in order to ensure full compliance.

7. **State of Connecticut Contractor Prequalification Program.**

(THIS ITEM IS NOT APPLICABLE TO THIS ITB).

8. **Non-Resident Contractor 5% Tax For Contracts.** CGS Section 12-430(7) requires non-resident contractors who perform services or furnish materials, or both, for the construction, alteration or improvement of any project in which the contract price is at least \$250,000, to furnish the Department of Revenue Services (DRS) a Guarantee Bond for 5% of the total cost of the work, issued under a contract using Form AU-766, Guarantee Bond. This form is

available on the State DRS website. Form AU-766 must be submitted for each additional change order or supplement issued against the contract. Non-resident contractors must have completed and submitted to the DRS Form REG-1, Business Tax Registration Application, to register with the DRS and have been issued a Connecticut Tax Registration Number. This form is available on the DRS website. Non-resident contractors have 120 days from the commencement of the contract to file the Guarantee Bond with the State. Commencement of the contract, as defined by law, "means the time when the non-resident contractor signs the contract, but, in any event, occurs no later than when the work under the contract actually starts."

As soon as the guarantee bond is filed with the DRS, the non-resident contractor shall submit the copy of such Guarantee Bond together with the non-resident contractor's Connecticut Tax Registration Number to the Town department for whom the project is required. After the non-resident contractor receives its Certificate of Compliance from the DRS confirming that the Guarantee Bond requirement has been met, the non-resident contractor shall submit a copy of the same to the department, for whom the work is being performed, with a copy to the Purchasing Department.

9. **Equal Employment Opportunity (EEO); Minority Business Enterprises (MBE).** The contractor agrees and warrants that in the performance of the contract such contractor will not discriminate or permit discrimination against any person or group of persons on the grounds of race, color, religious creed, age, marital status, national origin, ancestry, sex, gender identity or expression, status as a veteran, intellectual disability, mental disability or physical disability, including, but not limited to, blindness, unless it is shown by such contractor that such disability prevents performance of the work involved, in any manner prohibited by the laws of the United States or of the State of Connecticut;

The contractor agrees, in all solicitations or advertisements for employees placed by or on behalf of the contractor, to state that it is an "equal opportunity employer" in accordance with regulations adopted by the Commission on Human Rights and Opportunities;

The contractor agrees to provide each labor union or representative of workers with which such contractor has a collective bargaining agreement or other contract or understanding and each vendor with which such contractor has a contract or understanding, a notice to be provided by the Commission on Human Rights and Opportunities advising the labor union or workers' representative of the contractor's commitments under this section, and to post copies of the notice in conspicuous places available to employees and applicants for employment;

The contractor agrees to comply with each provision of this section and sections 46a-68e and 46a-68f and with each regulation or relevant order issued by the Connecticut CHRO pursuant to sections 46a-56, 46a-68e, 46a-68f and 46a-86; and

The contractor agrees to provide the CHRO with such information requested by the commission, and permit access to pertinent books, records and accounts, concerning the employment practices and procedures of the contractor as relate to the provisions of this section and section 46a-56.

The contractor agrees and warrants that in the performance of the contract such contractor will not discriminate or permit discrimination against any person or group of persons on the grounds of sexual orientation, in any manner prohibited by the laws of the United States or of the state of Connecticut, and that employees are treated when employed without regard to their sexual orientation;

The contractor agrees to provide the CHRO with such information requested by the commission, and permit access to pertinent books, records and accounts, concerning the employment practices and procedures of the contractor which relate to the provisions of this section and section 46a-56.

10. The successful bidder shall:

- (a) Comply fully with all federal and state antidiscrimination and contract compliance laws, and shall not discriminate or permit a discriminatory practice to be committed;
- (b) Cooperate fully with the Connecticut CHRO;
- (c) Submit periodic reports of its employment and subcontracting practices in such a form, in such a manner and at such a time as may be prescribed by the commission;
- (d) Maintain full and accurate support data for a period of two (2) years from the date the record is made or the date the contract compliance form is submitted, whichever is later, provided that this provision shall not excuse compliance with any other applicable record retention statute, regulation or policy providing for a period of retention in excess of two (2) years;
- (e) Not discharge, discipline or otherwise discriminate against any person who has filed a complaint, testified or assisted in any proceeding with the commission;
- (f) Make available for inspection and copying any support data requested by the commission, and make available for interview any agent, servant or employee having knowledge of any matter concerning the investigation of a discriminatory practice complaint or any matter relating to a contract compliance review; and
- (g) Include a provision in all subcontracts with minority business enterprises requiring that the minority business enterprise provide the commission with such information on its structure and operations as the commission finds necessary to make an informed determination as to whether the standards of Section 4a-60 of the Connecticut General Statutes, as amended by Section 2 of Public Act 89-253, have been met.

n. LICENSES AND PERMITS

The successful bidder certifies that, throughout the Contract term, it shall have and provide proof of all approvals, permits and licenses required by the Town and/or any state or federal authority. The successful bidder shall immediately and in writing notify the Town of the loss or suspension of any such approval, permit or license.

o. AMENDMENTS

The Contract may not be altered or amended except by the written agreement of both parties.

p. ENTIRE AGREEMENT

It is expressly understood and agreed that the Contract contains the entire agreement between the parties, and that the parties are not, and shall not be, bound by any stipulations, representations, agreements or promises, oral or otherwise, not printed or inserted in the Contract or its attached exhibits.

q. VALIDITY

The invalidity of one or more of the phrases, sentences or clauses contained in the Contract shall not affect the remaining portions so long as the material purposes of the Contract can be determined and effectuated.

r. CONNECTICUT LAW AND COURTS

The Contract shall be governed by and construed in accordance with the internal laws (as opposed to the conflicts of law provisions) of the State of Connecticut, and the parties irrevocably submit in any suit, action or proceeding arising out of the Contract to the jurisdiction of any court of the State of Connecticut, as applicable.

s. NON-EMPLOYMENT RELATIONSHIP

The Town and the successful bidder are independent parties. Nothing contained in the Contract shall create, or be construed or deemed as creating, the relationships of principal and agent, partnership, joint venture, employer and employee, and/or any relationship other than that of independent parties contracting with each other solely for the purpose of carrying out the terms and conditions of the Contract.

The successful bidder understands and agrees that it is not entitled to employee benefits, including but not limited to workers compensation and employment insurance coverage, and disability. The successful bidder shall be solely responsible for any applicable taxes.

t. COMPLIANCE WITH SOLID WASTE DISPOSAL ACT

The successful bidder shall comply with section 6002 of the Solid Waste Disposal Act, as amended by the Resource Conservation and Recovery Act.

The requirements of Section 6002 include procuring only items designated in guidelines of the Environmental Protection Agency (EPA) at 40 CFR part 247 that contain the highest percentage of recovered materials practicable, consistent with maintaining a satisfactory level of competition, where the purchase price of the item exceeds \$10,000 or the value of the quantity acquired during the preceding fiscal year exceeded \$10,000; procuring solid waste management services in a manner that maximizes energy and resource recovery; and establishing an affirmative procurement program for procurement of recovered materials identified in the EPA guidelines.

END OF STANDARD INSTRUCTIONS TO BIDDERS

GENERAL SPECIFICATIONS

GENERAL SPECIFICATIONS

OVERVIEW:

The Town of Cheshire is seeking competitive bids from qualified and responsible vendors for furnishing HVAC upgrades to the Administration Building located at the Cheshire Water Pollution Control Plant (WPCP).

SCOPE OF WORK:

All work shall be in accordance with these bid documents and as described on the attached project design plan set.

There shall be two (2) separate base bids for this project:

- **BASE BID "A"** (also known as **Phase 1**) shall include all work associated with only the administration section of the building, which excludes the laboratory section, as shown on the PLANS.
- **BASE BID "B"** (also known as **Phase 2**) shall include all work associated with only the Laboratory section, as shown on the PLANS.

The Town of Cheshire may elect to award each of the Base Bids separately or together if, in its sole discretion and judgement, will be in the Town's best interest.

PRE-BID TOUR: (NON-MANDATORY)

It is recommended that any bidder who intends to submit a bid in response to this solicitation to have its designated representative tour the operations building. The WPCP is located at 1325 Cheshire Street, Cheshire, Connecticut.

A tour of the facility must be performed no later than **Wednesday, March 4, 2026**. Please contact David Milano, Superintendent, directly to schedule the site visit at: dmilano@chshirect.gov or call (475) 343-2772.

PROJECT MANAGEMENT & MEETINGS:

The apparent successful Bidder shall be responsible to provide project oversight and coordination as necessary for prompt and successful completion of all contract services. The contractor shall attend a project kick-off meeting to review the scope of work and be available for up to two (2) in person coordination meetings with the Town throughout the Contract period.

The Contractor shall always have a supervisor onsite when work is being performed throughout the entire course of this Contract. This person shall be the responsible individual in charge whom the Town shall coordinate all onsite activities, including Inspections. The Contractor shall identify this person at the pre-construction meeting and provide contact information, including emergency contact information outside of normal work hours.

SCHEDULE OF VALUES

The apparent successful Bidder must submit, prior to the execution of an Agreement, a preliminary schedule of values for all of the Work and must be deemed acceptable by the Town Engineer before the Agreement is executed.

TIME OF COMPLETION:

For each base bid, the contractor affirms that time is of the essence regarding the execution of this project and furthermore accepts the Town's commitment to have the work completed within **seventy-five (75) consecutive calendar days**, starting on the Notice to Proceed.

MATERIALS:

The Contractor shall furnish and install all materials necessary to complete this project unless specifically otherwise noted. The Contractor shall furnish all materials to meet or exceed those specified. The Contractor shall install all materials in accordance with both the material manufacturers recommendations, accepted industry standard practices and the contract specifications. The Town of Cheshire will not be held liable for costs incurred to implement or correct work which does not conform to local or state codes, requirements, ordinances, or regulations.

The Contractor owns all materials to be removed from the site except those noted to be salvaged and is responsible for its suitable disposal.

UTILITY SYSTEMS:

The plans require a Contractors working knowledge of local, municipal, water authority, and state codes for utility systems. Any conflicts between materials and locations shown, and local requirements shall be brought to the attention of the Engineer prior to the execution of work. The Town of Cheshire will not be held liable for costs incurred to implement or correct work which does not conform to local or state codes, requirements, ordinances, or regulations.

COORDINATION OF WORK:

The Contractor shall coordinate with the Town and its agent accordingly. The Contractor's allowable work hours at the site are limited to: Monday through Friday between 7:00AM and 3:30PM.

There shall be no work on Saturdays, Sundays, and all town observed Holidays.

If additional time is needed to complete the project outside of the regular working hours noted above, then the Contractor shall notify the Town Engineer for approval and coordination.

LICENSES:

The Contractor and its subcontractors performing the work shall hold relevant licenses issued by the State of Connecticut. All work under this Contract shall be subject to the rules and ordinances of the State of Connecticut and the Town of Cheshire.

PERMITS:

The Contractor is responsible for obtaining all necessary permits, including all associated costs required for this Contract work. Permit fees associated with town department permits shall be waived.

INSPECTION:

Authorized representatives and agents of the Town of Cheshire shall have access and be permitted to inspect all work, materials, payrolls, contract records, invoices of materials and other relevant data in the development and progress of this project.

TESTING:

The Contractor shall perform all tests as deemed necessary to ensure proper compliance. The Contractor shall arrange for any inspections required by the State or the Town of Cheshire and shall bear the costs of any such inspections.

END GENERAL SPECIFICATIONS

SPECIAL PROVISIONS

SUBMITTALS

1.00 GENERAL

1.01 RELATED DOCUMENTS

- A. The General Provisions of the Contract apply to the work specified in this Section.

1.02 SECTION INCLUDES

- A. Schedule of Submittals
- B. Construction Progress Schedule
- C. Schedule of Values
- D. Shop Drawings
- E. Product Data
- F. Manufacturer's Instruction
- G. Application for Payment
- H. Certified payroll

1.03 PROCEDURES

- A. Digital pdf files of the submittals shall be submitted to the Cheshire Town Engineer at mkement@cheshirect.gov.
- B. All submittals shall be accompanied by a completed transmittal form accepted by the Town Engineer. The form shall identify: Project, preparer of the submittal, date, name and address of Contractor, Subcontractor, Supplier, and manufacturer; identify pertinent drawing sheet, detail, and Specification Section number, as appropriate; and identify deviations from Contract Documents. Provide space for Contractor and Engineer review stamps.
- C. Submit initial progress schedules, schedule of submittals, and schedule of values prior to initiation of work. After review by Engineer, revise and resubmit as required. Submit revised schedules with each Application for Payment, reflecting changes since previous submittal.
- D. Comply with progress schedule for submittals related to Work progress. Coordinate submittal of related items.
- E. After Town Engineer review of submittal, revise and resubmit as required, identifying changes made since previous submittal.
- F. Distribute copies of reviewed submittals to Owner and concerned persons. Instruct recipients to promptly report any inability to comply with provisions

2.00 PRODUCTS

2.01 SCHEDULE OF SUBMITTALS

- A. Prior to the initiation of work, the Contractor shall submit a schedule of submittals, arranged in chronological order by dates required by the construction schedule. Include time required for review, re-submittal, ordering, manufacturing, fabrication, and delivery.
- B. Coordinate Schedule of Submittals with list of subcontracts, the Schedule of Values, and Construction Progress Schedule.

2.02 CONSTRUCTION PROGRESS SCHEDULE

- A. Prior to the initiation of work, the Contractor shall submit a schedule of the anticipated starting and completion dates for the various activities. The schedule shall be in a form approved by the Engineer and shall correspond to the schedule of Values.
- B. The Contractor shall issue an up-to-date progress schedule to the Engineer, along with each application for payment.
- C. It shall be the Contractor's responsibility to notify and coordinate their work with the local utility companies, local fire & police departments, and the Cheshire Department of Public Works and Engineering.

2.03 SCHEDULE OF VALUES

- A. Prior to the initiation of work, the Contractor shall submit a Schedule of Values allocating portions of the Contract Price to various portions of the Work and used as the basis for reviewing Contractor's Applications for Payment. The schedule shall be in a form approved by the Town Engineer.
- B. The Contractor shall issue an up-to-date schedule of values to the Town Engineer, along with each application for payment.

2.04 SHOP DRAWINGS

- A. Shop Drawings shall be complete, giving all information necessary or requested in the individual section of the specifications. They shall also show adjoining Work and details of connection thereto.
- B. Shop Drawings shall be for whole systems. Partial submissions will not be accepted.
- C. The Town Engineer reserves the right to review and approve shop drawings only after approval of related product data and samples.
- D. Shop drawings shall be properly identified and contain the name of the project, name of the firm submitting the shop drawings, shop drawing number, date of shop drawings and revisions, Contractor's stamp of approval, and sufficient spaces near the title block for the Engineer's stamp.

- E. When the Shop Drawing is returned by the Town Engineer with the stamp "Revise and Resubmit" or "Disapproved", the Contractor shall correct the original drawing or prepare a new drawing and resubmit to the Town Engineer for approval. This procedure shall be repeated until the Town Engineer's approval is obtained.
- F. When the Shop Drawing is returned by the Town Engineer with the stamp "Approved" or "Approved as Corrected", the Contractor shall provide and distribute prints for all Subcontractors.
- G. The Contractor shall maintain one full set of approved shop drawings at the site.

2.05 PRODUCT DATA

- A. Mark each copy to identify applicable products, models, options, and other data; supplement manufacturers' standard data to provide information unique to the Work.
- B. Submit the number of copies that Contractor requires, plus two copies, which will be retained by the Town Engineer.

2.06 MANUFACTURER'S INSTRUCTIONS

- A. When required, submit manufacturer's printed instructions for delivery, storage, assembly, installation, start-up, adjusting, and finishing, in quantities specified for product data.

2.07 APPLICATION FOR PAYMENT

- A. The Application for Payment shall be submitted on a form approved by the Town Engineer.

2.08 CERTIFIED PAYROLL

- A. Along with the submittal of each Application for Payment, the Contractor shall provide written certification that they and their respective subcontractors have complied with the Prevailing Wage Rate requirements established by the State of Connecticut Department of Labor for the period during which the work is performed. Certified payroll shall be submitted in a form approved by the Town Engineer.

END OF SUBMITTAL SPECIFICATIONS

CONTRACT CLOSEOUT

1.00 GENERAL INFORMATION

1.01 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract apply to this Section.

1.02 SECTION INCLUDES

- A. Closeout Procedures.
- B. Final Cleaning.
- C. Final Inspection.
- D. Project Record Documents.
- E. Guarantees, Warranties, and Bonds.

1.03 CLOSEOUT PROCEDURES

- A. Comply with procedures stated in General Conditions of the Contract for issuance of Certificate of Substantial Completion.
- B. Furnish warranties and bonds for items listed in pertinent other sections of the Contract Documents.
- C. Provide evidence of payment and release of liens.

1.04 FINAL CLEANING

- A. Execute prior to Final Inspection.
- B. Repair, patch, and touch up marred surfaces to the specified finish, to match adjacent surfaces.
- C. In cleaning items with manufacturer's finish or items previously finished by a Subcontractor, care shall be taken not to damage such manufacturer's or Subcontractor's finish. Any damage to finishes caused by cleaning operations shall be repaired at the Contractor's expense.
- D. Broom clean exposed concrete surfaces and paved surfaces.
- E. Remove waste and surplus materials, rubbish and construction facilities from the Project and from the site.

1.05 FINAL INSPECTION

- A. Upon completion of final cleaning, the Contractor shall notify the Town Engineer who shall then arrange for final inspection. At the time of final inspection of the work performed under the Contract, all work covered by the Drawings and these Specifications shall be complete in every respect and in perfect operating condition. All surplus materials of every character resulting from the work of this project shall have been removed from the site.
- B. Any defects discovered at time of the final inspection shall be corrected in accordance with the terms of the contract prior to final acceptance of the work.

1.06 RECORD CONTRACT DOCUMENTS

- A. Job set: Promptly following receipt of the Owner's Notice to Proceed, secure from the Town Engineer at no charge to the Contractor a complete set of all Contract Documents. Additional copies may be purchased by the Contractor.
- B. During the progress of the work, the Contractor shall maintain a current record set of all Drawings, Specifications, Addenda, Change Orders, Work Change Directives, Field Orders, and written interpretations and clarifications in good order and annotated to show changes made during construction.
- C. Manufacturers' and subcontractors', shop drawings, line-and-control diagrams, assembly and erection drawings, etc., shall also be corrected to indicate As-built conditions, and maintained as Record Contract Documents.
- D. Store Record Documents separate from those used for construction.
- E. Keep Record Documents current: do not permanently conceal any work until required information has been recorded.
- F. Accuracy of records:
 - 1. Thoroughly coordinate changes within the Record Documents, making adequate and proper entries on each page of Specifications and each sheet of Drawings and other Documents where such entry is required to show the change properly.
 - 2. Make entries within 24 hours after receipt of information that the change has occurred. Date all entries.
- G. At the completion of the construction work and prior to acceptance of the project, the Contractor shall provide the marked-up Record Contract Documents to the Town Engineer. Final Site As-Built Plan shall be provided.

1.07 GUARANTEES, WARRANTIES AND BONDS

- A. Except as otherwise specified, the Contractor shall guaranty all work against defects resulting from materials, workmanship, or equipment which are inferior, defective, or not in accordance with the terms of the Contract.
- B. All workmanship and materials shall be fully guaranteed for a period of one (1) year after acceptance of the entire installation covered by this contract. Should any defects occur during the guaranteed period, the contractor shall repair and/or replace all defective equipment, material and/or work at no extra charge to the owner.
- C. Furnish fully executed guarantees, warranties and bonds to the Owner in accordance with the General Conditions.

END OF CONTRACT CLOSEOUT SPECIFICATIONS

TECHNICAL SPECIFICATIONS

HVAC UPGRADES

**WASTEWATER TREATMENT PLANT ADMINISTRATION BUILDING
1325 CHESHIRE STREET
CHESHIRE, CT 06410**

DIVISION 01 – GENERAL REQUIREMENTS

Section 011000	Summary of Work	3
Section 012500	Substitution Procedures	4
Section 012600	Contract Modification Procedures	2
Section 012900	Payment Procedures	4
Section 013100	Project Management and Coordination	8
Section 013200	Construction Progress Documentation	6
Section 013233	Photographic Documentation	2
Section 013300	Submittal Procedures	9
Section 014000	Quality Requirements	8
Section 014200	References	7
Section 015000	Temporary Facilities and Controls	4
Section 016000	Product Requirements	5
Section 017300	Execution	6
Section 017700	Closeout Procedures	3
Section 017823	Operation and Maintenance Data	7
Section 017839	Project Record Documents	3
Section 017900	Demonstration and Training	4

DIVISION 02 – EXISTING CONDITIONS

Section 024119	Selective Demolition	6

DIVISION 07 – THERMAL AND MOISTURE PROTECTION

Section 078413	Penetration Firestopping	4
Section 079200	Joint Sealants	6

DIVISION 09 – FINISHES

Section 099123	Interior Painting	7

DIVISION 23 – HEATING, VENTILATING AND AIR CONDITIONING

Section 230130.52	Existing HVAC Air Distribution System Cleaning	6
Section 230500	Common Work Results for HVAC	6
Section 230529	Hangers and Supports for HVAC Piping and Equipment	8
Section 230553	Identification for HVAC Piping and Equipment	6
Section 230593	Testing, Adjusting, and Balancing for HVAC	11
Section 232300	Refrigerant Piping	6
Section 233346	Flexible Ducts	4
Section 233401	Lab Exhaust Fan	6
Section 233713.23	Registers and Grilles	2
Section 237416.11	Packaged, Small-Capacity, Rooftop Air-Conditioning Units	14
Section 238129	Variable-Refrigerant-Flow HVAC Systems	22

DIVISION 26 – ELECTRICAL

Section 260500	Common Work Results for Electrical	4
Section 260509	Electrical Demolition Requirements	2
Section 260519	Low-Voltage Electrical Power Conductors and Cables	6
Section 260523	Control Voltage Electrical Power Cables	10
Section 260526	Grounding and Bonding for Electrical Systems	5
Section 260529	Hangers and Supports for Electrical Systems	5
Section 260533	Raceway and Boxes for Electrical Systems	10
Section 260548	Vibration and Seismic Controls for Electrical Systems	7
Section 260553	Identification for Electrical Systems	10
Section 262726	Wiring Devices	10
Section 262816	Enclosed Switches and Circuit Breakers	4
Section 262923	Variable Frequency Motor Controllers	8

END OF TABLE OF CONTENTS

SECTION 011000 - SUMMARY OF WORK

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of Contract, including General Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 PROJECT DESCRIPTION

- A. The Work of the Project is defined by the Contract Documents and consists of an HVAC upgrade for an existing building.
- B. The Work generally includes, but is not limited to the following major elements:
 - 1. Demolition of existing water source heat pump system including the fan coil units, controls, heat pumps, and heat exchanger with the associated pumps.
 - 2. Provision and installation of new heat pumps, fan coil units and controls with some new ductwork.
 - 3. Provision and installation of a cooling tower for heat rejection.
 - 4. Provision and installation of an electric boiler for heat addition.
 - 5. Patch and repair to match existing of all walls and ceilings damaged during demolition and removal of old and installation of new equipment.
 - 6. Electrical: Provide removal and relocation of existing HVAC equipment circuits and provide new circuits for HVAC equipment, to include all breakers, conduit, wire and disconnects as specified.
 - 7. Offsite disposal of all removed materials.

1.3 CONTRACTOR USE OF PREMISES

- A. General: Limit use of the premises to construction activities in areas indicated. Do not disturb portions of Project site beyond areas in which the Work is indicated.
- B. Confine operations to as small work areas and accessways as possible. As much as possible and without damage to the finishes, doors, and related building systems, access the project area via the service doors designated by Owner.
- C. Keep driveways and entrances serving the premises clear and available to the Owner and emergency vehicles at all times. Do not use these areas for parking or storage of materials. Schedule deliveries to minimize space and time requirements for storage of materials and equipment on site.
- D. Maintain existing egress patterns, exit doors, and means of egress during construction, which will include the provision of temporary walkways, sidewalks, or other means necessary to provide adequate life safety for the building occupants, particularly at exitways which must continue to be open and serviceable while adjacent construction activity occurs.
- E. Use of the Existing Building: Maintain the existing building in a weathertight condition throughout the construction period. Repair damage caused by construction operations. Take all precautions necessary to protect the building and its occupants during the construction period.

1. Contractor is responsible to secure project area/site from intrusions during unoccupied (after hours) period of time. Any temporary doors and /or window coverings that may be necessary to complete repairs are the Contractors responsibility to furnish and install as part of the project scope.

1.4 OWNER OCCUPANCY

- A. Full Owner Occupancy: The Owner's administrative and maintenance staff will occupy the site and existing building during the entire construction period. Cooperate with the Owner during construction operations to minimize conflicts and facilitate Owner usage. Perform the Work so as not to interfere with the Owner's operations. Pre-schedule construction operations with the Owner for areas that must be evacuated for extended periods, giving the Owner the opportunity to relocate operations to non-affected areas.
 1. Maintain access to existing walkways, corridors, and other adjacent occupied or used facilities. Do not close or obstruct walkways, corridors, or other occupied or used facilities without written permission from Owner and approval of authorities having jurisdiction.
 2. Notify Owner not less than 72 hours in advance of activities that will affect Owner's operations.
- B. Utility Relocations: Schedule utility relocations that affect the building as early as possible. Coordinate Contractor's schedules with the utility companies and with the Owner to expedite the work while mitigating their interference with the Owner's operation of the building. Schedule protracted utility shutdowns over weekends to prevent any loss of use of building by Owner. Schedule and pay for overtime charges as required to complete the utility relocations and installations.

1.5 SPECIAL REQUIREMENTS

- A. The Contractor shall ensure that all work performed is done so in a safe manner and that all his/her employees shall adhere to all applicable safety procedures and practices at all times. There may be children and staff in the vicinity of the work area during normal working hours. The Contractor shall be aware at all times that additional safety considerations should be taken. Particular care shall be taken by the Contractor, Subcontractors and all those in their employ, that all tools, equipment, ladders, etc. are never left unsupervised.
- B. Smoking and Controlled Substance Restrictions: Use of tobacco products, alcoholic beverages, and other controlled substances inside the building or on the grounds is not permitted. Strict adherence to the regulations will be enforced for the entire duration of the construction.
- C. Site Security – Identification Badges
 1. The Contractor shall provide a list of all contact persons. The list shall include each trade, name of Contractor, contact person(s), phone numbers, fax numbers, Federal Employer Identification Number (FEIN), social security number if FEIN is not available, and Connecticut Tax Registration number.
 2. Prior to the start of work all Contractor and Sub-Contractor personnel assigned to perform work shall be required to fill out and submit to a background check at a cost provided by the Contractor. All information shall be submitted to the Town of Cheshire. Information for background check includes the following:
 - a. Identity Verification
 - b. Criminal Background
 - c. Additional checks as deemed warranted.

3. Security badges will be worn by all project personnel during construction activities. The Contractor will provide badges at no cost to the Owner. The Contractor will be responsible for monitoring the display of badges, including those of the personnel of all subcontractors and visitors to the project site.

D. Public Health Emergency:

1. The Contractor shall anticipate and incorporate in their Bids all potential costs related to a public health emergency such as the COVID-19/Coronavirus Pandemic, including rules, regulations, and recommendations issued by public authorities. The potential costs may include, but are not limited to, costs related to social distancing, manpower levels, project scheduling, construction coordination, material/product supplies and delivery delays, material escalation costs, increased subcontractor/supplier costs, loss of productivity and inefficiency costs, extended general conditions costs, and any other potential costs.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF SECTION 011000

SECTION 012500 - SUBSTITUTION PROCEDURES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes administrative and procedural requirements for substitutions.
- B. Related Sections:
 - 1. Section 016000 "Product Requirements" for requirements for submitting comparable product submittals for products by listed manufacturers.
 - 2. Divisions 02 through 49 Sections for specific requirements and limitations for substitutions.

1.3 DEFINITIONS

- A. Substitutions: Changes in products, materials, equipment, and methods of construction from those required by the Contract Documents and proposed by Contractor.
 - 1. Substitutions for Cause: Changes proposed by Contractor that are required due to changed Project conditions, such as unavailability of product, regulatory changes, or unavailability of required warranty terms.
 - 2. Substitutions for Convenience: Changes proposed by Contractor or Owner that are not required in order to meet other Project requirements but may offer advantage to Contractor or Owner.

1.4 SUBMITTALS

- A. Substitution Requests: Submit three (3) copies of each request for consideration. Identify product or fabrication or installation method to be replaced. Include Specification Section number and title and Drawing numbers and titles.
 - 1. Substitution Request Form: Use **CSI Form 1.5C, 13.1A**, or comparable form.
 - 2. Documentation: Show compliance with requirements for substitutions and the following, as applicable:
 - a. Statement indicating why specified product or fabrication or installation cannot be provided, if applicable.
 - b. Coordination information, including a list of changes or modifications needed to other parts of the Work and to construction performed by Owner and separate contractors, that will be necessary to accommodate proposed substitution.
 - c. Detailed, SIDE-BY-SIDE comparison of significant qualities of proposed substitution with those of the Work specified. Include annotated copy of applicable specification section. Significant qualities may include attributes such as performance, weight, size, durability, visual effect, sustainable design characteristics, warranties, and specific features and requirements indicated. Indicate deviations, if any, from the Work specified.

- d. Product Data, including drawings and descriptions of products and fabrication and installation procedures.
 - e. Samples, where applicable or requested.
 - f. Certificates and qualification data, where applicable or requested.
 - g. List of similar installations for completed projects with project names and addresses and names and addresses of Architects and Owners.
 - h. Material test reports from a qualified testing agency indicating and interpreting test results for compliance with requirements indicated.
 - i. Research reports evidencing compliance with building code in effect for Project, from ICC-ES.
 - j. Detailed comparison of Contractor's construction schedule using proposed substitution with products specified for the Work, including effect on the overall Contract Time. If specified product or method of construction cannot be provided within the Contract Time, include letter from manufacturer, on manufacturer's letterhead, stating date of receipt of purchase order, lack of availability, or delays in delivery.
 - k. Cost information, including a proposal of change, if any, in the Contract Sum.
 - l. Contractor's certification that proposed substitution complies with requirements in the Contract Documents except as indicated in substitution request, is compatible with related materials, and is appropriate for applications indicated.
 - m. Contractor's waiver of rights to additional payment or time that may subsequently become necessary because of failure of proposed substitution to produce indicated results.
3. Architect's Action: If necessary, Architect will request additional information or documentation for evaluation within seven (7) days of receipt of a request for substitution. Architect will notify Contractor of acceptance or rejection of proposed substitution within fifteen (15) days of receipt of request, or seven (7) days of receipt of additional information or documentation, whichever is later.
- a. Forms of Acceptance: Change Order, Construction Change Directive, or Architect's Supplemental Instructions for minor changes in the Work.
 - b. Use product specified if Architect does not issue a decision on use of a proposed substitution within time allocated.

1.5 QUALITY ASSURANCE

- A. Compatibility of Substitutions: Investigate and document compatibility of proposed substitution with related products and materials. Engage qualified testing agency to perform compatibility tests recommended by manufacturers.

1.6 PROCEDURES

- A. Coordination: Modify or adjust affected work as necessary to integrate work of the approved substitutions.

PART 2 - PRODUCTS

2.1 SUBSTITUTIONS

- A. Procurement Substitution Request: Submit to Architect seven (7) days prior to date of bid opening.

- B. Substitutions for Cause: Submit requests for substitution immediately upon discovery of need for change, but not later than fifteen (15) days prior to time required for preparation and review of related submittals.
1. Conditions: Architect will consider Contractor's request for substitution when the following conditions are satisfied. If the following conditions are not satisfied, Architect will return requests without action, except to record noncompliance with these requirements:
 - a. Requested substitution is consistent with the Contract Documents and will produce indicated results.
 - b. Substitution request is fully documented and properly submitted.
 - c. Requested substitution will not adversely affect Contractor's construction schedule.
 - d. Requested substitution has received necessary approvals of authorities having jurisdiction.
 - e. Requested substitution is compatible with other portions of the Work.
 - f. Requested substitution has been coordinated with other portions of the Work.
 - g. Requested substitution provides specified warranty.
 - h. If requested substitution involves more than one (1) contractor, requested substitution has been coordinated with other portions of the Work, is uniform and consistent, is compatible with other products, and is acceptable to all contractors involved.
- C. Substitutions for Convenience: Architect will consider requests for substitution if received within sixty (60) days after the Notice to Proceed. Requests received after that time may be considered or rejected at discretion of Architect.
1. Conditions: Architect will consider Contractor's request for substitution when the following conditions are satisfied. If the following conditions are not satisfied, Architect will return requests without action, except to record noncompliance with these requirements:
 - a. Requested substitution offers Owner a substantial advantage in cost, time, energy conservation, or other considerations, after deducting additional responsibilities Owner must assume. Owner's additional responsibilities may include compensation to Architect for redesign and evaluation services, increased cost of other construction by Owner, and similar considerations.
 - b. Requested substitution does not require extensive revisions to the Contract Documents.
 - c. Requested substitution is consistent with the Contract Documents and will produce indicated results.
 - d. Substitution request is fully documented and properly submitted.
 - e. Requested substitution will not adversely affect Contractor's construction schedule.
 - f. Requested substitution has received necessary approvals of authorities having jurisdiction.
 - g. Requested substitution is compatible with other portions of the Work.
 - h. Requested substitution has been coordinated with other portions of the Work.
 - i. Requested substitution provides specified warranty.
 - j. If requested substitution involves more than one (1) contractor, requested substitution has been coordinated with other portions of the Work, is uniform and consistent, is compatible with other products, and is acceptable to all contractors involved.

PART 3 - EXECUTION (Not Used)

END OF SECTION 012500

SECTION 012600 - CONTRACT MODIFICATION PROCEDURES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes administrative and procedural requirements for handling and processing Contract modifications.
- B. Related Sections:
 - 1. Section 016000 "Product Requirements" for administrative procedures for handling requests for substitutions made after Contract award.

1.3 MINOR CHANGES IN THE WORK

- A. Architect will issue supplemental instructions authorizing minor changes in the Work, not involving adjustment to the Contract Sum or the Contract Time, on AIA Document G710, "Architect's Supplemental Instructions."

1.4 PROPOSAL REQUESTS

- A. Owner-Initiated Proposal Requests: Architect will issue a detailed description of proposed changes in the Work that may require adjustment to the Contract Sum or the Contract Time. If necessary, the description will include supplemental or revised Drawings and Specifications.
 - 1. Proposal Requests issued by Architect are not instructions either to stop work in progress or to execute the proposed change.
 - 2. Within time specified in Proposal Request or twenty (20) days, when not otherwise specified, after receipt of Proposal Request, submit a quotation estimating cost adjustments to the Contract Sum and the Contract Time necessary to execute the change.
 - a. Include a list of quantities of products required or eliminated and unit costs, with total amount of purchases and credits to be made. If requested, furnish survey data to substantiate quantities..
 - b. Indicate applicable taxes, delivery charges, equipment rental, and amounts of trade discounts.
 - c. Include costs of labor and supervision directly attributable to the change.
 - d. Include an updated Contractor's construction schedule that indicates the effect of the change, including, but not limited to, changes in activity duration, start and finish times, and activity relationship. Use available total float before requesting an extension of the Contract Time.
 - e. Quotation Form: Use forms acceptable to Architect.
- B. Contractor-Initiated Proposals: If latent or changed conditions require modifications to the Contract, Contractor may initiate a claim by submitting a request for a change to the Architect.

1. Include a statement outlining reasons for the change and the effect of the change on the Work. Provide a complete description of the proposed change. Indicate the effect of the proposed change on the Contract Sum and the Contract Time.
2. Include a list of quantities of products required or eliminated and unit costs, with total amount of purchases and credits to be made. If requested, furnish survey data to substantiate quantities.
3. Indicate applicable taxes, delivery charges, equipment rental, and amounts of trade discounts.
4. Include costs of labor and supervision directly attributable to the change.
5. Include an updated Contractor's construction schedule that indicates the effect of the change, including, but not limited to, changes in activity duration, start and finish times, and activity relationship. Use available total float before requesting an extension of the Contract Time.
6. Comply with requirements in Section 012500 "Substitution Procedures" if the proposed change requires substitution of one product or system for product or system specified.
7. Proposal Request Form: Use form acceptable to Architect.

1.5 CHANGE ORDER PROCEDURES

- A. On Owner's approval of a Proposal Request, Architect will issue a Change Order for signatures of Owner and Contractor on AIA Document G701.

1.6 CONSTRUCTION CHANGE DIRECTIVE

- A. Construction Change Directive: Architect may issue a Construction Change Directive on AIA Document G714. Construction Change Directive instructs Contractor to proceed with a change in the Work, for subsequent inclusion in a Change Order.
 1. Construction Change Directive contains a complete description of change in the Work. It also designates method to be followed to determine change in the Contract Sum or the Contract Time.
- B. Documentation: Maintain detailed records on a time and material basis of work required by the Construction Change Directive.
 1. After completion of change, submit an itemized account and supporting data necessary to substantiate cost and time adjustments to the Contract.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF SECTION 012600

SECTION 012900 - PAYMENT PROCEDURES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section specifies administrative and procedural requirements necessary to prepare and process Applications for Payment.
- B. Related Sections:
 - 1. Section 012600 "Contract Modification Procedures" for administrative procedures for handling changes to the Contract.
 - 2. Section 013200 "Construction Progress Documentation" for administrative requirements governing the preparation and submittal of the Contractor's construction schedule.
 - 3. Section 013300 "Submittal Procedures" for administrative requirements governing the preparation and submittal of the submittal schedule.

1.3 SCHEDULE OF VALUES

- A. Coordination: Coordinate preparation of the schedule of values with preparation of Contractor's construction schedule.
 - 1. Correlate line items in the schedule of values with other required administrative forms and schedules, including the following:
 - a. Application for Payment forms with continuation sheets.
 - b. Submittal schedule.
 - c. Items required to be indicated as separate activities in Contractor's construction schedule.
 - 2. Submit the schedule of values to Architect at earliest possible date but no later than seven (7) days before the date scheduled for submittal of initial Applications for Payment.
- B. Format and Content: Use the Project Manual table of contents as a guide to establish line items for the schedule of values. Provide at least one (1) line item for each Specification Section.
 - 1. Identification: Include the following Project identification on the schedule of values:
 - a. Project name and location.
 - b. Name of Architect.
 - c. Architect's project number.
 - d. Contractor's name and address.
 - e. Date of submittal.
 - 2. Arrange schedule of values consistent with format of AIA Document G703.
 - 3. Provide a breakdown of the Contract Sum in enough detail to facilitate continued evaluation of Applications for Payment and progress reports. Coordinate with the Project

- Manual table of contents. Provide multiple line items for principal subcontract amounts in excess of five percent (5%) of Contract Sum.
4. Round amounts to nearest whole dollar; total shall equal the Contract Sum.
 5. Provide a separate line item in the schedule of values for each part of the Work where Applications for Payment may include materials or equipment purchased or fabricated and stored, but not yet installed.
 - a. Differentiate between items stored on-site and items stored off-site. If required, include evidence of insurance.
 6. Provide separate line items in the schedule of values for initial cost of materials, for each subsequent stage of completion, and for total installed value of that part of the Work.
 7. Each item in the schedule of values and Applications for Payment shall be complete. Include total cost and proportionate share of general overhead and profit for each item.
 - a. Temporary facilities and other major cost items that are not direct cost of actual work-in-place may be shown either as separate line items in the schedule of values or distributed as general overhead expense, at Contractor's option.
 8. Schedule Updating: Update and resubmit the schedule of values before the next Applications for Payment when Change Orders or Construction Change Directives result in a change in the Contract Sum.

1.4 APPLICATIONS FOR PAYMENT

- A. Each Application for Payment shall be consistent with previous applications and payments as certified by Architect and paid for by Owner.
 1. Initial Application for Payment, Application for Payment at time of Substantial Completion, and final Application for Payment involve additional requirements.
- B. Payment Application Times: The date for each progress payment is indicated in the Agreement between Owner and Contractor. The period of construction work covered by each Application for Payment is the period indicated in the Agreement.
- C. Application for Payment Forms: Use AIA Document G702 and AIA Document G703 or comparable form for Applications for Payment.
- D. Application Preparation: Complete every entry on form. Notarize and execute by a person authorized to sign legal documents on behalf of Contractor. Architect will return incomplete applications without action.
 1. Entries shall match data on the schedule of values and Contractor's construction schedule. Use updated schedules if revisions were made.
 2. Include amounts for work completed following previous Application for Payment, whether or not payment has been received. Include only amounts for work completed at time of Application for Payment.
 3. Include amounts of Change Orders and Construction Change Directives issued before last day of construction period covered by application.
 4. Indicate separate amounts for work being carried out under Owner-requested project acceleration.
 5. Include updated and approved Contractor's construction schedule, potential Change Order Log and Product Submittal Log.

- E. Stored Materials: Include in Application for Payment amounts applied for materials or equipment purchased or fabricated and stored, but not yet installed. Differentiate between items stored on-site and items stored off-site.
1. Provide certificate of insurance, evidence of transfer of title to Owner, and consent of surety to payment, for stored materials.
 2. Provide supporting documentation that verifies amount requested, such as paid invoices. Match amount requested with amounts indicated on documentation; do not include overhead and profit on stored materials.
 3. Provide summary documentation for stored materials indicating the following:
 - a. Materials previously stored and included in previous Applications for Payment.
 - b. Work completed for this Application utilizing previously stored materials.
 - c. Additional materials stored with this Application.
 - d. Total materials remaining stored, including materials with this Application.
- F. Transmittal: Submit three (3) signed and notarized original copies of each Application for Payment to Architect by a method ensuring receipt within 24 hours. One (1) copy shall include waivers of lien and similar attachments if required.
1. Transmit each copy with a transmittal form listing attachments and recording appropriate information about application.
- G. Waivers of Mechanic's Lien: With each Application for Payment, submit waivers of mechanic's liens from subcontractors, sub-subcontractors, and suppliers for construction period covered by the previous application.
1. Submit partial waivers on each item for amount requested in previous application, after deduction for retainage, on each item.
 2. When an application shows completion of an item, submit conditional final or full waivers.
 3. Owner reserves the right to designate which entities involved in the Work must submit waivers.
 4. Submit final Application for Payment with or preceded by conditional final waivers from every entity involved with performance of the Work covered by the application who is lawfully entitled to a lien.
 5. Waiver Forms: Submit waivers of lien on forms, executed in a manner acceptable to Owner.
- H. Initial Application for Payment: Administrative actions and submittals that must precede or coincide with submittal of first Application for Payment include the following:
1. List of subcontractors.
 2. Schedule of values.
 3. Contractor's construction schedule (preliminary if not final).
 4. Products list (preliminary if not final).
 5. Schedule of unit prices.
 6. Submittal schedule (preliminary if not final).
 7. List of Contractor's staff assignments.
 8. List of Contractor's principal consultants.
 9. Copies of building permits.
 10. Copies of authorizations and licenses from authorities having jurisdiction for performance of the Work.
 11. Initial progress report.
 12. Report of preconstruction conference.
 13. Certificates of insurance and insurance policies.
 14. Performance and payment bonds.

15. Data needed to acquire Owner's insurance.
- I. Application for Payment at Substantial Completion: After issuing the Certificate of Substantial Completion, submit an Application for Payment showing one hundred percent (100%) completion for portion of the Work claimed as substantially complete.
 1. Include documentation supporting claim that the Work is substantially complete and a statement showing an accounting of changes to the Contract Sum.
 2. This application shall reflect Certificates of Partial Substantial Completion issued previously for Owner occupancy of designated portions of the Work.
- J. Final Payment Application: Submit final Application for Payment with releases and supporting documentation not previously submitted and accepted, including, but not limited, to the following:
 1. Evidence of completion of Project closeout requirements.
 2. Insurance certificates for products and completed operations where required and proof that taxes, fees, and similar obligations were paid.
 3. Updated final statement, accounting for final changes to the Contract Sum.
 4. AIA Document G706, "Contractor's Affidavit of Payment of Debts and Claims."
 5. AIA Document G706A, "Contractor's Affidavit of Release of Liens."
 6. AIA Document G707, "Consent of Surety to Final Payment."
 7. Evidence that claims have been settled.
 8. Final meter readings for utilities, a measured record of stored fuel, and similar data as of date of Substantial Completion or when Owner took possession of and assumed responsibility for corresponding elements of the Work.
 9. Final liquidated damages settlement statement.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF SECTION 012900

SECTION 013100 - PROJECT MANAGEMENT AND COORDINATION

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes administrative provisions for coordinating construction operations on Project including, but not limited to, the following:
 - 1. General project coordination procedures.
 - 2. Administrative and supervisory personnel.
 - 3. Coordination drawings.
 - 4. Requests for Information (RFIs).
 - 5. Project meetings.
- B. Each contractor shall participate in coordination requirements. Certain areas of responsibility are assigned to a specific contractor.
- C. Related Sections:
 - 1. Section 013200 "Construction Progress Documentation" for preparing and submitting Contractor's construction schedule.
 - 2. Section 017300 "Execution" for procedures for coordinating general installation and field-engineering services, including establishment of benchmarks and control points.
 - 3. Section 017700 "Closeout Procedures" for coordinating closeout of the Contract.

1.3 DEFINITIONS

- A. RFI: Request from Owner, Architect, or Contractor seeking information from each other during construction.

1.4 COORDINATION

- A. Coordination: Coordinate construction operations included in different Sections of the Specifications to ensure efficient and orderly installation of each part of the Work. Coordinate construction operations, included in different Sections, that depend on each other for proper installation, connection, and operation.
 - 1. Schedule construction operations in sequence required to obtain the best results where installation of one (1) part of the Work depends on installation of other components, before or after its own installation.
 - 2. Coordinate installation of different components to ensure maximum performance and accessibility for required maintenance, service, and repair.
 - 3. Make adequate provisions to accommodate items scheduled for later installation.
- B. Prepare memoranda for distribution to each party involved, outlining special procedures required for coordination. Include such items as required notices, reports, and list of attendees at meetings.

1. Prepare similar memoranda for Owner and separate Contractors if coordination of their Work is required.
- C. Administrative Procedures: Coordinate scheduling and timing of required administrative procedures with other construction activities to avoid conflicts and to ensure orderly progress of the Work. Such administrative activities include, but are not limited to, the following:
1. Preparation of Contractor's construction schedule.
 2. Preparation of the schedule of values.
 3. Installation and removal of temporary facilities and controls.
 4. Delivery and processing of submittals.
 5. Progress meetings.
 6. Pre-installation conferences.
 7. Startup and adjustment of systems.
 8. Project closeout activities.
- D. Conservation: Coordinate construction activities to ensure that operations are carried out with consideration given to conservation of energy, water, and materials. Coordinate use of temporary utilities to minimize waste.
1. Salvage materials and equipment involved in performance of, but not actually incorporated into, the Work. Refer to other Sections for disposition of salvaged materials that are designated as Owner's property.

1.5 COORDINATION DRAWINGS

- A. Coordination Drawings, General: Prepare coordination drawings in accordance with requirements in individual Sections, where installation is not completely shown on Shop Drawings, where limited space availability necessitates coordination, or if coordination is required to facilitate integration of products and materials fabricated or installed by more than one (1) entity.
1. Content: Project-specific information, drawn accurately to a scale large enough to indicate and resolve conflicts. Do not base coordination drawings on standard printed data. Include the following information, as applicable:
 - a. Use applicable Drawings as a basis for preparation of coordination drawings. Prepare sections, elevations, and details as needed to describe relationship of various systems and components.
 - b. Coordinate the addition of trade-specific information to the coordination drawings by multiple Contractors in a sequence that best provides for coordination of the information and resolution of conflicts between installed components before submitting for review.
 - c. Indicate functional and spatial relationships of components of architectural, structural, civil, mechanical, and electrical systems.
 - d. Indicate space requirements for routine maintenance and for anticipated replacement of components during the life of the installation. Show location and size of access doors required for access to concealed dampers, valves, and other controls.
 - e. Indicate required installation sequences.
 - f. Indicate dimensions shown on the Drawings. Specifically note dimensions that appear to be in conflict with submitted equipment and minimum clearance requirements. Provide alternate sketches to Architect indicating proposed resolution of such conflicts. Minor dimension changes and difficult installations will not be considered changes to the Contract.

B. Coordination Drawing Organization: Organize coordination drawings as follows:

1. Floor Plans and Reflected Ceiling Plans: Show architectural and structural elements, and mechanical, plumbing, fire protection, fire alarm, and electrical Work. Show locations of visible ceiling-mounted devices relative to acoustical ceiling grid. Supplement plan drawings with section drawings where required to adequately represent the Work.
2. Plenum Space: Indicate subframing for support of ceiling and wall systems, mechanical and electrical equipment, and related Work. Locate components within ceiling plenum to accommodate layout of light fixtures indicated on Drawings. Indicate areas of conflict between light fixtures and other components.
3. Mechanical Rooms: Provide coordination drawings for mechanical rooms showing plans and elevations of mechanical, plumbing, fire protection, fire alarm, and electrical equipment.
4. Slab Edge and Embedded Items: Indicate slab edge locations and sizes and locations of embedded items for metal fabrications, sleeves, anchor bolts, bearing plates, angles, door floor closers, slab depressions for floor finishes, curbs and housekeeping pads, and similar items.
5. Mechanical and Plumbing Work: Show the following:
 - a. Sizes and bottom elevations of ductwork, piping, and conduit runs, including insulation, bracing, flanges, and support systems.
 - b. Dimensions of major components, such as dampers, valves, diffusers, access doors, cleanouts, and electrical distribution equipment.
 - c. Fire-rated enclosures around ductwork.
6. Electrical Work: Show the following:
 - a. Runs of vertical and horizontal conduit 1¼ inch diameter and larger.
 - b. Light fixture, exit light, emergency battery pack, smoke detector, and other fire alarm locations.
Panel board, switch board, switchgear, transformer, busway, generator, and motor control center locations.
 - c. Location of pull boxes and junction boxes, dimensioned from column center lines.
7. Fire Protection System: Show the following:
 - a. Locations of standpipes, mains piping, branch lines, pipe drops, and sprinkler heads.
8. Review: Architect will review coordination drawings to confirm that the Work is being coordinated, but not for the details of the coordination, which are the Contractor's responsibility. If the Architect determines that the coordination drawings are not being prepared in sufficient scope or detail, or are otherwise deficient, the Architect will so inform the Contractor, who shall make changes as directed and resubmit.
9. Coordination Drawing Prints: Prepare coordination drawing prints in accordance with requirements of Section 013300 "Submittal Procedures."

1.6 KEY PERSONNEL

- A. Key Personnel Names: Within fifteen (15) days of starting construction operations, submit a list of key personnel assignments, including superintendent and other personnel in attendance at Project site. Identify individuals and their duties and responsibilities; list addresses and telephone numbers, including home, office, and cellular telephone numbers and email addresses. Provide names, addresses, and telephone numbers of individuals assigned as standbys in the absence of individuals assigned to Project.

1. Post copies of list in project meeting room, in temporary field office, and by each temporary telephone. Keep list current at all times.

1.7 REQUESTS FOR INFORMATION (RFIs)

- A. General: Immediately on discovery of the need for additional information or interpretation of the Contract Documents, Contractor shall prepare and submit an RFI in the form specified.

1. Architect will return RFIs submitted to Architect by other entities controlled by Contractor with no response.
2. Coordinate and submit RFIs in a prompt manner so as to avoid delays in Contractor's work or work of subcontractors.

- B. Content of the RFI: Include a detailed, legible description of item needing information or interpretation and the following:

1. Project name.
2. Project number.
3. Date.
4. Name of Contractor.
5. Name of Architect.
6. RFI number, numbered sequentially.
7. RFI subject.
8. Specification Section number and title and related paragraphs, as appropriate.
9. Drawing number and detail references, as appropriate.
10. Field dimensions and conditions, as appropriate.
11. Contractor's suggested resolution. If Contractor's solution(s) impacts the Contract Time or the Contract Sum, Contractor shall state impact in the RFI.
12. Contractor's signature.
13. Attachments: Include sketches, descriptions, measurements, photos, Product Data, Shop Drawings, coordination drawings, and other information necessary to fully describe items needing interpretation.

- a. Include dimensions, thicknesses, structural grid references, and details of affected materials, assemblies, and attachments on attached sketches.

- C. RFI Forms: AIA Document G716 or comparable form.

- D. Architect's Action: Architect will review each RFI, determine action required, and respond. Allow seven (7) working days for Architect's response for each RFI. RFIs received by Architect after 1:00 p.m. will be considered as received the following working day.

1. The following RFIs will be returned without action:
 - a. Requests for approval of submittals.
 - b. Requests for approval of substitutions.
 - c. Requests for coordination information already indicated in the Contract Documents.
 - d. Requests for adjustments in the Contract Time or the Contract Sum.
 - e. Requests for interpretation of Architect's actions on submittals.
 - f. Incomplete RFIs or inaccurately prepared RFIs.
2. Architect's action may include a request for additional information, in which case Architect's time for response will date from time of receipt of additional information.

3. Architect's action on RFIs that may result in a change to the Contract Time or the Contract Sum may be eligible for Contractor to submit Change Proposal according to Section 012600 "Contract Modification Procedures."
 - a. If Contractor believes the RFI response warrants change in the Contract Time or the Contract Sum, notify Architect in writing within ten (10) days of receipt of the RFI response.
- E. On receipt of Architect's action, update the RFI log and immediately distribute the RFI response to affected parties. Review response and notify Architect within seven (7) days if Contractor disagrees with response.
- F. RFI Log: Prepare, maintain, and submit a tabular log of RFIs organized by the RFI number. Submit log weekly. Include the following:
 1. Project name.
 2. Name and address of Contractor.
 3. Name and address of Architect.
 4. RFI number including RFIs that were dropped and not submitted.
 5. RFI description.
 6. Date the RFI was submitted.
 7. Date Architect's response was received.
 8. Identification of related Minor Change in the Work, Construction Change Directive, and Proposal Request, as appropriate.

1.8 PROJECT MEETINGS

- A. General: Schedule and conduct meetings and conferences at Project site, unless otherwise indicated.
 1. Attendees: Inform participants and others involved, and individuals whose presence is required, of date and time of each meeting. Notify Owner and Architect of scheduled meeting dates and times.
 2. Agenda: Prepare the meeting agenda. Distribute the agenda to all invited attendees.
 3. Minutes: General Contractor or Construction Manager is responsible for recording significant discussions and agreements achieved. General Contractor or Construction Manager is also responsible for distributing the meeting minutes to everyone concerned including Owner and Architect, within three (3) days of the meeting.
- B. Pre-construction Conference: Schedule and conduct a preconstruction conference before starting construction, at a time convenient to Owner and Architect, but no later than fifteen (15) days after execution of the Agreement.
 1. Conduct the conference to review responsibilities and personnel assignments.
 2. Attendees: Authorized representatives of Owner, Construction Administrator, Architect, and their consultants; Contractor and its superintendent; major subcontractors; suppliers; and other concerned parties shall attend the conference. Participants at the conference shall be familiar with Project and authorized to conclude matters relating to the Work.
 3. Agenda: Discuss items of significance that could affect progress, including the following:
 - a. Tentative construction schedule.
 - b. Phasing.
 - c. Critical work sequencing and long-lead items.
 - d. Designation of key personnel and their duties.
 - e. Lines of communications.

- f. Procedures for processing field decisions and Change Orders.
 - g. Procedures for RFIs.
 - h. Procedures for testing and inspecting.
 - i. Procedures for processing Applications for Payment.
 - j. Distribution of the Contract Documents.
 - k. Submittal procedures.
 - l. Preparation of record documents.
 - m. Work restrictions.
 - n. Working hours.
 - o. Owner's occupancy requirements.
 - p. Responsibility for temporary facilities and controls.
 - q. Procedures for moisture and mold control.
 - r. Procedures for disruptions and shutdowns.
 - s. Parking availability.
 - t. Office, work, and storage areas.
 - u. Equipment deliveries and priorities.
 - v. First aid.
 - w. Security.
 - x. Progress cleaning.
4. Minutes: General Contractor or Construction Manager is responsible for recording and distributing meeting minutes.
- C. Preinstallation Conferences: Conduct a preinstallation conference at Project site before each construction activity that requires coordination with other construction.
- 1. Attendees: Installer and representatives of manufacturers and fabricators involved in or affected by the installation and its coordination or integration with other materials and installations that have preceded or will follow, shall attend the meeting. Advise Architect of scheduled meeting dates.
 - 2. Agenda: Review of the progress of other construction activities and preparations for the particular activity under consideration, including requirements for the following:
 - a. Contract Documents.
 - b. Options.
 - c. Related RFIs.
 - d. Related Change Orders.
 - e. Purchases.
 - f. Deliveries.
 - g. Submittals.
 - h. Possible conflicts.
 - i. Compatibility problems.
 - j. Time schedules.
 - k. Weather limitations.
 - l. Manufacturer's written recommendations.
 - m. Warranty requirements.
 - n. Compatibility of materials.
 - o. Acceptability of substrates.
 - p. Temporary facilities and controls.
 - q. Space and access limitations.
 - r. Regulations of authorities having jurisdiction.
 - s. Testing and inspecting requirements.
 - t. Installation procedures.
 - u. Coordination with other work.
 - v. Required performance results.
 - w. Protection of adjacent work.

- x. Protection of construction and personnel.
 - 3. Record significant conference discussions, agreements, and disagreements, including required corrective measures and actions.
 - 4. Reporting: Distribute minutes of the meeting to each party present and to other parties requiring information.
 - 5. Do not proceed with installation if the conference cannot be successfully concluded. Initiate whatever actions are necessary to resolve impediments to performance of the Work and reconvene the conference at earliest feasible date.
- D. Project Closeout Conference: Schedule and conduct a Project closeout conference, at a time convenient to Owner and Architect, but no later than thirty (30) days prior to the scheduled date of Substantial Completion.
- 1. Conduct the conference to review requirements and responsibilities related to Project closeout.
 - 2. Attendees: Authorized representatives of Owner, Architect, and their consultants; Contractor and its superintendent; major subcontractors; suppliers; and other concerned parties shall attend the meeting. Participants at the meeting shall be familiar with Project and authorized to conclude matters relating to the Work.
 - 3. Agenda: Discuss items of significance that could affect or delay Project closeout, including the following:
 - a. Preparation of record documents.
 - b. Procedures required prior to inspection for Substantial Completion and for final inspection for acceptance.
 - c. Submittal of written warranties.
 - d. Requirements for preparing operations and maintenance data.
 - e. Requirements for demonstration and training.
 - f. Preparation of Contractor's punch list.
 - g. Procedures for processing Applications for Payment at Substantial Completion and for final payment.
 - h. Submittal procedures.
 - i. Responsibility for removing temporary facilities and controls.
 - 4. Minutes: General Contractor or Construction Manager is responsible for recording and distributing meeting minutes.
- E. Progress Meetings: Conduct progress meetings at biweekly intervals.
- 1. Coordinate dates of meetings with preparation of payment requests.
 - 2. Attendees: In addition to representatives of Owner and Architect, each Contractor, subcontractor, supplier, and other entity concerned with current progress or involved in planning, coordination, or performance of future activities shall be represented at these meetings. All participants at the meeting shall be familiar with Project and authorized to conclude matters relating to the Work.
 - 3. Agenda: Review and correct or approve minutes of previous progress meeting. Review other items of significance that could affect progress. Include topics for discussion as appropriate to status of Project.
 - a. Contractor's Construction Schedule: Review progress since the last meeting. Determine whether each activity is on time, ahead of schedule, or behind schedule, in relation to Contractor's construction schedule. Determine how construction behind schedule will be expedited; secure commitments from parties involved to do so. Discuss whether schedule revisions are required to ensure that current and subsequent activities will be completed within the Contract Time.

- 1) Review schedule for next period.
- b. Review present and future needs of each entity present, including the following:
 - 1) Interface requirements.
 - 2) Sequence of operations.
 - 3) Status of submittals.
 - 4) Deliveries.
 - 5) Off-site fabrication.
 - 6) Access.
 - 7) Site utilization.
 - 8) Temporary facilities and controls.
 - 9) Progress cleaning.
 - 10) Quality and work standards.
 - 11) Status of correction of deficient items.
 - 12) Field observations.
 - 13) Status of RFIs.
 - 14) Status of proposal requests.
 - 15) Pending changes.
 - 16) Status of Change Orders.
 - 17) Pending claims and disputes.
 - 18) Documentation of information for payment requests.
4. Minutes: General Contractor or Construction Manager is responsible for recording and distributing meeting minutes.
 - a. Schedule Updating: Revise Contractor's construction schedule after each progress meeting where revisions to the schedule have been made or recognized. Issue revised schedule concurrently with the report of each meeting.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF SECTION 013100

SECTION 013200 - CONSTRUCTION PROGRESS DOCUMENTATION

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes administrative and procedural requirements for documenting the progress of construction during performance of the Work, including the following:
 - 1. Contractor's construction schedule.
 - 2. Daily construction reports.
 - 3. Material location reports.
 - 4. Field condition reports.
 - 5. Special reports.
- B. Related Sections:
 - 1. Section 013300 "Submittal Procedures" for submitting schedules and reports.
 - 2. Section 014000 "Quality Requirements" for submitting a schedule of tests and inspections.

1.3 DEFINITIONS

- A. Activity: A discrete part of a project that can be identified for planning, scheduling, monitoring, and controlling the construction project. Activities included in a construction schedule consume time and resources.
 - 1. Critical Activity: An activity on the critical path that must start and finish on the planned early start and finish times.
 - 2. Predecessor Activity: An activity that precedes another activity in the network.
 - 3. Successor Activity: An activity that follows another activity in the network.
- B. Cost Loading: The allocation of the schedule of values for the completion of an activity as scheduled. The sum of costs for all activities must equal the total Contract Sum, unless otherwise approved by Architect.
- C. Critical Path: The longest connected chain of interdependent activities through the network schedule that establishes the minimum overall Project duration and contains no float.
- D. Event: The starting or ending point of an activity.
- E. Float: The measure of leeway in starting and completing an activity.
 - 1. Float time is not for the exclusive use or benefit of either Owner or Contractor, but is a jointly owned, expiring Project resource available to both parties as needed to meet schedule milestones and Contract completion date.
 - 2. Free float is the amount of time an activity can be delayed without adversely affecting the early start of the successor activity.

- 3. Total float is the measure of leeway in starting or completing an activity without adversely affecting the planned Project completion date.

- F. Resource Loading: The allocation of manpower and equipment necessary for the completion of an activity as scheduled.

1.4 INFORMATIONAL SUBMITTALS

- A. Format for Submittals: Submit required submittals in the following format:

- 1. PDF electronic file.

- B. Contractor's Construction Schedule: Initial schedule, of size required to display entire schedule for entire construction period.

- 1. Submit a working electronic copy of schedule, using software indicated, and labeled to comply with requirements for submittals. Include type of schedule (initial or updated) and date on label.

- C. Daily Construction Reports: Submit at weekly intervals.

- D. Material Location Reports: Submit at weekly intervals.

- E. Field Condition Reports: Submit at time of discovery of differing conditions.

- F. Special Reports: Submit at time of unusual event.

1.5 QUALITY ASSURANCE

- A. Prescheduling Conference: Conduct conference at Project site to comply with requirements in Section 013100 "Project Management and Coordination." Review methods and procedures related to the Contractor's construction schedule, including, but not limited to, the following:

- 1. Review software limitations and content and format for reports.
- 2. Discuss constraints, including phasing, work stages and area separations.
- 3. Review delivery dates for Owner-furnished products.
- 4. Review schedule for work of Owner's separate contracts.
- 5. Review time required for review of submittals and resubmittals.
- 6. Review requirements for tests and inspections by independent testing and inspecting agencies.
- 7. Review time required for completion and startup procedures.
- 8. Review and finalize list of construction activities to be included in schedule.
- 9. Review submittal requirements and procedures.
- 10. Review procedures for updating schedule.

1.6 COORDINATION

- A. Coordinate preparation and processing of schedules and reports with performance of construction activities and with scheduling and reporting of separate contractors.

- B. Coordinate Contractor's construction schedule with the schedule of values, list of subcontracts, submittal schedule, progress reports, payment requests, and other required schedules and reports.

1. Secure time commitments for performing critical elements of the Work from entities involved.
2. Coordinate each construction activity in the network with other activities and schedule them in proper sequence.

PART 2 - PRODUCTS

2.1 CONTRACTOR'S CONSTRUCTION SCHEDULE, GENERAL

- A. Time Frame: Extend schedule from date established for the Notice to Proceed to date of Substantial Completion.
 1. Contract completion date shall not be changed by submission of a schedule that shows an early completion date, unless specifically authorized by Change Order.
- B. Activities: Treat each story or separate area as a separate numbered activity for each principal element of the Work. Comply with the following:
 1. Activity Duration: Define activities so no activity is longer than twenty (20) days, unless specifically allowed by Architect.
 2. Procurement Activities: Include procurement process activities for the following long lead items and major items, requiring a cycle of more than sixty (60) days, as separate activities in schedule. Procurement cycle activities include, but are not limited to, submittals, approvals, purchasing, fabrication, and delivery.
 3. Submittal Review Time: Include review and resubmittal times indicated in Section 013300 "Submittal Procedures" in schedule. Coordinate submittal review times in Contractor's construction schedule with submittal schedule.
 4. Startup and Testing Time: Include not less than fifteen (15) days for startup and testing.
 5. Substantial Completion: Indicate completion in advance of date established for Substantial Completion and allow time for Architect's administrative procedures necessary for certification of Substantial Completion.
 6. Punch List and Final Completion: Include not more than thirty (30) days for punch list and final completion.
- C. Constraints: Include constraints and work restrictions indicated in the Contract Documents and as follows in schedule and show how the sequence of the Work is affected.
 1. Phasing: Arrange list of activities on schedule by phase.
 2. Work Restrictions: Show the effect of the following items on the schedule:
 - a. Coordination with existing construction.
 - b. Uninterruptible services.
 - c. Use of premises restrictions.
 - d. Provisions for future construction.
 - e. Seasonal variations.
 - f. Environmental control.
 3. Work Stages: Indicate important stages of construction for each major portion of the Work, including, but not limited to, the following:
 - a. Subcontract awards.
 - b. Submittals.
 - c. Purchases.
 - d. Fabrication.

- e. Sample testing.
 - f. Deliveries.
 - g. Installation.
 - h. Tests and inspections.
 - i. Adjusting.
 - j. Startup and placement into final use and operation.
 - 4. Construction Areas: Identify each major area of construction for each major portion of the Work. Indicate where each construction activity within a major area must be sequenced or integrated with other construction activities to provide for the following:
 - a. Completion of mechanical installation.
 - b. Completion of electrical installation.
 - c. Substantial Completion.
 - D. Milestones: Include milestones indicated in the Contract Documents in schedule, including, but not limited to, the Notice to Proceed, Substantial Completion, and final completion.
 - E. Cost Correlation: At the head of schedule, provide a cost correlation line, indicating planned and actual costs. On the line, show dollar volume of the Work performed as of dates used for preparation of payment requests.
 - 1. Refer to Section 012900 "Payment Procedures" for cost reporting and payment procedures.
 - F. Upcoming Work Summary: Prepare summary report indicating activities scheduled to occur or commence prior to submittal of next schedule update. Summarize the following issues:
 - 1. Unresolved issues.
 - 2. Unanswered RFIs.
 - 3. Rejected or unreturned submittals.
 - 4. Notations on returned submittals.
 - G. Recovery Schedule: When periodic update indicates the Work is fourteen (14) or more calendar days behind the current approved schedule, submit a separate recovery schedule indicating means by which Contractor intends to regain compliance with the schedule. Indicate changes to working hours, working days, crew sizes, and equipment required to achieve compliance, and date by which recovery will be accomplished.
 - H. Computer Scheduling Software: Prepare schedules using current version of a program that has been developed specifically to manage construction schedules.
- 2.2 CONTRACTOR'S CONSTRUCTION SCHEDULE (GANTT CHART)
- A. Gantt-Chart Schedule: Submit a comprehensive, fully developed, horizontal Gantt-chart-type, Contractor's construction schedule within seven (7) days of date established for the Notice to Proceed.
 - B. Preparation: Indicate each significant construction activity separately. Identify first workday of each week with a continuous vertical line.
 - 1. For construction activities that require three months or longer to complete, indicate an estimated completion percentage in ten percent (10%) increments within time bar.

2.3 REPORTS

- A. Daily Construction Reports: Prepare a daily construction report recording the following information concerning events at Project site:
1. List of subcontractors at Project site.
 2. List of separate contractors at Project site.
 3. Approximate count of personnel at Project site.
 4. Equipment at Project site.
 5. Material deliveries.
 6. High and low temperatures and general weather conditions, including presence of rain or snow.
 7. Accidents.
 8. Meetings and significant decisions.
 9. Unusual events (refer to special reports).
 10. Stoppages, delays, shortages, and losses.
 11. Meter readings and similar recordings.
 12. Emergency procedures.
 13. Orders and requests of authorities having jurisdiction.
 14. Change Orders received and implemented.
 15. Construction Change Directives received and implemented.
 16. Services connected and disconnected.
 17. Equipment or system tests and startups.
 18. Partial completions and occupancies.
 19. Substantial Completions authorized.
- B. Material Location Reports: At weekly intervals, prepare and submit a comprehensive list of materials delivered to and stored at Project site. List shall be cumulative, showing materials previously reported plus items recently delivered. Include with list a statement of progress on and delivery dates for materials or items of equipment fabricated or stored away from Project site.
- C. Field Condition Reports: Immediately on discovery of a difference between field conditions and the Contract Documents, prepare and submit a detailed report. Submit with a Request for Information. Include a detailed description of the differing conditions, together with recommendations for changing the Contract Documents.

2.4 SPECIAL REPORTS

- A. General: Submit special reports directly to Owner within one (1) day of an occurrence. Distribute copies of report to parties affected by the occurrence.
- B. Reporting Unusual Events: When an event of an unusual and significant nature occurs at Project site, whether or not related directly to the Work, prepare and submit a special report. List chain of events, persons participating, response by Contractor's personnel, evaluation of results or effects, and similar pertinent information. Advise Owner in advance when these events are known or predictable.

PART 3 - EXECUTION

3.1 CONTRACTOR'S CONSTRUCTION SCHEDULE

- A. Contractor's Construction Schedule Updating: At monthly intervals, update schedule to reflect actual construction progress and activities. Issue schedule one (1) week before each regularly scheduled progress meeting.
 - 1. Revise schedule immediately after each meeting or other activity where revisions have been recognized or made. Issue updated schedule concurrently with the report of each such meeting.
 - 2. Include a report with updated schedule that indicates every change, including, but not limited to, changes in logic, durations, actual starts and finishes, and activity durations.
 - 3. As the Work progresses, indicate final completion percentage for each activity.
- B. Distribution: Distribute copies of approved schedule to Architect, Construction Administrator, Owner, separate contractors, testing and inspecting agencies, and other parties identified by Contractor with a need-to-know schedule responsibility.
 - 1. Post copies in Project meeting rooms and temporary field offices.
 - 2. When revisions are made, distribute updated schedules to the same parties and post in the same locations. Delete parties from distribution when they have completed their assigned portion of the Work and are no longer involved in performance of construction activities.

END OF SECTION 013200

SECTION 013233 - PHOTOGRAPHIC DOCUMENTATION

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes administrative and procedural requirements for the following:
 - 1. Periodic construction photographs.
- B. Related Sections:
 - 1. Section 013300 "Submittal Procedures" for submitting photographic documentation.
 - 2. Section 017700 "Closeout Procedures" for submitting photographic documentation as project record documents at Project closeout.

PART 2 - PRODUCTS

2.1 PHOTOGRAPHIC MEDIA

- A. Digital Images: Provide images in JPG format, produced by a digital camera with minimum sensor size of eight (8) megapixels, and at an image resolution of not less than 1600 by 1200 pixels and 400 dpi.

PART 3 - EXECUTION

3.1 CONSTRUCTION PHOTOGRAPHS

- A. General: Take photographs using the maximum range of depth of field, and that are in focus, to clearly show the Work. Photographs with blurry or out-of-focus areas will not be accepted.
 - 1. Maintain key plan with each set of construction photographs that identifies each photographic location.
- B. Digital Images: Submit digital images exactly as originally recorded in the digital camera, without alteration, manipulation, editing, or modifications using image-editing software.
 - 1. Date and Time: Include date and time in file name for each image.
 - 2. Field Office Images: Maintain one (1) set of images accessible in the field office at Project site, available at all times for reference. Identify images in the same manner as those submitted to Architect.
- C. Periodic Construction Photographs: Take eighteen to twenty (18-20) photographs weekly, with timing each month adjusted to coincide with the cutoff date associated with each Application for Payment. Select vantage points to show status of construction and progress since last photographs were taken.

- D. Additional Photographs: Architect may request photographs in addition to periodic photographs specified.
 - 1. In emergency situations, take additional photographs within 24 hours of request.
 - 2. Circumstances that could require additional photographs include, but are not limited to, the following:
 - a. Immediate follow-up when on-site events result in construction damage or losses.
 - b. Substantial Completion of a major phase or component of the Work.

END OF SECTION 013233

SECTION 013300 - SUBMITTAL PROCEDURES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes requirements for the submittal schedule and administrative and procedural requirements for submitting Shop Drawings, Product Data, Samples, and other submittals.
- B. Related Sections:
 - 1. Section 012900 "Payment Procedures" for submitting Applications for Payment and the schedule of values.
 - 2. Section 013200 "Construction Progress Documentation" for submitting schedules and reports, including Contractor's construction schedule.
 - 3. Section 017823 "Operation and Maintenance Data" for submitting operation and maintenance manuals.
 - 4. Section 017839 "Project Record Documents" for submitting record Drawings, record Specifications, and record Product Data.

1.3 DEFINITIONS

- A. Action Submittals: Written and graphic information and physical samples that require Architect's responsive action. Action submittals are those submittals indicated in individual Specification Sections as action submittals.
- B. Informational Submittals: Written and graphic information and physical samples that do not require Architect's responsive action. Submittals may be rejected for not complying with requirements. Informational submittals are those submittals indicated in individual Specification Sections as informational submittals.
- C. File Transfer Protocol (FTP): Communications protocol that enables transfer of files to and from another computer over a network and that serves as the basis for standard Internet protocols. An FTP site is a portion of a network located outside of network firewalls within which internal and external users are able to access files.
- D. Portable Document Format (PDF): An open standard file format licensed by Adobe Systems used for representing documents in a device-independent and display resolution-independent fixed-layout document format.

1.4 ACTION SUBMITTALS

- A. Submittal Schedule: Submit a schedule of submittals, arranged in chronological order by dates required by construction schedule. Include time required for review, ordering, manufacturing, fabrication, and delivery when establishing dates. Include additional time required for making corrections or modifications to submittals noted by the Architect and additional time for handling and reviewing submittals required by those corrections.

1. Coordinate submittal schedule with list of subcontracts, the schedule of values, and Contractor's construction schedule.
2. Submit concurrently with Contractor's construction schedule. Include submittals required during the first sixty (60) days of construction. List those submittals required to maintain orderly progress of the Work and those required early because of long lead time for manufacture or fabrication.
3. Format: Arrange the following information in a tabular format:
 - a. Scheduled date for first submittal.
 - b. Specification Section number and title.
 - c. Submittal Category: Action, informational.
 - d. Name of subcontractor.
 - e. Description of the Work covered.
 - f. Scheduled date for Architect's final release or approval.
 - g. Scheduled dates for purchasing.
 - h. Scheduled dates for installation.

1.5 SUBMITTAL ADMINISTRATIVE REQUIREMENTS

- A. Architect's Digital Data Files: Electronic copies of the CAD Drawings of the Contract Drawings will **not** be provided by Architect for Vendor's use in preparing submittals unless requested and Architect's user agreement properly completed.
- B. Coordination: Coordinate preparation and processing of submittals with performance of construction activities.
 1. Coordinate each submittal with fabrication, purchasing, testing, delivery, other submittals, and related activities that require sequential activity.
 2. Submit all submittal items required for each Specification Section concurrently unless partial submittals for portions of the Work are indicated on approved submittal schedule.
 3. Submit action submittals and informational submittals required by the same Specification Section as separate packages under separate transmittals.
 4. Coordinate transmittal of different types of submittals for related parts of the Work so processing will not be delayed because of need to review submittals concurrently for coordination.
 - a. Architect reserves the right to withhold action on a submittal requiring coordination with other submittals until related submittals are received.
- C. Processing Time: Allow time for submittal review, including time for resubmittals, as follows. Time for review shall commence on Architect's receipt of submittal. No extension of the Contract Time will be authorized because of failure to transmit submittals enough in advance of the Work to permit processing, including resubmittals.
 1. Initial Review: Allow ten (10) days for initial review of each submittal. Allow additional time if coordination with subsequent submittals is required. Architect will advise Contractor when a submittal being processed must be delayed for coordination.
 2. Resubmittal Review: Allow ten (10) days for review of each resubmittal.
 3. Sequential Review: Where sequential review of submittals by Architect's consultants, Owner, or other parties is indicated, allow fifteen (15) days for initial review of each submittal.
- D. Identification and Information: Place a permanent label or title block on each paper copy submittal item for identification.

1. Indicate name of firm or entity that prepared each submittal on label or title block.
2. Provide a space on label or beside title block to record Contractor's review and approval markings and action taken by Architect.
3. Include the following information for processing and recording action taken:
 - a. Project name.
 - b. Date.
 - c. Name of Architect.
 - d. Name of Contractor.
 - e. Name of subcontractor.
 - f. Name of supplier.
 - g. Name of manufacturer.
 - h. Submittal number or other unique identifier, including revision identifier.
 - 1) Submittal number shall use Specification Section number followed by a decimal point and then a sequential number (e.g., 061000.01). Resubmittals shall include an alphabetic suffix after another decimal point (e.g., 061000.01.A).
 - i. Number and title of appropriate Specification Section.
 - j. Drawing number and detail references, as appropriate.
 - k. Location(s) where product is to be installed, as appropriate.
 - l. Other necessary identification.

E. Identification and Information: Identify and incorporate information in each electronic submittal file as follows:

1. Assemble complete submittal package into a single indexed file with links enabling navigation to each item.
2. Name file with submittal number or other unique identifier, including revision identifier.
 - a. File name shall use project identifier and Specification Section number followed by a decimal point and then a sequential number (e.g., LNHS-061000.01). Resubmittals shall include an alphabetic suffix after another decimal point (e.g., LNHS-061000.01.A).
3. Provide means for insertion to permanently record Contractor's review and approval markings and action taken by Architect.
4. Include the following information on an inserted cover sheet:
 - a. Project name.
 - b. Date.
 - c. Name and address of Architect.
 - d. Name of Contractor.
 - e. Name of firm or entity that prepared submittal.
 - f. Name of subcontractor.
 - g. Name of supplier.
 - h. Name of manufacturer.
 - i. Number and title of appropriate Specification Section.
 - j. Drawing number and detail references, as appropriate.
 - k. Location(s) where product is to be installed, as appropriate.
 - l. Related physical samples submitted directly.
 - m. Other necessary identification.
5. Include the following information as keywords in the electronic file metadata:

- a. Project name.
 - b. Number and title of appropriate Specification Section.
 - c. Manufacturer name.
 - d. Product name.
- F. Options: Identify options requiring selection by the Architect.
- G. Deviations: Identify deviations from the Contract Documents on submittals.
- H. Additional Paper Copies: Unless additional copies are required for final submittal, and unless Architect observes noncompliance with provisions in the Contract Documents, initial submittal may serve as final submittal.
- I. Transmittal: Assemble each submittal individually and appropriately for transmittal and handling. Transmit each submittal using a transmittal form. Architect will return submittals, without review received from sources other than Contractor.
 - 1. Transmittal Form: Provide locations on form for the following information:
 - a. Project name.
 - b. Date.
 - c. Destination (To:).
 - d. Source (From:).
 - e. Names of subcontractor, manufacturer, and supplier.
 - f. Category and type of submittal.
 - g. Submittal purpose and description.
 - h. Specification Section number and title.
 - i. Indication of full or partial submittal.
 - j. Drawing number and detail references, as appropriate.
 - k. Transmittal number, numbered consecutively.
 - l. Submittal and transmittal distribution record.
 - m. Remarks.
 - n. Signature of transmitter.
 - 2. On an attached separate sheet, prepared on Contractor's letterhead, record relevant information, requests for data, revisions other than those requested by Architect on previous submittals, and deviations from requirements in the Contract Documents, including minor variations and limitations. Include same identification information as related submittal.
- J. Resubmittals: Make resubmittals in same form and number of copies as initial submittal.
 - 1. Note date and content of previous submittal.
 - 2. Note date and content of revision in label or title block and clearly indicate extent of revision.
 - 3. Resubmit submittals until they are marked with approval notation from Architect's action stamp.
- K. Distribution: Furnish copies of final submittals to manufacturers, subcontractors, suppliers, fabricators, installers, authorities having jurisdiction, and others as necessary for performance of construction activities. Show distribution on transmittal forms.
- L. Use for Construction: Use only final submittals that are marked with approval notation from Architect's action stamp.

PART 2 - PRODUCTS

2.1 SUBMITTAL PROCEDURES

- A. General Submittal Procedure Requirements: Prepare and submit submittals required by individual Specification Sections. Types of submittals are indicated in individual Specification Sections.
1. Submit electronic submittals via email as PDF electronic files.
 - a. Architect will return annotated file. Annotate and retain one (1) copy of file as an electronic Project record document file.
 2. Closeout Submittals and Maintenance Material Submittals: Comply with requirements specified in Section 017700 "Closeout Procedures."
 3. Certificates and Certifications Submittals: Provide a statement that includes signature of entity responsible for preparing certification. Certificates and certifications shall be signed by an officer or other individual authorized to sign documents on behalf of that entity.
 - a. Provide a digital signature with digital certificate on electronically-submitted certificates and certifications where indicated.
 - b. Provide a notarized statement on original paper copy certificates and certifications where indicated.
 4. Test and Inspection Reports Submittals: Comply with requirements specified in Section 014000 "Quality Requirements."
- B. Product Data: Collect information into a single submittal for each element of construction and type of product or equipment.
1. If information must be specially prepared for submittal because standard published data are not suitable for use, submit as Shop Drawings, not as Product Data.
 2. Mark each copy of each submittal to show which products and options are applicable.
 3. Include the following information, as applicable:
 - a. Manufacturer's catalog cuts.
 - b. Manufacturer's product specifications.
 - c. Standard color charts.
 - d. Statement of compliance with specified referenced standards.
 - e. Testing by recognized testing agency.
 - f. Application of testing agency labels and seals.
 - g. Notation of coordination requirements.
 - h. Availability and delivery time information.
 4. For equipment, include the following in addition to the above, as applicable:
 - a. Wiring diagrams showing factory-installed wiring.
 - b. Printed performance curves.
 - c. Operational range diagrams.
 - d. Clearances required to other construction, if not indicated on accompanying Shop Drawings.
 5. Submit Product Data before or concurrent with Samples.

- C. Shop Drawings: Prepare Project-specific information, drawn accurately to scale. Do not base Shop Drawings on reproductions of the Contract Documents or standard printed data.
1. Preparation: Fully illustrate requirements in the Contract Documents. Include the following information, as applicable:
 - a. Identification of products.
 - b. Schedules.
 - c. Compliance with specified standards.
 - d. Notation of coordination requirements.
 - e. Notation of dimensions established by field measurement.
 - f. Relationship and attachment to adjoining construction clearly indicated.
 - g. Seal and signature of professional engineer if specified.
 2. Sheet Size: Except for templates, patterns, and similar full-size drawings, submit Shop Drawings on sheets at least 8½ by 11 inches but no larger than 30 by 42 inches.
- D. Samples: Submit Samples for review of kind, color, pattern, and texture for a check of these characteristics with other elements and for a comparison of these characteristics between submittal and actual component as delivered and installed.
1. Transmit Samples that contain multiple, related components such as accessories together in one (1) submittal package.
 2. Identification: Attach label on unexposed side of Samples that includes the following:
 - a. Generic description of Sample.
 - b. Product name and name of manufacturer.
 - c. Sample source.
 - d. Number and title of applicable Specification Section.
 3. Disposition: Maintain sets of approved Samples at Project site, available for quality-control comparisons throughout the course of construction activity. Sample sets may be used to determine the final acceptance of construction associated with each set.
 - a. Samples that may be incorporated into the Work are indicated in individual Specification Sections. Such Samples must be in an undamaged condition at time of use.
 - b. Samples not incorporated into the Work, or otherwise designated as Owner's property, are the property of Contractor.
- E. Product Schedule: As required in individual Specification Sections, prepare a written summary indicating types of products required for the Work and their intended location. Include the following information in tabular form:
1. Type of product. Include unique identifier for each product indicated in the Contract Documents.
 2. Manufacturer and product name, and model number if applicable.
 3. Number and name of room or space.
 4. Location within room or space.
- F. Contractor's Construction Schedule: Comply with requirements specified in Section 013200 "Construction Progress Documentation."
- G. Application for Payment: Comply with requirements specified in Section 012900 "Payment Procedures."

- H. Schedule of Values: Comply with requirements specified in Section 012900 "Payment Procedures."
- I. Subcontract List: Prepare a written summary identifying individuals or firms proposed for each portion of the Work, including those who are to furnish products or equipment fabricated to a special design. Include the following information in tabular form:
 - 1. Name, address, and telephone number of entity performing subcontract or supplying products.
 - 2. Number and title of related Specification Section(s) covered by subcontract.
 - 3. Drawing number and detail references, as appropriate, covered by subcontract.
- J. Qualification Data: Prepare written information that demonstrates capabilities and experience of firm or person. Include lists of completed projects with project names and addresses, contact information of Architects and Owners, and other information specified.
- K. Welding Certificates: Prepare written certification that welding procedures and personnel comply with requirements in the Contract Documents. Submit record of Welding Procedure Specification and Procedure Qualification Record on American Welding Society (AWS) forms. Include names of firms and personnel certified.
- L. Installer Certificates: Submit written statements on manufacturer's letterhead certifying that Installer complies with requirements in the Contract Documents and, where required, is authorized by manufacturer for this specific Project.
- M. Manufacturer Certificates: Submit written statements on manufacturer's letterhead certifying that manufacturer complies with requirements in the Contract Documents. Include evidence of manufacturing experience where required.
- N. Product Certificates: Submit written statements on manufacturer's letterhead certifying that product complies with requirements in the Contract Documents.
- O. Material Certificates: Submit written statements on manufacturer's letterhead certifying that material complies with requirements in the Contract Documents.
- P. Material Test Reports: Submit reports written by a qualified testing agency, on testing agency's standard form, indicating and interpreting test results of material for compliance with requirements in the Contract Documents.
- Q. Product Test Reports: Submit written reports indicating current product produced by manufacturer complies with requirements in the Contract Documents. Base reports on evaluation of tests performed by manufacturer and witnessed by a qualified testing agency, or on comprehensive tests performed by a qualified testing agency.
- R. Research Reports: Submit written evidence, from a model code organization acceptable to authorities having jurisdiction, that product complies with building code in effect for Project. Include the following information:
 - 1. Name of evaluation organization.
 - 2. Date of evaluation.
 - 3. Time period when report is in effect.
 - 4. Product and manufacturers' names.
 - 5. Description of product.
 - 6. Test procedures and results.
 - 7. Limitations of use.

- S. Schedule of Tests and Inspections: Comply with requirements specified in Section 014000 "Quality Requirements."
- T. Pre-construction Test Reports: Submit reports written by a qualified testing agency, on testing agency's standard form, indicating and interpreting results of tests performed before installation of product, for compliance with performance requirements in the Contract Documents.
- U. Compatibility Test Reports: Submit reports written by a qualified testing agency, on testing agency's standard form, indicating and interpreting results of compatibility tests performed before installation of product. Include written recommendations for primers and substrate preparation needed for adhesion.
- V. Field Test Reports: Submit reports indicating and interpreting results of field tests performed either during installation of product or after product is installed in its final location, for compliance with requirements in the Contract Documents.
- W. Maintenance Data: Comply with requirements specified in Section 017823 "Operation and Maintenance Data."

PART 3 - EXECUTION

3.1 CONTRACTOR'S REVIEW

- A. Action and Informational Submittals: Review each submittal and check for coordination with other Work of the Contract and for compliance with the Contract Documents. Note corrections and field dimensions. Mark with approval stamp before submitting to Architect.
- B. Project Closeout and Maintenance/Material Submittals: Refer to requirements in Section 017700 "Closeout Procedures."
- C. Approval Stamp: Stamp each submittal with a uniform, approval stamp. Include Project name and location, submittal number, Specification Section title and number, name of reviewer, date of Contractor's approval, and statement certifying that submittal has been reviewed, checked, and approved for compliance with the Contract Documents.

3.2 ARCHITECT'S ACTION

- A. General: Architect will not review submittals that do not bear Contractor's approval stamp and will return them without action.
- B. Action Submittals: Architect will review each submittal, make marks to indicate corrections or modifications required, and return it. Architect will stamp each submittal with an action stamp and will mark stamp appropriately to indicate action.
- C. Informational Submittals: Architect will review each submittal and will not return it, or will return it if it does not comply with requirements. Architect will forward each submittal to appropriate party.
- D. Partial submittals prepared for a portion of the Work will be reviewed when use of partial submittals has received prior approval from Architect.
- E. Incomplete submittals are not acceptable, will be considered nonresponsive, and will be returned without review.

- F. Submittals not required by the Contract Documents may not be reviewed and may be discarded.

END OF SECTION 013300

SECTION 014000 - QUALITY REQUIREMENTS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes administrative and procedural requirements for quality assurance and quality control.
- B. Testing and inspecting services are required to verify compliance with requirements specified or indicated. These services do not relieve Contractor of responsibility for compliance with the Contract Document requirements.
 - 1. Specific quality-assurance and -control requirements for individual work results are specified in their respective Specification Sections. Requirements in individual Sections may also cover production of standard products.
 - 2. Specified tests, inspections, and related actions do not limit Contractor's other quality-assurance and quality-control procedures that facilitate compliance with the Contract Document requirements.
 - 3. Requirements for Contractor to provide quality-assurance and quality-control services required by Architect, Owner, or authorities having jurisdiction are not limited by provisions of this Section.
- C. Related Sections:
 - 1. Divisions 02 through 49 Sections for specific test and inspection requirements.

1.3 DEFINITIONS

- A. Quality-Assurance Services: Activities, actions, and procedures performed before and during execution of the Work to guard against defects and deficiencies and substantiate that proposed construction will comply with requirements.
- B. Quality-Control Services: Tests, inspections, procedures, and related actions during and after execution of the Work to evaluate that actual products incorporated into the Work and completed construction comply with requirements. Contractor's quality-control services do not include contract enforcement activities performed by Architect.
- D. Preconstruction Testing: Tests and inspections performed specifically for the Project before products and materials are incorporated into the Work, to verify performance or compliance with specified criteria.
- E. Product Tests: Tests and inspections that are performed by a nationally recognized testing laboratory (NRTL) according to 29 CFR 1910.7, by a testing agency accredited according to NIST's National Voluntary Laboratory Accreditation Program (NVLAP), or by a testing agency qualified to conduct product testing and acceptable to authorities having jurisdiction, to establish product performance and compliance with specified requirements.

- F. Source Quality-Control Tests: Tests and inspections that are performed at the source; for example, plant, mill, factory, or shop.
- G. Field Quality-Control Tests: Tests and inspections that are performed on-site for installation of the Work and for completed Work.
- H. Testing Agency: An entity engaged to perform specific tests, inspections, or both. Testing laboratory shall mean the same as testing agency.
- I. Installer/Applicator/Erector: Contractor or another entity engaged by Contractor as an employee, Subcontractor, or Sub-subcontractor, to perform a particular construction operation, including installation, erection, application, and similar operations.
 - 1. Use of trade-specific terminology in referring to a trade or entity does not require that certain construction activities be performed by accredited or unionized individuals, or that requirements specified apply exclusively to specific trade or trades.
- J. Experienced: When used with an entity or individual, "experienced" unless otherwise further described means having successfully completed a minimum of five (5) previous projects similar in nature, size, and extent to this Project; being familiar with special requirements indicated; and having complied with requirements of authorities having jurisdiction.

1.4 DELEGATED-DESIGN SERVICES

- A. Performance and Design Criteria: Where professional design services or certifications by a design professional are specifically required of Contractor by the Contract Documents, provide products and systems complying with specific performance and design criteria indicated.
 - 1. If criteria indicated are not sufficient to perform services or certification required, submit a written request for additional information to Architect.

1.5 CONFLICTING REQUIREMENTS

- A. Conflicting Standards and Other Requirements: If compliance with two (2) or more standards or requirements are specified and the standards or requirements establish different or conflicting requirements for minimum quantities or quality levels, comply with the most stringent requirement. Refer conflicting requirements that are different, but apparently equal, to Architect for direction before proceeding.
- B. Minimum Quantity or Quality Levels: The quantity or quality level shown or specified shall be the minimum provided or performed. The actual installation may comply exactly with the minimum quantity or quality specified, or it may exceed the minimum within reasonable limits. To comply with these requirements, indicated numeric values are minimum or maximum, as appropriate, for the context of requirements. Refer uncertainties to Architect for a decision before proceeding.

1.6 ACTION SUBMITTALS

- A. Delegated-Design Services Submittal: In addition to Shop Drawings, Product Data, and other required submittals, submit a statement signed and sealed by the responsible design professional, for each product and system specifically assigned to Contractor to be designed or certified by a design professional, indicating that the products and systems are in compliance with performance and design criteria indicated. Include list of codes, loads, and other factors used in performing these services.

1.7 INFORMATIONAL SUBMITTALS

- A. Contractor's Quality-Control Plan: For quality-assurance and quality-control activities and responsibilities.
- B. Qualification Data: For Contractor's quality-control personnel.
- C. Contractor's Statement of Responsibility: When required by authorities having jurisdiction, submit copy of written statement of responsibility submitted to authorities having jurisdiction before starting work on the following systems.
 - 1. Seismic-force-resisting system, designated seismic system, or component listed in the Statement of Special Inspections.
 - 2. Main wind-force-resisting system or a wind-resisting component listed in the Statement of Special Inspections.
- D. Testing Agency Qualifications: For testing agencies specified in "Quality Assurance" Article to demonstrate their capabilities and experience. Include proof of qualifications in the form of a recent report on the inspection of the testing agency by a recognized authority.
- E. Schedule of Tests and Inspections: Prepare in tabular form and include the following:
 - 1. Specification Section number and title.
 - 2. Entity responsible for performing tests and inspections.
 - 3. Description of test and inspection.
 - 4. Identification of applicable standards.
 - 5. Identification of test and inspection methods.
 - 6. Number of tests and inspections required.
 - 7. Time schedule or time span for tests and inspections.
 - 8. Requirements for obtaining samples.
 - 9. Unique characteristics of each quality-control service.
- F. Reports: Prepare and submit certified written reports and documents as specified.
- G. Permits, Licenses, and Certificates: For Owner's record, submit copies of permits, licenses, certifications, inspection reports, releases, jurisdictional settlements, notices, receipts for fee payments, judgments, correspondence, records, and similar documents established for compliance with standards and regulations bearing on performance of the Work.

1.8 CONTRACTOR'S QUALITY-CONTROL PLAN

- A. Quality-Control Plan, General: Submit quality-control plan within ten (10) days of Notice to Proceed, and not less than five (5) days prior to preconstruction conference. Submit in format acceptable to Architect. Identify personnel, procedures, controls, instructions, tests, records, and forms to be used to carry out Contractor's quality-assurance and quality-control responsibilities. Coordinate with Contractor's construction schedule.
- B. Quality-Control Personnel Qualifications: Engage qualified personnel trained and experienced in managing and executing quality-assurance and quality-control procedures similar in nature and extent to those required for Project.
- C. Submittal Procedure: Describe procedures for ensuring compliance with requirements through review and management of submittal process. Indicate qualifications of personnel responsible for submittal review.

- D. Testing and Inspection: Include in quality-control plan a comprehensive schedule of Work requiring testing or inspection, including the following:
 - 1. Contractor-performed tests and inspections including subcontractor-performed tests and inspections. Include required tests and inspections and Contractor-elected tests and inspections. Distinguish source quality-control tests and inspections from field quality-control tests and inspections.
 - 2. Special inspections required by authorities having jurisdiction and indicated on the "Statement of Special Inspections."
 - 3. Owner-performed tests and inspections indicated in the Contract Documents.
- E. Continuous Inspection of Workmanship: Describe process for continuous inspection during construction to identify and correct deficiencies in workmanship in addition to testing and inspection specified. Indicate types of corrective actions to be required to bring work into compliance with standards of workmanship established by Contract requirements.
- F. Monitoring and Documentation: Maintain testing and inspection reports including log of approved and rejected results. Include work Architect has indicated as nonconforming or defective. Indicate corrective actions taken to bring nonconforming work into compliance with requirements. Comply with requirements of authorities having jurisdiction.

1.9 REPORTS AND DOCUMENTS

- A. Test and Inspection Reports: Prepare and submit certified written reports specified in other Sections. Include the following:
 - 1. Date of issue.
 - 2. Project title and number.
 - 3. Name, address, and telephone number of testing agency.
 - 4. Dates and locations of samples and tests or inspections.
 - 5. Names of individuals making tests and inspections.
 - 6. Description of the Work and test and inspection method.
 - 7. Identification of product and Specification Section.
 - 8. Complete test or inspection data.
 - 9. Test and inspection results and an interpretation of test results.
 - 10. Record of temperature and weather conditions at time of sample taking and testing and inspecting.
 - 11. Comments or professional opinion on whether tested or inspected Work complies with the Contract Document requirements.
 - 12. Name and signature of laboratory inspector.
 - 13. Recommendations on retesting and reinspecting.
- B. Manufacturer's Technical Representative's Field Reports: Prepare written information documenting manufacturer's technical representative's tests and inspections specified in other Sections. Include the following:
 - 1. Name, address, and telephone number of technical representative making report.
 - 2. Statement on condition of substrates and their acceptability for installation of product.
 - 3. Statement that products at Project site comply with requirements.
 - 4. Summary of installation procedures being followed, whether they comply with requirements and, if not, what corrective action was taken.
 - 5. Results of operational and other tests and a statement of whether observed performance complies with requirements.
 - 6. Statement whether conditions, products, and installation will affect warranty.
 - 7. Other required items indicated in individual Specification Sections.

- C. Factory-Authorized Service Representative's Reports: Prepare written information documenting manufacturer's factory-authorized service representative's tests and inspections specified in other Sections. Include the following:
 - 1. Name, address, and telephone number of factory-authorized service representative making report.
 - 2. Statement that equipment complies with requirements.
 - 3. Results of operational and other tests and a statement of whether observed performance complies with requirements.
 - 4. Statement whether conditions, products, and installation will affect warranty.
 - 5. Other required items indicated in individual Specification Sections.

1.10 QUALITY ASSURANCE

- A. General: Qualifications paragraphs in this article establish the minimum qualification levels required; individual Specification Sections specify additional requirements.
- B. Manufacturer Qualifications: A firm experienced in manufacturing products or systems similar to those indicated for this Project and with a record of successful in-service performance, as well as sufficient production capacity to produce required units. As applicable, procure products from manufacturers able to meet qualification requirements, warranty requirements, and technical or factory-authorized service representative requirements.
- C. Fabricator Qualifications: A firm experienced in producing products similar to those indicated for this Project and with a record of successful in-service performance, as well as sufficient production capacity to produce required units.
- D. Installer Qualifications: A firm or individual experienced in installing, erecting, applying, or assembling work similar in material, design, and extent to that indicated for this Project, whose work has resulted in construction with a record of successful in-service performance.
- E. Professional Engineer Qualifications: A professional engineer who is legally qualified to practice in jurisdiction where Project is located and who is experienced in providing engineering services of the kind indicated. Engineering services are defined as those performed for installations of the system, assembly, or product that are similar in material, design, and extent to those indicated for this Project.
- F. Specialists: Certain Specification Sections require that specific construction activities shall be performed by entities who are recognized experts in those operations. Specialists shall satisfy qualification requirements indicated and shall be engaged for the activities indicated.
 - 1. Requirements of authorities having jurisdiction shall supersede requirements for specialists.
- G. Testing Agency Qualifications: An NRTL, an NVLAP, or an independent agency with the experience and capability to conduct testing and inspecting indicated, as documented according to ASTM E 329; and with additional qualifications specified in individual Sections; and where required by authorities having jurisdiction, that is acceptable to authorities.
- H. Manufacturer's Technical Representative Qualifications: An authorized representative of manufacturer who is trained and approved by manufacturer to observe and inspect installation of manufacturer's products that are similar in material, design, and extent to those indicated for this Project.

- I. Factory-Authorized Service Representative Qualifications: An authorized representative of manufacturer who is trained and approved by manufacturer to inspect installation of manufacturer's products that are similar in material, design, and extent to those indicated for this Project.

1.11 QUALITY CONTROL

- A. Owner Responsibilities: Where quality-control services are indicated as Owner's responsibility, Owner will engage a qualified testing agency to perform these services.
 - 1. Owner will furnish Contractor with names, addresses, and telephone numbers of testing agencies engaged and a description of types of testing and inspecting they are engaged to perform.
 - 2. Costs for retesting and reinspecting construction that replaces or is necessitated by work that failed to comply with the Contract Documents will be charged to Contractor, and the Contract Sum will be adjusted by Change Order.
 - 3. Costs for testing that is cancelled will be charged to the Contractor, and the Contract Sum will be adjusted by Change Order.
- B. Contractor Responsibilities: Tests and inspections not explicitly assigned to Owner are Contractor's responsibility. Perform additional quality-control activities, whether specified or not, to verify that the Work complies with requirements.
 - 1. Unless otherwise indicated, provide quality-control services specified and those required by authorities having jurisdiction. Perform quality-control services required of Contractor by authorities having jurisdiction, whether specified or not.
 - 2. Engage a qualified testing agency to perform these quality-control services.
 - a. Contractor shall not employ same entity engaged by Owner, unless agreed to in writing by Owner.
 - 3. Notify testing agencies at least 24 hours in advance of time when Work that requires testing or inspecting will be performed.
 - 4. Where quality-control services are indicated as Contractor's responsibility, submit a certified written report, in duplicate, of each quality-control service.
 - 5. Testing and inspecting requested by Contractor and not required by the Contract Documents are Contractor's responsibility.
 - 6. Submit additional copies of each written report directly to authorities having jurisdiction, when they so direct.
- C. Manufacturer's Field Services: Where indicated, engage a factory-authorized service representative to inspect field-assembled components and equipment installation, including service connections. Report results in writing as specified in Section 013300 "Submittal Procedures."
- D. Manufacturer's Technical Services: Where indicated, engage a manufacturer's technical representative to observe and inspect the Work. Manufacturer's technical representative's services include participation in preinstallation conferences, examination of substrates and conditions, verification of materials, observation of Installer activities, inspection of completed portions of the Work, and submittal of written reports.
- E. Retesting/Reinspecting: Regardless of whether original tests or inspections were Contractor's responsibility, provide quality-control services, including retesting and reinspecting, for construction that replaced Work that failed to comply with the Contract Documents.

- F. Testing Agency Responsibilities: Cooperate with Architect and Contractor in performance of duties. Provide qualified personnel to perform required tests and inspections.
1. Notify Architect and Contractor promptly of irregularities or deficiencies observed in the Work during performance of its services.
 2. Determine the location from which test samples will be taken and in which in-situ tests are conducted.
 3. Conduct and interpret tests and inspections and state in each report whether tested and inspected work complies with or deviates from requirements.
 4. Submit a certified written report, in duplicate, of each test, inspection, and similar quality-control service through Contractor.
 5. Do not release, revoke, alter, or increase the Contract Document requirements or approve or accept any portion of the Work.
 6. Do not perform any duties of Contractor.
- G. Associated Contractor Services: Cooperate with agencies and representatives performing required tests, inspections, and similar quality-control services, and provide reasonable auxiliary services as requested. Notify agency sufficiently in advance of operations to permit assignment of personnel. Provide the following:
1. Access to the Work.
 2. Incidental labor and facilities necessary to facilitate tests and inspections.
 3. Adequate quantities of representative samples of materials that require testing and inspection. Assist agency in obtaining samples.
 4. Facilities for storage and field curing of test samples.
 5. Delivery of samples to testing agencies.
 6. Preliminary design mix proposed for use for material mixes that require control by testing agency.
 7. Security and protection for samples and for testing and inspecting equipment at Project site.
- H. Coordination: Coordinate sequence of activities to accommodate required quality-assurance and quality-control services with a minimum of delay and to avoid necessity of removing and replacing construction to accommodate testing and inspecting.
1. Schedule times for tests, inspections, obtaining samples, and similar activities.
- I. Schedule of Tests and Inspections: Prepare a schedule of tests, inspections, and similar quality-control services required by the Contract Documents Coordinate and submit concurrently with Contractor's construction schedule. Update as the Work progresses.
1. Distribution: Distribute schedule to Owner, Architect, testing agencies, and each party involved in performance of portions of the Work where tests and inspections are required.

1.12 SPECIAL TESTS AND INSPECTIONS

- A. Special Tests and Inspections: Conducted by a qualified testing agency as required by authorities having jurisdiction, as indicated in individual Specification Sections, and as follows:
1. Verifying that manufacturer maintains detailed fabrication and quality-control procedures and reviewing the completeness and adequacy of those procedures to perform the Work.
 2. Notifying Architect and Contractor promptly of irregularities and deficiencies observed in the Work during performance of its services.
 3. Submitting a certified written report of each test, inspection, and similar quality-control service to Architect, Contractor and to authorities having jurisdiction.

4. Submitting a final report of special tests and inspections at Substantial Completion, which includes a list of unresolved deficiencies.
5. Interpreting tests and inspections and stating in each report whether tested and inspected work complies with or deviates from the Contract Documents.
6. Retesting and reinspecting corrected work.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION

3.1 TEST AND INSPECTION LOG

- A. Prepare a record of tests and inspections. Include the following:
 1. Date test or inspection was conducted.
 2. Description of the Work tested or inspected.
 3. Date test or inspection results were transmitted to Architect.
 4. Identification of testing agency or special inspector conducting test or inspection.
- B. Maintain log at Project site. Post changes and modifications as they occur. Provide access to test and inspection log for Architect's reference during normal working hours.
 1. Submit log at Project closeout as part of Project Record Documents.

3.2 REPAIR AND PROTECTION

- A. General: On completion of testing, inspecting, sample taking, and similar services, repair damaged construction and restore substrates and finishes.
 1. Provide materials and comply with installation requirements specified in other Specification Sections or matching existing substrates and finishes. Restore patched areas and extend restoration into adjoining areas with durable seams that are as invisible as possible. Comply with the Contract Document requirements for cutting and patching in Section 017300 "Execution."
- B. Protect construction exposed by or for quality-control service activities.
- C. Repair and protection are Contractor's responsibility, regardless of the assignment of responsibility for quality-control services.

END OF SECTION 014000

SECTION 014200 - REFERENCES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 DEFINITIONS

- A. General: Basic Contract definitions are included in the Conditions of the Contract.
- B. "Approved": When used to convey Architect's action on Contractor's submittals, applications, and requests, "approved" is limited to Architect's duties and responsibilities as stated in the Conditions of the Contract.
- C. "Directed": A command or instruction by Architect. Other terms including "requested," "authorized," "selected," "required," and "permitted" have the same meaning as "directed."
- D. "Indicated": Requirements expressed by graphic representations or in written form on Drawings, in Specifications, and in other Contract Documents. Other terms including "shown," "noted," "scheduled," and "specified" have the same meaning as "indicated."
- E. "Regulations": Laws, ordinances, statutes, and lawful orders issued by authorities having jurisdiction, and rules, conventions, and agreements within the construction industry that control performance of the Work.
- F. "Furnish": Supply and deliver to Project site, ready for unloading, unpacking, assembly, installation, and similar operations.
- G. "Install": Unload, temporarily store, unpack, assemble, erect, place, anchor, apply, work to dimension, finish, cure, protect, clean, and similar operations at Project site.
- H. "Provide": Furnish and install, complete and ready for the intended use.
- I. "Project Site": Space available for performing construction activities. The extent of Project site is shown on Drawings and may or may not be identical with the description of the land on which Project is to be built.

1.3 INDUSTRY STANDARDS

- A. Applicability of Standards: Unless the Contract Documents include more stringent requirements, applicable construction industry standards have the same force and effect as if bound or copied directly into the Contract Documents to the extent referenced. Such standards are made a part of the Contract Documents by reference.
- B. Publication Dates: Comply with standards in effect as of date of the Contract Documents unless otherwise indicated.
 - 1. For standards referenced by applicable building codes, comply with dates of standards as listed in building codes.

SECTION 015000 - TEMPORARY FACILITIES AND CONTROLS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes requirements for temporary support, security, and protection facilities.
- B. Related Requirements:
 - 1. Section 011000 "Summary of Work" for work restrictions and limitations on utility interruptions.

1.3 USE CHARGES

- A. General: Installation and removal of and use charges for temporary facilities shall be included in the Contract Sum unless otherwise indicated. Allow other entities to use temporary services and facilities without cost, including, but not limited to, Architect, testing agencies, and authorities having jurisdiction.
- B. Water and Sewer Service from Existing System: Water from Owner's existing water system is available for use without metering and without payment of use charges. Provide connections and extensions of services as required for construction operations.
- C. Electric Power Service from Existing System: Electric power from Owner's existing system is available for use without metering and without payment of use charges. Provide connections and extensions of services as required for construction operations.

1.4 INFORMATIONAL SUBMITTALS

- A. Site Plan: Show temporary facilities, utility hookups, staging areas, and parking areas for construction personnel.
- B. Project Identification and Temporary Signs: Show fabrication and installation details, including plans, elevations, details, layouts, typestyles, graphic elements, and message content.

1.5 QUALITY ASSURANCE

- A. Electric Service: Comply with NECA, NEMA, and UL standards and regulations for temporary electric service. Install service to comply with NFPA 70.

PART 2 - PRODUCTS

2.1 TEMPORARY FACILITIES

- A. Field Offices, General: Prefabricated or mobile units with serviceable finishes, temperature controls, and foundations adequate for normal loading, if required. Unit must be large enough

for regular job meetings, plan review areas, submittal storage and other job file and administrative functions.

1. If provided, Contractor will be responsible for its complete installation.
2. No building space will be provided by the Owner for the Contractor's field office.

B. Storage and Fabrication Sheds: Provide sheds sized, furnished, and equipped to accommodate materials and equipment for construction operations.

1. Sheds to be metal box storage units or have wood floors raised above the ground.
2. Store combustible materials apart from building.

2.2 EQUIPMENT

A. Fire Extinguishers: Portable, UL rated; with class and extinguishing agent as required by locations and classes of fire exposures.

PART 3 - EXECUTION

3.1 INSTALLATION, GENERAL

A. Locate facilities where they will serve Project adequately and result in minimum interference with performance of the Work. Relocate and modify facilities as required by progress of the Work.

B. Provide each facility ready for use when needed to avoid delay. Do not remove until facilities are no longer needed or are replaced by authorized use of completed permanent facilities.

3.2 TEMPORARY UTILITY INSTALLATION

A. General: Install temporary service or connect to existing service.

1. Arrange with utility company, Owner, and existing users for time when service can be interrupted, if necessary, to make connections for temporary services.

B. Water Service: Connect to Owner's existing water service facilities. Clean and maintain water service facilities in a condition acceptable to Owner. At Substantial Completion, restore these facilities to condition existing before initial use.

C. Sanitary Facilities: Provide temporary toilets, wash facilities, and drinking water for use of construction personnel. Comply with requirements of authorities having jurisdiction for type, number, location, operation, and maintenance of fixtures and facilities.

D. Electric Power Service: Connect to Owner's existing electric power service. Maintain equipment in a condition acceptable to Owner.

E. Electronic Communication Service: Regardless of availability of Owner's service, the Contractor shall maintain at his expense secure and reliable WiFi wireless connection to internet with provisions for access by Architect, the Owner's staff, Municipal Officials or Inspectors, and all subcontractors.

3.3 SUPPORT FACILITIES INSTALLATION

A. General: Comply with the following:

1. Provide construction for temporary sheds located within construction area or within 30 feet of building lines that is noncombustible according to ASTM E 136. Comply with NFPA 241.
 2. Maintain support facilities until Architect schedules Substantial Completion inspection. Remove before Substantial Completion. Personnel remaining after Substantial Completion will be permitted to use permanent facilities, under conditions acceptable to Owner.
- B. Traffic Controls: Comply with requirements of authorities having jurisdiction.
1. Protect existing site improvements to remain including curbs, pavement, and utilities.
 2. Maintain access for fire-fighting equipment and access to fire hydrants.
- C. Parking: Provide temporary parking areas for construction personnel.
- D. Project Signs: Provide Project signs as required by Owner. Unauthorized signs are not permitted.
1. Identification Signs: Provide Project identification signs.
 2. Temporary Signs: Provide other signs as indicated and as required to inform public and individuals seeking entrance to Project.
 - a. Provide temporary, directional signs for construction personnel and visitors.
 3. Maintain and touch up signs so they are legible at all times.
- E. Waste Disposal Facilities: Provide waste-collection containers in sizes adequate to handle waste from construction operations. Comply with requirements of authorities having jurisdiction. Comply with progress cleaning requirements in Section 017300 "Execution."
- F. Lifts and Hoists: Provide facilities necessary for hoisting materials and personnel.
1. Truck cranes and similar devices used for hoisting materials are considered "tools and equipment" and not temporary facilities.

3.4 SECURITY AND PROTECTION FACILITIES INSTALLATION

- A. Protection of Existing Facilities: Protect existing vegetation, equipment, structures, utilities, and other improvements at Project site and on adjacent properties, except those indicated to be removed or altered. Repair damage to existing facilities.
- B. Environmental Protection: Provide protection, operate temporary facilities, and conduct construction as required to comply with environmental regulations and that minimize possible air, waterway, and subsoil contamination or pollution or other undesirable effects.
- C. Barricades, Warning Signs, and Lights: Comply with requirements of authorities having jurisdiction for erecting structurally adequate barricades, including warning signs and lighting.
- D. Temporary Egress: Maintain temporary egress from existing occupied facilities as indicated and as required by authorities having jurisdiction.
- E. Temporary Enclosures: Provide temporary enclosures for protection of construction, in progress and completed, from exposure, foul weather, other construction operations, and similar activities. Provide temporary weathertight enclosure for building exterior.

3.5 OPERATION, TERMINATION, AND REMOVAL

- A. Temporary Facility Changeover: Do not change over from using temporary security and protection facilities to permanent facilities until Substantial Completion.
- B. Termination and Removal: Remove each temporary facility when need for its service has ended, when it has been replaced by authorized use of a permanent facility, or no later than Substantial Completion. Complete or, if necessary, restore permanent construction that may have been delayed because of interference with temporary facility. Repair damaged Work, clean exposed surfaces, and replace construction that cannot be satisfactorily repaired.
 - 1. Materials and facilities that constitute temporary facilities are property of Contractor. Owner reserves right to take possession of Project identification signs.
 - 2. At Substantial Completion, repair, renovate, and clean permanent facilities used during construction period. Comply with final cleaning requirements specified in Section 017700 "Closeout Procedures."

END OF SECTION 015000

SECTION 016000 - PRODUCT REQUIREMENTS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes administrative and procedural requirements for selection of products for use in Project; product delivery, storage, and handling; manufacturers' standard warranties on products; special warranties; and comparable products.
- B. Related Sections:
 - 1. Section 012500 "Substitution Procedures" for requests for substitutions.
 - 2. Section 014200 "References" for applicable industry standards for products specified.

1.3 DEFINITIONS

- A. Products: Items obtained for incorporating into the Work, whether purchased for Project or taken from previously purchased stock. The term "product" includes the terms "material," "equipment," "system," and terms of similar intent.
 - 1. Named Products: Items identified by manufacturer's product name, including make or model number or other designation shown or listed in manufacturer's published product literature, that is current as of date of the Contract Documents.
 - 2. New Products: Items that have not previously been incorporated into another project or facility. Products salvaged or recycled from other projects are not considered new products.
 - 3. Comparable Product: Product that is demonstrated and approved through submittal process to have the indicated qualities related to type, function, dimension, in-service performance, physical properties, appearance, and other characteristics that equal or exceed those of specified product.
- B. Basis-of-Design Product Specification: A specification in which a specific manufacturer's product is named and accompanied by the words "basis-of-design product," including make or model number or other designation, to establish the significant qualities related to type, function, dimension, in-service performance, physical properties, appearance, and other characteristics for purposes of evaluating comparable products of additional manufacturers named in the specification.

1.4 ACTION SUBMITTALS

- A. Comparable Product Requests: Submit request for consideration of each comparable product. Identify product or fabrication or installation method to be replaced. Include Specification Section number and title and Drawing numbers and titles.
 - 1. Include data to indicate compliance with the requirements specified in "Comparable Products" Article.

2. Architect's Action: If necessary, Architect will request additional information or documentation for evaluation within one (1) week of receipt of a comparable product request. Architect will notify Contractor of approval or rejection of proposed comparable product request within fifteen (15) days of receipt of request, or seven (7) days of receipt of additional information or documentation, whichever is later.
 - a. Form of Approval: As specified in Section 013300 "Submittal Procedures."
 - b. Use product specified if Architect does not issue a decision on use of a comparable product request within time allocated.

- B. Basis-of-Design Product Specification Submittal: Comply with requirements in Section 013300 "Submittal Procedures." Show compliance with requirements.

1.5 QUALITY ASSURANCE

- A. Compatibility of Options: If Contractor is given option of selecting between two (2) or more products for use on Project, select product compatible with products previously selected, even if previously selected products were also options.
 1. Each contractor is responsible for providing products and construction methods compatible with products and construction methods of other contractors.
 2. If a dispute arises between contractors over concurrently selectable but incompatible products, Architect will determine which products shall be used.

1.6 PRODUCT DELIVERY, STORAGE, AND HANDLING

- A. Deliver, store, and handle products using means and methods that will prevent damage, deterioration, and loss, including theft and vandalism. Comply with manufacturer's written instructions.
- B. Delivery and Handling:
 1. Schedule delivery to minimize long-term storage at Project site and to prevent overcrowding of construction spaces.
 2. Coordinate delivery with installation time to ensure minimum holding time for items that are flammable, hazardous, easily damaged, or sensitive to deterioration, theft, and other losses.
 3. Deliver products to Project site in an undamaged condition in manufacturer's original sealed container or other packaging system, complete with labels and instructions for handling, storing, unpacking, protecting, and installing.
 4. Inspect products on delivery to determine compliance with the Contract Documents and to determine that products are undamaged and properly protected.
- C. Storage:
 1. Store products to allow for inspection and measurement of quantity or counting of units.
 2. Store materials in a manner that will not endanger Project structure.
 3. Store products that are subject to damage by the elements, under cover in a weathertight enclosure above ground, with ventilation adequate to prevent condensation.
 4. Comply with product manufacturer's written instructions for temperature, humidity, ventilation, and weather-protection requirements for storage.
 5. Protect stored products from damage and liquids from freezing.
 6. Provide a secure location and enclosure at Project site for storage of materials and equipment by Owner's construction forces. Coordinate location with Owner.

1.7 PRODUCT WARRANTIES

- A. Warranties specified in other Sections shall be in addition to, and run concurrent with, other warranties required by the Contract Documents. Manufacturer's disclaimers and limitations on product warranties do not relieve Contractor of obligations under requirements of the Contract Documents.
 - 1. Manufacturer's Warranty: Written warranty furnished by individual manufacturer for a particular product and specifically endorsed by manufacturer to Owner.
 - 2. Special Warranty: Written warranty required by the Contract Documents to provide specific rights for Owner.
- B. Special Warranties: Prepare a written document that contains appropriate terms and identification, ready for execution.
 - 1. Manufacturer's Standard Form: Modified to include Project-specific information and properly executed.
 - 2. Specified Form: When specified forms are included with the Specifications, prepare a written document using indicated form properly executed.
 - 3. Refer to Divisions 02 through 49. Sections for specific content requirements and particular requirements for submitting special warranties.

PART 2 - PRODUCTS

2.1 PRODUCT SELECTION PROCEDURES

- A. General Product Requirements: Provide products that comply with the Contract Documents, are undamaged and, unless otherwise indicated, are new at time of installation.
 - 1. Provide products complete with accessories, trim, finish, fasteners, and other items needed for a complete installation and indicated use and effect.
 - 2. Standard Products: If available, and unless custom products or nonstandard options are specified, provide standard products of types that have been produced and used successfully in similar situations on other projects.
 - 3. Owner reserves the right to limit selection to products with warranties not in conflict with requirements of the Contract Documents.
 - 4. Where products are accompanied by the term "as selected," Architect will make selection.
 - 5. Descriptive, performance, and reference standard requirements in the Specifications establish salient characteristics of products.
 - 6. Or Equal: For products specified by name and accompanied by the term "or equal," or "or approved equal," or "or approved," comply with requirements in "Comparable Products" Article to obtain approval for use of an unnamed product.
- B. Product Selection Procedures:
 - 1. Product: Where Specifications name a single manufacturer and product, provide the named product that complies with requirements. Comparable products or substitutions for Contractor's convenience will not be considered.
 - 2. Manufacturer/Source: Where Specifications name a single manufacturer or source, provide a product by the named manufacturer or source that complies with requirements. Comparable products or substitutions for Contractor's convenience will not be considered.
 - 3. Products:

- a. Restricted List: Where Specifications include a list of names of both manufacturers and products, provide one (1) of the products listed that complies with requirements. Comparable products or substitutions for Contractor's convenience will be considered, unless otherwise indicated.
 - b. Non-Restricted List: Where Specifications include a list of names of both available manufacturers and products, provide one (1) of the products listed, or an unnamed product, that complies with requirements. Comply with requirements in "Comparable Products" Article for consideration of an unnamed product.
 - 4. Manufacturers:
 - a. Restricted List: Where Specifications include a list of manufacturers' names, provide a product by one (1) of the manufacturers listed that complies with requirements. Comparable products or substitutions for Contractor's convenience will be considered, unless otherwise indicated.
 - b. Non-Restricted List: Where Specifications include a list of available manufacturers, provide a product by one (1) of the manufacturers listed, or a product by an unnamed manufacturer, that complies with requirements. Comply with requirements in "Comparable Products" Article for consideration of an unnamed manufacturer's product.
 - 5. Basis-of-Design Product: Where Specifications name a product, or refer to a product indicated on Drawings, and include a list of manufacturers, provide the specified or indicated product or a comparable product by one (1) of the other named manufacturers. Drawings and Specifications indicate sizes, profiles, dimensions, and other characteristics that are based on the product named. Comply with requirements in "Comparable Products" Article for consideration of an unnamed product by one (1) of the other named manufacturers.
 - C. Visual Matching Specification: Where Specifications require "match Architect's sample", provide a product that complies with requirements and matches Architect's sample. Architect's decision will be final on whether a proposed product matches.
 - 1. If no product available within specified category matches and complies with other specified requirements, comply with requirements in Section 012500 "Substitution Procedures" for proposal of product.
 - D. Visual Selection Specification: Where Specifications include the phrase "as selected by Architect from manufacturer's full range" or similar phrase, select a product that complies with requirements. Architect will select color, gloss, pattern, density, or texture from manufacturer's product line that includes both standard and premium items.
- ## 2.2 COMPARABLE PRODUCTS
- A. Conditions for Consideration: Architect will consider Contractor's request for comparable product when the following conditions are satisfied. If the following conditions are not satisfied, Architect may return requests without action, except to record noncompliance with these requirements:
 - 1. Evidence that the proposed product does not require revisions to the Contract Documents, that it is consistent with the Contract Documents and will produce the indicated results, and that it is compatible with other portions of the Work.
 - 2. Detailed, SIDE-BY-SIDE comparison of significant qualities of proposed product with those named in the Specifications. Significant qualities include attributes such as

- performance, weight, size, durability, visual effect, and specific features and requirements indicated.
3. Evidence that proposed product provides specified warranty.
 4. List of similar installations for completed projects with project names and addresses and names and addresses of architects and owners, if requested.
 5. Samples, if requested.

PART 3 - EXECUTION (Not Used)

END OF SECTION 016000

SECTION 017300 - EXECUTION

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes general administrative and procedural requirements governing execution of the Work including, but not limited to, the following:
 - 1. Installation of the Work.
 - 2. Cutting and patching.
 - 3. Progress cleaning.
 - 4. Starting and adjusting.
 - 5. Protection of installed construction.
 - 6. Correction of the Work.
- B. Related Sections:
 - 1. Section 013300 "Submittal Procedures" for submitting surveys.
 - 2. Section 017700 "Closeout Procedures" for recording of Owner-accepted deviations from indicated lines and levels and final cleaning.

1.3 DEFINITIONS

- A. Cutting: Removal of in-place construction necessary to permit installation or performance of other work.
- B. Patching: Fitting and repair work required to restore construction to original conditions after installation of other work.

1.4 QUALITY ASSURANCE

- A. Cutting and Patching: Comply with requirements for and limitations on cutting and patching of construction elements.
 - 1. Structural Elements: When cutting and patching structural elements, notify Architect of locations and details of cutting and await directions from the Architect before proceeding. Shore, brace, and support structural element during cutting and patching. Do not cut and patch structural elements in a manner that could change their load-carrying capacity or increase deflection.
 - 2. Operational Elements: Do not cut and patch operating elements and related components in a manner that results in reducing their capacity to perform as intended or that results in increased maintenance or decreased operational life or safety.
 - 3. Other Construction Elements: Do not cut and patch other construction elements or components in a manner that could change their load-carrying capacity, that results in reducing their capacity to perform as intended, or that results in increased maintenance or decreased operational life or safety.

4. Visual Elements: Do not cut and patch construction in a manner that results in visual evidence of cutting and patching. Do not cut and patch exposed construction in a manner that would, in Architect's opinion, reduce the building's aesthetic qualities. Remove and replace construction that has been cut and patched in a visually unsatisfactory manner.
- B. Manufacturer's Installation Instructions: Obtain and maintain on-site manufacturer's written recommendations and instructions for installation of products and equipment.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. General: Comply with requirements specified in other Sections.
- B. In-Place Materials: Use materials for patching identical to in-place materials. For exposed surfaces, use materials that visually match in-place adjacent surfaces to the fullest extent possible.
1. If identical materials are unavailable or cannot be used, use materials that, when installed, will provide a match acceptable to the Architect for the visual and functional performance of in-place materials.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Existing Conditions: The existence and location of utilities and construction indicated as existing are not guaranteed. Before beginning, investigate and verify the existence and location of underground utilities, mechanical and electrical systems, and other construction affecting the Work.
- B. Examination and Acceptance of Conditions: Before proceeding with each component of the Work, examine substrates, areas, and conditions, with Installer or Applicator present where indicated, for compliance with requirements for installation tolerances and other conditions affecting performance. Record observations.
1. Written Report: Where a written report listing conditions detrimental to performance of the Work is required by other Sections, include the following:
 - a. Description of the Work.
 - b. List of detrimental conditions, including substrates.
 - c. List of unacceptable installation tolerances.
 - d. Recommended corrections.
 2. Verify compatibility with and suitability of substrates, including compatibility with existing finishes or primers.
 3. Examine roughing-in for mechanical and electrical systems to verify actual locations of connections before equipment and fixture installation.
 4. Examine walls, floors, and roofs for suitable conditions where products and systems are to be installed.
 5. Proceed with installation only after unsatisfactory conditions have been corrected. Proceeding with the Work indicates acceptance of surfaces and conditions.

3.2 PREPARATION

- A. Field Measurements: Take field measurements as required to fit the Work properly. Recheck measurements before installing each product. Where portions of the Work are indicated to fit to other construction, verify dimensions of other construction by field measurements before fabrication. Coordinate fabrication schedule with construction progress to avoid delaying the Work.
- B. Space Requirements: Verify space requirements and dimensions of items shown diagrammatically on Drawings.
- C. Review of Contract Documents and Field Conditions: Immediately on discovery of the need for clarification of the Contract Documents caused by differing field conditions outside the control of the Contractor, submit a request for information to Architect according to requirements in Section 013100 "Project Management and Coordination."

3.3 INSTALLATION

- A. General: Locate the Work and components of the Work accurately, in correct alignment and elevation, as indicated.
 - 1. Make vertical work plumb and make horizontal work level.
 - 2. Where space is limited, install components to maximize space available for maintenance and ease of removal for replacement.
 - 3. Conceal pipes, ducts, and wiring in finished areas, unless otherwise indicated.
 - 4. Maintain minimum headroom clearance of 96 inches in occupied spaces and 90 inches in unoccupied spaces.
- B. Comply with manufacturer's written instructions and recommendations for installing products in applications indicated.
- C. Install products at the time and under conditions that will ensure the best possible results. Maintain conditions required for product performance until Substantial Completion.
- D. Conduct construction operations so no part of the Work is subjected to damaging operations or loading in excess of that expected during normal conditions of occupancy.
- E. Tools and Equipment: Do not use tools or equipment that produce harmful noise levels.
- F. Templates: Obtain and distribute to the parties involved templates for work specified to be factory prepared and field installed. Check Shop Drawings of other work to confirm that adequate provisions are made for locating and installing products to comply with indicated requirements.
- G. Attachment: Provide blocking and attachment plates and anchors and fasteners of adequate size and number to securely anchor each component in place, accurately located and aligned with other portions of the Work. Where size and type of attachments are not indicated, verify size and type required for load conditions.
 - 1. Mounting Heights: Where mounting heights are not indicated, mount components at heights directed by Architect.
 - 2. Allow for building movement, including thermal expansion and contraction.
- H. Joints: Make joints of uniform width. Where joint locations in exposed work are not indicated, arrange joints for the best visual effect. Fit exposed connections together to form hairline joints.

- I. Hazardous Materials: Use products, cleaners, and installation materials that are not considered hazardous.

3.4 CUTTING AND PATCHING

- A. Cutting and Patching, General: Employ skilled workers to perform cutting and patching. Proceed with cutting and patching at the earliest feasible time, and complete without delay.
 - 1. Cut in-place construction to provide for installation of other components or performance of other construction, and subsequently patch as required to restore surfaces to their original condition.
- B. Temporary Support: Provide temporary support of work to be cut.
- C. Protection: Protect in-place construction during cutting and patching to prevent damage. Provide protection from adverse weather conditions for portions of Project that might be exposed during cutting and patching operations.
- D. Adjacent Occupied Areas: Where interference with use of adjoining areas or interruption of free passage to adjoining areas is unavoidable, coordinate cutting and patching.
- E. Existing Utility Services: Where existing services are required to be removed, relocated, or abandoned, bypass such systems before cutting to minimize interruption to occupied areas.
- F. Cutting: Cut in-place construction by sawing, drilling, breaking, chipping, grinding, and similar operations, including excavation, using methods least likely to damage elements retained or adjoining construction. If possible, review proposed procedures with original Installer; comply with original Installer's written recommendations.
 - 1. In general, use hand or small power tools designed for sawing and grinding, not hammering and chopping. Cut holes and slots neatly to minimum size required, and with minimum disturbance of adjacent surfaces. Temporarily cover openings when not in use.
 - 2. Finished Surfaces: Cut or drill from the exposed or finished side into concealed surfaces.
 - 3. Concrete and Masonry: Cut using a cutting machine, such as an abrasive saw or a diamond-core drill.
 - 4. Mechanical and Electrical Services: Cut off pipe or conduit in walls or partitions to be removed. Cap, valve, or plug and seal remaining portion of pipe or conduit to prevent entrance of moisture or other foreign matter after cutting.
 - 5. Proceed with patching after construction operations requiring cutting are complete.
- G. Patching: Patch construction by filling, repairing, refinishing, closing up, and similar operations following performance of other work. Patch with durable seams that are as invisible as practicable. Provide materials and comply with installation requirements specified in other Sections, where applicable.
 - 1. Inspection: Where feasible, test and inspect patched areas after completion to demonstrate physical integrity of installation.
 - 2. Exposed Finishes: Restore exposed finishes of patched areas and extend finish restoration into retained adjoining construction in a manner that will minimize evidence of patching and refinishing.
 - a. Clean piping, conduit, and similar features before applying paint or other finishing materials.
 - b. Restore damaged pipe covering to its original condition.

3. Ceilings: Patch, repair, or rehang in-place ceilings as necessary to provide an even-plane surface of uniform appearance.
 4. Exterior Building Enclosure: Patch components in a manner that restores enclosure to a weathertight condition.
- H. Cleaning: Clean areas and spaces where cutting and patching are performed. Remove paint, mortar, oils, putty, and similar materials from adjacent finished surfaces.

3.5 PROGRESS CLEANING

- A. General: Clean Project site and work areas daily, including common areas. Enforce requirements strictly. Dispose of materials lawfully.
1. Comply with requirements in NFPA 241 for removal of combustible waste materials and debris.
 2. Do not hold waste materials more than seven (7) days during normal weather or three (3) days if the temperature is expected to rise above 80 deg F.
 3. Containerize hazardous and unsanitary waste materials separately from other waste. Mark containers appropriately and dispose of legally, according to regulations.
 - a. Utilize containers intended for holding waste materials of type to be stored.
 4. Coordinate progress cleaning for joint-use areas where more than one installer has worked.
- B. Site: Maintain Project site free of waste materials and debris.
- C. Work Areas: Clean areas where work is in progress to the level of cleanliness necessary for proper execution of the Work.
1. Remove liquid spills promptly.
 2. Where dust would impair proper execution of the Work, broom-clean or vacuum the entire work area, as appropriate.
- D. Installed Work: Keep installed work clean. Clean installed surfaces according to written instructions of manufacturer or fabricator of product installed, using only cleaning materials specifically recommended. If specific cleaning materials are not recommended, use cleaning materials that are not hazardous to health or property and that will not damage exposed surfaces.
- E. Concealed Spaces: Remove debris from concealed spaces before enclosing the space.
- F. Exposed Surfaces in Finished Areas: Clean exposed surfaces and protect as necessary to ensure freedom from damage and deterioration at time of Substantial Completion.
- G. Waste Disposal: Do not bury or burn waste materials on-site. Do not wash waste materials down sewers or into waterways. Comply with waste disposal requirements in Section 015000 "Temporary Facilities and Controls."
- H. During handling and installation, clean and protect construction in progress and adjoining materials already in place. Apply protective covering where required to ensure protection from damage or deterioration at Substantial Completion.

- I. Clean and provide maintenance on completed construction as frequently as necessary through the remainder of the construction period. Adjust and lubricate operable components to ensure operability without damaging effects.
- J. Limiting Exposures: Supervise construction operations to assure that no part of the construction, completed or in progress, is subject to harmful, dangerous, damaging, or otherwise deleterious exposure during the construction period.

3.6 STARTING AND ADJUSTING

- A. Start equipment and operating components to confirm proper operation. Remove malfunctioning units, replace with new units, and retest.
- B. Adjust equipment for proper operation. Adjust operating components for proper operation without binding.
- C. Test each piece of equipment to verify proper operation. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.
- D. Manufacturer's Field Service: Comply with qualification requirements in Section 014000 "Quality Requirements."

3.7 PROTECTION OF INSTALLED CONSTRUCTION

- A. Provide final protection and maintain conditions that ensure installed Work is without damage or deterioration at time of Substantial Completion.
- B. Comply with manufacturer's written instructions for temperature and relative humidity.

3.8 CORRECTION OF THE WORK

- A. Repair or remove and replace defective construction. Restore damaged substrates and finishes.
 - 1. Repairing includes replacing defective parts, refinishing damaged surfaces, touching up with matching materials, and properly adjusting operating equipment.
- B. Restore permanent facilities used during construction to their specified condition.
- C. Remove and replace damaged surfaces that are exposed to view if surfaces cannot be repaired without visible evidence of repair.
- D. Repair components that do not operate properly. Remove and replace operating components that cannot be repaired.
- E. Remove and replace chipped, scratched, and broken glass or reflective surfaces.

END OF SECTION 017300

SECTION 017700 - CLOSEOUT PROCEDURES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes administrative and procedural requirements for contract closeout, including, but not limited to, the following:
 - 1. Substantial Completion procedures.
 - 2. Final completion procedures.
 - 3. Warranties.
- B. Related Sections:
 - 1. Section 017300 "Execution" for progress cleaning of Project site.
 - 2. Section 017823 "Operation and Maintenance Data" for operation and maintenance manual requirements.
 - 3. Section 017839 "Project Record Documents" for submitting Record Drawings, Record Specifications, and Record Product Data.
 - 4. Section 017900 "Demonstration and Training" for requirements for instructing Owner's personnel.
 - 5. Divisions 02 through 49 Sections for specific closeout and special cleaning requirements for the Work in those Sections.

1.3 SUBSTANTIAL COMPLETION

- A. Preliminary Procedures: Before requesting inspection for determining date of Substantial Completion, complete the following. List items below that are incomplete with request.
 - 1. Prepare a list of items to be completed and corrected (punch list), the value of items on the list, and reasons why the Work is not complete.
 - 2. Advise Owner of pending insurance changeover requirements.
 - 3. Submit specific warranties, workmanship bonds, maintenance service agreements, final certifications, and similar documents.
 - 4. Obtain and submit releases permitting Owner unrestricted use of the Work and access to services and utilities. Include occupancy permits, operating certificates, and similar releases.
 - 5. Prepare and submit Project Record Documents, operation and maintenance manuals, final completion construction photographic documentation, damage or settlement surveys, property surveys, and similar final record information.
 - 6. Deliver tools, spare parts, extra materials, and similar items to location designated by Owner. Label with manufacturer's name and model number where applicable.
 - 7. Complete startup testing of systems.
 - 8. Submit test/adjust/balance records.
 - 9. Terminate and remove temporary facilities from Project site, along with mockups, construction tools, and similar elements.
 - 10. Advise Owner of changeover in heat and other utilities.

11. Submit changeover information related to Owner's occupancy, use, operation, and maintenance.
12. Complete final cleaning requirements, including touchup painting.
13. Touch up and otherwise repair and restore marred exposed finishes to eliminate visual defects.

B. Inspection: Submit a written request for inspection for Substantial Completion. On receipt of request, Architect will either proceed with inspection or notify Contractor of unfulfilled requirements. Architect will prepare the Certificate of Substantial Completion after inspection or will notify Contractor of items, either on Contractor's list or additional items identified by Architect, that must be completed or corrected before certificate will be issued.

1. Reinspection: Request reinspection when the Work identified in previous inspections as incomplete is completed or corrected.
2. Results of completed inspection will form the basis of requirements for final completion.

1.4 FINAL COMPLETION

A. Preliminary Procedures: Before requesting final inspection for determining final completion, complete the following:

1. Submit a final Application for Payment according to Section 012900 "Payment Procedures".
2. Submit certified copy of Architect's Substantial Completion inspection list of items to be completed or corrected (punch list), endorsed and dated by Architect. The certified copy of the list shall state that each item has been completed or otherwise resolved for acceptance.
3. Submit evidence of final, continuing insurance coverage complying with insurance requirements.
4. Instruct Owner's personnel in operation, adjustment, and maintenance of products, equipment, and systems.
5. Secure and provide both temporary and final Certificate of Occupancy from the Building Official, meeting all local and state permit closeout requirements.

B. Inspection: Submit a written request for final inspection for acceptance. On receipt of request, Architect will either proceed with inspection or notify Contractor of unfulfilled requirements. Architect will prepare a final Certificate for Payment after inspection or will notify Contractor of construction that must be completed or corrected before certificate will be issued.

1. Reinspection: Request reinspection when the Work identified in previous inspections as incomplete is completed or corrected.

1.5 LIST OF INCOMPLETE ITEMS (PUNCH LIST)

A. Organization of List: Include name and identification of each space and area affected by construction operations for incomplete items and items needing correction including, if necessary, areas disturbed by Contractor that are outside the limits of construction. Use **CSI Form 14.1A** or comparable form.

1. Organize list of spaces in sequential order, starting with exterior areas first and proceeding from lowest floor to highest floor.
2. Organize items applying to each space by major element, including categories for ceiling, individual walls, floors, equipment, and building systems.
3. Include the following information at the top of each page:

- a. Project name.
- b. Date.
- c. Name of Architect.
- d. Name of Contractor.
- e. Page number.

4. Submit list of incomplete items in the following format:

- a. PDF electronic file. Architect will return annotated file.

1.6 WARRANTIES

- A. Submittal Time: Submit written warranties on request of Architect for designated portions of the Work where commencement of warranties other than date of Substantial Completion is indicated.
- B. Partial Occupancy: Submit properly executed warranties within fifteen (15) days of completion of designated portions of the Work that are completed and occupied or used by Owner during construction period by separate agreement with Contractor.
- C. Organize warranty documents into an orderly sequence based on the table of contents of the Project Manual.
 - 1. Bind warranties and bonds in heavy-duty, three-ring, vinyl-covered, loose-leaf binders, thickness as necessary to accommodate contents, and sized to receive 8½-by-11-inch paper.
 - 2. Provide heavy paper dividers with plastic-covered tabs for each separate warranty. Mark tab to identify the product or installation. Provide a typed description of the product or installation, including the name of the product and the name, address, and telephone number of Installer.
 - 3. Identify each binder on the front and spine with the typed or printed title "WARRANTIES," Project name, and name of Contractor.
 - 4. Scan warranties and bonds and assemble complete warranty and bond submittal package into a single indexed electronic PDF file with links enabling navigation to each item. Provide table of contents at beginning of document.
- D. Provide additional copies of each warranty to include in operation and maintenance manuals.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Cleaning Agents: Use cleaning materials and agents recommended by manufacturer or fabricator of the surface to be cleaned. Do not use cleaning agents that are potentially hazardous to health or property or that might damage finished surfaces.

PART 3 - EXECUTION (Not Used)

END OF SECTION 017700

SECTION 017823 - OPERATION AND MAINTENANCE DATA

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes administrative and procedural requirements for preparing operation and maintenance manuals, including the following:
 - 1. Operation and maintenance documentation directory.
 - 2. Emergency manuals.
 - 3. Systems and equipment operation manuals.
 - 4. Systems and equipment maintenance manuals.
 - 5. Product maintenance manuals.
- B. Related Sections:
 - 1. Section 013300 "Submittal Procedures" for submitting copies of submittals for operation and maintenance manuals.
 - 2. Divisions 02 through 49 Sections for specific operation and maintenance manual requirements for the Work in those Sections.

1.3 DEFINITIONS

- A. System: An organized collection of parts, equipment, or subsystems united by regular interaction.
- B. Subsystem: A portion of a system with characteristics similar to a system.

1.4 CLOSEOUT SUBMITTALS

- A. Manual Content: Operations and maintenance manual content is specified in individual specification sections, and as reviewed and approved at the time of Section submittals. Submit reviewed manual content formatted and organized as required by this Section.
 - 1. Architect will comment on whether content of operation and maintenance submittals is acceptable.
 - 2. Where applicable, clarify and update reviewed manual content to correspond to revisions and field conditions.
- B. Format: Submit operations and maintenance manuals in the following format:
 - 1. Two (2) thumb drives. Enable review comments on draft submittals.
 - 2. Two (2) paper copies. Include a complete operation and maintenance directory. Enclose title pages and directories in clear plastic sleeves. Architect will return both copies to be given to the Owner.

- C. Initial Manual Submittal: Submit draft copy of each manual at least thirty (30) days before commencing demonstration and training. Architect will comment on whether general scope and content of manual are acceptable.
- D. Final Manual Submittal: Submit each manual in final form prior to requesting inspection for Substantial Completion and at least fifteen (15) days before commencing demonstration and training. Architect will return copy with comments.
 - 1. Correct or modify each manual to comply with Architect's comments. Submit copies of each corrected manual within fifteen (15) days of receipt of Architect's comments and prior to commencing demonstration and training.
- E. Comply with Section 017700 "Closeout Procedures" for schedule for submitting operation and maintenance documentation.

1.5 FORMAT OF OPERATION AND MAINTENANCE MANUALS

- A. Manuals, Electronic Files: Submit manuals in the form of a multiple file composite electronic PDF file for each manual type required.
 - 1. Electronic Files: Use electronic files prepared by manufacturer where available. Where scanning of paper documents is required, configure scanned file for minimum readable file size.
 - 2. File Names and Bookmarks: Bookmark individual documents based on file names. Name document files to correspond to system, subsystem, and equipment names used in manual directory and table of contents. Group documents for each system and subsystem into individual composite bookmarked files, then create composite manual, so that resulting bookmarks reflect the system, subsystem, and equipment names in a readily navigated file tree. Configure electronic manual to display bookmark panel on opening file.
- B. Manuals, Paper Copy: Submit manuals in the form of hard copy, bound and labeled volumes.
 - 1. Binders: Heavy-duty, three-ring, vinyl-covered, loose-leaf binders, in thickness necessary to accommodate contents, sized to hold 8½-by-11-inch paper; with clear plastic sleeve on spine to hold label describing contents and with pockets inside covers to hold folded oversize sheets.
 - a. If two (2) or more binders are necessary to accommodate data of a system, organize data in each binder into groupings by subsystem and related components. Cross-reference other binders if necessary to provide essential information for proper operation or maintenance of equipment or system.
 - b. Identify each binder on front and spine, with printed title "OPERATION AND MAINTENANCE MANUAL," Project title or name, subject matter of contents, and indicate Specification Section number on bottom of spine. Indicate volume number for multiple-volume sets.
 - 2. Dividers: Heavy-paper dividers with plastic-covered tabs for each section of the manual. Mark each tab to indicate contents. Include typed list of products and major components of equipment included in the section on each divider, cross-referenced to Specification Section number and title of Project Manual.
 - 3. Protective Plastic Sleeves: Transparent plastic sleeves designed to enclose diagnostic software storage media for computerized electronic equipment. Enclose title pages and directories in clear plastic sleeves.
 - 4. Supplementary Text: Prepared on 8½-by-11-inch white bond paper.

5. Drawings: Attach reinforced, punched binder tabs on drawings and bind with text.
 - a. If oversize drawings are necessary, fold drawings to same size as text pages and use as foldouts.
 - b. If drawings are too large to be used as foldouts, fold and place drawings in labeled envelopes and bind envelopes in rear of manual. At appropriate locations in manual, insert typewritten pages indicating drawing titles, descriptions of contents, and drawing locations.

1.6 REQUIREMENTS FOR EMERGENCY, OPERATION, AND MAINTENANCE MANUALS

- A. Organization of Manuals: Unless otherwise indicated, organize each manual into a separate section for each system and subsystem, and a separate section for each piece of equipment not part of a system. Each manual shall contain the following materials, in the order listed:
 1. Title page.
 2. Table of contents.
 3. Manual contents.
- B. Title Page: Include the following information:
 1. Subject matter included in manual.
 2. Name and address of Project.
 3. Name and address of Owner.
 4. Date of submittal.
 5. Name and contact information for Contractor.
 6. Name and contact information for Architect.
 7. Names and contact information for major consultants to the Architect that designed the systems contained in the manuals.
 8. Cross-reference to related systems in other operation and maintenance manuals.
- C. Table of Contents: List each product included in manual, identified by product name, indexed to the content of the volume, and cross-referenced to Specification Section number in Project Manual.
 1. If operation or maintenance documentation requires more than one (1) volume to accommodate data, include comprehensive table of contents for all volumes in each volume of the set.
- D. Manual Contents: Organize into sets of manageable size. Arrange contents alphabetically by system, subsystem, and equipment. If possible, assemble instructions for subsystems, equipment, and components of one (1) system into a single binder.

1.7 EMERGENCY MANUALS

- A. Emergency Manual: Assemble a complete set of emergency information indicating procedures for use by emergency personnel and by Owner's operating personnel for types of emergencies indicated.
- B. Content: Organize manual into a separate section for each of the following:
 1. Type of emergency.
 2. Emergency instructions.
 3. Emergency procedures.

- C. Type of Emergency: Where applicable for each type of emergency indicated below, include instructions and procedures for each system, subsystem, piece of equipment, and component:
 - 1. Fire.
 - 2. Flood.
 - 3. Gas leak.
 - 4. Water leak.
 - 5. Power failure.
 - 6. Water outage.
 - 7. System, subsystem, or equipment failure.
 - 8. Chemical release or spill.
- D. Emergency Instructions: Describe and explain warnings, trouble indications, error messages, and similar codes and signals. Include responsibilities of Owner's operating personnel for notification of Installer, supplier, and manufacturer to maintain warranties.
- E. Emergency Procedures: Include the following, as applicable:
 - 1. Instructions on stopping.
 - 2. Shutdown instructions for each type of emergency.
 - 3. Operating instructions for conditions outside normal operating limits.
 - 4. Required sequences for electric or electronic systems.
 - 5. Special operating instructions and procedures.

1.8 SYSTEMS AND EQUIPMENT OPERATION MANUALS

- A. Systems and Equipment Operation Manual: Assemble a complete set of data indicating operation of each system, subsystem, and piece of equipment not part of a system. Include information required for daily operation and management, operating standards, and routine and special operating procedures.
 - 1. Engage a factory-authorized service representative to assemble and prepare information for each system, subsystem, and piece of equipment not part of a system.
 - 2. Prepare a separate manual for each system and subsystem, in the form of an instructional manual for use by Owner's operating personnel.
- B. Content: In addition to requirements in this Section, include operation data required in individual Specification Sections and the following information:
 - 1. System, subsystem, and equipment descriptions. Use designations for systems and equipment indicated on Contract Documents.
 - 2. Performance and design criteria if Contractor is delegated design responsibility.
 - 3. Operating standards.
 - 4. Operating procedures.
 - 5. Operating logs.
 - 6. Wiring diagrams.
 - 7. Control diagrams.
 - 8. Piped system diagrams.
 - 9. Precautions against improper use.
 - 10. License requirements including inspection and renewal dates.
- C. Descriptions: Include the following:
 - 1. Product name and model number. Use designations for products indicated on Contract Documents.

2. Manufacturer's name.
3. Equipment identification with serial number of each component.
4. Equipment function.
5. Operating characteristics.
6. Limiting conditions.
7. Performance curves.
8. Engineering data and tests.
9. Complete nomenclature and number of replacement parts.

D. Operating Procedures: Include the following, as applicable:

1. Startup procedures.
2. Equipment or system break-in procedures.
3. Routine and normal operating instructions.
4. Regulation and control procedures.
5. Instructions on stopping.
6. Normal shutdown instructions.
7. Seasonal and weekend operating instructions.
8. Required sequences for electric or electronic systems.
9. Special operating instructions and procedures.

E. Systems and Equipment Controls: Describe the sequence of operation, and diagram controls as installed.

F. Piped Systems: Diagram piping as installed, and identify color-coding where required for identification.

1.9 SYSTEMS AND EQUIPMENT MAINTENANCE MANUALS

A. Systems and Equipment Maintenance Manuals: Assemble a complete set of data indicating maintenance of each system, subsystem, and piece of equipment not part of a system. Include manufacturers' maintenance documentation, preventive maintenance procedures and frequency, repair procedures, wiring and systems diagrams, lists of spare parts, and warranty information.

1. Engage a factory-authorized service representative to assemble and prepare information for each system, subsystem, and piece of equipment not part of a system.
2. Prepare a separate manual for each system and subsystem, in the form of an instructional

B. Content: For each system, subsystem, and piece of equipment not part of a system, include source information, manufacturers' maintenance documentation, maintenance procedures, maintenance and service schedules, spare parts list and source information, maintenance service contracts, and warranty and bond information, as described below.

C. Source Information: List each system, subsystem, and piece of equipment included in manual, identified by product name and arranged to match manual's table of contents. For each product, list name, address, and telephone number of Installer or supplier and maintenance service agent, and cross-reference Specification Section number and title in Project Manual and drawing or schedule designation or identifier where applicable.

D. Manufacturers' Maintenance Documentation: Include the following information for each component part or piece of equipment:

1. Standard maintenance instructions and bulletins; include only sheets pertinent to product or component installed. Mark each sheet to identify each product or component incorporated into the Work. If data include more than one (1) item in a tabular format, identify each item using appropriate references from the Contract Documents. Identify data applicable to the Work and delete references to information not applicable.
 - a. Prepare supplementary text if manufacturers' standard printed data are not available and where the information is necessary for proper operation and maintenance of equipment or systems.
 2. Drawings, diagrams, and instructions required for maintenance, including disassembly and component removal, replacement, and assembly.
 3. Identification and nomenclature of parts and components.
 4. List of items recommended to be stocked as spare parts.
- E. Maintenance Procedures: Include the following information and items that detail essential maintenance procedures:
1. Test and inspection instructions.
 2. Troubleshooting guide.
 3. Precautions against improper maintenance.
 4. Disassembly; component removal, repair, and replacement; and reassembly instructions.
 5. Aligning, adjusting, and checking instructions.
- F. Maintenance and Service Schedules: Include service and lubrication requirements, list of required lubricants for equipment, and separate schedules for preventive and routine maintenance and service with standard time allotment.
1. Scheduled Maintenance and Service: Tabulate actions for daily, weekly, monthly, quarterly, semiannual, and annual frequencies.
 2. Maintenance and Service Record: Include manufacturers' forms for recording maintenance.
- G. Spare Parts List and Source Information: Include lists of replacement and repair parts, with parts identified and cross-referenced to manufacturers' maintenance documentation and local sources of maintenance materials and related services.
- H. Maintenance Service Contracts: Include copies of maintenance agreements with name and telephone number of service agent.
- I. Warranties and Bonds: Include copies of warranties and bonds and lists of circumstances and conditions that would affect validity of warranties or bonds.
1. Include procedures to follow and required notifications for warranty claims.
- J. Drawings: Prepare drawings supplementing manufacturers' printed data to illustrate the relationship of component parts of equipment and systems and to illustrate control sequence and flow diagrams. Coordinate these drawings with information contained in record Drawings to ensure correct illustration of completed installation.
1. Do not use original project record documents as part of maintenance manuals.

1.10 PRODUCT MAINTENANCE MANUALS

- A. Product Maintenance Manual: Assemble a complete set of maintenance data indicating care and maintenance of each product, material, and finish incorporated into the Work.
- B. Content: Organize manual into a separate section for each product, material, and finish. Include source information, product information, maintenance procedures, repair materials and sources, and warranties and bonds, as described below.
- C. Source Information: List each product included in manual, identified by product name and arranged to match manual's table of contents. For each product, list name, address, and telephone number of Installer or supplier and maintenance service agent, and cross-reference Specification Section number and title in Project Manual and drawing or schedule designation or identifier where applicable.
- D. Product Information: Include the following, as applicable:
 - 1. Product name and model number.
 - 2. Manufacturer's name.
 - 3. Color, pattern, and texture.
 - 4. Material and chemical composition.
 - 5. Reordering information for specially manufactured products.
- E. Maintenance Procedures: Include manufacturer's written recommendations and the following:
 - 1. Inspection procedures.
 - 2. Types of cleaning agents to be used and methods of cleaning.
 - 3. List of cleaning agents and methods of cleaning detrimental to product.
 - 4. Schedule for routine cleaning and maintenance.
 - 5. Repair instructions.
- F. Repair Materials and Sources: Include lists of materials and local sources of materials and related services.
- G. Warranties and Bonds: Include copies of warranties and bonds and lists of circumstances and conditions that would affect validity of warranties or bonds.
 - 1. Include procedures to follow and required notifications for warranty claims.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF SECTION 017823

SECTION 017839 - PROJECT RECORD DOCUMENTS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes administrative and procedural requirements for project record documents, including the following:
 - 1. Record Drawings.
 - 2. Record Specifications.
 - 3. Record Product Data.
 - 4. Miscellaneous record submittals.
- B. Related Sections:
 - 1. Section 017700 "Closeout Procedures" for general closeout procedures.
 - 2. Section 017823 "Operation and Maintenance Data" for operation and maintenance manual requirements.
 - 3. Divisions 02 through 49 Sections for specific requirements for project record documents of the Work in those Sections.

1.3 CLOSEOUT SUBMITTALS

- A. Record Drawings: Comply with the following:
 - 1. Number of Copies: Submit one (1) set(s) of marked-up record prints.
- B. Record Specifications: Submit one (1) paper copy of Project's Specifications, including addenda and contract modifications.
- C. Record Product Data: Submit one (1) paper copy of each submittal.
 - 1. Where record Product Data are required as part of operation and maintenance manuals, submit duplicate marked-up Product Data as a component of manual.

PART 2 - PRODUCTS

2.1 RECORD DRAWINGS

- A. Record Prints: Maintain one (1) set of marked-up paper copies of the Contract Drawings and Shop Drawings.
 - 1. Preparation: Mark record prints to show the actual installation where installation varies from that shown originally. Require individual or entity who obtained record data, whether individual or entity is Installer, subcontractor, or similar entity, to provide information for preparation of corresponding marked-up record prints.

- a. Give particular attention to information on concealed elements that would be difficult to identify or measure and record later.
 - b. Accurately record information in an acceptable drawing technique.
 - c. Record data as soon as possible after obtaining it.
 - d. Record and check the markup before enclosing concealed installations.
 - e. Cross-reference record prints to corresponding archive photographic documentation.
 2. Content: Types of items requiring marking include, but are not limited to, the following:
 - a. Dimensional changes to Drawings.
 - b. Revisions to details shown on Drawings.
 - c. Revisions to routing of piping and conduits.
 - d. Revisions to electrical circuitry.
 - e. Actual equipment locations.
 - f. Duct size and routing.
 - g. Locations of concealed internal utilities.
 - h. Changes made by Change Order or Construction Change Directive.
 - i. Changes made following Architect's written orders.
 - j. Details not on the original Contract Drawings.
 - k. Field records for variable and concealed conditions.
 - l. Record information on the Work that is shown only schematically.
 3. Mark the Contract Drawings and Shop Drawings completely and accurately. Utilize personnel proficient at recording graphic information in production of marked-up record prints.
 4. Mark record sets with erasable, red-colored pencil. Use other colors to distinguish between changes for different categories of the Work at same location.
 5. Mark important additional information that was either shown schematically or omitted from original Drawings.
 6. Note Construction Change Directive numbers, alternate numbers, Change Order numbers, and similar identification, where applicable.
- B. Format: Identify and date each record Drawing; include the designation "PROJECT RECORD DRAWING" in a prominent location.
1. Record Prints: Organize record prints and newly prepared record Drawings into manageable sets. Bind each set with durable paper cover sheets. Include identification on cover sheets.
 2. Format: Paper copy.
 3. Identification: As follows:
 - a. Project name.
 - b. Date.
 - c. Designation "PROJECT RECORD DRAWINGS."
 - d. Name of Architect.
 - e. Name of Contractor.

2.2 RECORD SPECIFICATIONS

- A. Preparation: Mark Specifications to indicate the actual product installation where installation varies from that indicated in Specifications, addenda, and contract modifications.
1. Give particular attention to information on concealed products and installations that cannot be readily identified and recorded later.
 2. Mark copy with the proprietary name and model number of products, materials, and equipment furnished, including substitutions and product options selected.

3. Record the name of manufacturer, supplier, Installer, and other information necessary to provide a record of selections made.
4. For each principal product, indicate whether record Product Data has been submitted in operation and maintenance manuals instead of submitted as record Product Data.
5. Note related Change Orders, record Product Data, and record Drawings where applicable.

B. Format: Submit record Specifications as paper copy.

2.3 RECORD PRODUCT DATA

A. Preparation: Mark Product Data to indicate the actual product installation where installation varies substantially from that indicated in Product Data submittal.

1. Give particular attention to information on concealed products and installations that cannot be readily identified and recorded later.
2. Include significant changes in the product delivered to Project site and changes in manufacturer's written instructions for installation.
3. Note related Change Orders, record Specifications, and record Drawings where applicable.

B. Format: Submit record Product Data as paper copy.

1. Include record Product Data directory organized by specification section number and title, electronically linked to each item of record Product Data.

PART 3 - EXECUTION

3.1 RECORDING AND MAINTENANCE

A. Recording: Maintain one (1) copy of each submittal during the construction period for project record document purposes. Post changes and modifications to project record documents as they occur; do not wait until the end of Project.

B. Maintenance of Record Documents and Samples: Store record documents and Samples in the field office apart from the Contract Documents used for construction. Do not use project record documents for construction purposes. Maintain record documents in good order and in a clean, dry, legible condition, protected from deterioration and loss. Provide access to project record documents for Architect's reference during normal working hours.

END OF SECTION 017839

SECTION 017900 - DEMONSTRATION AND TRAINING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes administrative and procedural requirements for instructing Owner's personnel, including the following:
 - 1. Demonstration of operation of systems, subsystems, and equipment.
 - 2. Training in operation and maintenance of systems, subsystems, and equipment.
- B. Related Sections:
 - 1. Divisions 02 through 49 Sections for specific requirements for demonstration and training for products in those Sections.

1.3 INFORMATIONAL SUBMITTALS

- A. Instruction Program: Submit outline of instructional program for demonstration and training, including a list of training modules and a schedule of proposed dates, times, length of instruction time, and instructors' names for each training module. Include learning objective and outline for each training module.
 - 1. Indicate proposed training modules utilizing manufacturer-produced demonstration for systems, equipment, and products in lieu of video recording of live instructional module.
- B. Attendance Record: For each training module, submit list of participants and length of instruction time.
- C. Evaluations: For each participant and for each training module, submit results and documentation of performance-based test.

1.4 QUALITY ASSURANCE

- A. Facilitator Qualifications: A firm or individual experienced in training or educating maintenance personnel in a training program similar in content and extent to that indicated for this Project, and whose work has resulted in training or education with a record of successful learning performance.
- B. Instructor Qualifications: A factory-authorized service representative, complying with requirements in Section 014000 "Quality Requirements," experienced in operation and maintenance procedures and training.
- C. Pre-Instruction Conference: Conduct conference at Project site to comply with requirements in Section 013100 "Project Management and Coordination." Review methods and procedures related to demonstration and training including, but not limited to, the following:

1. Inspect and discuss locations and other facilities required for instruction.
2. Review and finalize instruction schedule and verify availability of educational materials, instructors' personnel, audiovisual equipment, and facilities needed to avoid delays.
3. Review required content of instruction.
4. For instruction that must occur outside, review weather and forecasted weather conditions and procedures to follow if conditions are unfavorable.

1.5 COORDINATION

- A. Coordinate instruction schedule with Owner's operations. Adjust schedule as required to minimize disrupting Owner's operations.
- B. Coordinate instructors, including providing notification of dates, times, length of instruction time, and course content.
- C. Coordinate content of training modules with content of approved emergency, operation, and maintenance manuals. Do not submit instruction program until operation and maintenance data has been reviewed and approved by Architect.

PART 2 - PRODUCTS

2.1 INSTRUCTION PROGRAM

- A. Program Structure: Develop an instruction program that includes individual training modules for each system and for equipment not part of a system, as required by individual Specification Sections.
- B. Training Modules: Develop a learning objective and teaching outline for each module. Include a description of specific skills and knowledge that participant is expected to master. For each module, include instruction for the following as applicable to the system, equipment, or component:
 1. Basis of System Design, Operational Requirements, and Criteria: Include the following:
 - a. System, subsystem, and equipment descriptions.
 - b. Performance and design criteria if Contractor is delegated design responsibility.
 - c. Operating standards.
 - d. Regulatory requirements.
 - e. Equipment function.
 - f. Operating characteristics.
 - g. Limiting conditions.
 - h. Performance curves.
 2. Documentation: Review the following items in detail:
 - a. Emergency manuals.
 - b. Operations manuals.
 - c. Maintenance manuals.
 - d. Project record documents.
 - e. Identification systems.
 - f. Warranties and bonds.
 - g. Maintenance service agreements and similar continuing commitments.
 3. Emergencies: Include the following, as applicable:

- a. Instructions on meaning of warnings, trouble indications, and error messages.
 - b. Instructions on stopping.
 - c. Shutdown instructions for each type of emergency.
 - d. Operating instructions for conditions outside of normal operating limits.
 - e. Sequences for electric or electronic systems.
 - f. Special operating instructions and procedures.
4. Operations: Include the following, as applicable:
- a. Startup procedures.
 - b. Equipment or system break-in procedures.
 - c. Routine and normal operating instructions.
 - d. Regulation and control procedures.
 - e. Control sequences.
 - f. Safety procedures.
 - g. Instructions on stopping.
 - h. Normal shutdown instructions.
 - i. Operating procedures for emergencies.
 - j. Operating procedures for system, subsystem, or equipment failure.
 - k. Seasonal and weekend operating instructions.
 - l. Required sequences for electric or electronic systems.
 - m. Special operating instructions and procedures.
5. Adjustments: Include the following:
- a. Alignments.
 - b. Checking adjustments.
 - c. Noise and vibration adjustments.
 - d. Economy and efficiency adjustments.
6. Troubleshooting: Include the following:
- a. Diagnostic instructions.
 - b. Test and inspection procedures.
7. Maintenance: Include the following:
- a. Inspection procedures.
 - b. Types of cleaning agents to be used and methods of cleaning.
 - c. List of cleaning agents and methods of cleaning detrimental to product.
 - d. Procedures for routine cleaning
 - e. Procedures for preventive maintenance.
 - f. Procedures for routine maintenance.
 - g. Instruction on use of special tools.
8. Repairs: Include the following:
- a. Diagnosis instructions.
 - b. Repair instructions.
 - c. Disassembly; component removal, repair, and replacement; and reassembly instructions.
 - d. Instructions for identifying parts and components.
 - e. Review of spare parts needed for operation and maintenance.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Assemble educational materials necessary for instruction, including documentation and training module. Assemble training modules into a training manual organized in coordination with requirements in Section 017823 "Operations and Maintenance Data."
- B. Set up instructional equipment at instruction location.

3.2 INSTRUCTION

- A. Facilitator: Engage a qualified facilitator to prepare instruction program and training modules, to coordinate instructors, and to coordinate between Contractor and Owner for number of participants, instruction times, and location.
- B. Engage qualified instructors to instruct Owner's personnel to adjust, operate, and maintain systems, subsystems, and equipment not part of a system.
 - 1. Architect will furnish an instructor to describe basis of system design, operational requirements, criteria, and regulatory requirements.
 - 2. Owner will furnish Contractor with names and positions of participants.
- C. Scheduling: Provide instruction at mutually agreed on times. For equipment that requires seasonal operation, provide similar instruction at start of each season.
 - 1. Schedule training with Owner with at least seven (7) days advance notice.
- D. Evaluation: At conclusion of each training module, assess and document each participant's mastery of module by use of a demonstration performance-based test and ask Owner to sign-off on for acceptance.
- E. Cleanup: Collect used and leftover educational materials and give to Owner. Remove instructional equipment. Restore systems and equipment to condition existing before initial training use.

END OF SECTION 017900

SECTION 024119 - SELECTIVE DEMOLITION

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

A. Section Includes:

- 1. Demolition and removal of selected portions of equipment, building or structure.
- 2. Salvage of existing items to be reused or recycled.

B. Related Requirements:

- 1. Section 011000 "Summary of Work" for restrictions on use of the premises, Owner-occupancy requirements, and phasing requirements.
- 2. Section 017300 "Execution" for cutting and patching procedures.

1.3 DEFINITIONS

- A. Remove: Detach items from existing construction and dispose of them off-site unless indicated to be salvaged or reinstalled.
- B. Remove and Salvage: Detach items from existing construction, in a manner to prevent damage, and deliver to Owner ready for reuse.
- C. Remove and Reinstall: Detach items from existing construction, in a manner to prevent damage, prepare for reuse, and reinstall where indicated.
- D. Remove and Replace: Detach items from existing construction and dispose of them off-site unless indicated to be salvaged or reinstalled. Provide and install new items as specified.
- E. Existing to Remain: Leave existing items that are not to be removed and that are not otherwise indicated to be salvaged or reinstalled.
- F. Dismantle: To remove by disassembling or detaching an item from a surface, using gentle methods and equipment to prevent damage to the item and surfaces; disposing of items unless indicated to be salvaged or reinstalled.

1.4 MATERIALS OWNERSHIP

- A. Unless otherwise indicated, demolition waste becomes property of Contractor.
- B. Historic items, relics, antiques, and similar objects including, but not limited to, cornerstones and their contents, commemorative plaques and tablets, and other items of interest or value to Owner that may be uncovered during demolition remain the property of Owner.
 - 1. Carefully salvage in a manner to prevent damage and promptly return to Owner.

1.5 PRE-INSTALLATION MEETINGS

- A. Pre-demolition Conference: Conduct conference at Project site.
 - 1. Inspect and discuss condition of construction to be selectively demolished.
 - 2. Review structural load limitations of existing structure.
 - 3. Review and finalize selective demolition schedule and verify availability of materials, demolition personnel, equipment, and facilities needed to make progress and avoid delays.
 - 4. Review requirements of work performed by other trades that rely on substrates exposed by selective demolition operations.
 - 5. Review areas where existing construction is to remain and requires protection.

1.6 INFORMATIONAL SUBMITTALS

- A. Qualification Data: For refrigerant recovery technician.
- B. Proposed Protection Measures: Submit report, including Drawings, that indicates the measures proposed for protecting individuals and property, for environmental protection, for dust control and for noise control. Indicate proposed locations and construction of barriers.
- C. Schedule of Selective Demolition Activities: Indicate the following:
 - 1. Detailed sequence of selective demolition and removal work, with starting and ending dates for each activity. Ensure Owner's building manager's and other tenants' on-site operations are uninterrupted.
 - 2. Interruption of utility services. Indicate how long utility services will be interrupted.
 - 3. Coordination for shutoff, capping, and continuation of utility services.
 - 4. Coordination of Owner's continuing occupancy of portions of existing building and of Owner's partial occupancy of completed Work.
- D. Pre-demolition Photographs: Show existing conditions of adjoining construction, including finish surfaces, that might be misconstrued as damage caused by demolition operations. Comply with Section 013233 "Photographic Documentation." Submit before Work begins.
- E. Statement of Refrigerant Recovery: Signed by refrigerant recovery technician responsible for recovering refrigerant, stating that all refrigerant that was present was recovered and that recovery was performed according to EPA regulations. Include name and address of technician and date refrigerant was recovered.

1.7 CLOSEOUT SUBMITTALS

- A. Inventory: Submit a list of items that have been removed and salvaged.

1.8 QUALITY ASSURANCE

- A. Refrigerant Recovery Technician Qualifications: Certified by an EPA-approved certification program.

1.9 FIELD CONDITIONS

- A. Owner will occupy portions of building immediately adjacent to selective demolition area. Conduct selective demolition so Owner's operations will not be disrupted.
- B. Conditions existing at time of inspection for bidding purpose will be maintained by Owner as far as practical.

- C. Notify Architect of discrepancies between existing conditions and Drawings before proceeding with selective demolition.
 - D. Hazardous Materials: It is not expected that hazardous materials will be encountered in the Work.
 - 1. If suspected hazardous materials are encountered, do not disturb; immediately notify Architect and Owner. Hazardous materials will be removed by Owner under a separate contract. Contractor will be required to coordinate with Owner's vendor.
 - E. Storage or sale of removed items or materials on-site is not permitted.
 - F. Utility Service: Maintain existing utilities indicated to remain in service and protect them against damage during selective demolition operations.
 - 1. Maintain fire-protection facilities in service during selective demolition operations.
- 1.10 COORDINATION
- A. Arrange selective demolition schedule so as not to interfere with Owner's operations.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Regulatory Requirements: Comply with governing EPA notification regulations before beginning selective demolition. Comply with hauling and disposal regulations of authorities having jurisdiction.
- B. Standards: Comply with ASSE A10.6 and NFPA 241.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Verify that utilities have been disconnected and capped before starting selective demolition operations.
- B. Review Project Record Documents of existing construction or other existing condition and hazardous material information provided by Owner. Owner does not guarantee that existing conditions are same as those indicated in Project Record Documents.
 - 1. When unanticipated mechanical, electrical, or structural elements that conflict with intended function or design are encountered, investigate and measure the nature and extent of conflict. Promptly submit a written report to Architect.
- C. Perform an engineering survey of condition of building to determine whether removing any element might result in structural deficiency or unplanned collapse of any portion of structure or adjacent structures during selective building demolition operations.
 - 1. Perform surveys as the Work progresses to detect hazards resulting from selective demolition activities.
- D. Survey of Existing Conditions: Record existing conditions by use of measured drawings and preconstruction photographs or video.

1. Comply with requirements specified in Section 013233 "Photographic Documentation."
2. Inventory and record the condition of items to be removed and salvaged. Provide photographs or video of conditions that might be misconstrued as damage caused by salvage operations.

3.2 PREPARATION

- A. Refrigerant: Before starting demolition, remove refrigerant from mechanical equipment according to 40 CFR 82 and regulations of authorities having jurisdiction.

3.3 UTILITY SERVICES AND MECHANICAL/ELECTRICAL SYSTEMS

- A. Existing Services/Systems to Remain: Maintain services/systems indicated to remain and protect them against damage.
- B. Existing Services/Systems to Be Removed, Relocated, or Abandoned: Locate, identify, disconnect, and seal or cap off utility services and mechanical/electrical systems serving areas to be selectively demolished.
 1. Owner will arrange to shut off indicated services/systems when requested by Contractor.
 2. If services/systems are required to be removed, relocated, or abandoned, provide temporary services/systems that bypass area of selective demolition and that maintain continuity of services/systems to other parts of building.
 3. Disconnect, demolish, and remove fire-suppression systems, plumbing, and HVAC systems, equipment, and components indicated on Drawings to be removed.
 - a. Piping to Be Removed: Remove portion of piping indicated to be removed and cap or plug remaining piping with same or compatible piping material.
 - b. Piping to Be Abandoned in Place: Drain piping and cap or plug piping with same or compatible piping material and leave in place.
 - c. Equipment to Be Removed: Disconnect and cap services and remove equipment.
 - d. Equipment to Be Removed and Reinstalled: Disconnect and cap services and remove, clean, and store equipment; when appropriate, reinstall, reconnect, and make equipment operational.
 - e. Equipment to Be Removed and Salvaged: Disconnect and cap services and remove equipment and deliver to Owner.

3.4 PROTECTION

- A. Temporary Protection: Provide temporary barricades and other protection required to prevent injury to people and damage to adjacent buildings and facilities to remain.
 1. Provide protection to ensure safe passage of people around selective demolition area and to and from occupied portions of building.
 2. Provide temporary weather protection, during interval between selective demolition of existing construction on exterior surfaces and new construction, to prevent water leakage and damage to structure and interior areas.
 3. Protect walls, ceilings, floors, and other existing finish work that are to remain or that are exposed during selective demolition operations.
 4. Cover and protect furniture, furnishings, and equipment that have not been removed.
 5. Comply with requirements for temporary enclosures, dust control, heating, and cooling specified in Section 015000 "Temporary Facilities and Controls."
- B. Remove temporary barricades and protections where hazards no longer exist.

3.5 SELECTIVE DEMOLITION, GENERAL

- A. General: Demolish and remove existing construction only to the extent required by new construction and as indicated. Use methods required to complete the Work within limitations of governing regulations and as follows:
1. Proceed with selective demolition systematically, from higher to lower level. Complete selective demolition operations above each floor or tier before disturbing supporting members on the next lower level.
 2. Neatly cut openings and holes plumb, square, and true to dimensions required. Use cutting methods least likely to damage construction to remain or adjoining construction. Use hand tools or small power tools designed for sawing or grinding, not hammering and chopping. Temporarily cover openings to remain.
 3. Cut or drill from the exposed or finished side into concealed surfaces to avoid marring existing finished surfaces.
 4. Do not use cutting torches until work area is cleared of flammable materials. At concealed spaces, such as duct and pipe interiors, verify condition and contents of hidden space before starting flame-cutting operations. Maintain portable fire-suppression devices during flame-cutting operations.
 5. Maintain adequate ventilation when using cutting torches.
 6. Remove decayed, vermin-infested, or otherwise dangerous or unsuitable materials and promptly dispose of off-site.
 7. Locate selective demolition equipment and remove debris and materials so as not to impose excessive loads on supporting walls, floors, or framing.
 8. All removed materials and rubbish shall be constantly sprinkled with water or other dusting agent to mitigate dust. Provide drop cloths or other type of coverings to prevent infiltration of dust to other parts of the existing building.
 9. Dispose of demolished items and materials promptly.
- B. Removed and Salvaged Items:
1. Clean salvaged items.
 2. Pack or crate items after cleaning. Identify contents of containers.
 3. Store items in a secure area until delivery to Owner.
 4. Transport items to Owner's storage area designated by Owner.
 5. Protect items from damage during transport and storage.
- C. Removed and Reinstalled Items:
1. Clean and repair items to functional condition adequate for intended reuse.
 2. Pack or crate items after cleaning and repairing. Identify contents of containers.
 3. Protect items from damage during transport and storage.
 4. Reinstall items in locations indicated. Comply with installation requirements for new materials and equipment. Provide connections, supports, and miscellaneous materials necessary to make item functional for use indicated.
- D. Existing Items to Remain: Protect construction indicated to remain against damage and soiling during selective demolition. When permitted by Architect, items may be removed to a suitable, protected storage location during selective demolition and cleaned and reinstalled in their original locations after selective demolition operations are complete.

3.6 DISPOSAL OF DEMOLISHED MATERIALS

- A. Remove demolition waste materials from Project site and dispose of them in an EPA-approved construction and demolition waste landfill acceptable to authorities having jurisdiction.

1. Do not allow demolished materials to accumulate on-site.
2. Remove and transport debris in a manner that will prevent spillage on adjacent surfaces and areas.
3. Remove debris from elevated portions of building by chute, hoist, or other device that will convey debris to grade level in a controlled descent.

B. Burning: Do not burn demolished materials.

3.7 CLEANING

- A. Clean adjacent structures and improvements of dust, dirt, and debris caused by selective demolition operations. Return adjacent areas to condition existing before selective demolition operations began.

END OF SECTION 024119

SECTION 078413 - PENETRATION FIRESTOPPING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Fireproof firestopping and firesafing materials and accessories.

1.3 PERFORMANCE REQUIREMENTS

- A. Fireproofing Materials: ASTM E 119 and ASTM E 814 to achieve a fire rating as noted on Drawings.
- B. Surface Burning: ASTM E 84 with a flame spread/fuel contributed/smoke developed rating of 5/0/0.

1.4 SUBMITTALS

- A. Product Data: For each type of product indicated provide characteristics, performance, and limitation criteria.
- B. Manufacturer's Installation Instructions: Indicate preparation and installation instructions.
- C. Manufacturer's Certificate: Certify that products meet or exceed specified requirements.

1.5 QUALIFICATIONS

- A. Manufacturer: Company specializing in manufacturing the products specified in this Section with minimum three (3) years documented experience.
- B. Applicator: Company specializing in performing the work of this Section with minimum five (5) years documented experience.

1.6 REGULATORY REQUIREMENTS

- A. Conform to applicable State Building code for fire resistance ratings and surface burning characteristics.
- B. UL Classifications for these systems shall be (all two (2) hours or more):
 - 1. Duct Penetrations: C-AJ-7027
 - 2. Pipe Penetrations: C-AJ-1079
 - 3. Cable Penetrations: C-AJ-1079
 - 4. Conduit Penetrations: C-AJ-1079

1.7 ENVIRONMENTAL REQUIREMENTS

- A. Do not apply materials when temperature of substrate material and ambient air is below 60 degrees F.
- B. Maintain this minimum temperature before, during and for three (3) days after installation of materials.
- C. Provide ventilation in areas to receive solvent cured materials.

1.8 SEQUENCING

- A. Sequence Work to permit firestopping materials to be installed after adjacent and surrounding work is complete.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Thermal Ceramics; **Firemaster Putty, Bulk, and Blankets**
- B. Tremco Incorporated; **Fyre-shield and Cerablanket FS Hilti, Inc.**
- C. United States Gypsum; **Thermafiber Safing Insulation and FIRECODE compound**
- D. Substitutions: Under provisions of Section 012500 "Substitution Procedures".

2.2 MATERIALS

- A. Firestopping Material: Single component silicone elastomeric compounds; conforming to the following:
 - 1. Elongation & Shrinkage: Five percent (5%).
 - 2. Tensile Strength: 300 psi.
 - 3. Density: 8 lb/cu ft.
 - 4. Surface Durability: 35 (Shore Hardness).
 - 5. Durability and Longevity: Permanent.
 - 6. Side Effects during Installation: Non-toxic.
 - 7. Long Term Side Effects: None.
- B. Primer: Type recommended by firestopping manufacturer for specific substrate surfaces.
- C. Firesafing Blankets: ASTM C 665; 4 psf nominal density firesafing insulation.
- D. Putty Pads: UL CLIV; acoustic, intumescent pad; 3.2mm thickness.

2.3 ACCESSORIES

- A. Dam Material: Mineral fiber matting, permanent.
- B. Retainers: Stainless clips to support mineral fiber matting

2.4 FINISHES

- A. Color: Dark gray or manufacturer's standard color.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates and conditions, with Installer present, for compliance with requirements for opening configurations, penetrating items, substrates, and other conditions affecting performance of the Work.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Surface Cleaning: Clean out openings immediately before installing penetration firestopping to comply with manufacturer's written instructions and with the following requirements:
 - 1. Remove from surfaces of opening substrates and from penetrating items foreign materials that could interfere with adhesion of penetration firestopping.
 - 2. Clean opening substrates and penetrating items to produce clean, sound surfaces capable of developing optimum bond with penetration firestopping. Remove loose particles remaining from cleaning operation.
 - 3. Remove laitance and form-release agents from concrete.
- B. Install backing materials to arrest liquid material leakage.

3.3 INSTALLATION

- A. General: Install penetration firestopping to comply with manufacturer's written installation instructions and published drawings for products and applications indicated.
- B. Apply firestopping material to all wall and floor penetrations through rated assemblies. These penetrations include electrical conduit and raceways, plumbing and heating system penetrations, ducts, and other system chases.
- C. Apply primer and materials in accordance with manufacturer's instructions.
- D. Apply firestopping material in sufficient thickness to achieve rating to a density of fifty percent (50%) to uniform density and texture.
- E. Install material at walls or partition openings which contain penetrating sleeves, piping, ductwork, conduit, and other items requiring firestopping.
- F. Remove dam material after firestopping material has cured.

3.4 CLEANING AND PROTECTION

- A. Clean off excess materials adjacent to openings as the Work progresses by methods and with cleaning materials that are approved in writing by penetration firestopping manufacturers and that do not damage materials in which openings occur.

- B. Provide final protection and maintain conditions during and after installation that ensure that penetration firestopping is without damage or deterioration at time of Substantial Completion. If, despite such protection, damage or deterioration occurs, immediately cut out and remove damaged or deteriorated penetration firestopping and install new materials to produce systems complying with specified requirements.

3.5 SCHEDULE

- A. See Construction Documents for rating information and construction details and conditions.
- B. Firesafe all penetrations through new and existing masonry and gypsum board construction in the project work areas, equal to the one (1) or two (2) hour rating of the appropriate spaces.

END OF SECTION 078413

SECTION 079200 - JOINT SEALANTS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Silicone joint sealants.
 - 2. Latex joint sealants.

1.3 ACTION SUBMITTALS

- A. Product Data: For each joint-sealant product indicated.
- B. Samples: Manufacturer's color charts consisting of strips of cured sealants showing the full range of colors available for each product exposed to view.
- C. Joint-Sealant Schedule: Include the following information:
 - 1. Joint-sealant application, joint location, and designation.
 - 2. Joint-sealant manufacturer and product name.
 - 3. Joint-sealant formulation.
 - 4. Joint-sealant color.

1.4 INFORMATIONAL SUBMITTALS

- A. Qualification Data: For qualified Installer.
- B. Product Certificates: For each kind of joint sealant and accessory, from manufacturer.
- C. Product Test Reports: Based on evaluation of comprehensive tests performed by a qualified testing agency, indicating that sealants comply with requirements.
- D. Warranties: Sample of special warranties.

1.5 QUALITY ASSURANCE

- A. Installer Qualifications: Manufacturer's authorized representative who is trained and approved for installation of units required for this Project.
- B. Source Limitations: Obtain each kind of joint sealant from single source from single manufacturer.
- C. Product Testing: Test joint sealants using a qualified testing agency.
 - 1. Testing Agency Qualifications: An independent testing agency qualified according to ASTM C 1021 to conduct the testing indicated.

1.6 PROJECT CONDITIONS

- A. Do not proceed with installation of joint sealants under the following conditions:
1. When ambient and substrate temperature conditions are outside limits permitted by joint-sealant manufacturer or are below 40 deg F (5 deg C).
 2. When joint substrates are wet.
 3. Where joint widths are less than those allowed by joint-sealant manufacturer for applications indicated.
 4. Where contaminants capable of interfering with adhesion have not yet been removed from joint substrates.

1.7 WARRANTY

- A. Special Installer's Warranty: Manufacturer's standard form in which Installer agrees to repair or replace joint sealants that do not comply with performance and other requirements specified in this Section within specified warranty period.
1. Warranty Period: Two (2) years from date of Substantial Completion.
- B. Special warranties specified in this article exclude deterioration or failure of joint sealants from the following:
1. Movement of the structure caused by structural settlement or errors attributable to design or construction resulting in stresses on the sealant exceeding sealant manufacturer's written specifications for sealant elongation and compression.
 2. Disintegration of joint substrates from natural causes exceeding design specifications.
 3. Mechanical damage caused by individuals, tools, or other outside agents.
 4. Changes in sealant appearance caused by accumulation of dirt or other atmospheric contaminants.

PART 2 - PRODUCTS

2.1 MATERIALS, GENERAL

- A. Compatibility: Provide joint sealants, backings, and other related materials that are compatible with one another and with joint substrates under conditions of service and application, as demonstrated by joint-sealant manufacturer, based on testing and field experience.
- B. VOC Content of Interior Sealants: Sealants and sealant primers used inside the weatherproofing system shall comply with the following:
1. Architectural sealants shall have a VOC content of 250 g/L or less.
- C. Liquid-Applied Joint Sealants: Comply with ASTM C 920 and other requirements indicated for each liquid-applied joint sealant specified, including those referencing ASTM C 920 classifications for type, grade, class, and uses related to exposure and joint substrates.
- D. Stain-Test-Response Characteristics: Where sealants are specified to be non-staining to porous substrates, provide products that have undergone testing according to ASTM C 1248 and have not stained porous joint substrates indicated for Project.
- E. Colors of Exposed Joint Sealants: As selected by Architect and Owner from manufacturer's entire range, to match adjacent where required.

2.2 SILICONE JOINT SEALANTS

- A. Silicone, Non-Staining: Non-Staining, single-component, non-sag, plus fifty percent (+50%) and minus fifty percent (-50%) movement capability, non-traffic-use, neutral-curing silicone joint sealant; ASTM C 920, Type S, Grade NS, Class 50, Use NT.

1. Products:

- a. Dow Corning Corporation
- b. Master Bond, Inc.
- c. Pecora Corporation
- d. Tremco Incorporated
- e. Substitutions: Under provisions of Section 012500 "Substitution Procedures".

2.3 LATEX JOINT SEALANTS

- A. Latex Joint Sealant: Acrylic latex or siliconized acrylic latex, ASTM C 834, Type OP, Grade NF.

1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:

- a. BASF Building Systems; **Sonolac**
- b. Bostik, Inc.; **Chem-Calk 600**
- c. Pecora Corporation; **AC-20+**
- d. Tremco Incorporated; **Tremflex 834**
- e. Substitutions: Under provisions of Section 012500 "Substitution Procedures".

2.4 JOINT SEALANT BACKING

- A. General: Provide sealant backings of material that are non-staining; are compatible with joint substrates, sealants, primers, and other joint fillers; and are approved for applications indicated by sealant manufacturer based on field experience and laboratory testing.
- B. Cylindrical Sealant Backings: ASTM C 1330, Type B (bi-cellular material with a surface skin), and of size and density to control sealant depth and otherwise contribute to producing optimum sealant performance.
- C. Bond-Breaker Tape: Polyethylene tape or other plastic tape recommended by sealant manufacturer for preventing sealant from adhering to rigid, inflexible joint-filler materials or joint surfaces at back of joint. Provide self-adhesive tape where applicable.

2.5 MISCELLANEOUS MATERIALS

- A. Primer: Material recommended by joint-sealant manufacturer where required for adhesion of sealant to joint substrates indicated, as determined from preconstruction joint-sealant-substrate tests and field tests.
- B. Cleaners for Non-porous Surfaces: Chemical cleaners acceptable to manufacturers of sealants and sealant backing materials, free of oily residues or other substances capable of staining or harming joint substrates and adjacent nonporous surfaces in any way, and formulated to promote optimum adhesion of sealants to joint substrates.
- C. Masking Tape: Non-staining, non-absorbent material compatible with joint sealants and surfaces adjacent to joints.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine joints indicated to receive joint sealants, with Installer present, for compliance with requirements for joint configuration, installation tolerances, and other conditions affecting joint-sealant performance.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Surface Cleaning of Joints: Clean out joints immediately before installing joint sealants to comply with joint-sealant manufacturer's written instructions and the following requirements:
 - 1. Remove all foreign material from joint substrates that could interfere with adhesion of joint sealant, including dust, paints (except for permanent, protective coatings tested and approved for sealant adhesion and compatibility by sealant manufacturer), old joint sealants, oil, grease, waterproofing, water repellents, water, surface dirt, and frost.
 - 2. Clean porous joint substrate surfaces by brushing, grinding, mechanical abrading, or a combination of these methods to produce a clean, sound substrate capable of developing optimum bond with joint sealants. Remove loose particles remaining after cleaning operations above by vacuuming or blowing out joints with oil-free compressed air. Porous joint substrates include the following:
 - a. Concrete.
 - b. Masonry.
 - 3. Remove laitance and form-release agents from concrete.
 - 4. Clean nonporous joint substrate surfaces with chemical cleaners or other means that do not stain, harm substrates, or leave residues capable of interfering with adhesion of joint sealants. Nonporous joint substrates include the following:
 - a. Metal.
 - b. Glass.
 - c. Porcelain enamel.
 - d. Glazed surfaces of ceramic tile.
- B. Joint Priming: Prime joint substrates where recommended by joint-sealant manufacturer or prior experience. Apply primer to comply with joint-sealant manufacturer's written instructions. Confine primers to areas of joint-sealant bond; do not allow spillage or migration onto adjoining surfaces.
- C. Masking Tape: Use masking tape where required to prevent contact of sealant or primer with adjoining surfaces that otherwise would be permanently stained or damaged by such contact or by cleaning methods required to remove sealant smears. Remove tape immediately after tooling without disturbing joint seal.

3.3 INSTALLATION OF JOINT SEALANTS

- A. General: Comply with joint-sealant manufacturer's written installation instructions for products and applications indicated, unless more stringent requirements apply.
- B. Sealant Installation Standard: Comply with recommendations in ASTM C 1193 for use of joint sealants as applicable to materials, applications, and conditions indicated.

- C. Install sealant backings of kind indicated to support sealants during application and at position required to produce cross-sectional shapes and depths of installed sealants relative to joint widths that allow optimum sealant movement capability.
 - 1. Do not leave gaps between ends of sealant backings.
 - 2. Do not stretch, twist, puncture, or tear sealant backings.
 - 3. Remove absorbent sealant backings that have become wet before sealant application and replace them with dry materials.
- D. Install bond-breaker tape behind sealants where sealant backings are not used between sealants and backs of joints.
- E. Install sealants using proven techniques that comply with the following and at the same time backings are installed:
 - 1. Place sealants so they directly contact and fully wet joint substrates.
 - 2. Completely fill recesses in each joint configuration.
 - 3. Produce uniform, cross-sectional shapes and depths relative to joint widths that allow optimum sealant movement capability.
- F. Tooling of Non-Sag Sealants: Immediately after sealant application and before skinning or curing begins, tool sealants according to requirements specified in subparagraphs below to form smooth, uniform beads of configuration indicated; to eliminate air pockets; and to ensure contact and adhesion of sealant with sides of joint.
 - 1. Remove excess sealant from surfaces adjacent to joints.
 - 2. Use tooling agents that are approved in writing by sealant manufacturer and that do not discolor sealants or adjacent surfaces.
 - 3. Provide concave joint profile per Figure 8A in ASTM C 1193, unless otherwise indicated.
 - 4. Provide flush joint profile where indicated per Figure 8B in ASTM C 1193.
 - 5. Provide recessed joint configuration of recess depth and at locations indicated per Figure 8C in ASTM C 1193.
 - a. Use masking tape to protect surfaces adjacent to recessed tooled joints.

3.4 CLEANING

- A. Clean off excess sealant or sealant smears adjacent to joints as the Work progresses by methods and with cleaning materials approved in writing by manufacturers of joint sealants and of products in which joints occur.

3.5 PROTECTION

- A. Protect joint sealants during and after curing period from contact with contaminating substances and from damage resulting from construction operations or other causes so sealants are without deterioration or damage at time of Substantial Completion. If, despite such protection, damage or deterioration occurs, cut out and remove damaged or deteriorated joint sealants immediately so installations with repaired areas are indistinguishable from original work.

3.6 JOINT-SEALANT SCHEDULE

- A. Joint-Sealant Application: Exterior joints in vertical surfaces and horizontal non-traffic surfaces.
 - 1. Joint Locations:

- a. Joints between different materials.
 - b. Other Joints as indicated.
 - 2. Joint Sealant: Silicone, non-staining, S, NS, 50, NT.
- B. Joint-Sealant Application: Interior joints in vertical surfaces and horizontal non-traffic surfaces.
- 1. Joint Locations:
 - a. Perimeter joints of exterior openings where indicated.
 - b. Vertical joints on exposed surfaces of interior unit masonry and concrete walls and partitions.
 - c. Other joints as indicated.
 - 2. Joint Sealant: Latex.

END OF SECTION 079200

SECTION 099123 - INTERIOR PAINTING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes surface preparation and the application of paint systems on the following interior substrates:
 - 1. Concrete masonry units (CMU).
 - 2. Steel and iron.
 - 3. Galvanized metal.
 - 4. Gypsum board.
- B. Related Requirements:
 - 1. Section 099113 "Exterior Painting" for surface preparation and the application of paint systems on exterior substrates.

1.3 DEFINITIONS

- A. Gloss Level 1: Not more than 5 units at 60 degrees and 10 units at 85 degrees, according to ASTM D 523.
- B. Gloss Level 3: 10 to 25 units at 60 degrees and 10 to 35 units at 85 degrees, according to ASTM D 523.
- C. Gloss Level 5: 35 to 70 units at 60 degrees, according to ASTM D 523.

1.4 ACTION SUBMITTALS

- A. Product Data: For each type of product. Include preparation requirements and application instructions.
 - 1. Include Printout of current "MPI Approved Products List" for each product category specified, with the proposed product highlighted.
 - 2. Indicate VOC content.
- B. Samples: For each type of paint system and in each color and gloss of topcoat.
 - 1. Submit Samples on rigid backing, 8 inches square.
 - 2. Apply coats on Samples to show each coat required for system.
 - 3. Label each coat of each Sample.
 - 4. Label each Sample for location and application area.
- C. Product List: Cross-reference to paint system and locations of application areas. Use same designations indicated on Drawings and in schedules. Include color designations.

1.5 MAINTENANCE MATERIAL SUBMITTALS

- A. Furnish extra materials, from the same product run, that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
 - 1. Paint: Five percent (5%), but not less than 1 gal. of each material and color applied.

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Store materials not in use in tightly covered containers in well-ventilated areas with ambient temperatures continuously maintained at not less than 45 deg F (7 deg C).
 - 1. Maintain containers in clean condition, free of foreign materials and residue.
 - 2. Remove rags and waste from storage areas daily.

1.7 FIELD CONDITIONS

- A. Apply paints only when temperature of surfaces to be painted and ambient air temperatures are between 50 and 95 deg F (10 and 35 deg C).
- B. Do not apply paints when relative humidity exceeds eighty-five percent (85%); at temperatures less than 5 deg F (3 deg C) above the dew point; or to damp or wet surfaces.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Basis-of-Design:
 - 1. Sherwin-Williams Company (The)
- B. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 1. Benjamin Moore & Co.
 - 2. ICI Paints
 - 3. Substitutions: Under provisions of Section 012500 "Substitution Procedures".

2.2 PAINT, GENERAL

- A. MPI Standards: Provide products that comply with MPI standards indicated and that are listed in its "MPI Approved Products List."
- B. Material Compatibility:
 - 1. Provide materials for use within each paint system that are compatible with one another and substrates indicated, under conditions of service and application as demonstrated by manufacturer, based on testing and field experience.
 - 2. For each coat in a paint system, provide products recommended in writing by manufacturers of topcoat for use in paint system and on substrate indicated.
- C. VOC Content: Products shall comply with VOC limits of authorities having jurisdiction and, for interior paints and coatings applied at Project site, the following VOC limits, exclusive of

colorants added to a tint base, when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

1. Flat Paints and Coatings: 50 g/L.
2. Non-Flat Paints and Coatings: 150 g/L.
3. Primers, Sealers, and Undercoaters: 200 g/L.
4. Anti-corrosive and Anti-rust Paints Applied to Ferrous Metals: 250 g/L.
5. Zinc-Rich Industrial Maintenance Primers: 340 g/L.

- D. Colors: As selected by Architect and Owner from manufacturer's entire range if not specified on the Drawings, to match existing where required.

2.3 SOURCE QUALITY CONTROL

- A. Testing of Paint Materials: Owner reserves the right to invoke the following procedure:

1. Owner will engage the services of a qualified testing agency to sample paint materials. Contractor will be notified in advance and may be present when samples are taken. If paint materials have already been delivered to Project site, samples may be taken at Project site. Samples will be identified, sealed, and certified by testing agency.
2. Testing agency will perform tests for compliance with product requirements.
3. Owner may direct Contractor to stop applying coatings if test results show materials being used do not comply with product requirements. Contractor shall remove noncomplying paint materials from Project site, pay for testing, and repaint surfaces painted with rejected materials. Contractor will be required to remove rejected materials from previously painted surfaces if, on repainting with complying materials, the two (2) paints are incompatible.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates and conditions, with Applicator present, for compliance with requirements for maximum moisture content and other conditions affecting performance of the Work.
- B. Maximum Moisture Content of Substrates: When measured with an electronic moisture meter as follows:
1. Concrete: Twelve percent (12%).
 2. Masonry (CMUs): Twelve percent (12%).
 3. Gypsum Board: Twelve percent (12%).
- C. Gypsum Board Substrates: Verify that finishing compound is sanded smooth.
- D. Verify suitability of substrates, including surface conditions and compatibility with existing finishes and primers.
- E. Proceed with coating application only after unsatisfactory conditions have been corrected.
1. Application of coating indicates acceptance of surfaces and conditions.

3.2 PREPARATION

- A. Comply with manufacturer's written instructions and recommendations in "MPI Manual" applicable to substrates indicated.
- B. Remove hardware, covers, plates, and similar items already in place that are removable and are not to be painted. If removal is impractical or impossible because of size or weight of item, provide surface-applied protection before surface preparation and painting.
 - 1. After completing painting operations, use workers skilled in the trades involved to reinstall items that were removed. Remove surface-applied protection if any.
- C. Clean substrates of substances that could impair bond of paints, including dust, dirt, oil, grease, and incompatible paints and encapsulants.
 - 1. Remove incompatible primers and reprime substrate with compatible primers or apply tie coat as required to produce paint systems indicated.
- D. Concrete Substrates: Remove release agents, curing compounds, efflorescence, and chalk. Do not paint surfaces if moisture content or alkalinity of surfaces to be painted exceeds that permitted in manufacturer's written instructions.
- E. Masonry Substrates: Remove efflorescence and chalk. Do not paint surfaces if moisture content or alkalinity of surfaces or mortar joints exceeds that permitted in manufacturer's written instructions.
- F. Steel Substrates: Remove rust, loose mill scale, and shop primer, if any. Clean using methods recommended in writing by paint manufacturer but not less than the following:
 - 1. SSPC-SP 3, "Power Tool Cleaning."
- G. Shop-Primed Steel Substrates: Clean field welds, bolted connections, and abraded areas of shop paint, and paint exposed areas with the same material as used for shop priming to comply with SSPC-PA 1 for touching up shop-primed surfaces.
- H. Galvanized-Metal Substrates: Remove grease and oil residue from galvanized sheet metal by mechanical methods to produce clean, lightly etched surfaces that promote adhesion of subsequently applied paints.

3.3 APPLICATION

- A. Apply paints according to manufacturer's written instructions and to recommendations in "MPI Manual."
 - 1. Use applicators and techniques suited for paint and substrate indicated.
 - 2. Paint surfaces behind movable equipment and furniture same as similar exposed surfaces. Before final installation, paint surfaces behind permanently fixed equipment or furniture with prime coat only.
 - 3. Paint front and backsides of access panels, removable or hinged covers, and similar hinged items to match exposed surfaces.
 - 4. Do not paint over labels of independent testing agencies or equipment name, identification, performance rating, or nomenclature plates.
 - 5. Primers specified in painting schedules may be omitted on items that are factory primed or factory finished if acceptable to topcoat manufacturers.

- B. Tint each undercoat a lighter shade to facilitate identification of each coat if multiple coats of same material are to be applied. Tint undercoats to match color of topcoat, but provide sufficient difference in shade of undercoats to distinguish each separate coat.
- C. If undercoats or other conditions show through topcoat, apply additional coats until cured film has a uniform paint finish, color, and appearance.
- D. Apply paints to produce surface films without cloudiness, spotting, holidays, laps, brush marks, roller tracking, runs, sags, ropiness, or other surface imperfections. Cut in sharp lines and color breaks.
- E. Painting Fire Suppression, Plumbing, HVAC, Electrical, Communication, and Electronic Safety and Security Work:
 - 1. Paint the following work where exposed in equipment rooms, unless factory-finished:
 - a. Equipment, including panelboards.
 - b. Uninsulated metal piping.
 - c. Pipe hangers and supports.
 - d. Metal conduit.
 - e. Tanks that do not have factory-applied final finishes.
 - f. Duct, equipment, and pipe insulation having cotton or canvas insulation covering or other paintable jacket material.
 - 2. Paint the following work where exposed in occupied spaces, unless factory-finished:
 - a. Equipment, including panelboards.
 - b. Uninsulated metal piping.
 - c. Pipe hangers and supports.
 - d. Metal conduit.
 - e. Duct, equipment, and pipe insulation having cotton or canvas insulation covering or other paintable jacket material.
 - f. Other items as directed by Architect.
 - 3. Paint portions of internal surfaces of metal ducts, without liner, behind air inlets and outlets that are visible from occupied spaces.

3.4 FIELD QUALITY CONTROL

- A. Dry Film Thickness Testing: Owner may engage the services of a qualified testing and inspecting agency to inspect and test paint for dry film thickness.
 - 1. Contractor shall touch up and restore painted surfaces damaged by testing.
 - 2. If test results show that dry film thickness of applied paint does not comply with paint manufacturer's written recommendations, Contractor shall pay for testing and apply additional coats as needed to provide dry film thickness that complies with paint manufacturer's written recommendations.

3.5 CLEANING AND PROTECTION

- A. At end of each workday, remove rubbish, empty cans, rags, and other discarded materials from Project site.
- B. After completing paint application, clean spattered surfaces. Remove spattered paints by washing, scraping, or other methods. Do not scratch or damage adjacent finished surfaces.

- C. Protect work of other trades against damage from paint application. Correct damage to work of other trades by cleaning, repairing, replacing, and refinishing, as approved by Architect, and leave in an undamaged condition.
- D. At completion of construction activities of other trades, touch up and restore damaged or defaced painted surfaces.

3.6 INTERIOR PAINTING SCHEDULE

A. Concrete Substrates, Nontraffic Surfaces:

1. Institutional Low-Odor/VOC Latex System:

- a. Prime Coat: Primer sealer, interior, institutional low odor/VOC, **MPI #149**.
- b. Intermediate Coat: Latex, interior, institutional low odor/VOC, matching topcoat.
- c. Topcoat: Latex, interior, institutional low odor/VOC, flat (Gloss Level 1), **MPI #143**, at ceilings.

B. CMU Substrates:

1. Institutional Low-Odor/VOC Latex System:

- a. Block Filler: Block filler, latex, interior/exterior, **MPI #4**.
- b. Intermediate Coat: Latex, interior, institutional low odor/VOC, matching topcoat.
- c. Topcoat: Latex, interior, institutional low odor/VOC, eggshell (Gloss Level 3), **MPI #145**.
- d. Topcoat: Latex, interior, institutional low odor/VOC, semi-gloss (Gloss Level 5), **MPI #147**.

C. Steel Substrates:

1. Institutional Low-Odor/VOC Latex System:

- a. Prime Coat: Primer, rust-inhibitive, water based, **MPI #107**.
- b. Intermediate Coat: Latex, interior, institutional low odor/VOC, matching topcoat.
- c. Topcoat: Latex, interior, institutional low odor/VOC, eggshell (Gloss Level 3), **MPI #145**.
- d. Topcoat: Latex, interior, institutional low odor/VOC, semi-gloss (Gloss Level 5), **MPI #148**.

D. Galvanized-Metal Substrates:

1. Institutional Low-Odor/VOC Latex System:

- a. Prime Coat: Primer, galvanized, water based, **MPI #134**.
- b. Intermediate Coat: Latex, interior, institutional low odor/VOC, matching topcoat.
- c. Topcoat: Latex, interior, institutional low odor/VOC, eggshell (Gloss Level 3), **MPI #145**.
- d. Topcoat: Latex, interior, institutional low odor/VOC, semi-gloss (Gloss Level 5), **MPI #148**.

E. Gypsum Board Substrates:

1. Latex System:

- a. Prime Coat: Primer sealer, latex, interior, **MPI #50**.
- b. Intermediate Coat: Latex, interior, matching topcoat.
- c. Topcoat: Latex, interior, eggshell, (Gloss Level 3), **MPI #52**.

END OF SECTION 099123

SECTION 230130.52 - EXISTING HVAC AIR DISTRIBUTION SYSTEM CLEANING

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes cleaning existing HVAC air-distribution equipment, ducts, plenums, and system components.
- B. Related Requirements:
 - 1. Section 233113.00 "Metal Ducts" for cleaning newly installed metal ducts.
 - 2. Section 233116.00 "Nonmetal Ducts" for cleaning newly installed nonmetal ducts.
 - 3. Section 230593.00 "Testing, Adjusting, Balancing for HVAC" for system flow documentation before cleaning and balancing and following cleaning and restoration.
 - 4. Section 233300.00 "Air Duct Accessories" for restoration of opened ducts and plenums with access doors.

1.2 DEFINITIONS

- A. ACAC: American Council for Accredited Certification.
- B. ASCS: Air systems cleaning specialist.
- C. CESB: Council of Engineering and Scientific Specialty Boards.
- D. IICRC: Institute of Inspection, Cleaning, and Restoration Certification.
- E. NADCA: National Air Duct Cleaners Association.

1.3 ACTION SUBMITTALS

- A. Product Data:
 - 1. Cleaning agents
 - 2. Antimicrobial surface treatments.

1.4 INFORMATIONAL SUBMITTALS

- A. Qualification Data:
 - 1. For an ASCS.
- B. Field Quality-Control Reports:
 - 1. Project's existing conditions.
 - 2. Evaluations and recommendations, including cleanliness verification.
 - 3. Strategies and procedures plan.

1.5 CLOSEOUT SUBMITTALS

- A. Post-Project report.

1.6 QUALITY ASSURANCE

- A. ASCS Qualifications: A certified member of NADCA.
 - 1. Certification: Employ an ASCS certified by NADCA on a full-time basis.
 - 2. Supervisor Qualifications: Certified as an ASCS by NADCA.
- B. UL Compliance: Comply with UL 181 and UL 181A for fibrous-glass ducts.

PART 2 - PRODUCTS

2.1 HVAC CLEANING AGENTS

- A. Description:
 - 1. Formulated for each specific soiled coil condition that needs remedy.
 - 2. Will not corrode or tarnish aluminum, copper, or other metals.

2.2 ANTIMICROBIAL SURFACE TREATMENT

- A. Description: Specific product selected shall be as recommended by the IEP based on the specific antimicrobial needs of the specific Project conditions.
 - 1. Formulated to kill and inhibit growth of microorganisms.
 - 2. EPA-registered for use in HVAC systems and for the specific application in which it will be used.
 - 3. Have no residual action after drying, with zero VOC off-gassing.
 - 4. OSHA compliant.
 - 5. Treatment shall dry clear to allow continued visual observation of the treated surface.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Inspect HVAC air-distribution equipment, ducts, plenums, and system components to determine appropriate methods, tools, and equipment required for performance of the Work.
- B. Perform "Project Evaluation and Recommendation" according to NADCA ACR.
- C. Cleaning Plan: Prepare a written plan for air-distribution system cleaning that includes strategies and step-by-step procedures. At a minimum, include the following:
 - 1. Supervisor contact information.
 - 2. Work schedule, including location, times, and impact on occupied areas.
 - 3. Methods and materials planned for each HVAC component type.

4. Required support from other trades.
 5. Equipment and material storage requirements.
 6. Exhaust equipment setup locations.
- D. Existing Conditions Report: Prepare a written report that documents existing conditions of the systems and equipment. Include documentation of existing conditions, including inspection results, photo images, laboratory results, and interpretations of the laboratory results by an IEP.
1. Prepare written report listing conditions detrimental to performance of the Work.
- E. Proceed with work only after conditions detrimental to performance of the Work have been corrected.
- F. Use the existing service openings, as required for proper cleaning, at various points of the HVAC system for physical and mechanical entry and for inspection.
- G. Comply with NADCA ACR, "Guidelines for Constructing Service Openings in HVAC Systems" Section.
- H. Mark the position of manual volume dampers and air-directional mechanical devices inside the system prior to cleaning.

3.2 CLEANING

- A. Comply with NADCA ACR, including items identified as "recommended," "advised," and "suggested."
- B. Perform electrical lockout and tagout according to Owner's standards or authorities having jurisdiction.
- C. Remove non-adhered substances and deposits from within the HVAC system.
- D. Complete cleaning in accordance with Owner-Contractor agreed-upon scope of work.
- E. Systems and Components to Be Cleaned: All air-moving and -distribution equipment.
- F. Collect debris removed during cleaning. Ensure that debris is not dispersed outside the HVAC system during the cleaning process.
- G. Particulate Collection:
1. For particulate collection equipment, include adequate filtration to contain debris removed. Locate equipment downwind and away from all air intakes and other points of entry into the building.
 2. HEPA filtration with 99.97 percent collection efficiency for particles sized 0.3 micrometer or larger shall be used where the particulate collection equipment is exhausting inside the building,
- H. Control odors and mist vapors during the cleaning and restoration process.
- I. Mark the position of manual volume dampers and air-directional mechanical devices inside the system prior to cleaning. Restore them to their marked position on completion of cleaning.

- J. System components shall be cleaned so that all HVAC system components are visibly clean. On completion, all components must be returned to those settings recorded just prior to cleaning operations.
- K. Clean all air-distribution devices, registers, grilles, and diffusers.
- L. Clean non-adhered substance deposits according to NADCA ACR and the following:
 - 1. Clean air-handling units, airstream surfaces, components, condensate collectors, and drains.
 - 2. Ensure that a suitable operative drainage system is in place prior to beginning wash-down procedures.
 - 3. Clean evaporator coils, reheat coils, and other airstream components.
- M. Air-Distribution Systems:
 - 1. Create service openings in the HVAC system as necessary to accommodate cleaning.
 - 2. Mechanically clean air-distribution systems specified to remove all visible contaminants, so that the systems are capable of passing the HVAC System Cleanliness Tests (see NADCA ACR).
- N. Debris removed from the HVAC system shall be disposed of according to applicable Federal, state, and local requirements.
- O. Mechanical Cleaning Methodology:
 - 1. Source-Removal Cleaning Methods: The HVAC system shall be cleaned using source-removal mechanical cleaning methods designed to extract contaminants from within the HVAC system and to safely remove these contaminants from the facility. No cleaning method, or combination of methods, shall be used that could potentially damage components of the HVAC system or negatively alter the integrity of the system.
 - a. Use continuously operating vacuum-collection devices to keep each section being cleaned under negative pressure.
 - b. Cleaning methods that require mechanical agitation devices to dislodge debris that is adhered to interior surfaces of HVAC system components shall be equipped to safely remove these devices. Cleaning methods shall not damage the integrity of HVAC system components or damage porous surface materials, such as duct and plenum liners.
 - 2. Cleaning Mineral-Fiber Insulation Components:
 - a. Fibrous-glass thermal or acoustical insulation elements present in equipment or ductwork shall be thoroughly cleaned with HEPA vacuuming equipment while the HVAC system is under constant negative pressure and shall not be permitted to get wet according to NADCA ACR.
 - b. Cleaning methods used shall not cause damage to fibrous-glass components and will render the system capable of passing the HVAC System Cleanliness Tests (see NADCA ACR).
 - c. Fibrous materials that become wet shall be discarded and replaced.
- P. Coil Cleaning:

1. See NADCA ACR, "Coil Surface Cleaning" Section. Type 1, or Type 1 and Type 2, cleaning methods shall be used to render the coil visibly clean and capable of passing coil cleaning verification.
2. Coil drain pans shall be subject to NADCA ACR, "Non-Porous Surfaces Cleaning Verification." Ensure that condensate drain pans are operational.
3. Electric-resistance coils shall be de-energized, locked out, and tagged before cleaning.
4. Cleaning methods shall not cause any appreciable damage to, cause displacement of, inhibit heat transfer, or cause erosion of the coil surface or fins, and shall comply with coil manufacturer's written recommendations.
5. Rinse thoroughly with clean water to remove any latent residues.

Q. Application of Antimicrobial Treatment:

1. Apply antimicrobial treatments and coatings after the system is rendered clean.
2. Apply antimicrobial agents and coatings directly onto surfaces of interior ductwork.

3.3 CLEANLINESS VERIFICATION

- A. Verify cleanliness according to NADCA ACR, "Verification of HVAC System Cleanliness" Section.
- B. Verify HVAC system cleanliness after mechanical cleaning and before applying any treatment or introducing any treatment-related substance to the HVAC system, including biocidal agents and coatings.
- C. Surface-Cleaning Verification: Perform visual inspection for cleanliness. If no contaminants are evident through visual inspection, the HVAC system shall be considered clean. If visible contaminants are evident through visual inspection, those portions of the system where contaminants are visible shall be re-cleaned and subjected to re-inspection for cleanliness.
- D. Verification of Coil Cleaning: Coil will be considered clean if the coil is free of foreign matter and chemical residue, based on a thorough visual inspection.
- E. Prepare a written cleanliness verification report. At a minimum, include the following:
 1. Written documentation of the success of the cleaning.
 2. Site inspection reports, initialed by supervisor, including notation on areas of inspection, as verified through visual inspection.
 3. Surface comparison test results if required.
 4. Gravimetric analysis (nonporous surfaces only).
 5. System areas found to be damaged.

3.4 RESTORATION

- A. Restore and repair HVAC air-distribution equipment, ducts, plenums, and components according to NADCA ACR, "Restoration and Repair of Mechanical Systems" Section.
- B. Restore service openings capable of future reopening. Comply with requirements in Section 233113 "Metal Ducts and Section 233116 "Nonmetal Ducts."
- C. Reseal fibrous-glass ducts. Comply with requirements in Section 233116 "Nonmetal Ducts."

- D. Replace fibrous-glass materials that cannot be restored by cleaning or resurfacing. Comply with requirements in Section 233113 "Metal Ducts" and Section 233116 "Nonmetal Ducts."
- E. Replace damaged insulation according to Section 230713 "Duct Insulation."
- F. Ensure that closures do not hinder or alter airflow.
- G. New closure materials, including insulation, shall match opened materials and shall have removable closure panels fitted with gaskets and fasteners.
- H. Restore manual volume dampers and air-directional mechanical devices inside the system to their marked position on completion of cleaning.
- I. Measure air flows through air-distribution system.
- J. Measure static-pressure differential across each coil.

3.5 PROJECT CLOSEOUT

- A. Post-Project Report:
 - 1. Post-cleaning laboratory results if any.
 - 2. Post-cleaning photo images.
 - 3. Post-cleaning verification summary.
- B. Drawings:
 - 1. Deviations of existing system from Owner's record drawings.
 - 2. Location of service openings.

END OF SECTION 230130.52

SECTION 230500 - COMMON WORK RESULTS FOR HVAC

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Motors.
2. Alignment guides and anchors.
3. Sleeves without waterstop.
4. Sleeves with waterstop.
5. Stack-sleeve fittings.
6. Sleeve-seal systems.
7. Grout.
8. Silicone sealants.

1.2 ACTION SUBMITTALS

A. Product Data:

1. For each type of product, excluding motors which are included in Part 1 of HVAC equipment Sections.
 - a. Include construction details, material descriptions, and dimensions of individual components, and finishes.
 - b. Include operating characteristics and furnished accessories.

1.3 INFORMATIONAL SUBMITTALS

- A. Product Certificates: For each type of meter.

1.4 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For each type of expansion joint, meter, and gauge to include in operation and maintenance manuals.

1.5 COORDINATION

- A. Coordinate features of motors, installed units, and accessory devices to be compatible with the following:
1. Motor controllers.
 2. Torque, speed, and horsepower requirements of the load.
 3. Ratings and characteristics of supply circuit and required control sequence.
 4. Ambient and environmental conditions of installation location.

PART 2 - PRODUCTS

2.1 MOTORS

A. Motor Requirements, General:

1. Content includes motors for use on alternating-current power systems of up to 600 V and installed at equipment manufacturer's factory or shipped separately by equipment manufacturer for field installation.
2. Comply with requirements in this Section except when stricter requirements are specified in equipment schedules or Sections.
3. Comply with NEMA MG 1 unless otherwise indicated.

B. Motor Characteristics:

1. Duty: Continuous duty at ambient temperature of 40 deg C and at altitude of 3300 ft. above sea level.
2. Capacity and Torque Characteristics: Sufficient to start, accelerate, and operate connected loads at designated speeds, at installed altitude and environment, with indicated operating sequence, and without exceeding nameplate ratings or considering service factor.

C. Polyphase Motors:

1. Description: NEMA MG 1, Design B, medium induction motor.
2. Efficiency: Premium Efficient, as defined in NEMA MG 1.
3. Multispeed Motors: Variable torque.
 - a. For motors with 2:1 speed ratio, consequent pole, single winding.
 - b. For motors with other than 2:1 speed ratio, separate winding for each speed.
4. Rotor: Random-wound, squirrel cage.
5. Bearings: Regreasable, shielded, antifriction ball bearings suitable for radial and thrust loading.
6. Temperature Rise: Match insulation rating.
7. Insulation: Class F.
8. Code Letter Designation:
 - a. Motors 15 Hp and Larger: NEMA starting Code F or Code G.
 - b. Motors Smaller Than 15 Hp: Manufacturer's standard starting characteristic.

D. Additional Requirements for Polyphase Motors:

1. Motors Used with Variable-Frequency Controllers: Ratings, characteristics, and features coordinated with and approved by controller manufacturer.
 - a. Windings: Copper magnet wire with moisture-resistant insulation varnish, designed and tested to resist transient spikes, high frequencies, and short time-rise pulses produced by pulse-width-modulated inverters.
 - b. Premium-Efficient Motors: Class B temperature rise; Class F insulation.
 - c. Inverter-Duty Motors: Class F temperature rise; Class H insulation.
 - d. Thermal Protection: Comply with NEMA MG 1 requirements for thermally protected motors.

E. Single-Phase Motors:

1. Motors larger than 1/20 hp must be one of the following, to suit starting torque and requirements of specific motor application:
 - a. Permanent-split capacitor.
 - b. Split phase.
 - c. Capacitor start, inductor run.
 - d. Capacitor start, capacitor run.
2. Multispeed Motors: Variable-torque, permanent-split-capacitor type.
3. Bearings: Prelubricated, antifriction ball bearings or sleeve bearings suitable for radial and thrust loading.
4. Motors 1/20 hp and Smaller: Shaded-pole type.
5. Thermal Protection: Internal protection to automatically open power supply circuit to motor when winding temperature exceeds a safe value calibrated to temperature rating of motor insulation. Thermal-protection device will automatically reset when motor temperature returns to normal range.

F. Electronically Commutated Motors:

1. Microprocessor-Based Electronic Control Module: Converts 120 V or 240 V single-phase AC power to three-phase DC power to operate the brushless DC motor.
2. Three-phase power motor module with permanent magnet rotor.
3. Circuit board or digital speed controller/LED display.
4. Building Automation System Interface: Via AC voltage signal, DC voltage signal or Digital Serial Interface (DSI).

2.2 SLEEVES AND SLEEVE SEALS

A. Sleeves without Waterstop:

1. Cast-Iron Pipe Sleeves: Cast or fabricated of cast or ductile iron, with plain ends.
2. Steel Pipe Sleeves: ASTM A53/A53M, Type E, Grade B, Schedule 40, hot-dip galvanized, with plain ends.
3. Steel Sheet Sleeves: ASTM A653/A653M, 24 gauge minimum thickness; hot-dip galvanized, round tube closed with welded longitudinal joint.

B. Sleeves with Waterstop:

1. Description: Manufactured PVC/HDPE, steel, stainless steel or galvanized-steel, sleeve-type, waterstop assembly, made for imbedding in concrete slab or wall.

C. Stack-Sleeve Fittings:

1. Description: Manufactured, galvanized cast-iron sleeve with integral cast flashing flange for use in waterproof floors and roofs. Include clamping ring, bolts, and nuts for membrane flashing.

D. Grout:

1. Description: Nonshrink, for interior and exterior sealing openings in non-fire-rated walls or floors.
2. Standard: ASTM C1107/C1107M, Grade B, post-hardening and volume-adjusting, dry, hydraulic-cement grout.
3. Design Mix: 5000 psi, 28-day compressive strength.

- 4. Packaging: Premixed and factory packaged.
- E. Silicone Sealants:
 - 1. Silicone Sealant, S, NS, 25, NT: Single-component, nonsag, plus 25 percent and minus 25 percent movement capability, nontraffic-use, neutral-curing silicone joint sealant.
 - a. Standard: ASTM C920, Type S, Grade NS, Class 25, Use NT.

PART 3 - EXECUTION

3.1 INSTALLATION OF SLEEVES - GENERAL

- A. Install sleeves for piping passing through penetrations in floors, partitions, roofs, and walls.
- B. For sleeves that will have sleeve-seal system installed, select sleeves of size large enough to provide 1-inch annular clear space between piping and concrete slabs and walls.
- C. Install sleeves in concrete floors, concrete roof slabs, and concrete walls as new slabs and walls are constructed.
 - 1. Permanent sleeves are not required for holes in slabs formed by molded-PE or -PP sleeves.
 - 2. Cut sleeves to length for mounting flush with both surfaces.
 - a. Exception: Extend sleeves installed in floors of mechanical equipment areas or other wet areas 2 inches above finished floor level.
 - 3. Using grout or silicone sealant, seal space outside of sleeves in floors/slabs/walls without sleeve-seal system. Select to maintain fire resistance of floor/slab/wall.
- D. Install sleeves for pipes passing through interior partitions.
 - 1. Cut sleeves to length for mounting flush with both surfaces.
 - 2. Install sleeves that are large enough to provide 1/4-inch annular clear space between sleeve and pipe or pipe insulation.
 - 3. Seal annular space between sleeve and piping or piping insulation; use joint sealants that joint sealant manufacturer's literature indicates is appropriate for size, depth, and location of joint.
- E. Fire-Resistance-Rated Penetrations, Horizontal Assembly Penetrations, and Smoke-Barrier Penetrations: Maintain indicated fire or smoke rating of walls, partitions, ceilings, and floors at pipe penetrations. Seal pipe penetrations with fire- and smoke-stop materials.

3.2 INSTALLATION OF SLEEVES WITH WATERSTOP

- A. Install sleeve with waterstop as new walls and slabs are constructed.
- B. Assemble fitting components of length to be flush with both surfaces of concrete slabs and walls. Position waterstop flange centered across width of concrete slab or wall.

- C. Secure nailing flanges to wooden concrete forms.
- D. Using grout or silicone sealant, seal space around outside of sleeves.

3.3 INSTALLATION OF STACK-SLEEVE FITTINGS

- A. Install stack-sleeve fittings in new slabs as slabs are constructed.
 - 1. Install fittings that are large enough to provide 1/4-inch annular clear space between sleeve and pipe or pipe insulation.
 - 2. Secure flashing between clamping flanges for pipes penetrating floors with membrane waterproofing.
 - 3. Install section of cast-iron soil pipe to extend sleeve to 3 inches above finished floor level.
 - 4. Extend cast-iron sleeve fittings below floor slab as required to secure clamping ring if ring is specified.
 - 5. Using silicone sealant, seal space between top hub of stack-sleeve fitting and pipe.
- B. Fire-Resistance-Rated Penetrations, Horizontal Assembly Penetrations, and Smoke Barrier Penetrations: Maintain indicated fire or smoke rating of floors at pipe penetrations. Seal pipe penetrations with fire- and smoke-stop materials.

3.4 INSTALLATION OF SLEEVE-SEAL SYSTEMS

- A. Install sleeve-seal systems in sleeves in exterior concrete walls and slabs-on-grade at service piping entries into building, and passing through exterior walls.
- B. Select type, size, and number of sealing elements required for piping material and size and for sleeve ID or hole size. Assemble sleeve-seal system components, and install in annular space between piping and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make a watertight seal.

3.5 CONNECTIONS

- A. Install meters and gauges adjacent to machines and equipment to allow space for service and maintenance of meters, gauges, machines, and equipment.

3.6 ADJUSTING

- A. After installation, calibrate meters according to manufacturer's written instructions.
- B. Adjust faces of meters and gauges to proper angle for best visibility.

3.7 SLEEVES APPLICATION

- A. Use sleeves and sleeve seals for the following piping-penetration applications:
 - 1. Exterior Concrete Walls above and below Grade:
 - a. Sleeves with waterstops.

2. Concrete Slabs-on-Grade:
 - a. Sleeves with waterstops.
3. Concrete Slabs above Grade:
 - a. Sleeves with waterstops or stack-sleeve fittings.
4. Interior Walls and Partitions:
 - a. Sleeves without waterstops.

END OF SECTION 230500

SECTION 230529 FL – HANGERS AND SUPPORTS FOR HVAC

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Pipe hangers and supports - metal.
2. Thermal-hanger shield inserts.
3. Fastener systems.
4. Equipment stands - outdoor type.

B. Related Requirements:

1. Section 230500 "Common Work Results for HVAC" for pipe guides and anchors.
2. Section 230548.13 "Vibration Controls for HVAC" for vibration isolation devices.
3. Section 233113 "Metal Ducts" and Section 233116 "Nonmetal Ducts" for duct hangers and supports.

1.2 ACTION SUBMITTALS

A. Product Data:

1. For each type of product.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

A. Structural Performance: Hangers and supports for HVAC piping and equipment are to withstand the effects of gravity loads and stresses within limits and under conditions indicated in accordance with ASCE/SEI 7.

1. Design equipment supports capable of supporting combined operating weight of supported equipment and connected systems and components.

2.2 PIPE HANGERS AND SUPPORTS - METAL

A. Pipe Hangers and Supports - Carbon Steel:

1. Description: MSS SP-58, Types 1 through 58, factory-fabricated components.
2. Galvanized Metallic Coatings: Pregalvanized, hot-dip galvanized, or electro-galvanized.
3. Nonmetallic Coatings: Plastic coated, or epoxy powder coated.
4. Padded Hangers: Hanger with fiberglass or other pipe insulation pad or cushion to support bearing surface of piping.

5. Hanger Rods: Continuous-thread rod, nuts, and washers made of carbon steel or stainless steel.

B. Pipe Hangers and Supports - Stainless Steel:

1. Description: MSS SP-58, Types 1 through 58, factory-fabricated components.
2. Padded Hangers: Hanger with fiberglass or other pipe insulation pad or cushion to support bearing surface of piping.
3. Hanger Rods: Continuous-thread rod, nuts, and washer made of stainless steel.

C. Pipe/Tube Hangers and Supports - Copper:

1. Description: MSS SP-58, Types 1 through 58, copper-plated steel, factory-fabricated components.
2. Hanger Rods: Continuous-thread rod, nuts, and washer made of copper-plated steel or stainless steel.

2.3 THERMAL-HANGER SHIELD INSERTS

- A. Insulation-Insert Material for Cold Piping: ASTM C552, Type II cellular glass with 100 psi or ASTM C591, Type VI, Grade 1 polyisocyanurate with 125 psi minimum compressive strength and vapor barrier.
- B. Insulation-Insert Material for Hot Piping: Water-repellent-treated, ASTM C533, Type I calcium silicate with 100 psi, ASTM C552, Type II cellular glass with 100 psi or ASTM C591, Type VI, Grade 1 polyisocyanurate with 125 psi minimum compressive strength.
- C. For Trapeze or Clamped Systems: Insert and shield are to cover entire circumference of pipe.
- D. For Clevis or Band Hangers: Insert and shield are to cover bottom 180 degrees of pipe.
- E. Insert Length: Extend 2 inches beyond sheet metal shield for piping operating below ambient air temperature.

2.4 FASTENER SYSTEMS

- A. Fastener System - Mechanical-Expansion Anchors: Insert-wedge-type anchors for use in hardened portland cement concrete; with pull-out, tension, and shear capacities required for supported loads and building materials where used.
 1. Indoor Applications: Zinc-plated or stainless steel.
 2. Outdoor Applications: Stainless steel.

2.5 EQUIPMENT STANDS, OUTDOOR TYPE

- A. Description: Individual foot supports with elevated adjustable channel cross bars and clamps/fasteners/bolts for ground- or roof-supported outdoor equipment components, without roof membrane penetration, in a prefabricated system that can be modularly-assembled on site.

- B. Foot Material: Rubber or polypropylene.
- C. Rails Material: Hot dip galvanized carbon steel.

2.6 MATERIALS

- A. Aluminum: ASTM B221.
- B. Carbon Steel: ASTM A1011/A1011M.
- C. Structural Steel: ASTM A36/A36M, carbon-steel plates, shapes, and bars; galvanized.
- D. Stainless Steel: ASTM A240/A240M.
- E. Threaded Rods: Continuously threaded. Zinc-plated or galvanized steel for indoor applications and stainless steel for outdoor applications. Mating nuts and washers of similar materials as rods.
- F. Grout: ASTM C1107/C1107M, factory-mixed and -packaged, dry, hydraulic-cement, nonshrink and nonmetallic grout; suitable for interior and exterior applications.
 - 1. Properties: Nonstaining, noncorrosive, and nongaseous.
 - 2. Design Mix: 5000 psi, 28-day compressive strength.

PART 3 - EXECUTION

3.1 APPLICATION

- A. Comply with requirements for firestopping materials and installation for penetrations through fire-rated walls, ceilings, and assemblies.
- B. Strength of Support Assemblies: Where not indicated, select sizes of components so strength will be adequate to carry static loads within specified loading limits. Minimum static design load used for strength determination is to include weight of supported components plus 200 lb.

3.2 INSTALLATION OF HANGERS AND SUPPORTS

- A. Install hangers and supports to allow controlled thermal movement of piping systems, to permit freedom of movement between pipe anchors, and to facilitate action of expansion joints, expansion loops, expansion bends, and similar units.
- B. Install lateral bracing with pipe hangers and supports to prevent swaying.
- C. Install building attachments within concrete slabs or attach to structural steel. Install additional attachments at concentrated loads, including valves, flanges, and strainers, NPS 2-1/2 and larger and at changes in direction of piping. Coordinate location of concrete inserts before concrete is placed.
- D. Load Distribution: Install hangers and supports so that piping live and dead loads and stresses from movement will not be transmitted to connected equipment.

- E. Pipe Slopes: Install hangers and supports to provide indicated pipe slopes and to not exceed maximum pipe deflections allowed by ASME B31.9 for building services piping.
- F. Insulated Piping:
 - 1. Attach clamps and spacers to piping.
 - a. Piping Operating above Ambient Air Temperature: Clamp may project through insulation.
 - b. Piping Operating below Ambient Air Temperature: Use thermal-hanger shield insert with clamp sized to match OD of insert.
 - c. Do not exceed pipe stress limits allowed by ASME B31.9 for building services piping.
 - 2. Install MSS SP-58, Type 39, protection saddles if insulation without vapor barrier is indicated. Fill interior voids with insulation that matches adjoining insulation.
 - a. Thermal-hanger shield inserts may be used as an option. Include steel weight-distribution plate for pipe NPS 4 and larger if pipe is installed on rollers.
 - 3. Install MSS SP-58, Type 40, protective shields on cold piping with vapor barrier. Shields are to span an arc of 180 degrees.
 - a. Thermal-hanger shield inserts may be used as an option. Include steel weight-distribution plate for pipe NPS 4 and larger if pipe is installed on rollers.
 - 4. Shield Dimensions for Pipe: Not less than the following:
 - a. NPS 1/4 to NPS 3-1/2: 12 inches long and 0.048 inch thick.
 - b. NPS 4: 12 inches long and 0.06 inch thick.
 - c. NPS 5 and NPS 6: 18 inches long and 0.06 inch thick.
 - d. NPS 8 to NPS 14: 24 inches long and 0.075 inch thick.
 - e. NPS 16 to NPS 24: 24 inches long and 0.105 inch thick.
 - 5. Pipes NPS 8 and Larger: Include wood or reinforced calcium-silicate-insulation inserts of length at least as long as protective shield.
- G. Metal Pipe-Hanger Installation: Comply with MSS SP-58. Install hangers, supports, clamps, and attachments as required to properly support piping from the building structure.
- H. Thermal-Hanger Shield Installation: Install in pipe hanger or shield for insulated piping.
- I. Fastener System Installation:
 - 1. Install mechanical-expansion anchors after concrete is placed and completely cured.
 - 2. Install fasteners in accordance with manufacturer's written instructions.
 - 3. Install lag screw wood fasteners in accordance with manufacturer's written instructions.
- J. Install hangers and supports complete with necessary attachments, inserts, bolts, rods, nuts, washers, and other accessories.

3.3 ADJUSTING

- A. Hanger Adjustments: Adjust hangers to distribute loads equally on attachments and to achieve indicated slope of pipe.
- B. Trim excess length of continuous-thread hanger and support rods to 1-1/2 inches.

3.4 HANGER AND SUPPORT SCHEDULE

- A. Specific hanger and support requirements are in Sections specifying piping systems and equipment.
- B. Comply with MSS SP-58 for pipe-hanger selections and applications that are not specified in piping system Sections.
- C. Use hangers and supports with galvanized metallic coatings for piping and equipment that will not have field-applied finish.
- D. Use nonmetallic coatings on attachments for electrolytic protection where attachments are in direct contact with copper tubing.
- E. Use carbon-steel pipe hangers and supports and attachments for general service applications.
- F. Use stainless steel pipe hangers and and stainless steel or corrosion-resistant attachments for hostile environment applications.
- G. Use copper-plated pipe hangers and copper or stainless steel attachments for copper piping and tubing.
- H. Use padded hangers for piping that is subject to scratching.
- I. Use thermal-hanger shield inserts for insulated piping and tubing.
- J. Horizontal-Piping Hangers and Supports: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
 - 1. Adjustable, Steel Clevis Hangers (MSS Type 1): For suspension of noninsulated or insulated, stationary pipes NPS 1/2 to NPS 30.
 - 2. Yoke-Type Pipe Clamps (MSS Type 2): For suspension of up to 1050 deg F, pipes NPS 4 to NPS 24, requiring up to 4 inches of insulation.
 - 3. Carbon- or Alloy-Steel, Double-Bolt Pipe Clamps (MSS Type 3): For suspension of pipes NPS 3/4 to NPS 36, requiring clamp flexibility and up to 4 inches of insulation.
 - 4. Steel Pipe Clamps (MSS Type 4): For suspension of cold and hot pipes NPS 1/2 to NPS 24 if little or no insulation is required.
 - 5. Pipe Hangers (MSS Type 5): For suspension of pipes NPS 1/2 to NPS 4, to allow off-center closure for hanger installation before pipe erection.
 - 6. Adjustable, Swivel Split- or Solid-Ring Hangers (MSS Type 6): For suspension of noninsulated, stationary pipes NPS 3/4 to NPS 8.
 - 7. Adjustable, Steel Band Hangers (MSS Type 7): For suspension of noninsulated, stationary pipes NPS 1/2 to NPS 8.
 - 8. Adjustable Band Hangers (MSS Type 9): For suspension of noninsulated, stationary pipes NPS 1/2 to NPS 8.
 - 9. Adjustable, Swivel-Ring Band Hangers (MSS Type 10): For suspension of noninsulated, stationary pipes NPS 1/2 to NPS 8.

10. Split Pipe Ring with or without Turnbuckle Hangers (MSS Type 11): For suspension of noninsulated, stationary pipes NPS 3/8 to NPS 8.
 11. Extension Hinged or Two-Bolt Split Pipe Clamps (MSS Type 12): For suspension of noninsulated, stationary pipes NPS 3/8 to NPS 3.
 12. U-Bolts (MSS Type 24): For support of heavy pipes NPS 1/2 to NPS 30.
 13. Clips (MSS Type 26): For support of insulated pipes not subject to expansion or contraction.
 14. Pipe Saddle Supports (MSS Type 36): For support of pipes NPS 4 to NPS 36, with steel-pipe base stanchion support and cast-iron floor flange or carbon-steel plate.
 15. Pipe Stanchion Saddles (MSS Type 37): For support of pipes NPS 4 to NPS 36, with steel-pipe base stanchion support and cast-iron floor flange or carbon-steel plate, and with U-bolt to retain pipe.
 16. Adjustable Pipe Saddle Supports (MSS Type 38): For stanchion-type support for pipes NPS 2-1/2 to NPS 36 if vertical adjustment is required, with steel-pipe base stanchion support and cast-iron floor flange.
 17. Single-Pipe Rolls (MSS Type 41): For suspension of pipes NPS 1 to NPS 30, from two rods if longitudinal movement caused by expansion and contraction might occur.
 18. Adjustable Roller Hangers (MSS Type 43): For suspension of pipes NPS 2-1/2 to NPS 24, from single rod if horizontal movement caused by expansion and contraction might occur.
 19. Complete Pipe Rolls (MSS Type 44): For support of pipes NPS 2 to NPS 42 if longitudinal movement caused by expansion and contraction might occur but vertical adjustment is unnecessary.
 20. Pipe Roll and Plate Units (MSS Type 45): For support of pipes NPS 2 to NPS 24 if small horizontal movement caused by expansion and contraction might occur and vertical adjustment is unnecessary.
 21. Adjustable Pipe Roll and Base Units (MSS Type 46): For support of pipes NPS 2 to NPS 30 if vertical and lateral adjustment during installation might be required in addition to expansion and contraction.
- K. Vertical-Piping Clamps: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Extension Pipe or Riser Clamps (MSS Type 8): For support of pipe risers NPS 3/4 to NPS 24.
 2. Carbon- or Alloy-Steel Riser Clamps (MSS Type 42): For support of pipe risers NPS 3/4 to NPS 24 if longer ends are required for riser clamps.
- L. Hanger-Rod Attachments: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Steel Turnbuckles (MSS Type 13): For adjustment up to 6 inches for heavy loads.
 2. Steel Clevises (MSS Type 14): For 120 to 450 deg F piping installations.
 3. Swivel Turnbuckles (MSS Type 15): For use with MSS Type 11, split pipe rings.
 4. Malleable-Iron Sockets (MSS Type 16): For attaching hanger rods to various types of building attachments.
 5. Steel Weldless Eye Nuts (MSS Type 17): For 120 to 450 deg F piping installations.
- M. Building Attachments: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Steel or Malleable Concrete Inserts (MSS Type 18): For upper attachment to suspend pipe hangers from concrete ceiling.
 2. Top-Beam C-Clamps (MSS Type 19): For use under roof installations with bar-joist construction, to attach to top flange of structural shape.

3. Side-Beam or Channel Clamps (MSS Type 20): For attaching to bottom flange of beams, channels, or angles.
 4. Center-Beam Clamps (MSS Type 21): For attaching to center of bottom flange of beams.
 5. Welded Beam Attachments (MSS Type 22): For attaching to bottom of beams if loads are considerable and rod sizes are large.
 6. C-Clamps (MSS Type 23): For structural shapes.
 7. Top-Beam Clamps (MSS Type 25): For top of beams if hanger rod is required tangent to flange edge.
 8. Side-Beam Clamps (MSS Type 27): For bottom of steel I-beams.
 9. Steel-Beam Clamps with Eye Nuts (MSS Type 28): For attaching to bottom of steel I-beams for heavy loads.
 10. Linked-Steel Clamps with Eye Nuts (MSS Type 29): For attaching to bottom of steel I-beams for heavy loads, with link extensions.
 11. Malleable-Beam Clamps with Extension Pieces (MSS Type 30): For attaching to structural steel.
 12. Welded-Steel Brackets: For support of pipes from below or for suspending from above by using clip and rod. Use one of the following for indicated loads:
 - a. Light (MSS Type 31): 750 lb.
 - b. Medium (MSS Type 32): 1500 lb.
 - c. Heavy (MSS Type 33): 3000 lb.
 13. Side-Beam Brackets (MSS Type 34): For sides of steel or wooden beams.
 14. Plate Lugs (MSS Type 57): For attaching to steel beams if flexibility at beam is required.
 15. Horizontal Travelers (MSS Type 58): For supporting piping systems subject to linear horizontal movement where headroom is limited.
- N. Saddles and Shields: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Steel-Pipe-Covering Protection Saddles (MSS Type 39): To fill interior voids with insulation that matches adjoining insulation.
 2. Protection Shields (MSS Type 40): Of length recommended in writing by manufacturer to prevent crushing insulation.
 3. Thermal-Hanger Shield Inserts: For supporting insulated pipe.
- O. Spring Hangers and Supports: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Restraint-Control Devices (MSS Type 47): Where indicated to control piping movement.
 2. Spring Cushions (MSS Type 48): For light loads if vertical movement does not exceed 1-1/4 inches.
 3. Spring-Cushion Roll Hangers (MSS Type 49): For equipping Type 41, roll hanger with springs.
 4. Spring Sway Braces (MSS Type 50): To retard sway, shock, vibration, or thermal expansion in piping systems.
 5. Variable-Spring Hangers (MSS Type 51): Preset to indicated load and limit variability factor to 25 percent to allow expansion and contraction of piping system from hanger.
 6. Variable-Spring Base Supports (MSS Type 52): Preset to indicated load and limit variability factor to 25 percent to allow expansion and contraction of piping system from base support.
 7. Variable-Spring Trapeze Hangers (MSS Type 53): Preset to indicated load and limit variability factor to 25 percent to allow expansion and contraction of piping system from trapeze support.

- 8. Constant Supports: For critical piping stress and if necessary to avoid transfer of stress from one support to another support, critical terminal, or connected equipment. Include auxiliary stops for erection, hydrostatic test, and load-adjustment capability. These supports include the following types:
 - a. Horizontal (MSS Type 54): Mounted horizontally.
 - b. Vertical (MSS Type 55): Mounted vertically.
 - c. Trapeze (MSS Type 56): Two vertical-type supports and one trapeze member.
- P. Comply with MSS SP-58 for trapeze pipe-hanger selections and applications that are not specified in piping system Sections.
- Q. Use mechanical-expansion anchors instead of building attachments where required in concrete construction.

END OF SECTION 230529

SECTION 230553 FL- IDENTIFICATION FOR HVAC PIPING AND EQUIPMENT

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Equipment labels.
 - 2. Warning signs and labels.
 - 3. Warning tape.
 - 4. Pipe labels.
 - 5. Duct labels.
 - 6. Valve tags.
 - 7. Warning tags.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product.

PART 2 - PRODUCTS

2.1 EQUIPMENT LABELS

- A. Metal Labels for Equipment:
 - 1. Material and Thickness: Brass, 0.032-inch, stainless steel, 0.025-inch, aluminum, 0.032-inch or anodized aluminum, 0.032-inch minimum thickness, with predrilled or stamped holes for attachment hardware.
 - 2. Letter and Background Color: As indicated for specific application under Part 3.
 - 3. Minimum Label Size: Length and width vary for required label content, but not less than 2-1/2 by 3/4 inch.
 - 4. Minimum Letter Size: 1/4 inch for name of units if viewing distance is less than 24 inches, 1/2 inch for viewing distances of up to 72 inches, and proportionately larger lettering for greater viewing distances. Include secondary lettering two-thirds to three-fourths the size of principal lettering.
 - 5. Fasteners: Stainless steel rivets or self-tapping screws.
 - 6. Adhesive: Contact-type permanent adhesive, compatible with label and with substrate.
- B. Plastic Labels for Equipment:
 - 1. Material and Thickness: Multilayer, multicolor, plastic labels for mechanical engraving, 1/16 inch thick, with predrilled holes for attachment hardware.
 - 2. Letter and Background Color: As indicated for specific application under Part 3.
 - 3. Maximum Temperature: Able to withstand temperatures of up to 160 deg F.
 - 4. Minimum Label Size: Length and width vary for required label content, but not less than 2-1/2 by 3/4 inch.
 - 5. Minimum Letter Size: 1/4 inch for name of units if viewing distance is less than 24 inches, 1/2 inch for viewing distances of up to 72 inches, and proportionately larger lettering for

greater viewing distances. Include secondary lettering two-thirds to three-fourths the size of principal lettering.

6. Fasteners: Stainless steel rivets or self-tapping screws.
7. Adhesive: Contact-type permanent adhesive, compatible with label and with substrate.

2.2 WARNING SIGNS AND LABELS

- A. Material and Thickness: Multilayer, multicolor, plastic labels for mechanical engraving, 1/16 inch thick, with predrilled holes for attachment hardware.
- B. Letter and Background Color: As indicated for specific application under Part 3.
- C. Maximum Temperature: Able to withstand temperatures of up to 160 deg F.
- D. Minimum Label Size: Length and width vary for required label content, but not less than 2-1/2 by 3/4 inch.
- E. Minimum Letter Size: 1/4 inch for name of units if viewing distance is less than 24 inches, 1/2 inch for viewing distances of up to 72 inches, and proportionately larger lettering for greater viewing distances. Include secondary lettering two-thirds to three-fourths the size of principal lettering.
- F. Fasteners: Stainless steel rivets or self-taping screws.
- G. Adhesive: Contact-type permanent adhesive, compatible with label and with substrate.
- H. Arc-Flash Warning Signs: Provide arc-flash warning signs in locations and with content in accordance with requirements of OSHA and NFPA70E.
- I. Label Content: Include caution and warning information plus emergency notification instructions.

2.3 WARNING TAPE

- A. Material: Vinyl.
- B. Minimum Thickness: 0.005 inch.
- C. Letter, Pattern, and Background Color: As indicated for specific application under Part 3.
- D. Waterproof Adhesive Backing: Suitable for indoor or outdoor use.
- E. Maximum Temperature: 160 deg F.
- F. Minimum Width: 2 inches.

2.4 PIPE LABELS

- A. General Requirements for Manufactured Pipe Labels: Preprinted, color coded, with lettering indicating service and showing flow direction in accordance with ASME A13.1.
- B. Letter and Background Color: As indicated for specific application under Part 3.

- C. Pretensioned Pipe Labels: Precoiled, semirigid plastic formed to partially cover or cover full circumference of pipe and to attach to pipe without fasteners or adhesive.
- D. Self-Adhesive Pipe Labels: Printed plastic with contact-type, permanent-adhesive backing.
- E. Pipe Label Contents: Include identification of piping service using same designations or abbreviations as used on Drawings. Also include:
 - 1. Pipe size.
 - 2. Flow-Direction Arrows: Include flow-direction arrows on main distribution piping. Arrows may be either integral with label or applied separately.
 - 3. Lettering Size: Size letters in accordance with ASME A13.1 for piping.

2.5 DUCT LABELS

- A. Material and Thickness: Multilayer, multicolor, plastic labels for mechanical engraving, 1/16 inch thick, and having predrilled holes for attachment hardware.
- B. Letter and Background Color: As indicated for specific application under Part 3.
- C. Maximum Temperature: Able to withstand temperatures up to 160 deg F.
- D. Minimum Label Size: Length and width vary for required label content, but not less than 2-1/2 by 3/4 inch.
- E. Minimum Letter Size: 1/4 inch for name of units if viewing distance is less than 24 inches, 1/2 inch for viewing distances of up to 72 inches, and proportionately larger lettering for greater viewing distances. Include secondary lettering two-thirds to three-fourths the size of principal lettering.
- F. Fasteners: Stainless steel rivets or self-tapping screws.
- G. Adhesive: Contact-type permanent adhesive, compatible with label and with substrate.
- H. Duct Label Contents: Include identification of duct service using same designations or abbreviations as used on Drawings. Also include the following:
 - 1. Duct size.
 - 2. Flow-Direction Arrows: Include flow-direction arrows on main distribution ducts. Arrows may be either integral with label or may be applied separately.
 - 3. Lettering Size: Size letters in accordance with ASME A13.1 for piping.

2.6 VALVE TAGS

- A. Description: Stamped or engraved with 1/4-inch letters for piping system abbreviation and 1/2-inch numbers.
 - 1. Tag Material: Brass, 0.04-inch, stainless steel, 0.024-inch, aluminum, 0.031-inch or anodized aluminum, 0.031-inch minimum thickness, with predrilled or stamped holes for attachment hardware.
 - 2. Fasteners: Brass wire, link chain, beaded chain or S-hook.
- B. Letter and Background Color: As indicated for specific application under Part 3.

- C. Valve Schedules: For each piping system, on 8-1/2-by-11-inch bond paper. Tabulate valve number, piping system, system abbreviation (as shown on valve tag), location of valve (room or space), normal-operating position (open, closed, or modulating), and variations for identification. Mark valves for emergency shutoff and similar special uses.

1. Include valve-tag schedule in operation and maintenance data.

2.7 WARNING TAGS

- A. Description: Preprinted or partially preprinted accident-prevention tags of plasticized card stock with matte finish suitable for writing.

1. Size: 3 by 5-1/4 inches minimum.
2. Fasteners: Brass grommet and wire or Reinforced grommet and wire or string.
3. Nomenclature: Large-size primary caption, such as "DANGER," "CAUTION," or "DO NOT OPERATE."
4. Letter and Background Color: As indicated for specific application under Part 3.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Clean piping and equipment surfaces of incompatible primers, paints, and encapsulants, as well as dirt, oil, grease, release agents, and other substances that could impair bond of identification devices.

3.2 INSTALLATION, GENERAL REQUIREMENTS

- A. Coordinate installation of identifying devices with completion of covering and painting of surfaces where devices are to be applied.
- B. Coordinate installation of identifying devices with locations of access panels and doors.
- C. Install identifying devices before installing acoustical ceilings and similar concealment.
- D. Locate identifying devices so that they are readily visible from the point of normal approach.

3.3 INSTALLATION OF EQUIPMENT LABELS, WARNING SIGNS, AND LABELS

- A. Permanently fasten labels on each item of mechanical equipment.
- B. Sign and Label Colors:
 1. White letters on an ANSI Z535.1 safety-blue background .
- C. Locate equipment labels where accessible and visible.
- D. Arc-Flash Warning Signs: Provide arc-flash warning signs on electrical disconnects and other equipment where arc-flash hazard exists, as indicated on Drawings, and in accordance with requirements of OSHA and NFPA 70E, and other applicable codes and standards.

3.4 INSTALLATION OF WARNING TAPE

- A. Warning Tape Color and Pattern: Yellow background with black diagonal stripes.
- B. Install warning tape on pipes and ducts, with cross-designated walkways providing less than 6 ft. of clearance.
- C. Locate tape so as to be readily visible from the point of normal approach.

3.5 INSTALLATION OF PIPE LABELS

- A. Install pipe labels showing service and flow direction with permanent adhesive on pipes.
- B. Pipe-Label Locations: Locate pipe labels where piping is exposed or above accessible ceilings in finished spaces; machine rooms; accessible maintenance spaces such as shafts, tunnels, and plenums; and exterior exposed locations as follows:
 - 1. Within 3 ft. of each valve and control device.
 - 2. At access doors, manholes, and similar access points that permit view of concealed piping.
 - 3. Within 3 ft. of equipment items and other points of origination and termination.
 - 4. Spaced at maximum intervals of 25 ft. along each run. Reduce intervals to 10 ft. in areas of congested piping, ductwork, and equipment.
- C. Do not apply plastic pipe labels or plastic tapes directly to bare pipes conveying fluids at temperatures of 125 deg F or higher. Where these pipes are to remain uninsulated, use a short section of insulation or use stenciled labels.
- D. Flow-Direction Arrows: Use arrows to indicate direction of flow in pipes, including pipes where flow is allowed in both directions.
- E. Pipe-Label Color Schedule:
 - 1. Chilled-Water Piping: White letters on an ANSI Z535.1 safety-green background.
 - 2. Condenser-Water Piping: White letters on an ANSI Z535.1 safety-green background.
 - 3. Heating Water Piping: White letters on an ANSI Z535.1 safety-green background.
 - 4. Refrigerant Piping: White letters on an ANSI Z535.1 safety-blue background.
 - 5. Low-Pressure Steam Piping: Black letters on an ANSI Z535.1 safety-yellow background or White letters on an ANSI Z535.1 safety-green background.
 - 6. High-Pressure Steam Piping: Black letters on an ANSI Z535.1 safety-yellow background or White letters on an ANSI Z535.1 safety-green background.
 - 7. Steam Condensate Piping: Black letters on an ANSI Z535.1 safety-yellow background or White letters on an ANSI Z535.1 safety-green background.
 - 8. Toxic and Corrosive Fluids: Black letters on an ANSI Z535.1 safety-orange background.
 - 9. Flammable Fluids: Black letters on an ANSI Z535.1 safety-yellow background.
 - 10. Combustible Fluids: White letters on an ANSI Z535.1 safety-brown background.
 - 11. Potable and Other Water: White letters on an ANSI Z535.1 safety-green background.
 - 12. Compressed Air: White letters on an ANSI Z535.1 safety-blue background.

3.6 INSTALLATION OF DUCT LABELS

- A. Install plastic-laminated self-adhesive duct labels showing service and flow direction with permanent adhesive on air ducts.

1. Provide labels in the following color codes:
 - a. For air supply ducts: White letters on blue background.
 - b. For air return ducts: White letters on blue background.
 - c. For exhaust-, outside-, relief-, return-, and mixed-air ducts: White letters on blue background.
- B. Locate label near each point where ducts enter into and exit from concealed spaces and at maximum intervals of 20 ft. where exposed or are concealed by removable ceiling system.
- C. Access Panels and Door Labels, Equipment Labels, and Similar Operational Instructions:
 1. Black letters on White background.

3.7 INSTALLATION OF VALVE TAGS

- A. Install tags on valves and control devices in piping systems, except check valves, valves within factory-fabricated equipment units, shutoff valves, and HVAC terminal devices and similar roughing-in connections of end-use fixtures and units. List tagged valves in a valve schedule in the operating and maintenance manual.
- B. Valve-Tag Application Schedule: Tag valves according to size, shape, and color scheme and with captions similar to those indicated in "Valve-Tag Size and Shape" Subparagraph below.
 1. Valve-Tag Size and Shape:
 - a. Chilled Water: 1-1/2 inches, round.
 - b. Condenser Water: 1-1/2 inches, round.
 - c. Refrigerant: 1-1/2 inches, round.
 - d. Hot Water: 1-1/2 inches, round.
 - e. Gas: 1-1/2 inches, round.
 - f. Low-Pressure Steam: 1-1/2 inches, round.
 - g. High-Pressure Steam: 1-1/2 inches, round.
 - h. Steam Condensate: 1-1/2 inches, round.
 2. Valve-Tag Colors:
 - a. For each piping system, use the same lettering and background coloring system on valve tags as used for the Pipe Label Schedule text and background.

3.8 INSTALLATION OF WARNING TAGS

- A. Warning Tag Color: Black letters on an ANSI Z535.1 safety-yellow background.
- B. Attach warning tags, with proper message, to equipment and other items where indicated on Drawings or scheduled.

END OF SECTION 230553

SECTION 230593 FL – TESTING, ADJUSTING AND BALANCING FOR HVAC

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Testing, Adjusting, and Balancing of Air Systems:
 - a. Air systems.
 - b. Variable-air-volume systems.
2. Testing, adjusting, and balancing of equipment.
3. Testing, adjusting, and balancing of existing HVAC systems and equipment.

1.2 DEFINITIONS

- A. AABC: Associated Air Balance Council.
- B. NEBB: National Environmental Balancing Bureau.
- C. TAB: Testing, adjusting, and balancing.
- D. TABB: Testing, Adjusting, and Balancing Bureau.
- E. TAB Specialist: An independent entity meeting qualifications to perform TAB work.

1.3 INFORMATIONAL SUBMITTALS

- A. Qualification Data: Within 30 days of Contractor's Notice to Proceed, submit documentation that the TAB specialist and this Project's TAB team members meet the qualifications specified in "Quality Assurance" Article.
- B. Certified TAB reports.
- C. Sample report forms.
- D. Instrument calibration reports, to include the following:
 1. Instrument type and make.
 2. Serial number.
 3. Application.
 4. Dates of use.
 5. Dates of calibration.

1.4 QUALITY ASSURANCE

- A. TAB Specialists Qualifications, Certified by NEBB or TABB:
 - 1. TAB Field Supervisor: Employee of the TAB specialist and certified by NEBB or TABB.
 - 2. TAB Technician: Employee of the TAB specialist and certified by NEBB or TABB.
- B. Instrumentation Type, Quantity, Accuracy, and Calibration: Comply with requirements in ASHRAE 111, Section 4, "Instrumentation."
- C. Code and AHJ Compliance: TAB is required to comply with governing codes and requirements of authorities having jurisdiction.

1.5 FIELD CONDITIONS

- A. Owner Occupancy: Owner may occupy areas of building. Cooperate with Owner during TAB operations to minimize conflicts with Owner's operations.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine the Contract Documents to become familiar with Project requirements and to discover conditions in systems designs that may preclude proper TAB of systems and equipment.
- B. Examine installed systems for balancing devices, such as test ports, gauge cocks, thermometer wells, flow-control devices, balancing valves and fittings, and manual volume dampers. Verify that locations of these balancing devices are applicable for intended purpose and are accessible.
- C. Examine the approved submittals for HVAC systems and equipment.
- D. Examine HVAC equipment and verify that bearings are greased, belts are aligned and tight, filters are clean, and equipment with functioning controls is ready for operation.
- E. Examine operating safety interlocks and controls on HVAC equipment.
- F. Examine control dampers for proper installation for their intended function of isolating, throttling, diverting, or mixing air flows.
- G. Report deficiencies discovered before and during performance of TAB procedures. Observe and record system reactions to changes in conditions. Record default set points if different from indicated values.

3.2 PREPARATION

- A. Prepare a TAB plan that includes the following:

1. Equipment and systems to be tested.
 2. Strategies and step-by-step procedures for balancing the systems.
 3. Instrumentation to be used.
 4. Sample forms with specific identification for all equipment.
- B. Perform system-readiness checks of HVAC systems and equipment to verify system readiness for TAB work. Include, at a minimum, the following:
1. Airside:
 - a. Verify that leakage and pressure tests on air distribution systems have been satisfactorily completed.
 - b. Duct systems are complete with terminals installed.
 - c. Volume, smoke, and fire dampers are open and functional.
 - d. Clean filters are installed.
 - e. Fans are operating, free of vibration, and rotating in correct direction.
 - f. Variable-frequency controllers' startup is complete and safeties are verified.
 - g. Automatic temperature-control systems are operational.
 - h. Ceilings are installed.
 - i. Windows and doors are installed.
 - j. Suitable access to balancing devices and equipment is provided.

3.3 GENERAL PROCEDURES FOR TESTING AND BALANCING

- A. Perform testing and balancing procedures on each system in accordance with the procedures contained in ASHRAE 111 or NEBB's "Procedural Standards for Testing, Adjusting, and Balancing of Environmental Systems" and in this Section.
- B. Cut insulation, ducts, pipes, and equipment casings for installation of test probes to the minimum extent necessary for TAB procedures.
1. After testing and balancing, patch probe holes in ducts with same material and thickness as used to construct ducts.
 2. Where holes for probes are required in piping or hydronic equipment, install pressure and temperature test plugs to seal systems.
 3. Install and join new insulation that matches removed materials. Restore insulation, coverings, vapor barrier, and finish in accordance with Section 230713 "Duct Insulation," Section 230716 "HVAC Equipment Insulation," and Section 230719 "HVAC Piping Insulation."
- C. Mark equipment and balancing devices, including damper-control positions, valve position indicators, fan-speed-control levers, and similar controls and devices, with paint or other suitable, permanent identification material to show final settings.
- D. Take and report testing and balancing measurements in inch-pound (IP) units.

3.4 TESTING, ADJUSTING, AND BALANCING OF HVAC EQUIPMENT

- A. Test, adjust, and balance HVAC equipment indicated on Drawings, including, but not limited to, the following:
1. Motors.
 2. Fans.

3. Radiant heaters.
4. Energy-recovery units.
5. Rooftop units.
6. Variable-refrigerant-flow systems.
7. Heat pumps.
8. Fan coil units.

3.5 GENERAL PROCEDURES FOR BALANCING AIR SYSTEMS

- A. Prepare test reports for both fans and outlets. Obtain manufacturer's outlet factors and recommended testing procedures. Crosscheck the summation of required outlet volumes with required fan volumes.
- B. Prepare schematic diagrams of systems' Record drawings duct layouts.
- C. Determine the best locations in main and branch ducts for accurate duct-airflow measurements.
- D. Check airflow patterns from the outdoor-air louvers and dampers and the return- and exhaust-air dampers through the supply-fan discharge and mixing dampers.
- E. Locate start-stop and disconnect switches, electrical interlocks, and motor starters.
- F. Verify that motor starters are equipped with properly sized thermal protection.
- G. Check dampers for proper position to achieve desired airflow path.
- H. Check for airflow blockages.
- I. Check condensate drains for proper connections and functioning.
- J. Check for proper sealing of air-handling-unit components.

3.6 PROCEDURES FOR AIR SYSTEMS

- A. Adjust fans to deliver total indicated airflows within the maximum allowable fan speed listed by fan manufacturer.
 1. Measure total airflow.
 - a. Set outside-air, return-air, and relief-air dampers for proper position that simulates minimum outdoor-air conditions.
 - b. Where duct conditions allow, measure airflow by main Pitot-tube traverse. If necessary, perform multiple Pitot-tube traverses close to the fan and prior to any outlets, to obtain total airflow.
 - c. Where duct conditions are unsuitable for Pitot-tube traverse measurements, a coil traverse may be acceptable.
 2. Measure fan static pressures as follows:
 - a. Measure static pressure directly at the fan outlet or through the flexible connection.
 - b. Measure static pressure directly at the fan inlet or through the flexible connection.
 - c. Measure static pressure across each component that makes up the air-handling system.

- d. Report artificial loading of filters at the time static pressures are measured.
3. Do not make fan-speed adjustments that result in motor overload. Consult equipment manufacturers about fan-speed safety factors. Modulate dampers and measure fan-motor amperage to ensure that no overload occurs. Measure amperage in full-cooling, full-heating, economizer, and any other operating mode to determine the maximum required brake horsepower.
- B. Adjust volume dampers for main duct, submain ducts, and major branch ducts to indicated airflows.
 1. Measure airflow of submain and branch ducts.
 2. Adjust submain and branch duct volume dampers for specified airflow.
 3. Re-measure each submain and branch duct after all have been adjusted.
- C. Adjust air inlets and outlets for each space to indicated airflows.
 1. Set airflow patterns of adjustable outlets for proper distribution without drafts.
 2. Measure inlets and outlets airflow.
 3. Adjust each inlet and outlet for specified airflow.
 4. Re-measure each inlet and outlet after they have been adjusted.
- D. Verify final system conditions.
 1. Re-measure and confirm that minimum outdoor, return, and relief airflows are within design. Readjust to design if necessary.
 2. Re-measure and confirm that total airflow is within design.
 3. Re-measure all final fan operating data, speed, volts, amps, and static profile.
 4. Mark all final settings.
 5. Measure and record all operating data.
 6. Record final fan-performance data.

3.7 PROCEDURES FOR MOTORS

- A. Motors 1/2 HP and Larger: Test at final balanced conditions and record the following data:
 1. Manufacturer's name, model number, and serial number.
 2. Motor horsepower rating.
 3. Motor rpm.
 4. Phase and hertz.
 5. Nameplate and measured voltage, each phase.
 6. Nameplate and measured amperage, each phase.
 7. Starter size and thermal-protection-element rating.
 8. Service factor and frame size.
- B. Motors Driven by Variable-Frequency Controllers: Test manual bypass of controller to prove proper operation.

3.8 HVAC CONTROLS VERIFICATION

- A. In conjunction with system balancing, perform the following:
 1. Verify HVAC control system is operating within the design limitations.
 2. Confirm that the sequences of operation are in compliance with Contract Documents.

3. Verify that controllers are calibrated and function as intended.
4. Verify that controller set points are as indicated.
5. Verify the operation of lockout or interlock systems.
6. Verify the operation of valve and damper actuators.
7. Verify that controlled devices are properly installed and connected to correct controller.
8. Verify that controlled devices travel freely and are in position indicated by controller: open, closed, or modulating.
9. Verify location and installation of sensors to ensure that they sense only intended temperature, humidity, or pressure.

- B. Reporting: Include a summary of verifications performed, remaining deficiencies, and variations from indicated conditions.

3.9 PROCEDURES FOR TESTING, ADJUSTING, AND BALANCING EXISTING SYSTEMS

- A. Perform a preconstruction inspection of existing equipment that is to remain and be reused.
1. Measure and record the operating speed, airflow, and static pressure of each fan and equipment with fan(s).
 2. Measure motor voltage and amperage. Compare the values to motor nameplate information.
 3. Check the condition of filters.
 4. Check the condition of coils.
 5. Check the operation of the drain pan and condensate-drain trap.
 6. Check bearings and other lubricated parts for proper lubrication.
 7. Report on the operating condition of the equipment and the results of the measurements taken. Report deficiencies.
- B. TAB After Construction: Before performing testing and balancing of renovated existing systems, inspect existing equipment that is to remain and be reused to verify that existing equipment has been cleaned and refurbished in accordance with renovation scope indicated by Contract Documents. Verify the following:
1. New filters are installed.
 2. Coils are clean and fins combed.
 3. Drain pans are clean.
 4. Fans are clean.
 5. Bearings and other parts are properly lubricated.
 6. Deficiencies noted in the preconstruction report are corrected.
- C. Perform testing and balancing of existing systems to the extent that existing systems are affected by the renovation work.
1. Compare the indicated airflow of the renovated work to the measured fan airflows, and determine the new fan speed and the face velocity of filters and coils.
 2. Verify that the indicated airflows of the renovated work result in filter and coil face velocities and fan speeds that are within the acceptable limits defined by equipment manufacturer.
 3. If calculations increase or decrease the airflow rates by more than 5 percent, make equipment adjustments to achieve the calculated rates. If increase or decrease is 5 percent or less, equipment adjustments are not required.
 4. Balance each air outlet.

3.10 TOLERANCES

- A. Set HVAC system's airflow rates within the following tolerances:
 - 1. Supply, Return, and Exhaust Fans and Equipment with Fans: Plus or minus 10 percent. If design value is less than 100 cfm, within 10 cfm.
 - 2. Air Outlets and Inlets: Plus or minus 10 percent. If design value is less than 100 cfm, within 10 cfm.
- B. Maintaining pressure relationships as designed shall have priority over the tolerances specified above.

3.11 FINAL REPORT

- A. General: Prepare a certified written report; tabulate and divide the report into separate sections for tested systems and balanced systems.
 - 1. Include a certification sheet at the front of the report's binder, signed and sealed by the certified testing and balancing engineer.
 - 2. Include a list of instruments used for procedures, along with proof of calibration.
 - 3. Certify validity and accuracy of field data.
- B. Final Report Contents: In addition to certified field-report data, include the following:
 - 1. Fan curves.
 - 2. Manufacturers' test data.
 - 3. Field test reports prepared by system and equipment installers.
 - 4. Other information relative to equipment performance; do not include Shop Drawings and Product Data.
- C. General Report Data: In addition to form titles and entries, include the following data:
 - 1. Title page.
 - 2. Name and address of the TAB specialist.
 - 3. Project name.
 - 4. Project location.
 - 5. Architect's name and address.
 - 6. Engineer's name and address.
 - 7. Contractor's name and address.
 - 8. Report date.
 - 9. Signature of TAB supervisor who certifies the report.
 - 10. Table of Contents with the total number of pages defined for each section of the report. Number each page in the report.
 - 11. Summary of contents, including the following:
 - a. Indicated versus final performance.
 - b. Notable characteristics of systems.
 - c. Description of system operation sequence if it varies from the Contract Documents.
 - 12. Nomenclature sheets for each item of equipment.
 - 13. Notes to explain why certain final data in the body of reports vary from indicated values.
 - 14. Test conditions for fans performance forms, including the following:

- a. Settings for outdoor-, return-, and exhaust-air dampers.
 - b. Conditions of filters.
 - c. Cooling coil, wet- and dry-bulb conditions.
 - d. Heating coil, dry-bulb conditions.
 - e. Face and bypass damper settings at coils.
 - f. Fan drive settings, including settings and percentage of maximum pitch diameter.
 - g. Variable-frequency controller or Inlet vane settings for variable-air-volume systems.
 - h. Settings for pressure controller(s).
 - i. Other system operating conditions that affect performance.
- D. System Diagrams: Include schematic layouts of air and hydronic distribution systems. Present each system with single-line diagram and include the following:
 - 1. Quantities of outdoor, supply, return, and exhaust airflows.
 - 2. Duct, outlet, and inlet sizes.
 - 3. Pipe and valve sizes and locations.
 - 4. Terminal units.
 - 5. Balancing stations.
 - 6. Position of balancing devices.
- E. Air-Handling-Unit Test Reports: For air-handling units, include the following:
 - 1. Unit Data:
 - a. Unit identification.
 - b. Location.
 - c. Make and type.
 - d. Model number and unit size.
 - e. Manufacturer's serial number.
 - f. Unit arrangement and class.
 - g. Discharge arrangement.
 - h. Sheave make, size in inches, and bore.
 - i. Center-to-center dimensions of sheave and amount of adjustments in inches.
 - j. Number, make, and size of belts.
 - k. Number, type, and size of filters.
 - 2. Motor Data:
 - a. Motor make, and frame type and size.
 - b. Horsepower and speed.
 - c. Volts, phase, and hertz.
 - d. Full-load amperage and service factor.
 - e. Sheave make, size in inches, and bore.
 - f. Center-to-center dimensions of sheave and amount of adjustments in inches.
 - 3. Test Data (Indicated and Actual Values):
 - a. Total airflow rate in cfm.
 - b. Total system static pressure in inches wg.
 - c. Fan speed.
 - d. Inlet and discharge static pressure in inches wg.
 - e. For each filter bank, filter static-pressure differential in inches wg.
 - f. Cooling-coil static-pressure differential in inches wg.
 - g. Heating-coil static-pressure differential in inches wg.

- h. List for each internal component with pressure-drop, static-pressure differential in inches wg.
- i. Outdoor airflow in cfm.
- j. Return airflow in cfm.
- k. Outdoor-air damper position.
- l. Return-air damper position.

F. Apparatus-Coil Test Reports:

1. Coil Data:

- a. System identification.
- b. Location.
- c. Coil type.
- d. Number of rows.
- e. Fin spacing in fins per inch o.c.
- f. Make and model number.
- g. Face area in sq. ft..
- h. Tube size in NPS.
- i. Tube and fin materials.
- j. Circuiting arrangement.

2. Test Data (Indicated and Actual Values):

- a. Airflow rate in cfm.
- b. Average face velocity in fpm.
- c. Air pressure drop in inches wg.
- d. Outdoor-air, wet- and dry-bulb temperatures in deg F.
- e. Return-air, wet- and dry-bulb temperatures in deg F.
- f. Entering-air, wet- and dry-bulb temperatures in deg F.
- g. Leaving-air, wet- and dry-bulb temperatures in deg F.

G. Gas- and Oil-Fired Heat Apparatus Test Reports: In addition to manufacturer's factory startup equipment reports, include the following:

1. Unit Data:

- a. System identification.
- b. Location.
- c. Make and type.
- d. Model number and unit size.
- e. Manufacturer's serial number.
- f. Fuel type in input data.
- g. Output capacity in Btu/h.
- h. Ignition type.
- i. Burner-control types.
- j. Motor horsepower and speed.
- k. Motor volts, phase, and hertz.
- l. Motor full-load amperage and service factor.

2. Test Data (Indicated and Actual Values):

- a. Total airflow rate in cfm.
- b. Entering-air temperature in deg F.
- c. Leaving-air temperature in deg F.

- d. Air temperature differential in deg F.
 - e. Entering-air static pressure in inches wg.
 - f. Leaving-air static pressure in inches wg.
 - g. Air static-pressure differential in inches wg.
 - h. Low-fire fuel input in Btu/h.
 - i. High-fire fuel input in Btu/h.
 - j. Manifold pressure in psig.
 - k. High-temperature-limit setting in deg F.
 - l. Operating set point in Btu/h.
 - m. Motor voltage at each connection.
 - n. Motor amperage for each phase.
 - o. Heating value of fuel in Btu/h.
- H. Electric-Coil Test Reports: For electric furnaces, duct coils, and electric coils installed in central-station air-handling units, include the following:
- 1. Unit Data:
 - a. System identification.
 - b. Location.
 - c. Coil identification.
 - d. Capacity in Btu/h.
 - e. Number of stages.
 - f. Connected volts, phase, and hertz.
 - g. Rated amperage.
 - h. Airflow rate in cfm.
 - i. Face area in sq. ft..
 - j. Minimum face velocity in fpm.
 - 2. Test Data (Indicated and Actual Values):
 - a. Heat output in Btu/h.
 - b. Airflow rate in cfm.
 - c. Air velocity in fpm.
 - d. Entering-air temperature in deg F.
 - e. Leaving-air temperature in deg F.
 - f. Voltage at each connection.
 - g. Amperage for each phase.
- I. Fan Test Reports: For supply, return, and exhaust fans, include the following:
- 1. Fan Data:
 - a. System identification.
 - b. Location.
 - c. Make and type.
 - d. Model number and size.
 - e. Manufacturer's serial number.
 - f. Arrangement and class.
 - g. Sheave make, size in inches, and bore.
 - h. Center-to-center dimensions of sheave and amount of adjustments in inches.
 - 2. Motor Data:
 - a. Motor make, and frame type and size.

- b. Horsepower and speed.
 - c. Volts, phase, and hertz.
 - d. Full-load amperage and service factor.
 - 3. Test Data (Indicated and Actual Values):
 - a. Total airflow rate in cfm.
 - b. Total system static pressure in inches wg.
 - c. Fan speed.
 - d. Discharge static pressure in inches wg.
 - e. Suction static pressure in inches wg.
- J. Round, Flat-Oval, and Rectangular Duct Traverse Reports: Include a diagram with a grid representing the duct cross-section and record the following:
 - 1. Report Data:
 - a. System fan and air-handling-unit number.
 - b. Location and zone.
 - c. Traverse air temperature in deg F.
 - d. Duct static pressure in inches wg.
 - e. Duct size in inches.
 - f. Duct area in sq. ft..
 - g. Indicated airflow rate in cfm.
 - h. Indicated velocity in fpm.
 - i. Actual airflow rate in cfm.
 - j. Actual average velocity in fpm.
 - k. Barometric pressure in psig.
- K.
- L. Instrument Calibration Reports:
 - 1. Report Data:
 - a. Instrument type and make.
 - b. Serial number.
 - c. Application.
 - d. Dates of use.
 - e. Dates of calibration.

END OF SECTION 230593

SECTION 232300 FL – REFRIGERANT PIPING

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Copper tube and fittings.
 - 2. Valves and specialties.
 - 3. Refrigerants.

1.2 ACTION SUBMITTALS

- A. Product Data Submittals: For each product.
 - 1. Submit data for each type of refrigerant piping, fitting, valve, piping specialty, and refrigerant.

1.3 INFORMATIONAL SUBMITTALS

- A. Field Quality-Control Reports: For each field quality control test and inspection.

1.4 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For refrigerant valves and piping specialties to include in maintenance manuals.

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Store piping with end caps in place to ensure that piping interior and exterior are clean when installed.
- B. Prepare valves and specialties for shipping as follows:
 - 1. Protect internal parts against rust and corrosion.
 - 2. Protect threads and other end connections.
- C. Use the following precautions during storage:
 - 1. Maintain valve and specialty end protection.
 - 2. Store valves and specialties indoors and maintain at higher-than-ambient-dew-point temperature. If outdoor storage is necessary, store valves off the ground in watertight enclosures.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Comply with ASHRAE 15.
- B. Comply with ASME B31.5.
- C. Test Pressure for Refrigerant R-410A:
 - 1. Suction Tubing for Refrigeration and Air-Conditioning Applications Other than Heat Pumps: 300 psig.
 - 2. Suction Tubing for Heat-Pump Applications: 535 psig.
 - 3. Hot-Gas and Tubing Lines: 535 psig.
- D. Test Pressure for Refrigerant R-454B:
 - 1. Suction Tubing for Refrigeration and Air-Conditioning Applications Other than Heat Pumps: Equipment manufacturers recommendations or 300 psig.
 - 2. Suction Tubing for Heat-Pump Applications: Equipment manufacturers recommendations or 535 psig.
 - 3. Hot-Gas and Tubing Lines: Equipment manufacturers recommendations or 535 psig.

2.2 COPPER TUBE AND FITTINGS

- A. Copper Tube: ASTM B88, Type K or L or ASTM B280, Type ACR.
- B. Wrought-Copper Fittings, Solder Joint: ASME B16.22.
- C. Wrought-Copper Fittings, Brazed Joint: ASME B16.50.
- D. Wrought-Copper Unions: ASME B16.22.
- E. Solder Filler Metals: ASTM B32. Use 95-5 tin antimony or alloy HB solder to join copper socket fittings on copper pipe.
- F. Brazing Filler Metals: AWS A5.8M/A5.8.
- G. Flexible Connectors:
 - 1. Body: Tin-bronze bellows with woven, flexible, tinned-bronze-wire-reinforced protective jacket.
 - 2. End Connections: Socket ends.
 - 3. Offset Performance: Capable of minimum 3/4-inch misalignment in minimum 7-inch- long assembly.
 - 4. Working Pressure Rating: Factory test at minimum 500 psig.
 - 5. Maximum Operating Temperature: 250 deg F.
- H. Copper-Tube, Pressure-Seal-Joint Fittings for Refrigerant Piping:
 - 1. Standard: UL 207; certified by UL for field installation. Certification as a UL-recognized component alone is unacceptable.

2. Housing: Copper.
3. O-Rings: Compatible with specific refrigerant.
4. Tools: Manufacturer's approved special tools.
5. Minimum Rated Pressure: 700 psig.

2.3 VALVES AND SPECIALTIES

A. Diaphragm Packless Valves:

1. Body and Bonnet: Forged brass or cast bronze; globe design with straight-through or angle pattern.
2. Diaphragm: Phosphor bronze and stainless steel with stainless steel spring.
3. Operator: Rising stem and hand wheel.
4. Seat: Nylon.
5. End Connections: Socket, union, or flanged.
6. Working Pressure Rating: 500 psig.
7. Maximum Operating Temperature: 240 deg F.

B. Packed-Angle Valves:

1. Body and Bonnet: Forged brass or cast bronze.
2. Packing: Molded stem, back seating, and replaceable under pressure.
3. Operator: Rising stem.
4. Seat: Nonrotating, self-aligning polytetrafluoroethylene.
5. Seal Cap: Forged-brass or valox hex cap.
6. End Connections: Socket, union, threaded, or flanged.
7. Working Pressure Rating: 500 psig.
8. Maximum Operating Temperature: 275 deg F.

C. Permanent Filter Dryers: Comply with AHRI 730 I-P.

1. Body and Cover: Painted-steel shell.
2. Filter Media: 10 micron, pleated with integral end rings; stainless steel support.
3. Desiccant Media: Activated alumina or charcoal.
4. End Connections: Socket.
5. Maximum Pressure Loss: 2 psig.
6. Working Pressure Rating: 500 psig.
7. Maximum Operating Temperature: 240 deg F.

2.4 REFRIGERANTS

A. R-454B:

PART 3 - EXECUTION

3.1 VALVE AND SPECIALTY APPLICATIONS

- A. Install service valves for gauge taps at inlet and outlet of hot-gas bypass valves and strainers if they are not an integral part of valves and strainers.
- B. Except as otherwise indicated, install diaphragm packless or packed-angle valves on inlet and outlet side of filter dryers.
- C. Install filter dryers in liquid line between compressor and thermostatic expansion valve.
- D. Provide refrigerant locking caps on refrigerant charging ports that are located outdoors unless otherwise protected from unauthorized access by a means acceptable to authority having jurisdiction.

3.2 INSTALLATION OF PIPING, GENERAL

- A. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems; indicated locations and arrangements were used to size pipe and calculate friction loss, expansion, pump sizing, and other design considerations. Install piping as indicated unless deviations to layout are approved on Shop Drawings.
- B. Install refrigerant piping in accordance with ASHRAE 15.
- C. Install piping in accordance with equipment manufacturer's recommendations, including requirements for length, slope of piping and oil traps.
- D. Install piping in concealed locations unless otherwise indicated and except in equipment rooms and service areas.
- E. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.
- F. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal.
- G. Install piping adjacent to machines to allow service and maintenance.
- H. Install piping free of sags and bends.
- I. Install fittings for changes in direction and branch connections.
- J. Select system components with pressure rating equal to or greater than system operating pressure.
- K. Install piping as short and direct as possible, with a minimum number of joints, elbows, and fittings.
- L. Arrange piping to allow inspection and service of refrigeration equipment. Install valves and specialties in accessible locations to allow for service and inspection.
- M. Install refrigerant piping in protective conduit where installed belowground.

- N. Install refrigerant piping in rigid or flexible conduit in locations where exposed to mechanical injury.
- O. When brazing or soldering, remove solenoid-valve coils and sight glasses; also remove valve stems, seats, packing, and accessible internal parts of refrigerant specialties. Do not apply heat near expansion-valve bulb.
- P. Install piping with adequate clearance between pipe and adjacent walls and hangers or between pipes for insulation installation.
- Q. Identify refrigerant piping and valves in accordance with Section 230553 "Identification for HVAC Piping and Equipment."
- R. Install sleeves for piping penetrations of walls, ceilings, and floors. Comply with requirements for sleeves specified in Section 230500 "Common Work Results for HVAC."
- S. Install sleeve seals for piping penetrations of concrete walls and slabs. Comply with requirements for sleeve seals specified in Section 230500 "Common Work Results for HVAC."

3.3 PIPE JOINT CONSTRUCTION

- A. Ream ends of pipes and tubes and remove burrs. Bevel plain ends of steel pipe.
- B. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.
- C. Soldered Joints: Construct joints in accordance with ASTM B828 or CDA's "Copper Tube Handbook."
- D. Brazed Joints: Construct joints in accordance with AWS BRH, "Brazing Handbook," Ch. 35, "Pipe and Tubing."
 - 1. Use Type BCuP (copper-phosphorus) alloy for joining copper socket fittings with copper pipe.
 - 2. Use Type BAg (cadmium-free silver) alloy for joining copper with bronze or steel.
- E. Threaded Joints: Thread steel pipe with tapered pipe threads in accordance with ASME B1.20.1. Cut threads full and clean using sharp dies. Ream threaded pipe ends to remove burrs and to restore full ID. Join pipe fittings and valves as follows:
 - 1. Apply appropriate tape or thread compound to external pipe threads unless dry-seal threading is specified.
 - 2. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or
- F. Welded Joints: Construct joints in accordance with AWS D10.12M/D10.12.
- G. Flanged Joints: Select appropriate gasket material, size, type, and thickness for service application. Install gasket concentrically positioned. Use suitable lubricants on bolt threads.

3.4 INSTALLATION OF HANGERS AND SUPPORTS

- A. Comply with Section 230529 "Hangers and Supports for HVAC Piping and Equipment" for hangers, supports, and anchor devices.

- B. Install the following pipe attachments:
 - 1. Adjustable steel clevis hangers for individual horizontal runs less than 20 ft. long.
 - 2. Roller hangers and spring hangers for individual horizontal runs 20 ft. or longer.
 - 3. Pipe Roller: MSS SP-58, Type 44 for multiple horizontal piping 20 ft. or longer, supported on a trapeze.
 - 4. Spring hangers to support vertical runs.
 - 5. Copper-clad hangers and supports for hangers and supports in direct contact with copper pipe.
- C. Install hangers for copper tubing, with maximum horizontal spacing and minimum rod diameters, to comply with MSS SP-58, locally enforced codes, and authorities having jurisdiction requirements, whichever are most stringent.
- D. Support horizontal piping within 12 inches of each fitting.
- E. Support vertical runs of copper tubing to comply with MSS SP-58, locally enforced codes, and authorities having jurisdiction requirements, whichever are most stringent.

3.5 FIELD QUALITY CONTROL

- A. Testing Agency: Engage a qualified testing agency to perform tests and inspections.
- B. Tests and Inspections:
 - 1. Comply with ASME B31.5, Chapter VI.
 - 2. Test refrigerant piping and specialties. Isolate compressor, condenser, evaporator, and safety devices from test pressure if they are not rated above the test pressure.
 - 3. Test high- and low-pressure side piping of each system at not less than the pressures indicated in "Performance Requirements" Article.
 - a. Fill system with nitrogen to the required test pressure.
 - b. System must maintain test pressure at the manifold gauge throughout duration of test.
 - c. Test joints and fittings with electronic leak detector or by brushing a small amount of soap and glycerin solution over joints.
 - d. Remake leaking joints using new materials, and retest until satisfactory results are achieved.
- C. Prepare test and inspection reports.

3.6 SYSTEM CHARGING

- A. Charge system using the following procedures:
 - 1. Follow manufacturers' recommendations. A triple evacuation with dry nitrogen is recommended but not required. At a minimum perform the following.
 - 2. Evacuate entire refrigerant system with a vacuum pump to 500 micrometers. If vacuum holds for 12 hours, system is ready for charging.
 - 3. Break vacuum with refrigerant gas, allowing pressure to build up to 2 psig.

END OF SECTION 232300

SECTION 233346 FL – FLEXIBLE DUCTS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Flexible ducts, noninsulated.
 - 2. Flexible ducts, insulated.
 - 3. Flexible duct connectors.

1.2 ACTION SUBMITTALS

- A. Product Data:
 - 1. Flexible ducts, noninsulated.
 - 2. Flexible ducts, insulated.
 - 3. Flexible duct connectors.
- B. Product Data Submittals: For each type of product.

1.3 INFORMATIONAL SUBMITTALS

- A. Coordination Drawings: Reflected ceiling plans, drawn to scale, on which ceiling-mounted access panels and access doors required for access to duct accessories are shown and coordinated with each other, using input from installers of the items involved.

PART 2 - PRODUCTS

2.1 ASSEMBLY DESCRIPTION

- A. Comply with NFPA 90A and NFPA 90B.
- B. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for acceptable materials, material thicknesses, and duct construction methods unless otherwise indicated. Sheet metal materials must be free of pitting, seam marks, roller marks, stains, discolorations, and other imperfections.
- C. Comply with the Air Duct Council's (formerly, Air Diffusion Council) "ADC Flexible Air Duct Test Code - FD 72-R1" and "Flexible Duct Performance & Installation Standards."
- D. Comply with ASTM E96/E96M.

2.2 FLEXIBLE DUCTS, NONINSULATED

- A. Standard: Product is to be UL 181 listed and bearing the UL label.

- B. Flexible Ducts, Noninsulated - Class 1, Two-Ply Vinyl or Polyethylene Film Supported by Helically Wound, Spring-Steel Wire:
 - 1. Pressure Rating: 10 inch wg positive and 1.0 inch wg negative.
 - 2. Maximum Air Velocity: 4000 fpm.
 - 3. Temperature Range: Minus 10 to plus 160 deg F.
- C. Flexible Ducts, Noninsulated - Class 1, Multiple Layers of Aluminum Laminate Supported by Helically Wound, Spring-Steel Wire:
 - 1. Pressure Rating: 10 inch wg positive and 1.0 inch wg negative.
 - 2. Maximum Air Velocity: 4000 fpm.
 - 3. Temperature Range: Minus 20 to plus 210 deg F.
- D. Flexible Ducts, Noninsulated - Class 1, Aluminum Laminate and Polyester Film with Latex Adhesive Supported by Helically Wound, Spring-Steel Wire:
 - 1. Pressure Rating: 10 inch wg positive and 1.0 inch wg negative.
 - 2. Maximum Air Velocity: 4000 fpm.
 - 3. Temperature Range: Minus 20 to plus 210 deg F.
- E. Flexible Ducts, Noninsulated - Class 0, Interlocking Spiral of Aluminum Foil:
 - 1. Pressure Rating: 8 inch wg positive or negative.
 - 2. Maximum Air Velocity: 5000 fpm.
 - 3. Temperature Range: Minus 100 to plus 435 deg F.

2.3 FLEXIBLE DUCTS, INSULATED

- A. Standard: Product is to be UL 181 listed and bearing the UL label.
- B. Flexible Ducts, Insulated - Class 1, Two-Ply Vinyl Film Supported by Helically Wound, Spring-Steel Wire; Fibrous-Glass Insulation:
 - 1. Pressure Rating: 10 inch wg positive and 1.0 inch wg negative.
 - 2. Maximum Air Velocity: 4000 fpm.
 - 3. Temperature Range: Minus 10 to plus 160 deg F.
 - 4. Insulation R-Value: Comply with ASHRAE/IES 90.1.
 - 5. Vapor-Barrier Film: Polyethylene or Aluminized.
- C. Flexible Ducts, Insulated - Class 1, Multiple Layers of Aluminum Laminate Supported by Helically Wound, Spring-Steel Wire; Fibrous-Glass Insulation:
 - 1. Pressure Rating: 10 inch wg positive and 1.0 inch wg negative.
 - 2. Maximum Air Velocity: 4000 fpm.
 - 3. Temperature Range: Minus 20 to plus 210 deg F.
 - 4. Insulation R-Value: Comply with ASHRAE/IES 90.1.
 - 5. Vapor-Barrier Film: Polyethylene or Aluminized.

- D. Flexible Ducts, Insulated - Class 1, Aluminum Laminate and Polyester Film with Latex Adhesive Supported by Helically Wound, Spring-Steel Wire; Fibrous-Glass Insulation:

1. Pressure Rating: 10 inch wg positive and 1.0 inch wg negative.
2. Maximum Air Velocity: 4000 fpm.
3. Temperature Range: Minus 20 to plus 210 deg F.
4. Insulation R-Value: Comply with ASHRAE/IES 90.1.
5. Vapor-Barrier Film: Polyethylene or Aluminized.

- E. Flexible Ducts, Insulated - Class 0, Interlocking Spiral of Aluminum Foil; Fibrous-Glass Insulation:

1. Pressure Rating: 8 inch wg positive or negative.
2. Maximum Air Velocity: 5000 fpm.
3. Temperature Range: Minus 20 to plus 250 deg F.
4. Insulation R-Value: Comply with ASHRAE/IES 90.1.
5. Vapor-Barrier Film: Polyethylene or Aluminized.

2.4 FLEXIBLE DUCT CONNECTORS

- A. Clamps: Stainless steel band with stainless steel or zinc-plated hex screw to tighten band with a worm-gear action or Nylon strap in sizes 3 through 18 inches, to suit duct size.
- B. Non-Clamp Connectors: Adhesive, Liquid adhesive plus tape or Adhesive plus sheet metal screws.

PART 3 - EXECUTION

3.1 INSTALLATION OF FLEXIBLE DUCTS

- A. Install flexible ducts in accordance with applicable details in the following publications:
1. ADC's "Flexible Duct Performance & Installation Standards" for flexible ducts.
 2. NAIMA AH116.
 3. SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for metal ducts.
 4. SMACNA's "Fibrous Glass Duct Construction Standards" for fibrous-glass ducts.
- B. Install in indoor applications only. Do not install flexible duct in locations where it will be exposed to UV lighting.
- C. Connect terminal units to supply ducts directly or with maximum 12-inch lengths of flexible duct. Do not use flexible ducts to change directions.
- D. Connect diffusers and light troffer boots to ducts directly or with maximum 60-inch lengths of flexible duct clamped or strapped in place.
- E. Connect flexible ducts to metal ducts with adhesive, liquid adhesive plus tape or draw bands.
- F. Installation:

1. Install ducts fully extended.
2. Do not bend ducts across sharp corners.
3. Bends of flexible ducting must not exceed a minimum of one-duct diameter.
4. Avoid contact with metal fixtures, water lines, pipes, or conduits.
5. Install flexible ducts in a direct line, without sags, twists, or turns.
6. Install in accordance with ADC instructions.

G. Supporting Flexible Ducts:

1. Support flexible duct at manufacturer's recommended intervals, but at no greater distance than 4 ft. Provide sufficient support so that maximum centerline sag is 1/2 in. per ft. between supports. A connection to rigid duct or equipment may be considered a support joint.
2. Install extra supports at bends placed approximately one-duct diameter from center line of the bend.
3. Ducts may rest on ceiling joists or truss supports. Spacing between supports must not exceed the maximum spacing in accordance with manufacturer's written installation instructions.
4. Vertically installed ducts must be stabilized by support straps at a maximum of 72 inches o.c.

END OF SECTION 233346

SECTION 233401 – LABORATORY EXHAUST FAN

PART 1 - GENERAL

1.1 WORK INCLUDED

- A. High-Plume laboratory Exhaust System, Model Vektor-H with UL762

1.2 RELATED WORK

- A. All sections, drawing plans, specifications and contract documents.

1.3 REFERENCES

- A. ANSI/AMCA Standard 99-10, "Standards Handbook"
- B. ANSI/AMCA Standard 204-05, "Balance Quality and Vibration Levels for Fans"
- C. ANSI/AMCA Standard 210-07, "Laboratory Methods of Testing Fans for Aerodynamic Performance Rating"
- D. AMCA Publication 211-05, "Certified Ratings Program – Product Rating Manual for Fan Air Performance"
- E. ANSI/AMCA Standard 300-08, "Reverberant Room Method for Sound Testing of Fans"
- F. AMCA Publication 311-05, "Certified Ratings Program – Product Rating Manual for Fan Sound Performance"
- G. AMBA Method of Evaluating Load Ratings of Bearings ANSI-11 (r1999)
- H. ANSI/AMCA Standard 500-D-12, "Laboratory Methods of Testing Dampers for Rating"
- I. ANSI/AMCA Standard 500-L-12, "Laboratory Methods of Testing Louvers for Rating"
- J. SMACNA - Medium Pressure Plenum Construction Standard
- K. ANSI/AIHA Z9.5-2012 – Laboratory Ventilation
- L. ASHRAE - Laboratory Design Guide
- M. IBC 2009 – International Building Code
- N. ICC-ES AC 156 – International Code Council Evaluation Services Acceptance Criteria 156
- O. NFPA 96-14 "Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations"
- P. OSHA guideline 1910.212 – General requirements for Machine Guarding. (www.osha.gov)

- Q. OSHA guideline 1910.219 – General requirements for guarding safe use of mechanical power transmission apparatus. (www.osha.gov)
- R. OSHA guideline 1926.300 – General requirements for safe operation and maintenance of hand and power tools. (www.osha.gov)
- S. UL/CUL 705, Power Ventilators
- T. UL 762, Grease Extraction

1.4 QUALITY ASSURANCE

- A. Performance ratings: Conform to ANSI/AMCA Standards 210 and 300. Fans must be tested in accordance with AMCA Publications 211 and 311 in an AMCA accredited laboratory and certified for air and sound performance. Fan shall be licensed to bear the AMCA ratings seal for air performance (AMCA 210) and sound performance (AMCA 300). Manufacturers that are not licensed to bear the AMCA 210 ratings seal must provide performance witness testing (at the manufacturer's expense), per paragraph 1.4.D.
- B. Classification for Spark Resistant Construction shall conform to ANSI/AMCA Standard 99.
- C. Each fan shall be vibration tested before shipping, as an assembly, in accordance with ANSI/AMCA Standard 204. Each assembled fan shall be test run at the factory at the specified fan RPM and vibration signatures shall be taken on each bearing in three planes - horizontal, vertical, and axial. The maximum allowable fan vibration shall be less than 0.15 in. /sec peak velocity; filter-in reading as measured at the fan RPM. This report shall be provided at no charge to the customer upon request.
- D. Manufacturers that do not comply with paragraph 1.4.A must also provide, at the owner and engineer's option and manufacturer's expense, witness testing of fan discharge airflow, performed at an AMCA accredited laboratory, in accordance with AMCA 210. This test shall verify the critical and safety related performance of the high plume blower, as stated by the manufacturer.

1.5 SUBMITTALS

- A. Provide dimensional drawings and product data on each high-plume laboratory exhaust fan assembly.
- B. Provide fan curves for each fan at the specified operation point, with the flow, static pressure and horsepower clearly plotted.
- C. Provide nozzle velocity of exhaust fan, total exhaust flow, and discharge plume height at specified wind velocity.
- D. Strictly adhere to QUALITY ASSURANCE requirements, as stated in section 1.4 of this specification.

1.6 DELIVERY, STORAGE AND HANDLING

- A. Deliver materials to site in manufacturer's original, unopened containers and packaging, with labels clearly indicating manufacturer, material, products included, and location of installation.

- B. Store materials in a dry area indoor, protected from damage, and in accordance with manufacturer's instructions. For long term storage, follow manufacturer's Installation, Operation and Maintenance manual.
- C. Handle and lift fans in accordance with the manufacturer's instructions. Protect materials and finishes during handling and installation to prevent damage. Follow all safety warnings posted by the manufacturer.

1.7 WARRANTY

- A. Submit, for Owner's acceptance, manufacturer's standard warranty document executed by authorized company official. Manufacturer's warranty is in addition to, and not a limitation of, other rights Owner may have under Contract Documents.
 - 1. The warranty of this equipment is to be free from defects in material and workmanship for a period of 12 months from the purchase date. Any units or parts which prove defective during the warranty period will be replaced at the manufacturers' option when returned to the manufacturer, transportation prepaid.
 - 2. Motor Warranty is warranted by the motor manufacturer for a period of one year. Should motors furnished prove defective during this period, they should be returned to the nearest authorized motor service station.

PART 2 - EQUIPMENT

2.1 GENERAL

- A. Base fan performance at standard conditions (density 0.075 Lb. /ft³).
- B. Fans selected shall be capable of accommodating static pressure and flow variations of +/-15% of scheduled values.
- C. Each fan shall be belt driven.
- D. Each fan to be equipped with 316 stainless steel lifting lugs for corrosion resistance.
- E. Fasteners exposed to corrosive exhaust shall be stainless steel.
- F. Fan assembly shall be designed for a minimum of 125 MPH wind loading, without the use of guy wires.

2.2 CORROSION RESISTANT COATING

- A. All steel fan and system components (fan, nozzle, windband and plenum) shall be corrosion resistant coated with LabCoat™, a two-part electrostatically applied and baked, sustainable, corrosion-resistant coating system. Standard finish color to be RAL 7023, concrete grey.
- B. All parts shall be cleaned and chemically prepared for coating using a multistage wash system which includes acid pickling to remove oxide, improving the coating bond to the substrate.
- C. The first powder coat applied over the prepared surface shall be an epoxy primer. After application, the coating shall be heated to a gelatinous consistency (partial cure) at which time

the second powder coat of polyester resin shall be electrostatically applied and then be cured simultaneously at a uniform temperature of 400°F (204°C).

- D. The coating system shall not be less than a total thickness of 6 mils, shall not be affected by the UV component of sunlight (does not chalk), and have superior corrosion resistance to acid, alkali, and solvents. Coating system shall exceed 4000-hour ASTM B117 Salt Spray Resistance.
- E. Note that 10-20 mil thick wet coating systems pollute the environment (air and water), and that these manually applied coatings are not uniform over the impeller surface and can cause fan imbalance and vibration.

2.3 FAN HOUSING AND OUTLET

- A. Fan housing to be aerodynamically designed with high-efficiency inlet, engineered to reduce incoming air turbulence.
- B. Fan housing shall be welded steel and meet specification section 2.15 for corrosion resistant coating. No uncoated metal fan parts shall be acceptable.
- C. Load bearing or structural fan components that are fabricated of polypropylene or fiberglass that have lower mechanical properties than steel, have rough interior surfaces in which corrosive, hazardous compounds can collect, and / or which chalk and structurally degrade due to the UV component of the sunlight shall not be acceptable.
- D. A high velocity conical discharge nozzle shall be supplied by the fan manufacturer and be designed to efficiently handle an outlet velocity of up to 6000 FPM (30.48 m/s). Discharge nozzles shall be steel with corrosion resistant coating or chemical resistant medium density polyethylene with UV inhibitors to prevent chalking and have smooth interior surfaces. Discharge stack caps or hinged covers, impeding exhaust flow shall not be permitted.
- E. Provide housing drain for removal of cleaning fluids, rain and condensation.
- F. A bolted and gasketed access door shall be supplied in the fan housing allowing for servicing and cleaning. Access door can also be used for impeller inspection or removal of impeller, shaft and bearings without removal of the fan housing.
- G. Fan shall be UL762 listed for grease exhaust applications.

2.4 FAN IMPELLER

- A. Fan impeller shall be centrifugal, backward inclined, with non-stall characteristics. The impeller shall be electronically balanced both statically and dynamically per AMCA Standard 204.
- B. Fan impeller shall be manufactured of aluminum (AMCA type B spark resistant), fully welded and meet specification section 2.15 for corrosion resistant coating.

2.5 FAN BYPASS AIR PLENUM

- A. For constant volume systems, the fan shall be connected directly to the exhaust duct without the need of a bypass air plenum. Fans mounted directly to roof curbs shall be provided with a damper tray located in the roof curb for mounting of the gravity isolation damper.

- B. For variable volume systems, a bypass air plenum shall be provided as shown on drawings. The plenum shall be equipped with a bypass air damper and intake air hood with bird screen for introducing outside air at roof level upstream of the fan.
- C. The plenum shall be constructed of fully welded steel, meet specification section 2.15 for corrosion resistant coating, and mount on roof curb as shown on the project drawings. Plenums that are fabricated of plastics or resins that are combustible and have mechanical properties less than steel shall not be acceptable.
- D. The bypass air plenum shall be mounted on factory fabricated roof curb provided by the fan manufacturer, as shown on the project drawings (see section 2.5)
- E. Fan designs that use inlet flexible connectors that can leak causing loss of lab exhaust shall not be accepted.
- F. Bypass air dampers shall be opposed-blade design and coated with up to 4 mils of Hi-Pro Polyester resin, electrostatically applied and baked.
- G. A fan isolation damper, either gravity backdraft or two position actuated, fabricated of steel or aluminum, and coated with minimum 4 mils of Hi-Pro Polyester resin, electrostatically applied and baked, shall be provided as shown on the project documents.
- H. Blower / Plenum vibration isolation shall be limited to neoprene / cork vibration pads.

2.6 BYPASS AIR PLENUM CURB

- A. Exhaust system manufacturer shall supply a structural support curb for the plenum, of specified height, as shown on the drawings.
- B. Curb shall be fabricated of a minimum of 14 gauge of galvanized corrosion resistant coated steel and structurally reinforced.
- C. Curbs shall be insulated.
- D. Roof curb to be a minimum of 18 inches tall and include venting to prevent heat build-up around the duct.
- E. When properly anchored to the roof structure, the standard curb / plenum / blower assembly shall withstand wind loads of up to 125 mph without additional structural support.

2.7 FAN MOTORS AND DRIVE

- A. Motors shall be premium efficiency, standard NEMA frame, 1800 or 3600 RPM, Totally Enclosed Fan Cooled (TEFC) with a 1.15 service factor. A factory-mounted NEMA 3R disconnect switch shall be provided for each fan. Motor maintenance shall be accomplished without fan impeller removal or requiring maintenance personnel to access the contaminated exhaust components.
- B. Drive belts and sheaves shall be sized for 200% of the motor horsepower, and shall be readily and easily accessible for service, if required. Drive shall consist of a minimum of two belts under all circumstances.

- C. Fan shaft to be turned and polished of 1040 steel material 316 stainless steel as standard, coated with corrosion resistant coating.
- D. Fan shaft bearings shall be Air Handling Quality, ball or roller pillow block type and be sized for an L-10 life of no less than 100,000 hours. Bearings shall be fixed to the fan shaft using concentric mounting locking collars, which reduce vibration, increase service life, and improve serviceability. Bearings that use set screws shall not be allowed.
- E. All shaft bearings shall have extended lube lines with Zerk fittings.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine areas to receive fans. Notify the Engineer of conditions that would adversely affect installation or subsequent utilization and maintenance of fans. Do not proceed with installation until unsatisfactory conditions are corrected.

3.2 INSTALLATION

- A. Install fans as indicated, with flexible electrical leads.
- B. Pipe housing drain to nearest drain.
- C. Install fans in accordance with manufacturer's Installation, Operation and Maintenance manual.

3.3 ACCEPTABLE MANUFACTURERS

- A. Greenheck Fan Corp, PO Box 410, Schofield WI 54476-0410, www.greenheck.com
- B. Model Vektor-H with UL762, High Plume Laboratory Exhaust System.

END OF SECTION 233401

SECTION 233713.23 – REGISTERS AND GRILLES

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Registers - fixed-blade face.
2. Grilles - fixed-blade face.
3. Grilles - linear bar.

1.2 ACTION SUBMITTALS

A. Product Data:

1. For each type of product.
 - a. Data Sheet: Indicate materials of construction, finish, and mounting details; and performance data including throw and drop, static-pressure drop, and noise ratings.

PART 2 - PRODUCTS

2.1 REGISTERS

A. Registers - Fixed-Blade Face:

1. Material: Steel or Aluminum.
2. Finish: Baked enamel, white or Clear anodized.
3. Face-Blade Arrangement: Fixed-position face blades.
4. Mounting: Countersunk screw, Concealed or Lay in.

2.2 GRILLES

A. Grilles - Fixed-Blade Face:

1. Material: Steel or Aluminum.
2. Finish: Baked enamel, white.
3. Face-Blade Arrangement: Fixed-face blade position.
4. Mounting: Countersunk screw, Concealed or Lay in.
5. Accessory: Filter.

B. Grilles - Linear Bar:

1. Material: Steel, Stainless steel or Aluminum.
2. Finish: Baked enamel, white or Clear anodized.
3. Face-Blade Arrangement:
4. Mounting: Countersunk screw, Concealed or Lay in.
5. Damper Type: Adjustable opposed blade.

2.3 SOURCE QUALITY CONTROL

- A. Verification of Performance: Rate registers and grilles in accordance with ASHRAE 70.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine areas where registers and grilles are installed for compliance with requirements for installation tolerances and other conditions affecting performance of equipment.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION OF REGISTERS AND GRILLES

- A. Install registers and grilles level and plumb.
- B. Outlets and Inlets Locations: Drawings indicate general arrangement of ducts, fittings, and accessories. Air outlet and inlet locations have been indicated to achieve design requirements for air volume, noise criteria, airflow pattern, throw, and pressure drop. Make final locations where indicated. For units installed in lay-in ceiling panels, locate units in the center of panel. Where architectural features or other items conflict with installation, notify Architect for a determination of final location.
- C. Install registers and grilles with airtight connections to ducts and to allow service and maintenance of dampers, air extractors, and fire dampers.

3.3 ADJUSTING

- A. After installation, adjust registers and grilles to air patterns indicated, or as directed, before starting air balancing.

END OF SECTION 233713.23

SECTION 237416.11 – PACKAGED, SMALL CAPACITY, ROOFTOP AIR CONDITIONING UNITS

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Packaged, small-capacity, rooftop air-conditioning units.

1.2 DEFINITIONS

- A. RTU: Rooftop unit. As used in this Section, this abbreviation means packaged, small-capacity, rooftop air-conditioning units. This abbreviation is used regardless of whether the unit is mounted on the roof or on a concrete base on ground.

1.3 ACTION SUBMITTALS

A. Product Data:

1. For each RTU.
 - a. Include construction details, material descriptions, dimensions of individual components and profiles, and finishes.
 - b. Include rated capacities, dimensions, required clearances, characteristics, and furnished specialties and accessories.
 - c. Include unit dimensions and weight.
 - d. Include cabinet material, metal thickness, finishes, insulation, and accessories.
 - e. Fans:
 - 1) Include certified fan-performance curves with system operating conditions indicated.
 - 2) Include certified fan-sound power ratings.
 - 3) Include fan construction and accessories.
 - 4) Include motor ratings, electrical characteristics, and motor accessories.
 - f. Include certified coil-performance ratings with system operating conditions indicated.
 - g. Include filters with performance characteristics.
 - h. Include gas furnaces with performance characteristics.
 - i. Include dampers, including housings, linkages, and operators.

1.4 INFORMATIONAL SUBMITTALS

- A. Sample Warranty: For manufacturer's warranty.
- B. Source quality-control reports.
- C. System startup reports.

- D. Field quality-control reports.

1.5 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For RTUs to include in emergency, operation, and maintenance manuals.

1.6 MAINTENANCE MATERIAL SUBMITTALS

- A. Furnish extra materials that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
 - 1. Filters: One set(s) of filters for each unit.
 - 2. Gaskets: One set(s) for each access door.
 - 3. Fan Belts: One set(s) for each belt-driven fan.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by an NRTL, and marked for intended location and application.
- B. NFPA Compliance: Comply with NFPA 90A for design, fabrication, and installation of RTUs and components.
- C. ASHRAE 62.1 Compliance: Applicable requirements in ASHRAE 62.1, Section 5 - "Systems and Equipment" and Section 7 - "Construction and Startup."
- D. ASHRAE 15 Compliance: For refrigeration system safety.
- E. ASHRAE/IES 90.1 Compliance: Applicable requirements in ASHRAE/IES 90.1, Section 6 - "Heating, Ventilating, and Air-Conditioning."

2.2 PACKAGED, SMALL-CAPACITY, ROOFTOP AIR-CONDITIONING UNITS

- A. Unit Casings:
 - 1. General Fabrication Requirements for Casings: Formed and reinforced double-wall insulated panels, fabricated to allow removal for access to internal parts and components, with joints between sections sealed.
 - 2. Double-Wall Construction:
 - a. Outside Casing Wall: Galvanized steel, minimum 18 gauge thick with manufacturer's standard finish, with pitched roof panels and knockouts with grommet seals for electrical and piping connections and lifting lugs.
 - b. Inside Casing Wall: G90-coated galvanized steel, 0.028 inch thick.
 - c. Floor Plate: G90 galvanized steel, minimum 18 gauge thick.
 - d. Casing Insulation:

- 1) Materials: Injected polyurethane foam insulation.
 - 2) Insulation Thickness: 2 inches.
 - 3) Thermal Break: Provide continuity of insulation with no through-casing metal in casing walls, floors, or roof of unit.
3. Static-Pressure Classifications:
 - a. For Unit Sections Upstream of Fans: Minus 2-inch wg.
 - b. For Unit Sections Downstream and Including Fans: 3-inch wg.
4. Panels and Doors:
 - a. Panels:
 - 1) Fabrication: Formed and reinforced with same materials and insulation thickness as casing.
 - 2) Fasteners: Two or more camlock type for panel lift-out operation. Arrangement to allow panels to be opened against air-pressure differential.
 - 3) Gasket: Neoprene, applied around entire perimeters of panel frames.
 - 4) Size: Large enough to allow inspection and maintenance of air-handling unit's internal components.
 - b. Access Doors:
 - 1) Hinges: A minimum of two ball-bearing hinges or stainless steel piano hinge and two wedge-lever-type latches, operable from inside and outside. Arrange doors to be opened against air-pressure differential.
 - 2) Gasket: Neoprene, applied around entire perimeters of panel frames.
 - 3) Size: Large enough to allow inspection and maintenance of air-handling unit's internal components.
 - c. Locations and Applications:
 - 1) Fan Section: Inspection and access panels.
 - 2) Coil Section: Inspection and access panels.
 - 3) Damper Section: Inspection and access panels.
 - 4) Filter Section: Inspection and access panels large enough to allow periodic removal and installation of filters.
5. Condensate Drain Pans:
 - a. Location: Each type of cooling coil.
 - b. Construction:
 - 1) Single-wall, stainless steel sheet.
 - c. Drain Connection:
 - 1) Located at lowest point of pan and sized to prevent overflow. Terminate with threaded nipple on one end of pan.
 - 2) Minimum Connection Size: NPS 1.
 - d. Slope: Minimum 0.125-in./ft. slope, to comply with ASHRAE 62.1, in at least two planes to collect condensate from cooling coils (including coil piping connections, coil headers, and return bends) and to direct water toward drain connection.
 - e. Length: Extend drain pan downstream from leaving face.

- f. Width: Entire width of water producing device.
- g. Depth: A minimum of 2 inches deep.

B. Fans, Drives, And Motors:

1. Fan and Drive Assemblies: Statically and dynamically balanced and designed for continuous operation at maximum-rated fan speed and motor horsepower.
2. Supply-Air Fans: Centrifugal, rated according to AMCA 210; galvanized or painted steel; mounted on solid-steel shaft.
 - a. Shafts: With field-adjustable alignment.
 - 1) Turned, ground, and polished hot-rolled steel with keyway.
 - b. Shaft Bearings:
 - 1) Heavy-duty, self-aligning, pillow-block type with an L-50 rated life of minimum 100,000 hours according to ABMA 9.
 - c. Housings: Formed- and reinforced-steel panels to form curved scroll housings with shaped cutoff and spun-metal inlet bell.
 - 1) Bracing: Steel angle or channel supports for mounting and supporting fan scroll, wheel, motor, and accessories.
 - d. Centrifugal Fan Wheels: Inlet flange, backplate, and shallow blades with inlet and tip curved forward in direction of airflow and mechanically fastened to flange and backplate; steel or aluminum hub swaged to backplate and fastened to shaft with setscrews.
 - e. Mounting: For internal vibration isolation and seismic control. Factory-mount fans with manufacturer's standard restrained vibration isolation mounting devices having a minimum static deflection of 1 inch.
 - f. Shaft Lubrication Lines: Extended to a location outside the casing.
 - g. Flexible Connector: Factory fabricated with a fabric strip minimum 3-1/2 inches wide, attached to two strips of minimum 2-3/4-inch- wide by 0.028-inch- thick, galvanized-steel sheet.
 - 1) Flexible Connector Fabric: Glass fabric, double coated with neoprene. Fabrics, coatings, and adhesives to comply with UL 181, Class 1.
3. Drives, Direct: Factory-mounted, direct drive.
4. Condenser-Coil Fan: propeller, mounted on shaft of permanently lubricated motors.
5. Relief-Air Fan: Shaft mounted on permanently lubricated motor.
6. Motors:
 - a. Comply with NEMA designation, temperature rating, service factor, and efficiency requirements for motors specified in Section 230500 "Common Work Results for HVAC."
 - b. Motor Sizes: Minimum size as indicated. If not indicated, large enough so driven load will not require motor to operate in service factor range above 1.0.
 - c. Efficiency: Premium efficient as defined in NEMA MG 1.

- d. Motor Pulleys: Adjustable pitch for use with 5-hp motors and smaller; fixed pitch for use with motors larger than 5 hp. Select pulley size so pitch adjustment is at the middle of adjustment range at fan design conditions.
- e. Controllers, Electrical Devices, and Wiring: Comply with requirements for electrical devices and connections specified in electrical Sections.

C. Rotary Heat Exchanger:

- 1. Heat exchanger integral with unit.
- 2. Casing:
 - a. Galvanized steel, stainless steel, or aluminum with manufacturer's standard factory-painted finish.
 - b. Integral purge section limiting carryover of exhaust air to between 0.05 percent at 1.6-inch wg and 0.20 percent at 4-inch wg differential pressure.
 - c. Casing seals on periphery of rotor and on duct divider and purge section.
 - d. Support vertical rotor on grease-lubricated ball bearings having extended grease fittings or permanently lubricated bearings. Support horizontal rotors on tapered roller bearing.
- 3. Rotor - Aluminum, Metallic, or Polymer: Aluminum, metallic, or polymer segmented wheel, strengthened with radial spokes impregnated with nonmigrating, water-selective, Type A Silica Gel or 3-angstrom molecular-sieve desiccant coating.
- 4. Drive: Fractional horsepower motor and gear reducer. Permanently lubricated wheel bearings.
- 5. Controls:
 - a. Starting relay, factory mounted and wired, and manual motor starter for field wiring.
 - b. Variable-frequency controller, factory mounted and wired, permitting input of field connected 4-20 mA or 1-10-V control signal.
 - c. Pilot-Light Indicator: Display rotor rotation and speed.
 - d. Speed Settings: Adjustable settings for maximum and minimum rotor speed limits.
 - e. Defrost cycle.

D. Coils:

- 1. General Requirements for Coils:
 - a. Comply with AHRI 410.
 - b. Fabricate coils section to allow for removal and replacement of coil for maintenance and to allow in-place access for service and maintenance of coil(s).
 - c. Coils to not act as structural component of unit.
- 2. Supply-Air Refrigerant Coil:
 - a. Tubes: Copper.
 - b. Fins:
 - 1) Material: Aluminum.
 - c. Fin and Tube Joints: Mechanical bond.
 - d. Headers: Seamless-copper headers with brazed connections.
 - e. Frames: Galvanized steel.
 - f. Coatings: Corrosion-resistant coating.
 - g. Ratings: Designed, tested, and rated according to ASHRAE 33 and AHRI 410.

- 1) Working Pressure: Minimum 300 psig.
 3. Outdoor-Air Refrigerant Coil:
 - a. Tubes: Copper.
 - b. Fins:
 - 1) Material: Aluminum.
 - c. Fin and Tube Joints: Mechanical bond.
 - d. Headers: Seamless-copper headers with brazed connections.
 - e. Frames: Galvanized steel.
 - f. Coatings: Corrosion-resistant coating.
 - g. Ratings: Designed, tested, and rated according to ASHRAE 33 and AHRI 410.
 - 1) Working Pressure: Minimum 300 psig.
 4. Hot-Gas Reheat Refrigerant Coil:
 - a. Tubes: Copper.
 - b. Fins:
 - 1) Material: Aluminum.
 - c. Fin and Tube Joints: Mechanical bond.
 - d. Headers: Seamless-copper headers with brazed connections.
 - e. Frames: Galvanized steel.
 - f. Coatings: Corrosion-resistant coating.
 - g. Ratings: Designed, tested, and rated according to ASHRAE 33 and AHRI 410.
 - 1) Working Pressure: Minimum 300 psig.
 - h. Suction-discharge bypass valve.
- E. Refrigerant Circuit Components:
 1. Compressor: Hermetic, digital scroll, mounted on vibration isolators; with internal overcurrent and high-temperature protection, internal pressure relief, and crankcase heater.
 2. Refrigeration Specialties:
 - a. Refrigerant: R-454B.
 - b. Expansion valve with replaceable thermostatic element.
 - c. Refrigerant filter/dryer.
 - d. Manual-reset high-pressure safety switch.
 - e. Automatic-reset low-pressure safety switch.
 - f. Minimum off-time relay.
 - g. Automatic-reset compressor motor thermal overload.
 - h. Brass service valves installed in compressor suction and liquid lines.
 - i. Hot-gas reheat solenoid valve modulating with a replaceable magnetic coil.
- F. Air Filtration:
 1. Panel Filters:

- a. Description: Pleated factory-fabricated, self-supported, disposable air filters with holding frames.
- b. Filter Unit Class: UL 900.
- c. Media: Interlaced glass, synthetic or cotton fibers coated with nonflammable adhesive and antimicrobial coating.
- d. Filter-Media Frame: Beverage board with perforated metal retainer, or metal grid, on outlet side.

G. Gas Furnaces:

- 1. Description: Factory assembled, piped, and wired; complying with ANSI Z21.47/CSA 2.3 and NFPA 54.
- 2. CSA Approval: Designed and certified by and bearing label of CSA.
- 3. Burners: Stainless steel.
 - a. Rated Minimum Turndown Ratio: 10 to 1.
 - b. Fuel: Natural/Bio gas.
 - c. Ignition: Electronically controlled electric spark or hot-surface igniter with flame sensor.
 - d. Gas Train: Single-body, regulated, redundant, 24-V ac gas valve assembly containing pilot solenoid valve, pilot filter, pressure regulator, pilot shutoff, and manual shutoff.
- 4. Heat-Exchanger and Drain Pan: Stainless steel.
- 5. Venting, Power: Power vented, with integral, motorized centrifugal fan interlocked with gas valve.
- 6. Safety Controls:
 - a. Gas Manifold: Safety switches and controls complying with ANSI standards.

H. Dampers:

- 1. Outdoor- and Return-Air Dampers: Double-skin, airfoil-blade, galvanized-steel dampers with compressible jamb seals and extruded-vinyl blade edge seals in opposed or parallel-blade arrangement with zinc-plated steel operating rods rotating in sintered bronze or nylon bearings mounted in a single galvanized-steel frame, and with operating rods connected with a common linkage.

I. Electrical Power Connections:

- 1. RTU to have a single connection of power to unit with unit-mounted disconnect switch accessible from outside unit and control-circuit transformer with built-in overcurrent protection.

J. Controls:

- 1. Basic Unit Controls:
 - a. Control-voltage transformer.
 - b. Wall-mounted thermostat or sensor with the following features:
 - 1) Heat-cool-off switch.
 - 2) Fan on-auto switch.
 - 3) Fan-speed switch.
 - 4) Manual or Automatic changeover.
 - 5) Adjustable deadband.
 - 6) Concealed or Exposed set point.

- 7) Concealed or Exposed indication.
- 8) Degree F indication.
- 9) Unoccupied-period-override push button.
- 10) Data entry and access port to input temperature set points, occupied and unoccupied periods, and output room temperature, supply-air temperature, operating mode, and status.

2. Controller:

- a. Type: Electronic.
- b. Controller to have volatile-memory backup.
- c. Safety Control Operation:
 - 1) Smoke Detectors: Stop fan and close outdoor-air damper if smoke is detected. Provide additional contacts for alarm interface to fire-alarm control panel.
- d. Scheduled Operation: Occupied and unoccupied periods on seven-day clock with a minimum of two programmable periods per day.
- e. Unoccupied Period:
 - 1) Heating Setback: 10 deg F.
 - 2) Cooling Setback: System off.
 - 3) Override Operation: Two hours.
- f. Supply Fan Operation:
 - 1) Occupied Periods: Run fan continuously.
 - 2) Unoccupied Periods: Cycle fan to maintain setback temperature.
- g. Refrigerant Circuit Operation:
 - 1) Occupied Periods: Cycle or stage compressors, and operate hot-gas bypass to match compressor output to cooling load to maintain room temperature. Cycle condenser fans to maintain maximum hot-gas pressure. Operate low-ambient control kit to maintain minimum hot-gas pressure.
 - 2) Unoccupied Periods: Compressors off.
- h. Hot-Gas Reheat-Coil Operation:
 - 1) Occupied Periods: Humidistat opens hot-gas valve to provide hot-gas reheat, and cycles the compressor.
 - 2) Unoccupied Periods: Reheat not required.
- i. Gas Furnace Operation:
 - 1) Occupied Periods: Cycle, Stage or Modulate burner to maintain room temperature.
 - 2) Unoccupied Periods: Cycle burner to maintain setback temperature.

3. Interface Requirements for HVAC Instrumentation and Control System:

- a. Interface relay for scheduled operation.
- b. Interface relay to provide indication of fault at the central workstation and diagnostic code storage.

- c. Provide BACnet or LonWorks compatible interface for central HVAC control workstation for the following:
 - 1) Adjusting set points.
 - 2) Monitoring supply fan start, stop, and operation.
 - 3) Inquiring data to include outdoor-air damper position, supply- and room-air temperature.
 - 4) Monitoring occupied and unoccupied operations.
 - 5) Monitoring constant and variable motor loads.
 - 6) Monitoring variable-frequency drive operation.
 - 7) Monitoring air-distribution static pressure and ventilation air volume.
- K. Roof Curbs:
 - 1. Materials: Galvanized steel with corrosion-protection coating, watertight gaskets, and factory-installed wood nailer; complying with NRCA standards.
 - a. Curb Insulation and Adhesive: Comply with NFPA 90A or NFPA 90B.
 - 1) Materials: ASTM C1071, Type I or II.
 - 2) Thickness: 1 inch minimum.
 - b. Application: Factory applied with adhesive and mechanical fasteners to the internal surface of curb.
 - 1) Liner Adhesive: Comply with ASTM C916, Type I.
 - 2) Mechanical Fasteners: Galvanized steel, suitable for adhesive attachment, mechanical attachment, or welding attachment to duct without damaging liner when applied as recommended by manufacturer and without causing leakage in cabinet.
 - 3) Liner materials applied in this location to have airstream surface coated with a temperature-resistant coating or faced with a plain or coated fibrous mat or fabric depending on service air velocity.
 - 2. Curb Dimensions: Adaptable horizontal dimensions as required for existing roof openings.
- L. Accessories:
 - 1. Duplex, 115-V, ground-fault-interrupter outlet with 15-A overcurrent protection. Include transformer if required. Outlet is to be energized even if the unit main disconnect is open.
 - 2. Filter differential pressure switch with sensor tubing on either side of filter. Set for final filter pressure loss.
 - 3. Return-air bypass damper.
 - 4. Safeties:
 - a. Smoke detector.
 - b. Condensate overflow switch.
 - c. Phase-loss reversal protection.
 - d. High and low pressure control.
 - e. Gas furnace airflow-proving switch.
 - 5. Coil guards of painted, galvanized-steel wire.
 - 6. Outdoor-air intake weather hood.

2.3 MATERIALS

A. Steel:

1. ASTM A36/A36M for carbon structural steel.
2. ASTM A568/A568M for steel sheet.

B. Stainless Steel:

1. Manufacturer's standard grade for casing.
2. Manufacturer's standard type, ASTM A240/A240M for bare steel exposed to airstream or moisture.

C. Galvanized Steel: ASTM A653/A653M.

D. Aluminum: ASTM B209.

E. Corrosion-Resistant Coating: Coat with a corrosion-resistant coating capable of withstanding a 3000-hour salt-spray test according to ASTM B117.

1. Standards:
 - a. ASTM B117 for salt spray.
 - b. ASTM D2794 for minimum impact resistance of 100 in-lb.
 - c. ASTM B3359 for cross-hatch adhesion of 5B.
2. Application: Immersion or Spray.
3. Thickness: 1 mil.
4. Gloss: Minimum gloss of 60 on a 60-degree meter.

2.4 SOURCE QUALITY CONTROL

A. AHRI Compliance:

1. Comply with AHRI 210/240 for testing and rating energy efficiencies for RTUs.
2. Comply with AHRI 340/360 for testing and rating energy efficiencies for RTUs.
3. Comply with AHRI 270 for testing and rating sound performance for RTUs.
4. Comply with AHRI 1060 for testing and rating performance for air-to-air exchanger.

B. AMCA Compliance:

1. Comply with AMCA 11 and bear the AMCA-Certified Ratings Seal for air and sound performance according to AMCA 211 and AMCA 311.
2. Damper leakage tested according to AMCA 500-D.
3. Operating Limits: Classify according to AMCA 99.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of RTUs.

- B. Examine roughing-in for RTUs to verify actual locations of piping and duct connections before equipment installation.
- C. Examine roofs for suitable conditions where RTUs will be installed.
- D. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION OF PACKAGED, SMALL-CAPACITY, ROOFTOP AIR-CONDITIONING UNITS

- A. Roof Curb: Install on roof structure or concrete base, level and secure, according to NRCA's "NRCA Roofing Manual: Membrane Roof Systems." or AHRI Guideline B. Install RTUs on curbs and coordinate roof penetrations and flashing with roof construction. Secure RTUs to upper curb rail, and secure curb base to roof framing or concrete base with anchor bolts. Coordinate sizes and locations of roof curbs with actual equipment provided.

3.3 PIPING CONNECTIONS

- A. Piping installation requirements are specified in other Sections. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Where installing piping adjacent to RTU, allow space for service and maintenance.
- C. Connect piping to unit mounted on vibration isolators with flexible connectors.
- D. Condensate drain: Extend to nearest equipment or roof drain. Construct deep trap at connection to drain pan and install cleanouts at changes in direction.
- E. Gas Piping: Connect gas piping to burner, full size of gas train inlet, and connect with union and shutoff valve with sufficient clearance for burner removal and service.

3.4 DUCT CONNECTIONS

- A. Comply with duct installation requirements specified in other HVAC Sections. Drawings indicate general arrangement of ducts. The following are specific connection requirements:
 - 1. Install ducts to termination at top of roof curb.
 - 2. Remove roof decking only as required for passage of ducts. Do not cut out decking under entire roof curb.
 - 3. Connect supply ducts to RTUs with flexible duct connectors.
 - 4. Install return-air duct continuously through roof structure.

3.5 ELECTRICAL CONNECTIONS

- A. Connect electrical wiring according to Section 260519 "Low-Voltage Electrical Power Conductors and Cables."
- B. Ground equipment according to Section 260526 "Grounding and Bonding for Electrical Systems."
- C. Install electrical devices furnished by manufacturer, but not factory mounted, according to NFPA 70 and NECA 1.

- D. Install nameplate for each electrical connection, indicating electrical equipment designation and circuit number feeding connection.
 - 1. Nameplate is to be laminated acrylic or melamine plastic signs as specified in Section 260553 "Identification for Electrical Systems."
 - 2. Locate nameplate where easily visible.

3.6 CONTROL CONNECTIONS

- A. Install control and electrical power wiring to field-mounted control devices.
- B. Connect control wiring according to Section 260523 "Control-Voltage Electrical Power Cables."

3.7 STARTUP SERVICE

- A. Engage a factory-authorized service representative to perform startup service.
 - 1. Complete installation and startup checks according to manufacturer's written instructions.
 - 2. Inspect for visible damage to unit casing.
 - 3. Inspect for visible damage to furnace combustion chamber.
 - 4. Inspect for visible damage to compressor, coils, and fans.
 - 5. Inspect internal insulation.
 - 6. Verify that labels are clearly visible.
 - 7. Verify that clearances have been provided for servicing.
 - 8. Verify that controls are connected and operable.
 - 9. Verify that filters are installed.
 - 10. Clean condenser coil and inspect for construction debris.
 - 11. Clean furnace flue and inspect for construction debris.
 - 12. Connect and purge gas line.
 - 13. Remove packing from vibration isolators.
 - 14. Verify lubrication on fan and motor bearings.
 - 15. Inspect fan-wheel rotation for movement in correct direction without vibration and binding.
 - 16. Adjust fan belts to proper alignment and tension.
 - 17. Start unit according to manufacturer's written instructions.
 - a. Start refrigeration system.
 - b. Do not operate below recommended low-ambient temperature.
 - c. Complete startup sheets and attach copy with Contractor's startup report.
 - 18. Inspect and record performance of interlocks and protective devices; verify sequences.
 - 19. Operate unit for an initial period as recommended or required by manufacturer.
 - 20. Perform the following operations for both minimum and maximum firing. Adjust burner for peak efficiency:
 - a. Measure gas pressure on manifold.
 - b. Inspect operation of power vents.
 - c. Measure combustion-air temperature at inlet to combustion chamber.
 - d. Measure flue-gas temperature at furnace discharge.
 - e. Perform flue-gas analysis. Measure and record flue-gas carbon dioxide and oxygen concentration.
 - f. Measure supply-air temperature and volume when burner is at maximum firing rate and when burner is off. Calculate useful heat to supply air.

21. Calibrate thermostats.
22. Adjust and inspect high-temperature limits.
23. Inspect outdoor-air dampers for proper stroke and interlock with return-air dampers.
24. Start refrigeration system and measure and record the following when ambient is a minimum of 15 deg F above return-air temperature:
 - a. Coil leaving-air, dry- and wet-bulb temperatures.
 - b. Coil entering-air, dry- and wet-bulb temperatures.
 - c. Outdoor-air, dry-bulb temperature.
 - d. Outdoor-air-coil, discharge-air, dry-bulb temperature.
25. Inspect controls for correct sequencing of heating, mixing dampers, refrigeration, and normal and emergency shutdown.
26. Measure and record the following minimum and maximum airflows. Plot fan volumes on fan curve.
 - a. Supply-air volume.
 - b. Return-air volume.
 - c. Relief-air volume.
 - d. Outdoor-air intake volume.
27. Simulate maximum cooling demand and inspect the following:
 - a. Compressor refrigerant suction and hot-gas pressures.
 - b. Short circuiting of air through condenser coil or from condenser fans to outdoor-air intake.
28. Verify operation of remote panel including pilot-light operation and failure modes. Inspect the following:
 - a. High-temperature limit on gas-fired heat exchanger.
 - b. Low-temperature safety operation.
 - c. Filter high-pressure differential alarm.
 - d. Relief-air fan operation.
 - e. Smoke and firestat alarms.
29. After startup and performance testing and prior to Substantial Completion, replace existing filters with new filters.

3.8 ADJUSTING

- A. Adjust damper linkages for proper damper operation.
- B. Comply with requirements in Section 230593 "Testing, Adjusting, and Balancing for HVAC" for air-handling system testing, adjusting, and balancing.
- C. Occupancy Adjustments: When requested within 12 months from date of Substantial Completion, provide on-site assistance in adjusting system to suit actual occupied conditions. Provide up to two visits to Project during other-than-normal occupancy hours for this purpose.

3.9 CLEANING

- A. After completing system installation and testing, adjusting, and balancing RTUs and air-distribution systems, clean RTUs internally to remove foreign material and construction dirt and dust. Clean fan wheels, cabinets, dampers, coils, and filter housings, and install new, clean filters.

3.10 FIELD QUALITY CONTROL

- A. Testing Agency: Engage a qualified testing agency to perform tests and inspections.
- B. Perform tests and inspections with the assistance of a factory-authorized service representative.
- C. Tests and Inspections:
 - 1. After installing RTUs and after electrical circuitry has been energized, test units for compliance with requirements.
 - 2. Inspect for and remove shipping bolts, blocks, and tie-down straps.
 - 3. Operational Test: After electrical circuitry has been energized, start units to confirm proper motor rotation and unit operation.
 - 4. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.
- D. RTU will be considered defective if it does not pass tests and inspections.
- E. Prepare test and inspection reports.

3.11 DEMONSTRATION

- A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, and maintain RTUs.

END OF SECTION 237416.11

SECTION 238129 – VARIABLE-REFRIGERANT-FLOW HVAC SYSTEMS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes: VRF HVAC systems.
 - 1. Indoor, concealed, ceiling-mounted units for ducting.
 - 2. Indoor, recessed, ceiling-mounted units.
 - 3. Indoor, energy recovery ventilator.
 - 4. Outdoor, air-source heat-pump units.
 - 5. System controls.
 - 6. System refrigerant and oil.
 - 7. System condensate drain piping.
 - 8. System refrigerant piping.
 - 9. System control cable.

1.2 DEFINITIONS

- A. Heat-Pump System Operation: System capable of operation with all zones in either heating or cooling, but not with simultaneous heating and cooling zones that transfer heat between zones.
- B. Low Voltage: As defined in NFPA 70 for circuits and equipment operating at less than 50 V or for remote-control, signaling power-limited circuits.
- C. Plenum: A space forming part of the air distribution system to which one or more air ducts are connected. An air duct is a passageway, other than a plenum, for transporting air to or from heating, ventilating, or air-conditioning equipment.
- D. Two-Pipe System Design: One refrigerant vapor line and one refrigerant liquid line connect a single outdoor unit or multiple manifold outdoor units in a single system to associated system HRCUs. One refrigerant liquid line and refrigerant vapor line connect HRCUs to associated indoor units. HRCUs used in two pipe systems act as an intermediate heat exchanger and include diverting valves and gas/liquid separators to move high and low pressure refrigerant between indoor units.
- E. VRF: Variable refrigerant flow.

1.3 ACTION SUBMITTALS

- A. Product Data: For VRF HVAC system components.
 - 1. Include construction details, material descriptions, dimensions of individual components and profiles, and finishes for indoor and outdoor units.
 - 2. Include rated capacities, operating characteristics, electrical characteristics, and furnished specialties and accessories.
 - 3. Include operating performance at design conditions and at extreme maximum and minimum outdoor ambient conditions.
 - 4. Include description of system controllers, dimensions, features, control interfaces and connections, power requirements, and connections.

5. Include system operating sequence of operation in narrative form for each unique indoor- and outdoor-unit control.
6. Include description of control software features.
7. Include total refrigerant required and a comprehensive breakdown of refrigerant required by each system installed.
8. Include refrigerant type and data sheets showing compliance with requirements indicated.
9. For system design software.
10. Indicate location and type of service access.

1.4 INFORMATIONAL SUBMITTALS

A. Qualification Data:

1. For Installer: Certificate from VRF HVAC system manufacturer certifying that Installer has successfully completed prerequisite training administered by manufacturer for proper installation of systems, including but not limited to, equipment, piping, controls, and accessories indicated and furnished for installation.

B. Sample Warranties: For manufacturer's warranties.

1.5 CLOSEOUT SUBMITTALS

- ##### A. Operation and Maintenance Data: For VRF HVAC systems to include in emergency, operation, and maintenance manuals.

1.6 MAINTENANCE MATERIAL SUBMITTALS

- ##### A. Furnish extra materials that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.

1. Filters:

- a. One set(s) for each unit with replaceable filters.
- b. One set(s) for each unit type and unique size of washable filters.

1.7 QUALITY ASSURANCE

- ##### A. Installer Qualifications: An entity that employs installers and supervisors who are trained and approved by VRF HVAC system manufacturer.

1. Each employee shall be certified by manufacturer for proper installation of systems, including, but not limited to, equipment, piping, controls, and accessories indicated and furnished for installation.
2. Installer certification shall be valid and current for duration of Project.
3. Retain copies of Installer certificates on-site and make available on request.
4. Each person assigned to Project shall have demonstrated past experience.
 - a. Demonstrated past experience with products being installed for period within three consecutive years before time of bid.

- b. Demonstrated past experience on five projects of similar complexity, scope, and value.
- B. ISO Compliance: System equipment and components furnished by VRF HVAC system manufacturer shall be manufactured in an ISO 9001 and ISO 14001 facility.

1.8 DELIVERY, STORAGE, AND HANDLING

- A. Deliver and store products in a clean and dry place.
- B. Comply with manufacturer's written rigging and installation instructions for unloading and moving to final installed location.
- C. Handle products carefully to prevent damage, breaking, denting, and scoring. Do not install damaged products.
- D. Protect products from weather, dirt, dust, water, construction debris, and physical damage.
 - 1. Retain factory-applied coverings on equipment to protect finishes during construction and remove just prior to operating unit.
 - 2. Cover unit openings before installation to prevent dirt and dust from entering inside of units. If required to remove coverings during unit installation, reapply coverings over openings after unit installation and remove just prior to operating unit.
- E. Replace installed products damaged during construction.

1.9 WARRANTY

- A. Manufacturer's Warranty: Manufacturer agrees to repair or replace equipment and components that fail(s) in materials or workmanship within specified warranty period.

PART 2 - PRODUCTS

2.1 VRF HVAC SYSTEMS

- A. Source Limitations: Obtain products from single source from single manufacturer including, but not limited to, the following:
 - 1. Indoor and outdoor units, including accessories.
 - 2. Controls and software.

2.2 SYSTEM DESCRIPTION

- A. Direct-expansion (DX) VRF HVAC system(s) with variable capacity in response to varying cooling and heating loads. System shall consist of multiple indoor units, outdoor unit(s), piping, controls, and electrical power to make complete operating system(s) complying with requirements indicated.

1. Two-pipe system design.
 2. System(s) operation, heat pump as indicated on Drawings.
 3. Each system with one refrigerant circuit shared by all indoor units connected to system.
- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- C. AHRI Compliance: System and equipment performance certified according to AHRI 1230 and products listed in AHRI directory.
- D. ASHRAE Compliance:
1. ASHRAE 15: For safety code for mechanical refrigeration.
- E. UL Compliance: Comply with UL 1995.

2.3 PERFORMANCE REQUIREMENTS

- A. Service Access:
1. Provide and document service access requirements.
 2. Locate equipment, system isolation valves, and other system components that require service and inspection in easily accessible locations. Avoid locations that are difficult to access if possible.
 3. Where serviceable components are installed behind walls and above inaccessible ceilings, provide finished assembly with access doors or panels to gain access. Properly size the openings to allow for service, removal, and replacement.
 4. If less than full and unrestricted access is provided, locate components within an 18-inch reach of the finished assembly.
 5. Where ladder access is required to service elevated components, provide an installation that provides for sufficient access within ladder manufacturer's written instructions for use.
 6. Comply with OSHA regulations.
- B. System Design and Installation Requirements:
1. Design and install systems indicated according to manufacturer's recommendations and written instructions.
 2. Where manufacturer's requirements differ from requirements indicated, contact Architect for direction. The most stringent requirements should apply unless otherwise directed in writing by Architect.
- C. Isolation of Equipment: Provide isolation valves to isolate each indoor unit and outdoor unit for service, removal, and replacement without interrupting system operation.
- D. System Capacity Ratio: The sum of connected capacity of all indoor units shall be within the following range of outdoor-unit rated capacity:
1. Not less than 50 percent.
 2. Not more than 150 percent.
 3. Range acceptable to manufacturer.
- E. System Turndown: Stable operation down to 20 percent of outdoor-unit capacity.

- F. System Auto Refrigerant Charge: Each system shall have an automatic refrigerant charge function to ensure the proper amount of refrigerant is installed in system.
- G. Outdoor Conditions:
 - 1. Suitable for outdoor ambient conditions encountered.
 - a. Design equipment and supports to withstand wind loads of governing code and ASCE/SEI 7.
 - b. Provide corrosion-resistant coating for components and supports where located in coastal or industrial climates that are known to be harmful to materials and finishes.
- H. Sound Performance: Sound levels generated by operating HVAC equipment shall be within requirements indicated.
 - 1. Indoor: Within design guidelines of "2015 ASHRAE HANDBOOK- HVAC Applications."
 - 2. Outdoor: Within ordinance of governing authorities.
- I. Thermal Movements: Allow for controlled thermal movements from ambient, surface, and system temperature changes.
- J. Capacities and Characteristics: As indicated on Drawings.

2.4 INDOOR, CONCEALED, CEILING-MOUNTED UNITS FOR DUCTING

- A. Description: Factory-assembled complete unit with components, piping, wiring, and controls required for mating to ductwork, piping, power, and controls field connections.
- B. Cabinet:
 - 1. Material: Galvanized or painted steel.
 - 2. Insulation: Manufacturer's standard internal insulation, to provide thermal resistance and prevent condensation.
 - 3. Duct Connections: Extended collar or flange, or designated exterior cabinet surface, designed for attaching field-installed ductwork.
 - 4. Mounting: Manufacturer-designed provisions for field installation.
 - 5. Internal Access: Removable panels or hinged doors of adequate size for field access to internal components for inspection, cleaning, service, and replacement.
- C. DX Coil Assembly:
 - 1. Coil Casing: Aluminum, galvanized, or stainless steel.
 - 2. Coil Fins: Aluminum, mechanically bonded to tubes, with arrangement required by performance.
 - 3. Coil Tubes: Copper, of diameter and thickness required by performance.
 - 4. Expansion Valve: Electronic modulating type with linear or proportional characteristics.
 - 5. Unit Internal Tubing: Copper tubing with brazed joints.
 - 6. Unit Internal Tubing Insulation: Manufacturer's standard insulation, of thickness to prevent condensation.
 - 7. Field Piping Connections: Manufacturer's standard.
 - 8. Factory Charge: Dehydrated air or nitrogen.
 - 9. Testing: Factory pressure tested and verified to be without leaks.

D. Drain Assembly:

1. Pan: Non-ferrous material, with bottom sloped to low point drain connection.
2. Condensate Removal: Unit-mounted pump or other integral lifting mechanism, capable of lifting drain water to an elevation above top of cabinet.
3. Field Piping Connection: Non-ferrous material.

E. Fan and Motor Assembly:

1. Fan(s):
 - a. Direct-drive arrangement.
 - b. Single or multiple fans connected to a common motor shaft and driven by a single motor.
 - c. Fabricated from non-ferrous components or ferrous components with corrosion-resistant finish.
 - d. Wheels statically and dynamically balanced.
2. Motor: Brushless dc or electronically commutated with permanently lubricated bearings.
3. Motor Protection: Integral protection against thermal, overload, and voltage fluctuations.
4. Speed Settings and Control: Two (low, high), three (low, medium, high), or more than three speed settings or variable speed with a speed range of least 50 percent.
5. Vibration Control: Integral isolation to dampen vibration transmission.

F. Filter Assembly:

1. Access: Bottom, side, or rear to accommodate field installation without removing ductwork and to accommodate filter replacement without need for tools.
2. Media: If more than one filter type is indicated, Contractor has option to choose.
 - a. Replaceable: Extended surface, panel, or cartridge with antimicrobial treatment fiber media.
 - b. Washable: Manufacturer's standard filter with antimicrobial treatment.

G. Unit Accessories:

1. Outdoor Air Ventilation Kit: Connection, motorized damper, and control sized to allow sequence of operation indicated on Drawings.

H. Unit Controls:

1. Enclosure: Metal, suitable for indoor locations.
2. Factory-Installed Controller: Configurable digital control.
3. Communication: Network communication with other indoor and outdoor units.
4. Cable and Wiring: Manufacturer's standard with each connection labeled and corresponding to a unit-mounted wiring diagram.
5. Field Connection: Manufacturer's standard with each connection labeled and corresponding to a unit-mounted wiring diagram.

I. Unit Electrical:

1. Enclosure: Metal, suitable for indoor locations.
2. Field Connection: Single point connection to power unit and integral controls.
3. Disconnecting Means: Factory-mounted circuit breaker or switch.

4. Control Transformer: Manufacturer's standard. Coordinate requirements with field power supply.
5. Wiring: Manufacturer's standard with each connection labeled and corresponding to a unit-mounted wiring diagram.
6. Raceways: Enclose line voltage wiring in raceways.

2.5 INDOOR, RECESSED, CEILING-MOUNTED UNITS

- A. Description: Factory-assembled complete unit with components, piping, wiring, and controls required for mating to ductwork, piping, power, and controls field connections.
- B. Cabinet:
 1. Material: Painted steel, or coated steel frame covered by a plastic cabinet, with an architectural acceptable finish suitable for tenant occupancy on exposed surfaces.
 2. Insulation: Manufacturer's standard internal insulation, to provide thermal resistance and prevent condensation.
 3. Mounting: Manufacturer-designed provisions for field installation.
 4. Internal Access: Removable panels of adequate size for field access to internal components for inspection, cleaning, service, and replacement.
- C. DX Coil Assembly:
 1. Coil Casing: Aluminum, galvanized, or stainless steel.
 2. Coil Fins: Aluminum, mechanically bonded to tubes, with arrangement required by performance.
 3. Coil Tubes: Copper, of diameter and thickness required by performance.
 4. Expansion Valve: Electronic modulating type with linear or proportional characteristics.
 5. Internal Tubing: Copper tubing with brazed joints.
 6. Internal Tubing Insulation: Manufacturer's standard insulation, of thickness to prevent condensation.
 7. Field Piping Connections: Manufacturer's standard.
 8. Factory Charge: Dehydrated air or nitrogen.
 9. Testing: Factory pressure tested and verified to be without leaks.
- D. Drain Assembly:
 1. Pan: Non-ferrous material, with bottom sloped to low point drain connection.
 2. Condensate Removal: Unit-mounted pump or other integral lifting mechanism, capable of lifting drain water to an elevation above top of cabinet.
 3. Field Piping Connection: Non-ferrous material.
- E. Fan and Motor Assembly:
 1. Fan(s):
 - a. Direct-drive arrangement.
 - b. Single or multiple fans connected to a common motor shaft and driven by a single motor.
 - c. Fabricated from non-ferrous components or ferrous components with corrosion protection finish.
 - d. Wheels statically and dynamically balanced.
 2. Motor: Brushless dc or electronically commutated with permanently lubricated bearings.

3. Motor Protection: Integral protection against thermal, overload, and voltage fluctuations.
4. Speed Settings and Control: Two (low, high), three (low, medium, high), or more than three speed settings or variable speed with a speed range of least 50 percent.
5. Vibration Control: Integral isolation to dampen vibration transmission.

F. Filter Assembly:

1. Access: Bottom, to accommodate filter replacement without the need for tools.
2. Media: If more than one filter type is indicated, Contractor has option to choose.
 - a. Replaceable: Extended surface, panel, or cartridge with antimicrobial treatment fiber media.
 - b. Washable: Manufacturer's standard filter with antimicrobial treatment.

G. Discharge-Air Grille Assembly: Mounted in bottom of unit cabinet.

1. Discharge Pattern: One-, two-, three-, or four-way throw as indicated on Drawings.

H. Return-Air Grille Assembly: Manufacturer's standard grille mounted in bottom of unit cabinet.

I. Outdoor Air Ventilation Connection: Sheet metal knockout for optional connection to outdoor air ventilation duct.

J. Unit Accessories:

1. Outdoor Air Ventilation Kit: Connection, motorized damper, and control to satisfy unit control sequence of operation indicated on Drawings.

K. Unit Controls:

1. Enclosure: Manufacturer's standard, and suitable for indoor locations.
2. Factory-Installed Controller: Configurable digital control.
3. Communication: Network communication with other indoor units and outdoor unit(s).
4. Cable and Wiring: Manufacturer's standard with each connection labeled and corresponding to a unit-mounted wiring diagram.
5. Field Connection: Manufacturer's standard with each connection labeled and corresponding to a unit-mounted wiring diagram.

L. Unit Electrical:

1. Enclosure: Manufacturer's standard, and suitable for indoor locations.
2. Field Connection: Single point connection to power entire unit and integral controls.
3. Disconnecting Means: Factory-mounted circuit breaker or switch, complying with NFPA 70.
4. Control Transformer: Manufacturer's standard. Coordinate requirements with field power supply.
5. Wiring: Manufacturer's standard with each connection labeled and corresponding to a unit-mounted wiring diagram.
6. Raceways: Enclose line voltage wiring in raceways to comply with NFPA 70.

2.6 INDOOR, ENERGY RECOVERY VENTILATOR

- A. Description: Factory-assembled complete unit with components, wiring, and controls required for mating to ductwork, power, and controls field connections.

B. Cabinet:

1. Material: Galvanized steel.
2. Insulation: Manufacturer's standard internal insulation.
3. Duct Connections: Extended collar or flange, or designated exterior cabinet surface, designed for attaching field-installed ductwork.
4. Mounting: Manufacturer-designed provisions for field installation.
5. Internal Access: Removable panels or hinged doors of adequate size for field access to internal components for inspection, cleaning, service, and replacement.

C. Damper Assemblies:

1. Outdoor Air Intake and Exhaust Air Discharge:
 - a. Low-leakage damper with spring return electric actuator to fail closed on loss of power.
 - b. Damper controlled by unit to open when unit is operating and close when unit off.
2. Energy Recovery Heat-Exchanger Bypass:
 - a. Low leakage damper with electric actuator with integral controls to bypass outdoor air around the energy recovery heat exchanger during times of favorable weather, and there is no energy-saving benefit to circulate air across the energy recovery heat exchanger.

D. Fan and Motor Assemblies: Separate fan and motor assemblies for supply and exhaust airstreams with control for equal airflow.

1. Fan(s):
 - a. Direct-drive arrangement.
 - b. Fabricated from non-ferrous components or ferrous components with corrosion protection finish.
 - c. Wheels statically and dynamically balanced.
2. Motor: Brushless dc or electronically commutated with permanently lubricated bearings.
3. Motor Protection: Integral protection against thermal, overload, and voltage fluctuations.
4. Speed Settings and Control: Two (low, high), three (low, medium, high), or more than three speed settings or variable speed with a speed range of least 50 percent.
5. Vibration Control: Integral isolation to dampen vibration transmission.

E. Filter Assemblies: Separate filter assemblies for outdoor air and exhaust airstreams entering energy recovery heat exchanger.

1. Access: To accommodate filter replacement without the need for tools.
2. Replaceable Media: Extended surface, panel, or cartridge with antimicrobial treatment fiber media.

F. Energy Recovery Heat Exchanger:

1. Total (sensible and latent) energy exchange between outdoor air and exhaust airstreams with performance indicated on Drawings.
2. Fixed element with no moving parts.
3. AHRI 1060 certified and bearing the AHRI label.

G. Unit Accessories:

1. Electric Duct Preheater:
 - a. Heater operation interlocked with energy recovery ventilator unit.
 - b. Heater with integral controls to control outdoor air temperature entering energy recovery ventilator unit to a temperature set-point determined by energy recovery ventilator unit manufacturer.
 - c. Listed and labeled.

H. Unit Controls:

1. Enclosure: Metal, similar to enclosure, and suitable for indoor locations.
2. Factory-Installed Controller: Configurable digital control.
3. Communication: Network communication with other indoor units and outdoor unit(s).
4. Cable and Wiring: Manufacturer's standard with each connection labeled and corresponding to a unit-mounted wiring diagram.
5. Field Connection: Manufacturer's standard with each connection labeled and corresponding to a unit-mounted wiring diagram.

I. Unit Electrical:

1. Enclosure: Metal, similar to enclosure, and suitable for indoor locations.
2. Field Connection: Single point connection to power entire unit and integral controls.
3. Disconnecting Means: Factory-mounted circuit breaker or switch, complying with NFPA 70.
4. Control Transformer: Manufacturer's standard. Coordinate requirements with field power supply.
5. Wiring: Manufacturer's standard with each connection labeled and corresponding to a unit-mounted wiring diagram.
6. Raceways: Enclose line voltage wiring in raceways to comply with NFPA 70.

2.7 OUTDOOR, AIR-SOURCE HEAT-PUMP UNITS

A. Description: Factory-assembled and -tested complete unit with components, piping, wiring, and controls required for mating to piping, power, and controls field connections.

1. Specially designed for use in systems with either all heating or all cooling demands, but not for use in systems with simultaneous heating and cooling.
2. Systems shall consist of one unit, or multiple unit modules that are designed by variable refrigerant system manufacturer for field interconnection to make a single refrigeration circuit that connects multiple indoor units.
3. All units installed shall be from the same product development generation.

B. Cabinet:

1. Galvanized steel and coated with a corrosion-resistant finish.
 - a. Coating with documented salt spray test performance of 1000 hours according ASTM B117 surface scratch test (SST) procedure.
2. Mounting: Manufacturer-designed provisions for field installation.
3. Internal Access: Removable panels or hinged doors of adequate size for field access to internal components for inspection, cleaning, service, and replacement.

C. Compressor and Motor Assembly:

1. One or more positive-displacement, direct-drive and hermetically sealed scroll compressor(s) with inverter drive and turndown to 15 percent of rated capacity.
2. Protection: Integral protection against the following:
 - a. High refrigerant pressure.
 - b. Low oil level.
 - c. High oil temperature.
 - d. Thermal and overload.
 - e. Voltage fluctuations.
 - f. Phase failure and phase reversal.
 - g. Short cycling.
3. Speed Control: Variable to automatically maintain refrigerant suction and condensing pressures while varying refrigerant flow to satisfy system cooling and heating loads.
4. Vibration Control: Integral isolation to dampen vibration transmission.
5. Oil management system to ensure safe and proper lubrication over entire operating range.
6. Crankcase heaters with integral control to maintain safe operating temperature.
7. Fusible plug.

D. Condenser Coil Assembly:

1. Plate Fin Coils:
 - a. Casing: Aluminum, galvanized, or stainless steel.
 - b. Fins: Aluminum or copper, mechanically bonded to tubes, with arrangement required by performance.
 - c. Tubes: Copper, of diameter and thickness required by performance.
2. Coating: Corrosion resistant.

E. Condenser Fan and Motor Assembly:

1. Fan(s): Propeller type.
 - a. Direct-drive arrangement.
 - b. Fabricated from non-ferrous components or ferrous components with corrosion protection finish to match performance indicated for condenser coil.
 - c. Statically and dynamically balanced.
2. Fan Guards: Removable safety guards complying with OSHA regulations. If using metal materials, coat with corrosion-resistant coating to match performance indicated for condenser coil.
3. Motor(s): Brushless dc or electronically commutated with permanently lubricated bearings and rated for outdoor duty.
4. Motor Protection: Integral protection against thermal, overload, and voltage fluctuations.
5. Speed Settings and Control: Variable speed with a speed range of least 75 percent.
6. Vibration Control: Integral isolation to dampen vibration transmission.

F. Drain Pan: If required by manufacturer's design, provide unit with non-ferrous drain pan with bottom sloped to a low point drain connection.

G. Unit Controls:

1. Enclosure: Manufacturer's standard, and suitable for unprotected outdoor locations.
2. Factory-Installed Controller: Configurable digital control.
3. Communication: Network communication with indoor units and other outdoor unit(s).
4. Cable and Wiring: Manufacturer's standard with each connection labeled and corresponding to a unit-mounted wiring diagram.
5. Field Connection: Manufacturer's standard with each connection labeled and corresponding to a unit-mounted wiring diagram.

H. Unit Electrical:

1. Enclosure: Metal, similar to enclosure, and suitable for unprotected outdoor locations.
2. Field Connection: Single point connection to power entire unit and integral controls.
3. Disconnecting Means: Factory-mounted circuit breaker or switch, complying with NFPA 70.
4. Control Transformer: Manufacturer's standard. Coordinate requirements with field power supply.
5. Wiring: Manufacturer's standard with each connection labeled and corresponding to a unit-mounted wiring diagram.
6. Raceways: Enclose line voltage wiring in raceways to comply with NFPA 70.

- I. Unit Hardware: Zinc-plated steel, or stainless steel. Coat exposed surfaces with additional corrosion-resistant coating if required to prevent corrosion when exposed to salt spray test for 1000 hours according ASTM B117.

J. Unit Piping:

1. Unit Tubing: Copper tubing with brazed joints.
2. Unit Tubing Insulation: Manufacturer's standard insulation, of thickness to prevent condensation.
3. Field Piping Connections: Manufacturer's standard.
4. Factory Charge: Dehydrated air or nitrogen.
5. Testing: Factory pressure tested and verified to be without leaks.

2.8 SYSTEM CONTROLS

A. General Requirements:

1. Network: Indoor units and outdoor units shall include integral controls and connect through a TIA-485A or manufacturer-selected control network.
2. Network Communication Protocol: Manufacturer proprietary or open control communication between interconnected units.
3. Operator Interface:
 - a. Operators shall interface with system and unit controls through the following:
 - 1) Operator interfaces integral to controllers.
 - b. Users shall be capable of interface with controllers for indoor units control to extent privileges are enabled. Control features available to users shall include the following:
 - 1) On/off control.
 - 2) Temperature set-point adjustment.

2.9 SYSTEM REFRIGERANT AND OIL

A. Refrigerant:

1. As required by VRF HVAC system manufacturer for system to comply with performance requirements indicated.
2. ASHRAE 34, Class A2L refrigerant classification.
3. R-454B.

B. Oil:

1. As required by VRF HVAC system manufacturer and to comply with performance requirements indicated.

2.10 SYSTEM CONDENSATE DRAIN PIPING

- A. If more than one material is listed, material selection is Contractor's option.
- B. CPVC plastic pipe according to ASTM F441/F441M, Schedule 40, with socket-type pipe fittings according to ASTM F438 and solvent cement according to ASTM F493.
- C. PVC plastic pipe according to ASTM D1785, Schedule 40, with socket-type pipe fittings according to ASTM D2466 and solvent cement according to ASTM D2564, primer according to ASTM F656.

2.11 SYSTEM REFRIGERANT PIPING

- A. Comply with requirements in Section 232300 "Refrigerant Piping" for system piping requirements.

2.12 FASTENER SYSTEMS

- A. Powder-Actuated Fasteners: Threaded, zinc-coated steel stud, for use in hardened portland cement concrete with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.
- B. Mechanical-Expansion Anchors: Insert-wedge-type anchors, for use in hardened portland cement concrete; with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.
 1. Indoor Applications: Zinc-coated or stainless steel.
 2. Outdoor Applications: Stainless steel.

2.13 PIPING AND TUBING INSULATION

- A. Comply with requirements in Section 230719 "HVAC Piping Insulation" for system piping insulation requirements.

2.14 SYSTEM CONTROL CABLE

- A. Cable Rating: Listed and labeled for application according to NFPA 70.
 - 1. Flame Travel and Smoke Density in Plenums: As determined by testing identical products according to NFPA 262, by a qualified testing agency. Identify products for installation in plenums with appropriate markings of applicable testing agency.
 - a. Flame Travel Distance: 60 inches or less.
 - b. Peak Optical Smoke Density: 0.5 or less.
 - c. Average Optical Smoke Density: 0.15 or less.
 - 2. Flame Travel and Smoke Density for Riser Cables in Non-Plenum Building Spaces: As determined by testing identical products according to UL 1666.
 - 3. Flame Travel and Smoke Density for Cables in Non-Riser Applications and Non-Plenum Building Spaces: As determined by testing identical products according to UL 1685.
- B. Low-Voltage Control Cabling:
 - 1. Paired Cable: NFPA 70, Type CMG.
 - a. One pair, twisted, No. 16 AWG, stranded (19x29) or No. 18 AWG, stranded (19x30) tinned-copper conductors as required by VRF HVAC system manufacturer.
 - b. PVC insulation.
 - c. Braided or foil shielded.
 - d. PVC jacket.
 - e. Flame Resistance: Comply with UL 1685.
 - 2. Plenum-Rated, Paired Cable: NFPA 70, Type CMP.
 - a. One pair, twisted, No. 16 AWG, stranded (19x29) or No. 18 AWG, stranded (19x30) tinned-copper conductors as required by VRF HVAC system manufacturer.
 - b. PVC insulation.
 - c. Braided or foil shielded.
 - d. PVC jacket.
 - e. NFPA 262 includes the standard flame-resistance test criteria in common use for cables and conductors.
 - f. Flame Resistance: Comply with NFPA 262.

2.15 MATERIALS

- A. Steel:
 - 1. ASTM A36/A36M for carbon structural steel.
 - 2. ASTM A568/A568M for steel sheet.
- B. Stainless Steel:
 - 1. Manufacturer's standard grade for casing.
 - 2. Manufacturer's standard type, ASTM A240/A240M for bare steel exposed to airstream or moisture.

- C. Galvanized Steel: ASTM A653/A653M.
- D. Aluminum: ASTM B209.
- E. Corrosion-Resistant Coating: Coat with a corrosion-resistant coating capable of withstanding a 3000-hour salt-spray test according to ASTM B117.
 - 1. Standards:
 - a. ASTM B117 for salt spray.
 - b. ASTM D2794 for minimum impact resistance of 100 in-lb.
 - c. ASTM B3359 for cross-hatch adhesion of 5B.
 - 2. Application: Immersion or Spray.
 - 3. Thickness: 1 mil.
 - 4. Gloss: Minimum gloss of 60 on a 60-degree meter.

2.16 SOURCE QUALITY CONTROL

- A. Factory Tests: Test and inspect factory-assembled equipment.
- B. Equipment will be considered defective if it does not pass tests and inspections.
- C. Prepare test and inspection reports for historical record. Submit reports only if requested.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of the Work.
- B. Examine products before installation. Reject products that are wet, moisture damaged, or mold damaged.
- C. Examine roughing-in for piping and tubing to verify actual locations of connections before equipment installation.
- D. Examine roughing-in for ductwork to verify actual locations of connections before equipment installation.
- E. Examine roughing-in for wiring and conduit to verify actual locations of connections before equipment installation.
- F. Examine walls, floors, roofs, and outdoor pads for suitable conditions where equipment will be installed.
- G. Prepare written report, endorsed by Installer, listing conditions detrimental to performance of the Work.
- H. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 EQUIPMENT INSTALLATION, GENERAL

- A. Clearance:
 - 1. Maintain manufacturer's recommended clearances for service and maintenance.
 - 2. Maintain clearances required by governing code.
- B. Loose Components: Install components, devices, and accessories furnished by manufacturer, with equipment, that are not factory mounted.

3.3 INSTALLATION OF INDOOR UNITS

- A. Install units to be level and plumb while providing a neat and finished appearance.
- B. Unless otherwise required by VRF HVAC system manufacturer, support ceiling-mounted units from structure above using threaded rods; minimum rod size of 3/8 inch.
- C. Adjust supports of exposed and recessed units to draw units tight to adjoining surfaces.
- D. Protect finished surfaces of ceilings, floors, and walls that come in direct contact with units. Refinish or replaced damaged areas after units are installed.
- E. In rooms with ceilings, conceal piping and tubing, controls, and electrical power serving units above ceilings.
- F. In rooms without ceiling, arrange piping and tubing, controls, and electrical power serving units to provide a neat and finished appearance.
- G. Provide lateral bracing if needed to limit movement of suspended units to not more than 0.25 inch.
- H. For floor- and wall-mounted units that are exposed, conceal piping and tubing, controls, and electrical power serving units within walls.

3.4 INSTALLATION OF OUTDOOR UNITS

- A. Install units to be level and plumb while providing a neat and finished appearance.
- B. Install outdoor units on support structures indicated on Drawings.

3.5 FOR PIPING INSTALLATION

- A. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping and tubing systems. Install piping and tubing as indicated unless deviations to layout are approved on coordination drawings.
- B. Install piping and tubing in concealed locations unless otherwise indicated and except in equipment rooms and service areas.
- C. Install piping and tubing at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.

- D. Install piping and tubing above accessible ceilings to allow sufficient space for ceiling panel removal.
- E. Install piping and tubing to permit valve servicing.
- F. Install piping and tubing at indicated slopes.
- G. Install piping and tubing free of sags.
- H. Install fittings for changes in direction and branch connections.
- I. Install piping and tubing to allow application of insulation.
- J. Install groups of pipes and tubing parallel to each other, spaced to permit applying insulation with service access between insulated piping and tubing.
- K. Install sleeves for piping and tubing penetrations of walls, ceilings, and floors. Comply with requirements for sleeves specified in Section 230500 "Common Work Results for HVAC."
- L. Install escutcheons for piping and tubing penetrations of walls, ceilings, and floors. Comply with requirements for escutcheons specified in Section 230500 "Common Work Results for HVAC."

3.6 INSTALLATION OF SYSTEM CONDENSATE DRAIN PIPING

A. General Requirements for Drain Piping and Tubing:

- 1. Install a union in piping at each threaded unit connection.
- 2. Install an adjustable stainless steel hose clamp with adjustable gear operator on unit hose connections. Tighten clamp to provide a leak-free installation.
- 3. If required for unit installation, provide a trap assembly in drain piping to prevent air circulated through unit from passing through drain piping. Comply with more stringent of the following:
 - a. Details indicated on Drawings.
 - b. Manufacturer's requirements.
 - c. Governing codes.
 - d. In the absence of requirements, comply with requirements of ASHRAE handbooks.
- 4. Extend drain piping from units with drain connections to drain receptors as indicated on Drawings. If not indicated on Drawings, terminate drain connection at nearest accessible location that is not exposed to view by occupants.
- 5. Provide each 90-degree change in direction with a Y- or T-fitting. Install a threaded plug connection in the dormant side of fitting or future use as a service cleanout.

B. Gravity Drains:

- 1. Slope piping from unit connection toward drain termination at a constant slope of not less than one percent.

C. Pumped Drains:

- 1. If unit condensate pump or lift mechanism is not included with an integral check valve, install a full-size check valve in each branch pipe near unit connection to prevent backflow into unit.

3.7 INSTALLATION OF REFRIGERANT PIPING

- A. Comply with the requirements of specified in Section 232300 "Refrigerant Piping".

3.8 INSTALLATION OF METAL HANGERS AND SUPPORTS

- A. Comply with requirements in Section 230529 "Hangers and Supports for HVAC Piping and Equipment".

3.9 INSTALLATION OF PIPING AND TUBING INSULATION

- A. Seal longitudinal seams and end joints with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated. Installation to maintain a continuous vapor barrier.
- B. Insulation Installation on Pipe Fittings and Elbows:
 - 1. Install mitered sections of pipe insulation.
 - 2. Secure insulation materials and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.
- C. Insulation Installation on Valves and Pipe Specialties:
 - 1. Install preformed valve covers manufactured of same material as pipe insulation when available.
 - 2. When preformed valve covers are unavailable, install cut sections of pipe and sheet insulation to valve body. Arrange insulation to permit access to packing and to allow valve operation without disturbing insulation.
 - 3. Secure insulation to valves and specialties and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.
- D. Where PVC jackets are indicated, install with 1-inch overlap at longitudinal seams and end joints; for horizontal applications. Seal with manufacturer's recommended adhesive.
 - 1. Apply two continuous beads of adhesive to seams and joints, one bead under lap and the finish bead along seam and joint edge.
- E. Where metal jackets are indicated, install with 2-inch overlap at longitudinal seams and end joints. Overlap longitudinal seams arranged to shed water. Seal end joints with weatherproof sealant recommended by insulation manufacturer. Secure jacket with stainless steel bands 12 inches o.c. and at end joints.

3.10 INSTALLATION OF DUCT, ACCESSORIES, AND AIR OUTLETS

- A. Where installing ductwork adjacent to equipment, allow space for service and maintenance.
- B. Comply with requirements for metal ducts specified in Section 233113 "Metal Ducts."
- C. Comply with requirements for nonmetal ducts specified in Section 233116 "Nonmetal Ducts."

- D. Comply with requirements for air duct accessories specified in Section 233300 "Air Duct Accessories."
- E. Comply with requirements for flexible ducts specified in Section 233346 "Flexible Ducts."
- F. Comply with requirements for air diffusers specified in Section 233713.13 "Air Diffusers."
- G. Comply with requirements for registers and grilles specified in Section 233713.23 "Registers and Grilles."

3.11 ELECTRICAL CONNECTIONS

- A. Comply with requirements indicated on Drawings and in applicable Division 26 Sections.
- B. To extent electrical power is required for system equipment, components, and controls, and is not indicated on Drawings and addressed in the Specifications, the design for such electrical power shall be delegated to VRF HVAC system provider.
 - 1. Delegated design of electrical power to equipment, components and controls, and associated installation shall be included at no additional cost to Owner.
- C. Connect field electrical power source to each separate electrical device requiring field electrical power. Coordinate termination point and connection type with Installer.
- D. Install nameplate or acrylic label with self-adhesive back for each electrical connection indicating electrical equipment designation and circuit number feeding connection.
 - 1. Nameplate shall be laminated phenolic layers of black with engraved white letters. Letters at least 1/2 inch high.
 - 2. Locate nameplate or label where easily visible.
 - 3. Outlet boxes shall be no smaller than 2 inches wide, 3 inches high, and 2-1/2 inches deep.
 - 4. Flexible metal conduit shall not be used.
- E. Comply with TIA-569-D for pull-box sizing and length of conduit and number of bends between pull points.
- F. Install manufactured conduit sweeps and long-radius elbows if possible.
- G. Install metal conduits with grounding bushings and connect with grounding conductor to grounding system.

3.12 INSTALLATION OF SYSTEM CONTROL CABLE

- A. Comply with NECA 1.
- B. Installation Method:
 - 1. Install cables in raceways except as follows:
 - a. Within equipment and associated control enclosures.
 - b. In accessible ceiling spaces where open cable installation method may be used.

- c. In gypsum board partitions where cable may be enclosed within wall cavity.
- 2. Conceal raceway and cables except in unfinished spaces.
- C. General Requirements for Cabling:
 - 1. Comply with TIA-568-C Series of standards.
 - 2. Comply with BICSI ITSIMM, Ch. 5, "Copper Structured Cabling Systems."
 - 3. Terminate all conductors; no cable shall contain unterminated elements. Make terminations only at indicated outlets, terminals, and cross-connect and patch panels.
 - 4. Cables may not be spliced and shall be continuous from terminal to terminal. Do not splice cable.
 - 5. Cables serving a common system may be grouped in a common raceway. Install control cable in separate raceway from power wiring. Do not group conductors from different systems or different voltages.
 - 6. Secure and support cables at intervals not exceeding 30 inches and not more than 6 inches from cabinets, boxes, fittings, outlets, racks, frames, and terminals.
 - 7. Bundle, lace, and train conductors to terminal points without exceeding manufacturer's limitations on bending radii, but not less than radii specified in BICSI ITSIMM, Ch. 5, "Copper Structured Cabling Systems." Install lacing bars and distribution spools.
 - 8. Do not install bruised, kinked, scored, deformed, or abraded cable. Remove and discard cable if damaged during installation and replace it with new cable.
 - 9. Cold-Weather Installation: Bring cable to room temperature before dereeling. Do not use heat lamps for heating.
 - 10. Pulling Cable: Comply with BICSI ITSIMM, Ch. 5, "Copper Structured Cabling Systems." Monitor cable pull tensions.
 - 11. Support: Do not allow cables to lie on removable ceiling tiles or access panels.
 - 12. Secure: Fasten securely in place with hardware specifically designed and installed so as to not damage cables.
 - 13. Provide strain relief.
 - 14. Keep runs short. Allow extra length for connecting to terminals.
 - 15. Do not bend cables in a radius less than 10 times the cable OD.
 - 16. Use sleeves or grommets to protect cables from vibration at points where they pass around sharp corners and through penetrations.
 - 17. Ground wire shall be copper, and grounding methods shall comply with IEEE C2. Demonstrate ground resistance.
- D. Balanced Twisted-Pair Cable Installation:
 - 1. Comply with TIA-568-C.2.
 - 2. Do not untwist balanced twisted-pair cables more than 1/2 inch at the point of termination to maintain cable geometry.
- E. Open-Cable Installation:
 - 1. Suspend copper cable not in a wireway or pathway a minimum of 8 inches above ceilings by cable supports not more than 30 inches apart.
 - 2. Cable shall not be run through or on structural members or in contact with pipes, ducts, or other potentially damaging items. Do not run cables between structural members and corrugated panels.
- F. Separation from EMI Sources: Comply with BICSI TDMM and TIA-569-D recommendations for separating unshielded cable from potential EMI sources including electrical power wiring and equipment.

3.13 FIRESTOPPING

- A. Comply with TIA-569-D, Annex A, "Firestopping."
- B. Comply with BICSI TDMM, "Firestopping" Chapter.

3.14 GROUNDING INSTALLATION

- A. For data communication wiring, comply with TIA-607-B and with BICSI TDMM, "Bonding and Grounding (Earthing)" Chapter.

3.15 IDENTIFICATION

- A. Identify system equipment, piping, tubing, and valves. Comply with requirements for identification specified in Section 230553 "Identification for HVAC Piping and Equipment."
- B. Identify system electrical and controls components, wiring, cabling, and terminals. Comply with requirements for identification specified in Section 260553 "Identification for Electrical Systems."
 - 1. Identify each control cable on each end and at each terminal with a number-coded identification tag. Each cable shall have a unique tag.

3.16 STARTUP SERVICE

- A. Engage a VRF HVAC system manufacturer's service representative to perform system(s) startup service.
 - 1. Service representative shall be a factory-trained and -authorized service representative of VRF HVAC system manufacturer.
 - 2. Complete startup service of each separate system.
 - 3. Complete system startup service according to manufacturer's written instructions.
- B. Startup checks shall include, but not be limited to, the following:
 - 1. Check control communications of equipment and each operating component in system(s).
 - 2. Check each indoor unit's response to demand for cooling and heating.
 - 3. Check each indoor unit's response to changes in airflow settings.
 - 4. Check each indoor unit, and outdoor unit for proper condensate removal.
 - 5. Check sound levels of each indoor and outdoor unit.
- C. Installer shall accompany manufacturer's service representative during startup service and provide manufacturer's service representative with requested documentation and technical support during startup service.
 - 1. Installer shall correct deficiencies found during startup service for reverification.
- D. System Operation Report:
 - 1. After completion of startup service, manufacturer shall issue a report for each separate system.

2. Report shall include complete documentation describing each startup check, the result, and any corrective action required.
3. Manufacturer shall electronically record not less than two hours of continuous operation of each system and submit with report for historical reference.
 - a. All available system operating parameters shall be included in the information submitted.

3.17 ADJUSTING

- A. Adjust equipment and components to function smoothly, and lubricate as recommended by manufacturer.
- B. Adjust initial temperature and humidity set points. Adjust initial airflow settings and discharge airflow patterns.
- C. Set field-adjustable switches and circuit-breaker trip ranges according to VRF HVAC system manufacturer's written instructions, and as indicated.

3.18 PROTECTION

- A. Protect products from moisture and water damage. Remove and replace products that are wet, moisture damaged, or mold damaged.
- B. Protect equipment from physical damage. Replace equipment with physical damage that cannot be repaired to new condition. Observable surface imperfections shall be grounds for removal and replacement.
- C. Protect equipment from electrical damage. Replace equipment suffering electrical damage.
- D. Cover and seal openings of equipment to keep inside of equipment clean. Do not remove covers until finish work is complete.

END OF SECTION 238129

SECTION 260500 - COMMON WORK RESULTS FOR ELECTRICAL.

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Electrical equipment coordination and installation.
 - 2. Sleeves for raceways and cables.
 - 3. Sleeve seals.
 - 4. Grout.
 - 5. Common electrical installation requirements.

1.3 DEFINITIONS

- A. EPDM: Ethylene-propylene-diene terpolymer rubber.
- B. NBR: Acrylonitrile-butadiene rubber.

1.4 SUBMITTALS

- A. Product Data: For sleeve seals.

1.5 COORDINATION

- A. Coordinate arrangement, mounting, and support of electrical equipment:
 - 1. To allow maximum possible headroom unless specific mounting heights that reduce headroom are indicated.
 - 2. To provide for ease of disconnecting the equipment with minimum interference to other installations.
 - 3. To allow right of way for piping and conduit installed at required slope.
 - 4. So connecting raceways, cables, wireways, cable trays, and busways will be clear of obstructions and of the working and access space of other equipment.
- B. Coordinate installation of required supporting devices and set sleeves in cast-in-place concrete, masonry walls, and other structural components as they are constructed.
- C. Coordinate location of access panels and doors for electrical items that are behind finished surfaces or otherwise concealed. Access doors and panels are specified in Section 083113 "Access Doors and Frames."
- D. Coordinate sleeve selection and application with selection and application of firestopping specified in Section 078413 "Penetration Firestopping."

PART 2 - PRODUCTS

2.1 SLEEVES FOR RACEWAYS AND CABLES

- A. Steel Pipe Sleeves: ASTM A 53, Type E, Grade B, Schedule 40, galvanized steel, plain ends.
- B. Cast-Iron Pipe Sleeves: Cast or fabricated "wall pipe," equivalent to ductile-iron pressure pipe, with plain ends and integral water stop, unless otherwise indicated.
- C. Sleeves for Rectangular Openings: Galvanized sheet steel.
 - 1. Minimum Metal Thickness:
 - a. For sleeve cross-section rectangle perimeter less than 50 inches and no side more than 16 inches, thickness shall be 0.052-inch.
 - b. For sleeve cross-section rectangle perimeter equal to, or more than, 50 inches and one (1) or more sides equal to, or more than, 16 inches, thickness shall be 0.138-inch.

2.2 SLEEVE SEALS

- A. Description: Modular sealing device, designed for field assembly, to fill annular space between sleeve and raceway or cable.
 - 1. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one (1) of the following:
 - a. Advance Products & Systems, Inc.
 - b. Calpico, Inc.
 - c. Metraflex Co.
 - d. Pipeline Seal and Insulator, Inc.
 - 2. Sealing Elements: EPDM and/or NBR interlocking links shaped to fit surface of cable or conduit. Include type and number required for material and size of raceway or cable.
 - 3. Pressure Plates: Stainless steel. Include two (2) for each sealing element.
 - 4. Connecting Bolts and Nuts: Stainless steel of length required to secure pressure plates to sealing elements. Include one (1) for each sealing element.

2.3 GROUT

- A. Nonmetallic, Shrinkage-Resistant Grout: ASTM C 1107, factory-packaged, nonmetallic aggregate grout, noncorrosive, non-staining, mixed with water to consistency suitable for application and a 30-minute working time.

PART 3 - EXECUTION

3.1 COMMON REQUIREMENTS FOR ELECTRICAL INSTALLATION

- A. Comply with NECA 1.
- B. Measure indicated mounting heights to bottom of unit for suspended items and to center of unit for wall-mounting items.

- C. Headroom Maintenance: If mounting heights or other location criteria are not indicated, arrange and install components and equipment to provide maximum possible headroom consistent with these requirements.
- D. Equipment: Install to facilitate service, maintenance, and repair or replacement of components of both electrical equipment and other nearby installations. Connect in such a way as to facilitate future disconnecting with minimum interference with other items in the vicinity.
- E. Right of Way: Give to piping systems installed at a required slope.

3.2 SLEEVE INSTALLATION FOR ELECTRICAL PENETRATIONS

- A. Electrical penetrations occur when raceways, cables, wireways, cable trays, or busways penetrate concrete slabs, concrete or masonry walls, or fire-rated floor and wall assemblies.
- B. Concrete Slabs and Walls: Install sleeves for penetrations unless core-drilled holes or formed openings are used. Install sleeves during erection of slabs and walls.
- C. Use pipe sleeves unless penetration arrangement requires rectangular sleeved opening.
- D. Fire-Rated Assemblies: Install sleeves for penetrations of fire-rated floor and wall assemblies unless openings compatible with firestop system used are fabricated during construction of floor or wall.
- E. Cut sleeves to length for mounting flush with both surfaces of walls.
- F. Extend sleeves installed in floors 2 inches above finished floor level.
- G. Size pipe sleeves to provide ½-inch annular clear space between sleeve and raceway or cable, unless indicated otherwise.
- H. Seal space outside of sleeves with grout for penetrations of concrete and masonry
 - 1. Promptly pack grout solidly between sleeve and wall so no voids remain. Tool exposed surfaces smooth; protect grout while curing.
- I. Interior Penetrations of Non-Fire-Rated Walls and Floors: Seal annular space between sleeve and raceway or cable, using joint sealant appropriate for size, depth, and location of joint. Comply with requirements in Section 079200 "Joint Sealants."
- J. Fire-Rated-Assembly Penetrations: Maintain indicated fire rating of walls, partitions, ceilings, and floors at raceway and cable penetrations. Install sleeves and seal raceway and cable penetration sleeves with firestop materials. Comply with requirements in Section 078413 "Penetration Firestopping."
- K. Roof-Penetration Sleeves: Seal penetration of individual raceways and cables with flexible boot-type flashing units applied in coordination with roofing work.
- L. Aboveground, Exterior-Wall Penetrations: Seal penetrations using steel pipe sleeves and mechanical sleeve seals. Select sleeve size to allow for 1-inch annular clear space between pipe and sleeve for installing mechanical sleeve seals.

3.3 SLEEVE-SEAL INSTALLATION

- A. Install to seal exterior wall penetrations.

- B. Use type and number of sealing elements recommended by manufacturer for raceway or cable material and size. Position raceway or cable in center of sleeve. Assemble mechanical sleeve seals and install in annular space between raceway or cable and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.

3.4 FIRESTOPPING

- A. Apply firestopping to penetrations of fire-rated floor and wall assemblies for electrical installations to restore original fire-resistance rating of assembly. Firestopping materials and installation requirements are specified in Section 078413 "Penetration Firestopping."

3.5 COMISSIONING OF EQUIPMENT

- A. Engage a factory authorized service representative, who is familiar with this project, to participate and assist, if necessary, in the functional performance testing of the equipment include in this Division with the Commissioning Agent.

END OF SECTION 260500

SECTION 260509 - ELECTRICAL DEMOLITION REQUIREMENTS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Demolition involving electrical system as described in Contract Documents.
- B. Related Sections:
 - 1. Section 260500 "Common Work Results for Electrical"
 - 2. New and replacement work specified in appropriate specification sections.

1.3 SCHEDULING

- A. Include on Construction Schedule sequence of individual electrical demolition operations.
- B. Coordinate with Owner for equipment and materials to be removed by Owner.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION

3.1 EXAMINATION

- A. All relocations, reconnections and removals are not necessarily indicated on Drawings. All such work shall be included without additional cost to Owner.

3.2 PREPARATION

- A. Disconnect equipment that is to be removed or relocated. Carefully remove, disassemble or dismantle as required, and store in approved location on site, existing items to be reused in completed work.
- B. Where affected by demolition or new construction, relocate, extend or repair raceways, conductors, outlets and apparatus to allow continued use of electrical system. Use methods and materials as specified for new construction.

3.3 PERFORMANCE

- A. Perform drilling, cutting, block-offs and demolition work required for removal of necessary portions of electrical system. Do not cut joists, beams, girders, trusses or columns without prior written permission from Architect.

- B. Remove concealed wiring abandoned due to demolition or new construction. Remove circuits, conduits and conductors that are not to be re-used back to next active fixture, device or junction box.
- C. Patch, repair and finish surfaces affected by electrical demolition work, unless work is specifically called for under other Sections of the specifications.

3.4 CLEANING

- A. Remove obsolete raceways, conductors, apparatus and lighting fixtures promptly from site and dispose of legally.

END OF SECTION 260509

SECTION 260519 - LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following:
 - 1. Building wires and cables rated 600 V and less.
 - 2. Connectors, splices, and terminations rated 600 V and less.
 - 3. Sleeves and sleeve seals for cables.

1.3 DEFINITIONS

- A. EPDM: Ethylene-propylene-diene terpolymer rubber.
- B. NBR: Acrylonitrile-butadiene rubber.

1.4 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Qualification Data: For testing agency.
- C. Field quality-control test reports.

1.5 QUALITY ASSURANCE

- A. Testing Agency Qualifications: An independent agency, with the experience and capability to conduct the testing indicated, that is a member company of the InterNational Electrical Testing Association or is a nationally recognized testing laboratory (NRTL) as defined by OSHA in 29 CFR 1910.7, and that is acceptable to authorities having jurisdiction.
 - 1. Testing Agency's Field Supervisor: Person currently certified by the InterNational Electrical Testing Association or the National Institute for Certification in Engineering Technologies to supervise on-site testing specified in Part 3.
- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- C. Comply with NFPA 70.

1.6 COORDINATION

- A. Set sleeves in cast-in-place concrete, masonry walls, and other structural components as they are constructed.

PART 2 - PRODUCTS

2.1 CONDUCTORS AND CABLES

- A. Manufacturers: Subject to compliance with requirements, provide products by one (1) of the following:
 - 1. Alcan Products Corporation; Alcan Cable Division
 - 2. American Insulated Wire Corp.; a Leviton Company
 - 3. General Cable Corporation
 - 4. Senator Wire & Cable Company
 - 5. Southwire Company
 - 6. Belden
- B. Copper Conductors: Comply with NEMA WC 70.
- C. Conductor Insulation: Comply with NEMA WC 70 for Types THHN-THWN.
- D. Multiconductor Cable: Comply with NEMA WC 70 for metal-clad cable, Type MC, mineral-insulated, and metal-sheathed cable, Type MI with ground wire.

2.2 CONNECTORS AND SPLICES

- A. Manufacturers: Subject to compliance with requirements, provide products by one (1) of the following:
 - 1. AFC Cable Systems, Inc.
 - 2. Hubbell Power Systems, Inc.
 - 3. O-Z/Gedney; EGS Electrical Group LLC
 - 4. 3M; Electrical Products Division
 - 5. Tyco Electronics Corp.
- B. Description: Factory-fabricated connectors and splices of size, ampacity rating, material, type, and class for application and service indicated.

2.3 SLEEVES FOR CABLES

- A. Steel Pipe Sleeves: ASTM A 53, Type E, Grade B, Schedule 40, galvanized steel, plain ends.
- B. Cast-Iron Pipe Sleeves: Cast or fabricated "wall pipe," equivalent to ductile-iron pressure pipe, with plain ends and integral water stop, unless otherwise indicated.
- C. Sleeves for Rectangular Openings: Galvanized sheet steel with minimum 0.052- or 0.138-inch thickness as indicated and of length to suit application.
- D. Coordinate sleeve selection and application with selection and application of firestopping specified in Section 078413 "Penetration Firestopping."

2.4 SLEEVE SEALS

- A. Manufacturers: Subject to compliance with requirements, provide products by one (1) of the following:
 - 1. Advance Products & Systems, Inc.
 - 2. Calpico, Inc.

3. Metraflex Co.
 4. Pipeline Seal and Insulator, Inc.
- B. Description: Modular sealing device, designed for field assembly, to fill annular space between sleeve and cable.
1. Sealing Elements: EPDM interlocking links shaped to fit surface of cable or conduit. Include type and number required for material and size of raceway or cable.
 2. Pressure Plates: Stainless steel. Include two (2) for each sealing element.
 3. Connecting Bolts and Nuts: Stainless steel of length required to secure pressure plates to sealing elements. Include one (1) for each sealing element.

PART 3 - EXECUTION

3.1 CONDUCTOR MATERIAL APPLICATIONS

- A. Feeders: Copper for all feeders including service entrance cables. Solid for No. 10 AWG and smaller; stranded for No. 8 AWG and larger.
- B. Branch Circuits: Copper. Solid for No. 10 AWG and smaller; stranded for No. 8 AWG and larger.

3.2 CONDUCTOR INSULATION AND MULTICONDUCTOR CABLE APPLICATIONS AND WIRING METHODS

- A. Exposed Feeders: Type THHN-THWN, single conductors in raceway.
- B. Feeders Concealed in Ceilings, Walls, Partitions, and Crawlspace: Type THHN-THWN, single conductors in raceway.
- C. Feeders Concealed in Concrete, below Slabs-on-Grade, and Underground: Type THHN-THWN, single conductors in raceway.
- D. Feeders in Cable Tray: Type THHN-THWN, single conductors in raceway and metal-clad cable, Type MC.
- E. Exposed Branch Circuits, Including in Crawlspace: Type THHN-THWN, single conductors in raceway.
- F. Branch Circuits Concealed in Ceilings, Walls, and Partitions: Type THHN-THWN, single conductors in raceway and metal-clad cable, Type MC.
- G. Branch Circuits Concealed in Concrete, below Slabs-on-Grade, and Underground: Type THHN-THWN, single conductors in raceway.
- H. Branch Circuits in Cable Tray: Type THHN-THWN, single conductors in raceway and metal-clad cable, Type MC.
- I. Class 1 Control Circuits: Type THHN-THWN, in raceway.
- J. Class 2 Control Circuits: Type THHN-THWN, in raceway Power-limited cable, concealed in building finishes, Power-limited tray cable, in cable tray.

3.3 INSTALLATION OF CONDUCTORS AND CABLES

- A. Conceal cables in finished walls, ceilings, and floors, unless otherwise indicated.
- B. Use manufacturer-approved pulling compound or lubricant where necessary; compound used must not deteriorate conductor or insulation. Do not exceed manufacturer's recommended maximum pulling tensions and sidewall pressure values.
- C. Use pulling means, including fish tape, cable, rope, and basket-weave wire/cable grips, that will not damage cables or raceway.
- D. Install exposed cables parallel and perpendicular to surfaces of exposed structural members, and follow surface contours where possible.
- E. Support cables according to Section 260529 "Hangers and Supports for Electrical Systems."
- F. Identify and color-code conductors and cables according to Section 260553 "Identification for Electrical Systems."

3.4 CONNECTIONS

- A. Tighten electrical connectors and terminals according to manufacturer's published torque-tightening values. If manufacturer's torque values are not indicated, use those specified in UL 486A and UL 486B.
- B. Make splices and taps that are compatible with conductor material and that possess equivalent or better mechanical strength and insulation ratings than un-spliced conductors.
- C. Wiring at Outlets: Install conductor at each outlet, with at least 12 inches of slack.

3.5 SLEEVE INSTALLATION FOR ELECTRICAL PENETRATIONS

- A. Coordinate sleeve selection and application with selection and application of firestopping specified in Section 078413 "Penetration Firestopping."
- B. Concrete Slabs and Walls: Install sleeves for penetrations unless core-drilled holes or formed openings are used. Install sleeves during erection of slabs and walls.
- C. Use pipe sleeves unless penetration arrangement requires rectangular sleeved opening.
- D. Rectangular Sleeve Minimum Metal Thickness:
 - 1. For sleeve rectangle perimeter less than 50 inches and no side greater than 16 inches, thickness shall be 0.052-inch.
 - 2. For sleeve rectangle perimeter equal to, or greater than, 50 inches and one (1) or more sides equal to, or greater than, 16 inches, thickness shall be 0.138-inch.
- E. Fire-Rated Assemblies: Install sleeves for penetrations of fire-rated floor and wall assemblies unless openings compatible with firestop system used are fabricated during construction of floor or wall.
- F. Cut sleeves to length for mounting flush with both wall surfaces.
- G. Extend sleeves installed in floors 2 inches above finished floor level.

- H. Size pipe sleeves to provide 1/4-inch annular clear space between sleeve and cable unless sleeve seal is to be installed or unless seismic criteria require different clearance.
- I. Seal space outside of sleeves with grout for penetrations of concrete and masonry and with approved joint compound for gypsum board assemblies.
- J. Interior Penetrations of Non-Fire-Rated Walls and Floors: Seal annular space between sleeve and cable, using joint sealant appropriate for size, depth, and location of joint according to Section 079200 "Joint Sealants."
- K. Fire-Rated-Assembly Penetrations: Maintain indicated fire rating of walls, partitions, ceilings, and floors at cable penetrations. Install sleeves and seal with firestop materials according to Section 078413 "Penetration Firestopping."
- L. Roof-Penetration Sleeves: Seal penetration of individual cables with flexible boot-type flashing units applied in coordination with roofing work.
- M. Aboveground Exterior-Wall Penetrations: Seal penetrations using sleeves and mechanical sleeve seals. Size sleeves to allow for 1-inch annular clear space between pipe and sleeve for installing mechanical sleeve seals.

3.6 SLEEVE-SEAL INSTALLATION

- A. Install to seal exterior-wall penetrations.
- B. Use type and number of sealing elements recommended by manufacturer for cable material and size. Position cable in center of sleeve. Assemble mechanical sleeve seals and install in annular space between cable and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.

3.7 FIRESTOPPING

- A. Apply firestopping to electrical penetrations of fire-rated floor and wall assemblies to restore original fire-resistance rating of assembly according to Section 078413 "Penetration Firestopping."

3.8 FIELD QUALITY CONTROL

- A. Perform tests and inspections and prepare test reports.
- B. Tests and Inspections:
 - 1. After installing conductors and cables and before electrical circuitry has been energized, test feeder conductors for compliance with requirements.
 - 2. Perform each visual and mechanical inspection and electrical test stated in NETA Acceptance Testing Specification. Certify compliance with test parameters.
 - 3. Infrared Scanning: After Substantial Completion, but not more than sixty (60) days after Final Acceptance, perform an infrared scan of each splice in cables and conductors No. 3 AWG and larger. Remove box and equipment covers so splices are accessible to portable scanner.
 - a. Instrument: Use an infrared scanning device designed to measure temperature or to detect significant deviations from normal values. Provide calibration record for device.

- b. Record of Infrared Scanning: Prepare a certified report that identifies splices checked and that describes scanning results. Include notation of deficiencies detected, remedial action taken, and observations after remedial action.
- C. Test Reports: Prepare a written report to record the following:
 - 1. Test procedures used.
 - 2. Test results that comply with requirements.
 - 3. Test results that do not comply with requirements and corrective action taken to achieve compliance with requirements.
- D. Remove and replace malfunctioning units and retest as specified above.

END OF SECTION 260519

SECTION 260523 - CONTROL-VOLTAGE ELECTRICAL POWER CABLES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. UTP cabling.
 - 2. 50/125 and 62.5/125-micrometer, multimode optical fiber cabling.
 - 3. RS-232 cabling.
 - 4. RS-485 cabling.
 - 5. Low-voltage control cabling.
 - 6. Control-circuit conductors.
 - 7. Identification products.

1.3 DEFINITIONS

- A. Basket Cable Tray: A fabricated structure consisting of wire mesh bottom and side rails.
- B. Channel Cable Tray: A fabricated structure consisting of a one-piece, ventilated-bottom or solid-bottom channel section.
- C. EMI: Electromagnetic interference.
- D. IDC: Insulation displacement connector.
- E. Ladder Cable Tray: A fabricated structure consisting of two longitudinal side rails connected by individual transverse members (rungs).
- F. Low Voltage: As defined in NFPA 70 for circuits and equipment operating at less than 50 V or for remote-control and signaling power-limited circuits.
- G. Open Cabling: Passing telecommunications cabling through open space (e.g., between the studs of a wall cavity).
- H. RCDD: Registered Communications Distribution Designer.
- I. Solid-Bottom or Nonventilated Cable Tray: A fabricated structure consisting of integral or separate longitudinal side rails, and a bottom without ventilation openings.
- J. Trough or Ventilated Cable Tray: A fabricated structure consisting of integral or separate longitudinal rails and a bottom having openings sufficient for the passage of air and using seventy-five percent (75%) or less of the plan area of the surface to support cables.
- K. UTP: Unshielded twisted pair.

1.4 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: For cable tray layout, showing cable tray route to scale, with relationship between the tray and adjacent structural, electrical, and mechanical elements. Include the following:
 - 1. Vertical and horizontal offsets and transitions.
 - 2. Clearances for access above and to side of cable trays.
 - 3. Vertical elevation of cable trays above the floor or bottom of ceiling structure.
 - 4. Load calculations to show dead and live loads as not exceeding manufacturer's rating for tray and its support elements.
- C. Qualification Data: For qualified layout technician, installation supervisor, and field inspector.
- D. Source quality-control reports.
- E. Field quality-control reports.
- F. Maintenance Data: For wire and cable to include in maintenance manuals.

1.5 QUALITY ASSURANCE

- A. Testing Agency Qualifications: Member company of an NRTL.
 - 1. Testing Agency's Field Supervisor: Currently certified by BICSI as an RCDD to supervise on-site testing.
- B. Surface-Burning Characteristics: As determined by testing identical products according to ASTM E 84 by a qualified testing agency. Identify products with appropriate markings of applicable testing agency.
 - 1. Flame-Spread Index: 25 or less.
 - 2. Smoke-Developed Index: 50 or less.
- C. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Test cables upon receipt at Project site.
 - 1. Test optical fiber cable to determine the continuity of the strand end to end. Use optical fiber flashlight or optical loss test set.
 - 2. Test optical fiber cable on reels. Use an optical time domain reflectometer to verify the cable length and locate cable defects, splices, and connector; include the loss value of each. Retain test data and include the record in maintenance data.
 - 3. Test each pair of UTP cable for open and short circuits.

1.7 PROJECT CONDITIONS

- A. Environmental Limitations: Do not deliver or install UTP and optical fiber cables and connecting materials until wet work in spaces is complete and dry, and temporary HVAC system is

operating and maintaining ambient temperature and humidity conditions at occupancy levels during the remainder of the construction period.

PART 2 - PRODUCTS

2.1 PATHWAYS

- A. Support of Open Cabling: NRTL labeled for support of Category 5e and Category 6 cabling, designed to prevent degradation of cable performance and pinch points that could damage cable.
 - 1. Support brackets with cable tie slots for fastening cable ties to brackets.
 - 2. Lacing bars, spools, J-hooks, and D-rings.
 - 3. Straps and other devices.
- B. Cable Trays:
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one (1) of the following:
 - a. Cable Management Solutions, Inc.
 - b. Cablofil Inc.
 - c. Cooper B-Line, Inc.
 - d. Cope - Tyco/Allied Tube & Conduit
 - e. GS Metals Corp.
 - 2. Cable Tray Materials: Metal, suitable for indoors and protected against corrosion by electroplated zinc galvanizing, complying with ASTM B 633, Type 1, not less than 0.000472-inch-thick hot-dip galvanizing, complying with ASTM A 123, Grade 0.55, not less than 0.002165-inch-thick.
 - a. Basket Cable Trays: Minimum 6 inches wide and 2 inches deep. Wire mesh spacing shall not exceed 2 by 4 inches.
 - b. Trough or Ventilated Cable Trays: Minimum nominally 6 inches wide.
 - c. Ladder Cable Trays: Nominally 18 inches wide, and a rung spacing of 12 inches.
 - d. Channel Cable Trays: One-piece construction, nominally 4 inches wide. Slot spacing shall not exceed 4½ inches o.c.
 - e. Solid-Bottom or Nonventilated Cable Trays: One-piece construction, nominally 12 inches wide. Provide with solid covers.
- C. Conduit and Boxes: Comply with requirements in Section 260533 "Raceway and Boxes for Electrical Systems." Flexible metal conduit shall not be used.
 - 1. Outlet boxes shall be no smaller than 2 inches wide, 3 inches high, and 2½ inches deep.

2.2 UTP CABLE

- A. Manufacturers: Subject to compliance with requirements, provide products by one (1) of the following:
 - 1. Berk-Tek; a Nexans company
 - 2. CommScope, Inc.
 - 3. Mohawk; a division of Belden CDT
 - 4. Superior Essex Inc.

- B. Description: 100-ohm, 4-pair UTP, formed into 25-pair, binder groups covered with a blue thermoplastic jacket unless color is otherwise specified in another section.
1. Comply with ICEA S-90-661 for mechanical properties.
 2. Comply with TIA/EIA-568-B.1 for performance specifications.
 3. Comply with TIA/EIA-568-B.2, Category 6.
 4. Listed and labeled by an NRTL acceptable to authorities having jurisdiction as complying with UL 444 and NFPA 70 for the following types:
 - a. Communications, Plenum Rated: Type CMP complying with UL 1685.
 - b. Communications, Riser Rated: Type CMP or Type CMR in metallic conduit installed per NFPA 70, Article 300.22, "Wiring in Ducts, Plenums, and Other Air-Handling Spaces."

2.3 UTP CABLE HARDWARE

- A. Manufacturers: Subject to compliance with requirements, provide products by one (1) of the following:
1. Hubbell Premise Wiring
 2. Orthotronics
 3. Leviton Voice & Data Division
 4. Panduit Corp.
- B. UTP Cable Connecting Hardware: IDC type, using modules designed for punch-down caps or tools. Cables shall be terminated with connecting hardware of the same category or higher.
- C. Connecting Blocks: 110 style for Category 6. Provide blocks for the number of cables terminated on the block, plus twenty-five percent (25%) spare; integral with connector bodies, including plugs and jacks where indicated.

2.4 OPTICAL FIBER CABLE

- A. Manufacturers: Subject to compliance with requirements, provide products by one (1) of the following:
1. Berk-Tek; a Nexans company
 2. ADC
 3. Corning Cable Systems
 4. American Technology Systems Industries, Inc.
 5. Dynacom Corporation
- B. Description: Unless modified by another section - Multimode, 50/125-micrometer, 12-fiber, nonconductive, tight buffer, optical fiber cable.
1. Comply with ICEA S-83-596 for mechanical properties.
 2. Comply with TIA/EIA-568-B.3 for performance specifications.
 3. Comply with TIA/EIA-492AAAA-B for detailed specifications.
 4. Listed and labeled by an NRTL acceptable to authorities having jurisdiction as complying with UL 444, UL 1651, and NFPA 70 for the following types:
 - a. General Purpose, Nonconductive: Type OFN or OFNG.
 - b. Riser Rated, Nonconductive: Type OFNR, complying with UL 1666.
 5. Maximum Attenuation: 3.50 dB/km at 850 nm; 1.5 dB/km at 1300 nm.

6. Minimum Modal Bandwidth: 160 MHz-km at 850 nm; 500 MHz-km at 1300 nm.
7. Plenum Rated, Nonconductive: Type OFNP, complying with NFPA 262.

C. Jacket:

1. Jacket Color: Aqua for 50/125-micrometer cable.
2. Cable cordage jacket, fiber, unit, and group color shall be according to TIA/EIA-598-B.
3. Imprinted with fiber count, fiber type, and aggregate length at regular intervals not to exceed 40 inches.

2.5 OPTICAL FIBER CABLE HARDWARE

A. Manufacturers: Subject to compliance with requirements, provide products by one (1) of the following:

1. Berk-Tek; a Nexans company
2. Corning Cable Systems
3. Dynacom Corporation
4. CommScope, Inc.
5. Siemon Co. (The)

B. Cable Connecting Hardware: Comply with the Fiber Optic Connector Intermateability Standards (FOCIS) specifications of TIA/EIA-604-2, TIA/EIA-604-3-A, and TIA/EIA-604-12. Comply with TIA/EIA-568-B.3.

1. Quick-connect, simplex and duplex, Type SC, Type ST, Type LC, Type MT-RJ connectors. Insertion loss not more than 0.75 dB.
2. Type SFF connectors may be used in termination racks, panels, and equipment packages.

2.6 RS-232 CABLE

A. Plenum-Rated Cable: NFPA 70, Type CMP.

1. Paired, two (2) pairs, No. 22 AWG, stranded (7x30) tinned-copper conductors.
2. Plastic insulation.
3. Individual aluminum foil-polyester tape shielded pairs with one hundred percent (100%) shield coverage.
4. Plastic jacket.
5. Pairs are cabled on common axis with No. 24 AWG, stranded (7x32) tinned-copper drain wire.
6. Flame Resistance: Comply with NFPA 262.

2.7 RS-485 CABLE

A. Plenum-Rated Cable: NFPA 70, Type CMP.

1. Paired, two (2) pairs, No. 22 AWG, stranded (7x30) tinned-copper conductors.
2. Fluorinated ethylene propylene insulation.
3. Unshielded.
4. Fluorinated ethylene propylene jacket.
5. Flame Resistance: NFPA 262, Flame Test.

2.8 LOW-VOLTAGE CONTROL CABLE

- A. Plenum-Rated, Paired Cable: NFPA 70, Type CMP.
 - 1. One (1) pair, twisted, No. 16 AWG, stranded (19x29) tinned-copper conductors.
 - 2. PVC insulation.
 - 3. Unshielded.
 - 4. PVC jacket.
 - 5. Flame Resistance: Comply with NFPA 262.
- B. Plenum-Rated, Paired Cable: NFPA 70, Type CMP.
 - 1. One (1) pair, twisted, No. 18 AWG, stranded (19x30) tinned-copper conductors.
 - 2. Fluorinated ethylene propylene insulation.
 - 3. Unshielded.
 - 4. Plastic jacket.
 - 5. Flame Resistance: NFPA 262, Flame Test.

2.9 CONTROL-CIRCUIT CONDUCTORS

- A. Class 1 Control Circuits: Stranded copper, Type THHN-THWN, in raceway, complying with UL 83 and/or UL 44.
- B. Class 2 Control Circuits: Stranded copper, Type THHN-THWN, in raceway, Type XHHN, in raceway, power-limited cable, concealed in building finishes, power-limited tray cable, in cable tray, complying with UL 83 and/or UL 44.
- C. Class 3 Remote-Control and Signal Circuits: Stranded copper, Type TW or Type TF, complying with UL 83.

2.10 IDENTIFICATION PRODUCTS

- A. Manufacturers: Subject to compliance with requirements, provide products by one (1) of the following:
 - 1. Brady Corporation
 - 2. HellermannTyton
 - 3. Kroy LLC
 - 4. Panduit Corp.
- B. Comply with UL 969 for a system of labeling materials, including label stocks, laminating adhesives, and inks used by label printers.
- C. Comply with requirements in Section 260553 "Identification for Electrical Systems."

2.11 SOURCE QUALITY CONTROL

- A. Testing Agency: Engage a qualified testing agency to evaluate cables.
- B. Factory test UTP and optical fiber cables on reels according to TIA/EIA-568-B.1.
- C. Factory test UTP cables according to TIA/EIA-568-B.2.
- D. Factory test multimode optical fiber cables according to TIA/EIA-526-14-A and TIA/EIA-568-B.3.

- E. Cable will be considered defective if it does not pass tests and inspections.
- F. Prepare test and inspection reports.

PART 3 - EXECUTION

3.1 INSTALLATION OF PATHWAYS

- A. Cable Trays: Comply with NEMA VE 2 and TIA/EIA-569-A-7.
- B. Comply with TIA/EIA-569-A for pull-box sizing and length of conduit and number of bends between pull points.
- C. Comply with requirements in Section 260533 "Raceway and Boxes for Electrical Systems" for installation of conduits and wireways.
- D. Install manufactured conduit sweeps and long-radius elbows if possible.
- E. Pathway Installation in Equipment Rooms:
 - 1. Position conduit ends adjacent to a corner on backboard if a single piece of plywood is installed or in the corner of room if multiple sheets of plywood are installed around perimeter walls of room.
 - 2. Install cable trays to route cables if conduits cannot be located in these positions.
 - 3. Secure conduits to backboard if entering room from overhead.
 - 4. Extend conduits 3 inches above finished floor.
 - 5. Install metal conduits with grounding bushings and connect with grounding conductor to grounding system.
- F. Backboards: Install backboards with 96-inch dimension vertical. Butt adjacent sheets tightly and form smooth gap-free corners and joints.

3.2 INSTALLATION OF CONDUCTORS AND CABLES

- A. Comply with NECA 1.
- B. General Requirements for Cabling:
 - 1. Comply with TIA/EIA-568-B.1.
 - 2. Comply with BICSI ITSIM, Ch. 6, "Cable Termination Practices."
 - 3. Terminate all conductors; no cable shall contain unterminated elements. Make terminations only at indicated outlets, terminals, and cross-connect and patch panels.
 - 4. Cables may not be spliced. Secure and support cables at intervals not exceeding 30 inches and not more than 6 inches from cabinets, boxes, fittings, outlets, racks, frames, and terminals.
 - 5. Bundle, lace, and train conductors to terminal points without exceeding manufacturer's limitations on bending radii, but not less than radii specified in BICSI ITSIM, "Cabling Termination Practices" Chapter. Install lacing bars and distribution spools.
 - 6. Do not install bruised, kinked, scored, deformed, or abraded cable. Do not splice cable between termination, tap, or junction points. Remove and discard cable if damaged during installation and replace it with new cable.
 - 7. Cold-Weather Installation: Bring cable to room temperature before dereeling. Heat lamps shall not be used for heating.

8. Pulling Cable: Comply with BICSI ITSIM, Ch. 4, "Pulling Cable." Monitor cable pull tensions.
- C. UTP Cable Installation:
1. Comply with TIA/EIA-568-B.2.
 2. Install 110-style IDC termination hardware unless otherwise indicated.
 3. Do not untwist UTP cables more than 1/2 inch from the point of termination to maintain cable geometry.
- D. Installation of Control-Circuit Conductors:
1. Install wiring in raceways. Comply with requirements specified in Section 260533 "Raceway and Boxes for Electrical Systems."
- E. Optical Fiber Cable Installation:
1. Comply with TIA/EIA-568-B.3.
 2. Cable shall be terminated on connecting hardware that is rack or cabinet mounted.
- F. Open-Cable Installation:
1. Install cabling with horizontal and vertical cable guides in telecommunications spaces with terminating hardware and interconnection equipment.
 2. Suspend copper cable not in a wireway or pathway a minimum of 8 inches above ceilings by cable supports not more than 60 inches apart.
 3. Cable shall not be run through structural members or in contact with pipes, ducts, or other potentially damaging items.
- G. Separation from EMI Sources:
1. Comply with BICSI TDMM and TIA/EIA-569-A recommendations for separating unshielded copper voice and data communication cable from potential EMI sources, including electrical power lines and equipment.
 2. Separation between open communications cables or cables in nonmetallic raceways and unshielded power conductors and electrical equipment shall be as follows:
 - a. Electrical Equipment Rating Less Than 2 kVA: A minimum of 5 inches.
 - b. Electrical Equipment Rating between 2 and 5 kVA: A minimum of 12 inches.
 - c. Electrical Equipment Rating More Than 5 kVA: A minimum of 24 inches.
 3. Separation between communications cables in grounded metallic raceways and unshielded power lines or electrical equipment shall be as follows:
 - a. Electrical Equipment Rating Less Than 2 kVA: A minimum of 2½ inches.
 - b. Electrical Equipment Rating between 2 and 5 kVA: A minimum of 6 inches.
 - c. Electrical Equipment Rating More Than 5 kVA: A minimum of 12 inches.
 4. Separation between communications cables in grounded metallic raceways and power lines and electrical equipment located in grounded metallic conduits or enclosures shall be as follows:
 - a. Electrical Equipment Rating Less Than 2 kVA: No requirement.
 - b. Electrical Equipment Rating between 2 and 5 kVA: A minimum of 3 inches.
 - c. Electrical Equipment Rating More Than 5 kVA: A minimum of 6 inches.

5. Separation between Cables and Electrical Motors and Transformers, 5 kVA or HP and Larger: A minimum of 48 inches.
6. Separation between Cables and Fluorescent Fixtures: A minimum of 5 inches.

3.3 REMOVAL OF CONDUCTORS AND CABLES

- A. Remove abandoned conductors and cables.

3.4 CONTROL-CIRCUIT CONDUCTORS

- A. Minimum Conductor Sizes:
 1. Class 1 remote-control and signal circuits, No 14 AWG.
 2. Class 2 low-energy, remote-control, and signal circuits, No. 16 AWG.
 3. Class 3 low-energy, remote-control, alarm, and signal circuits, No 12 AWG.

3.5 FIRESTOPPING

- A. Comply with requirements in Section 078413 "Penetration Firestopping."
- B. Comply with TIA/EIA-569-A, Annex A, "Firestopping."
- C. Comply with BICSI TDMM, "Firestopping Systems" Article.

3.6 GROUNDING

- A. For data communication wiring, comply with ANSI-J-STD-607-A and with BICSI TDMM, "Grounding, Bonding, and Electrical Protection" Chapter.
- B. For low-voltage wiring and cabling, comply with requirements in Section 260526 "Grounding and Bonding for Electrical Systems."

3.7 IDENTIFICATION

- A. Identify system components, wiring, and cabling according to TIA/EIA-606-A. Comply with requirements for identification specified in Section 260553 "Identification for Electrical Systems."

3.8 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
- B. Tests and Inspections:
 1. Visually inspect UTP and optical fiber cable jacket materials for UL or third-party certification markings. Inspect cabling terminations to confirm color-coding for pin assignments, and inspect cabling connections to confirm compliance with TIA/EIA-568-B.1.
 2. Visually inspect cable placement, cable termination, grounding and bonding, equipment and patch cords, and labeling of all components.
 3. Test UTP cabling for DC loop resistance, shorts, opens, intermittent faults, and polarity between conductors. Test operation of shorting bars in connection blocks. Test cables after termination but not after cross connection.
 - a. Test instruments shall meet or exceed applicable requirements in TIA/EIA-568-B.2. Perform tests with a tester that complies with performance requirements in "Test

Instruments (Normative)" Annex, complying with measurement accuracy specified in "Measurement Accuracy (Informative)" Annex. Use only test cords and adapters that are qualified by test equipment manufacturer for channel or link test configuration.

4. Optical Fiber Cable Tests:
 - a. Test instruments shall meet or exceed applicable requirements in TIA/EIA-568-B.1. Use only test cords and adapters that are qualified by test equipment manufacturer for channel or link test configuration.
 - b. Link End-to-End Attenuation Tests:
 - 1) Multimode Link Measurements: Test at 850 or 1300 nm in one direction according to TIA/EIA-526-14-A, Method B, One Reference Jumper.
 - 2) Attenuation test results for links shall be less than 2.0 dB. Attenuation test results shall be less than that calculated according to equation in TIA/EIA-568-B.1.
- C. Document data for each measurement. Print data for submittals in a summary report that is formatted using Table 10.1 in BICSI TDMM as a guide, or transfer the data from the instrument to the computer, save as text files, print, and submit.
- D. End-to-end cabling will be considered defective if it does not pass tests and inspections.
- E. Prepare test and inspection reports.

END OF SECTION 260523

SECTION 260526 - GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes grounding systems and equipment, plus the following special applications:
 - 1. Foundation steel electrodes.

1.3 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. As-Built Data: Plans showing dimensioned as-built locations of grounding features specified in "Field Quality Control" Article, including the following:
 - 1. Grounding for sensitive electronic equipment.
- C. Qualification Data: For qualified testing agency and testing agency's field supervisor.
- D. Field quality-control reports.
- E. Operation and Maintenance Data: For grounding to include in emergency, operation, and maintenance manuals. In addition to items specified in Section 017823 "Operation and Maintenance Data," include the following:
 - 1. Instructions for periodic testing and inspection of grounding features on NETA MTS and NFPA 70B.
 - a. Tests shall determine if ground-resistance or impedance values remain within specified maximums, and instructions shall recommend corrective action if values do not.
 - b. Include recommended testing intervals.

1.4 QUALITY ASSURANCE

- A. Testing Agency Qualifications: Member company of NETA or an NRTL.
 - 1. Testing Agency's Field Supervisor: Currently certified by NETA to supervise on-site testing.
- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- C. Comply with UL 467 for grounding and bonding materials and equipment.

PART 2 - PRODUCTS

2.1 CONDUCTORS

- A. Insulated Conductors: Copper wire or cable insulated for 600 V unless otherwise required by applicable Code or authorities having jurisdiction.
- B. Bare Copper Conductors:
 - 1. Solid Conductors: ASTM B 3.
 - 2. Stranded Conductors: ASTM B 8.
 - 3. Tinned Conductors: ASTM B 33.
 - 4. Bonding Cable: 28 kcmil, 14 strands of No. 17 AWG conductor, ¼-inch in diameter.
 - 5. Bonding Conductor: No. 4 or No. 6 AWG, stranded conductor.
 - 6. Bonding Jumper: Copper tape, braided conductors terminated with copper ferrules; 1-5/8 inches wide and 1/16-inch-thick.
 - 7. Tinned Bonding Jumper: Tinned-copper tape, braided conductors terminated with copper ferrules; 1-5/8 inches wide and 1/16-inch-thick.
- C. Grounding Bus: Predrilled rectangular bars of annealed copper, ¼ by 4 inches in cross section, with 9/32-inch holes spaced 1-1/8 inches apart. Stand-off insulators for mounting shall comply with UL 891 for use in switchboards, 600 V. Lexan or PVC, impulse tested at 5000 V.

2.2 CONNECTORS

- A. Listed and labeled by an NRTL acceptable to authorities having jurisdiction for applications in which used and for specific types, sizes, and combinations of conductors and other items connected.
- B. Welded Connectors: Exothermic-welding kits of types recommended by kit manufacturer for materials being joined and installation conditions.
- C. Bus-bar Connectors: Mechanical type, cast silicon bronze, solderless compression and exothermic-type wire terminals, and long-barrel, two-bolt connection to ground bus bar.

2.3 GROUNDING ELECTRODES

- A. Chemical-Enhanced Grounding Electrodes: Copper tube, straight or L-shaped, charged with nonhazardous electrolytic chemical salts.
 - 1. Termination: Factory-attached No. 4/0 AWG bare conductor at least 48 inches long.
 - 2. Backfill Material: Electrode manufacturer's recommended material.

PART 3 - EXECUTION

3.1 APPLICATIONS

- A. Conductors: Install solid conductor for No. 8 AWG and smaller, and stranded conductors for No. 6 AWG and larger unless otherwise indicated.
- B. Isolated Grounding Conductors: Green-colored insulation with continuous yellow stripe. On feeders with isolated ground, identify grounding conductor where visible to normal inspection, with alternating bands of green and yellow tape, with at least three (3) bands of green and two (2) bands of yellow.

- C. Grounding Bus: Install in electrical and network equipment rooms, in rooms housing service equipment, and elsewhere as indicated.
 - 1. Install bus on insulated spacers 2 inches minimum from wall, 6 inches above finished floor unless otherwise indicated.
 - 2. Where indicated on both sides of doorways, route bus up to top of door frame, across top of doorway, and down to specified height above floor; connect to horizontal bus.
- D. Conductor Terminations and Connections:
 - 1. Pipe and Equipment Grounding Conductor Terminations: Bolted connectors.
 - 2. Underground Connections: Welded connectors except at test wells and as otherwise indicated.
 - 3. Connections to Ground Rods at Test Wells: Bolted connectors.
 - 4. Connections to Structural Steel: Welded connectors.

3.2 EQUIPMENT GROUNDING

- A. Install insulated equipment grounding conductors with the following items, in addition to those required by NFPA 70:
 - 1. Feeders and branch circuits.
 - 2. Lighting circuits.
 - 3. Receptacle circuits.
 - 4. Single-phase motor and appliance branch circuits.
 - 5. Three-phase motor and appliance branch circuits.
 - 6. Flexible raceway runs.
 - 7. Metal-clad cable runs.
 - 8. Busway Supply Circuits: Install insulated equipment grounding conductor from grounding bus in the switchgear, switchboard, or distribution panel to equipment grounding bar terminal on busway.
 - 9. Computer and Rack-Mounted Electronic Equipment Circuits: Install insulated equipment grounding conductor in branch-circuit runs from equipment-area power panels and power-distribution units.
- B. Air-Duct Equipment Circuits: Install insulated equipment grounding conductor to duct-mounted electrical devices operating at 120 V and more, including air cleaners, heaters, dampers, humidifiers, and other duct electrical equipment. Bond conductor to each unit and to air duct and connected metallic piping.
- C. Isolated Equipment Enclosure Circuits: For designated equipment supplied by a branch circuit or feeder, isolate equipment enclosure from supply circuit raceway with a nonmetallic raceway fitting listed for the purpose. Install fitting where raceway enters enclosure, and install a separate insulated equipment grounding conductor. Isolate conductor from raceway and from panelboard grounding terminals. Terminate at equipment grounding conductor terminal of the applicable derived system or service unless otherwise indicated.

3.3 INSTALLATION

- A. Grounding Conductors: Route along shortest and straightest paths possible unless otherwise indicated or required by Code. Avoid obstructing access or placing conductors where they may be subjected to strain, impact, or damage.

- B. Bonding Straps and Jumpers: Install in locations accessible for inspection and maintenance except where routed through short lengths of conduit.
 - 1. Bonding to Structure: Bond straps directly to basic structure, taking care not to penetrate any adjacent parts.
 - 2. Bonding to Equipment Mounted on Vibration Isolation Hangers and Supports: Install bonding so vibration is not transmitted to rigidly mounted equipment.
 - 3. Use exothermic-welded connectors for outdoor locations; if a disconnect-type connection is required, use a bolted clamp.
- C. Bonding Interior Metal Ducts: Bond metal air ducts to equipment grounding conductors of associated fans, blowers, electric heaters, and air cleaners. Install tinned bonding jumper to bond across flexible duct connections to achieve continuity.

3.4 LABELING

- A. Comply with requirements in Section 260553 "Identification for Electrical Systems" Article for instruction signs. The label or its text shall be green.
- B. Install labels at the telecommunications bonding conductor and grounding equalizer and at the grounding electrode conductor where exposed.
 - 1. Label Text: "If this connector or cable is loose or if it must be removed for any reason, notify the facility manager."

3.5 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
 - 1. Manufacturer's Field Service: Contractor shall engage a factory-authorized service representative to inspect components, assemblies, and equipment installations, including connections, and to assist in testing.
- B. Tests and Inspections:
 - 1. After installing grounding system but before permanent electrical circuits have been energized, test for compliance with requirements.
 - 2. Inspect physical and mechanical condition. Verify tightness of accessible, bolted, electrical connections with a calibrated torque wrench according to manufacturer's written instructions.
 - 3. Prepare dimensioned Drawings locating each grounding electrodes. Identify each by letter in alphabetical order, and key to the record of tests and observations. Include the number of rods driven and their depth at each location, and include observations of weather and other phenomena that may affect test results. Describe measures taken to improve test results.
- C. Grounding system will be considered defective if it does not pass tests and inspections.
- D. Prepare test and inspection reports.
- E. Report measured ground resistances that exceed the following values:
 - 1. Power and Lighting Equipment or System with Capacity of 500 kVA and Less: 10 ohms.
 - 2. Power and Lighting Equipment or System with Capacity of 500 to 1000 kVA: 5 ohms.

GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS

3. Power and Lighting Equipment or System with Capacity More Than 1000 kVA: 3 ohms.
 4. Power Distribution Units or Panelboards Serving Electronic Equipment: 1 ohm.
 5. Substations and Pad-Mounted Equipment: 5 ohms.
 6. Manhole Grounds: 10 ohms.
- F. Excessive Ground Resistance: If resistance to ground exceeds specified values, notify Architect promptly and include recommendations to reduce ground resistance.

END OF SECTION 260526

SECTION 260529 - HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following:
 - 1. Hangers and supports for electrical equipment and systems.
- B. Related Sections include the following:
 - 1. Section 260548 "Vibration and Seismic Controls for Electrical Systems" for products and installation requirements necessary for compliance with seismic criteria.

1.3 DEFINITIONS

- A. EMT: Electrical metallic tubing.
- B. IMC: Intermediate metal conduit.
- C. RMC: Rigid metal conduit.

1.4 PERFORMANCE REQUIREMENTS

- A. Delegated Design: Design supports for multiple raceways, including comprehensive engineering analysis by a qualified professional engineer, using performance requirements and design criteria indicated.
- B. Design supports for multiple raceways capable of supporting combined weight of supported systems and its contents.
- C. Design equipment supports capable of supporting combined operating weight of supported equipment and connected systems and components.
- D. Rated Strength: Adequate in tension, shear, and pullout force to resist maximum loads calculated or imposed for this Project, with a minimum structural safety factor of five (5) times the applied force.

1.5 SUBMITTALS

- A. Product Data: For the following:
 - 1. Steel slotted support systems.
 - 2. Nonmetallic slotted support systems.
 - 3. Associated hardware.

- B. Shop Drawings: Signed and sealed by a qualified professional engineer. Show fabrication and installation details and include calculations for the following:
 - 1. Trapeze hangers. Include Product Data for components.
 - 2. Steel slotted channel systems. Include Product Data for components.
 - 3. Nonmetallic slotted channel systems. Include Product Data for components.
 - 4. Equipment supports.

- C. Welding certificates.

1.6 QUALITY ASSURANCE

- A. Welding: Qualify procedures and personnel according to AWS D1.1, "Structural Welding Code - Steel."
- B. Comply with NFPA 70.

1.7 COORDINATION

- A. Coordinate installation of roof curbs, equipment supports, and roof penetrations. These items are specified in Section 077200 "Roof Accessories."

PART 2 - PRODUCTS

2.1 SUPPORT, ANCHORAGE, AND ATTACHMENT COMPONENTS

- A. Steel Slotted Support Systems: Comply with MFMA 4, factory-fabricated components for field assembly.
 - 1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Allied Tube & Conduit
 - b. Cooper B-Line, Inc.; a division of Cooper Industries
 - c. ERICO International Corporation
 - d. GS Metals Corp.
 - e. Thomas & Betts Corporation
 - f. Unistrut; Tyco International, Ltd.
 - g. Wesanco, Inc.
 - 2. Metallic Coatings: Hot-dip galvanized after fabrication and applied according to MFMA-4.
 - 3. Nonmetallic Coatings: Manufacturer's standard PVC, polyurethane, or polyester coating applied according to MFMA-4.
 - 4. Painted Coatings: Manufacturer's standard painted coating applied according to MFMA-4.
 - 5. Channel Dimensions: Selected for applicable load criteria.
- B. Nonmetallic Slotted Support Systems: Structural-grade, factory-formed, glass-fiber-resin channels and angles with 9/16-inch-diameter holes at a maximum of 8 inches o.c., in at least one (1) surface.

HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Allied Tube & Conduit
 - b. Cooper B-Line, Inc.; a division of Cooper Industries
 - c. Fabco Plastics Wholesale Limited
 - d. Seasafe, Inc.
 2. Fittings and Accessories: Products of channel and angle manufacturer and designed for use with those items.
 3. Fitting and Accessory Materials: Same as channels and angles, except metal items may be stainless steel.
 4. Rated Strength: Selected to suit applicable load criteria.
- C. Raceway and Cable Supports: As described in NECA 1 and NECA 101.
- D. Conduit and Cable Support Devices: Steel and malleable-iron hangers, clamps, and associated fittings, designed for types and sizes of raceway or cable to be supported.
- E. Support for Conductors in Vertical Conduit: Factory-fabricated assembly consisting of threaded body and insulating wedging plug or plugs for non-armored electrical conductors or cables in riser conduits. Plugs shall have number, size, and shape of conductor gripping pieces as required to suit individual conductors or cables supported. Body shall be malleable iron.
- F. Structural Steel for Fabricated Supports and Restraints: ASTM A 36, steel plates, shapes, and bars; black and galvanized.
- G. Mounting, Anchoring, and Attachment Components: Items for fastening electrical items or their supports to building surfaces include the following:
1. Powder-Actuated Fasteners: Threaded-steel stud, for use in hardened Portland cement concrete, steel, or wood, with tension, shear, and pullout capacities appropriate for supported loads and building materials where used.
 - a. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 1) Hilti Inc.
 - 2) ITW Ramset/Red Head; a division of Illinois Tool Works, Inc.
 - 3) MKT Fastening, LLC
 - 4) Simpson Strong-Tie Co., Inc.; Masterset Fastening Systems Unit
 2. Mechanical-Expansion Anchors: Insert-wedge-type, zinc-coated and stainless steel, for use in hardened Portland cement concrete with tension, shear, and pullout capacities appropriate for supported loads and building materials in which used.
 - a. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 1) Cooper B-Line, Inc.; a division of Cooper Industries
 - 2) Empire Tool and Manufacturing Co., Inc.
 - 3) Hilti Inc.

- 4) ITW Ramset/Red Head; a division of Illinois Tool Works, Inc.
- 5) MKT Fastening, LLC
- 3. Concrete Inserts: Steel or malleable-iron, slotted support system units similar to MSS Type 18; complying with MFMA-4 or MSS SP-58.
- 4. Clamps for Attachment to Steel Structural Elements: MSS SP-58, type suitable for attached structural element.
- 5. Through Bolts: Structural type, hex head, and high strength. Comply with ASTM A 325.
- 6. Toggle Bolts: All-steel springhead type.
- 7. Hanger Rods: Threaded steel.

2.2 FABRICATED METAL EQUIPMENT SUPPORT ASSEMBLIES

- A. Description: Welded or bolted, structural-steel shapes, shop or field fabricated to fit dimensions of supported equipment.

PART 3 - EXECUTION

3.1 APPLICATION

- A. Comply with NECA 1 and NECA 101 for application of hangers and supports for electrical equipment and systems except if requirements in this Section are stricter.
- B. Maximum Support Spacing and Minimum Hanger Rod Size for Raceway: Space supports for EMT, IMC, and RMC as required by scheduled in NECA 1, where its Table 1 lists maximum spacings less than stated in NFPA 70. Minimum rod size shall be ¼-inch in diameter.
- C. Multiple Raceways or Cables: Install trapeze-type supports fabricated with steel slotted or other support system, sized so capacity can be increased by at least twenty-five percent (25%) in future without exceeding specified design load limits.
 - 1. Secure raceways and cables to these supports with single-bolt conduit clamps using spring friction action for retention in support channel.
- D. Spring-steel clamps designed for supporting single conduits without bolts may be used for 1½-inch and smaller raceways serving branch circuits and communication systems above suspended ceilings and for fastening raceways to trapeze supports.

3.2 SUPPORT INSTALLATION

- A. Comply with NECA 1 and NECA 101 for installation requirements except as specified in this Article.
- B. Raceway Support Methods: In addition to methods described in NECA 1, EMT, IMC, and RMC may be supported by openings through structure members, as permitted in NFPA 70.
- C. Strength of Support Assemblies: Where not indicated, select sizes of components so strength will be adequate to carry present and future static loads within specified loading limits. Minimum static design load used for strength determination shall be weight of supported components plus 200 lb.
- D. Mounting and Anchorage of Surface-Mounted Equipment and Components: Anchor and fasten electrical items and their supports to building structural elements by the following methods unless otherwise indicated by code:

1. To New Concrete: Bolt to concrete inserts.
2. To Masonry: Approved toggle-type bolts on hollow masonry units and expansion anchor fasteners on solid masonry units.
3. To Existing Concrete: Expansion anchor fasteners.
4. Instead of expansion anchors, powder-actuated driven threaded studs provided with lock washers and nuts may be used in existing standard-weight concrete 4 inches thick or greater. Do not use for anchorage to lightweight-aggregate concrete or for slabs less than 4 inches thick.
5. To Steel: Welded threaded studs complying with AWS D1.1, with lock washers and nuts, Beam clamps (MSS Type 19, 21, 23, 25, or 27) complying with MSS SP-69, Spring-tension clamps.
6. To Light Steel: Sheet metal screws.
7. Items Mounted on Hollow Walls and Nonstructural Building Surfaces: Mount cabinets, panelboards, disconnect switches, control enclosures, pull and junction boxes, transformers, and other devices on slotted-channel racks attached to substrate by means that meet seismic-restraint strength and anchorage requirements.

- E. Drill holes for expansion anchors in concrete at locations and to depths that avoid reinforcing bars.

3.3 INSTALLATION OF FABRICATED METAL SUPPORTS

- A. Cut, fit, and place miscellaneous metal supports accurately in location, alignment, and elevation to support and anchor electrical materials and equipment.
- B. Field Welding: Comply with AWS D1.1.

3.4 PAINTING

- A. Touchup: Clean field welds and abraded areas of shop paint. Paint exposed areas immediately after erecting hangers and supports. Use same materials as used for shop painting. Comply with SSPC-PA 1 requirements for touching up field-painted surfaces.
1. Apply paint by brush or spray to provide minimum dry film thickness of 2.0 mils.
- B. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A 780.

END OF SECTION 260529

SECTION 260533 - RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes raceways, fittings, boxes, enclosures, and cabinets for electrical wiring.

1.3 DEFINITIONS

- A. EMT: Electrical metallic tubing.
- B. ENT: Electrical nonmetallic tubing.
- C. EPDM: Ethylene-propylene-diene terpolymer rubber.
- D. FMC: Flexible metal conduit.
- E. IMC: Intermediate metal conduit.
- F. LFMC: Liquidtight flexible metal conduit.
- G. LFNC: Liquidtight flexible nonmetallic conduit.
- H. NBR: Acrylonitrile-butadiene rubber.
- I. RMC: Rigid metal conduit.
- J. RNC: Rigid nonmetallic conduit.

1.4 SUBMITTALS

- A. Product Data: For conduit, surface raceways, wireways and fittings, floor boxes, hinged-cover enclosures, and cabinets.
- B. Shop Drawings: For the following raceway components. Include plans, elevations, sections, details, and attachments to other work.
 - 1. Custom enclosures and cabinets.
- C. Coordination Drawings: Conduit routing plans, drawn to scale, on which the following items are shown and coordinated with each other, based on input from installers of the items involved:
 - 1. Structural members in the paths of conduit groups with common supports.
 - 2. HVAC and plumbing items and architectural features in the paths of conduit groups with common supports.

- D. Manufacturer Seismic Qualification Certification: Submit certification that enclosures and cabinets and their mounting provisions, including those for internal components, will withstand seismic forces defined in Section 260548 "Vibration and Seismic Controls for Electrical Systems." Include the following:
 - 1. Basis for Certification: Indicate whether withstand certification is based on actual test of assembled components or on calculation.
 - a. The term "withstand" means "the cabinet or enclosure will remain in place without separation of any parts when subjected to the seismic forces specified and the unit will retain its enclosure characteristics, including its interior accessibility, after the seismic event."
 - 2. Dimensioned Outline Drawings of Equipment Unit: Identify center of gravity and locate and describe mounting and anchorage provisions.
 - 3. Detailed description of equipment anchorage devices on which the certification is based and their installation requirements.
- E. Qualification Data: For professional engineer and testing agency.
- F. Source quality-control test reports.

1.5 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- B. Comply with NFPA 70.

PART 2 - PRODUCTS

2.1 METAL CONDUIT AND TUBING

- A. Manufacturers: Subject to compliance with requirements, provide products by one (1) of the following:
 - 1. AFC Cable Systems, Inc.
 - 2. Alflec Inc.
 - 3. Allied Tube & Conduit; a Tyco International Ltd. Co.
 - 4. Anamet Electrical, Inc.; Anaconda Metal Hose
 - 5. Electri-Flex Co.
 - 6. Manhattan/CDT/Cole-Flex
 - 7. Maverick Tube Corporation
 - 8. O-Z Gedney; a unit of General Signal
 - 9. Wheatland Tube Company
- B. Rigid Steel Conduit: ANSI C80.1.
- C. Aluminum Rigid Conduit: ANSI C80.5.
- D. IMC: ANSI C80.6.
- E. PVC-Coated Steel Conduit: PVC-coated rigid steel conduit and IMC.

1. Comply with NEMA RN 1.
2. Coating Thickness: 0.040 inch, minimum.

F. EMT: ANSI C80.3.

G. FMC: Zinc-coated steel or aluminum.

H. LFMC: Flexible steel conduit with PVC jacket.

I. Fittings for Conduit (Including all Types and Flexible and Liquidtight), EMT, and Cable: NEMA FB 1; listed for type and size raceway with which used, and for application and environment in which installed.

1. Conduit Fittings for Hazardous (Classified) Locations: Comply with UL 886.
2. Fittings for EMT: Steel or die-cast and set-screw or compression type.
3. Coating for Fittings for PVC-Coated Conduit: Minimum thickness, 0.040-inch, with overlapping sleeves protecting threaded joints.

J. Joint Compound for Rigid Steel Conduit or IMC: Listed for use in cable connector assemblies, and compounded for use to lubricate and protect threaded raceway joints from corrosion and enhance their conductivity.

2.2 NONMETALLIC CONDUIT AND TUBING

A. Manufacturers: Subject to compliance with requirements, provide products by one (1) of the following:

1. AFC Cable Systems, Inc.
2. Anamet Electrical, Inc.; Anaconda Metal Hose
3. Arnco Corporation
4. CANTEX Inc.
5. CertainTeed Corp.; Pipe & Plastics Group
6. Condux International, Inc.
7. ElecSYS, Inc.
8. Electri-Flex Co.
9. Lamson & Sessions; Carlon Electrical Products
10. Manhattan/CDT/Cole-Flex
11. RACO; a Hubbell Company
12. Thomas & Betts Corporation

B. ENT: NEMA TC 13.

C. RNC: NEMA TC 2, Type EPC-40-PVC, unless otherwise indicated.

D. LFNC: UL 1660.

E. Fittings for ENT and RNC: NEMA TC 3; match to conduit or tubing type and material.

F. Fittings for LFNC: UL 514B.

2.3 COMMUNICATIONS CABLE RACEWAY AND FITTINGS

A. Manufacturers: Subject to compliance with requirements, provide products by one (1) of the following:

1. Arnco Corporation
2. Endot Industries Inc.
3. IPEX Inc.
4. Lamson & Sessions; Carlon Electrical Products

- B. Description: Comply with UL 2024; flexible type, approved for plenum, riser, general-use installation.

2.4 METAL WIREWAYS

- A. Manufacturers: Subject to compliance with requirements, provide products by one (1) of the following:

1. Cooper B-Line, Inc.
2. Hoffman
3. Square D; Schneider Electric

- B. Description: Sheet metal sized and shaped as indicated, NEMA 250, Type 1, unless otherwise indicated.

- C. Fittings and Accessories: Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, and other fittings to match and mate with wireways as required for complete system.

- D. Wireway Covers: Hinged type, Screw-cover type, Flanged-and-gasketed type, or as indicated.

- E. Finish: Manufacturer's standard enamel finish.

2.5 NONMETALLIC WIREWAYS

- A. Manufacturers: Subject to compliance with requirements, provide products by one (1) of the following:

1. Hoffman
2. Lamson & Sessions; Carlon Electrical Products

- B. Description: Fiberglass polyester, extruded and fabricated to size and shape indicated, with no holes or knockouts. Cover is gasketed with oil-resistant gasket material and fastened with captive screws treated for corrosion resistance. Connections are flanged, with stainless-steel screws and oil-resistant gaskets.

- C. Fittings and Accessories: Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, and other fittings to match and mate with wireways as required for complete system.

2.6 SURFACE RACEWAYS

- A. Surface Metal Raceways: Galvanized steel with snap-on covers. Manufacturer's standard enamel finish in color selected by Architect and Owner.

1. Manufacturers: Subject to compliance with requirements, provide products by one (1) of the following:

- a. Thomas & Betts Corporation
- b. Walker Systems, Inc.; Wiremold Company (The)

c. Wiremold Company (The); Electrical Sales Division

- B. Surface Nonmetallic Raceways: Two-piece construction, manufactured of rigid PVC with texture and color selected by Architect and Owner from manufacturer's entire range.

1. Manufacturers: Subject to compliance with requirements, provide products by one (1) of the following:
 - a. Butler Manufacturing Company; Walker Division
 - b. Enduro Systems, Inc.; Composite Products Division
 - c. Hubbell Incorporated; Wiring Device-Kellems Division
 - d. Lamson & Sessions; Carlon Electrical Products
 - e. Panduit Corp.
 - f. Walker Systems, Inc.; Wiremold Company (The)
 - g. Wiremold Company (The); Electrical Sales Division

2.7 BOXES, ENCLOSURES, AND CABINETS

- A. Manufacturers: Subject to compliance with requirements, provide products by one (1) of the following:
1. Cooper Crouse-Hinds; Div. of Cooper Industries, Inc.
 2. EGS/Appleton Electric
 3. Erickson Electrical Equipment Company
 4. Hoffman
 5. Hubbell Incorporated; Killark Electric Manufacturing Co. Division
 6. O-Z/Gedney; a unit of General Signal
 7. RACO; a Hubbell Company
 8. Robroy Industries, Inc.; Enclosure Division
 9. Scott Fetzer Co.; Adalet Division
 10. Spring City Electrical Manufacturing Company
 11. Thomas & Betts Corporation
 12. Walker Systems, Inc.; Wiremold Company (The)
 13. Woodhead, Daniel Company; Woodhead Industries, Inc. Subsidiary
- B. Sheet Metal Outlet and Device Boxes: NEMA OS 1.
- C. Cast-Metal Outlet and Device Boxes: NEMA FB 1, cast ferrous alloy, Type FD, with gasketed cover.
- D. Nonmetallic Outlet and Device Boxes: NEMA OS 2.
- E. Small Sheet Metal Pull and Junction Boxes: NEMA OS 1.
- F. Cast-Metal Access, Pull, and Junction Boxes: NEMA FB 1, galvanized cast iron with gasketed cover.
- G. Hinged-Cover Enclosures: NEMA 250, Type 1, with continuous-hinge cover with flush latch, unless otherwise indicated.
1. Metal Enclosures: Steel, finished inside and out with manufacturer's standard enamel.
 2. Nonmetallic Enclosures: Plastic, finished inside with radio-frequency-resistant paint.
- H. Cabinets:

1. NEMA 250, Type 1, galvanized-steel box with removable interior panel and removable front, finished inside and out with manufacturer's standard enamel.
2. Hinged door in front cover with flush latch and concealed hinge.
3. Key latch to match panelboards.
4. Metal barriers to separate wiring of different systems and voltage.
5. Accessory feet where required for freestanding equipment.

2.8 SLEEVES FOR RACEWAYS

- A. Steel Pipe Sleeves: ASTM A 53, Type E, Grade B, Schedule 40, galvanized steel, plain ends.
- B. Cast-Iron Pipe Sleeves: Cast or fabricated "wall pipe," equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop, unless otherwise indicated.
- C. Sleeves for Rectangular Openings: Galvanized sheet steel with minimum 0.052- or 0.138-inch thickness as indicated and of length to suit application.
- D. Coordinate sleeve selection and application with selection and application of firestopping.

2.9 SLEEVE SEALS

- A. Basis-of-Design Product: Subject to compliance with requirements, provide the product indicated on Drawings or a comparable product by one (1) of the following:
 1. Advance Products & Systems, Inc.
 2. Calpico, Inc.
 3. Metraflex Co.
 4. Pipeline Seal and Insulator, Inc.
- B. Description: Modular sealing device, designed for field assembly, to fill annular space between sleeve and cable.
 1. Sealing Elements: EPDM interlocking links shaped to fit surface of cable or conduit. Include type and number required for material and size of raceway or cable.
 2. Pressure Plates: Stainless steel. Include two (2) for each sealing element.
 3. Connecting Bolts and Nuts: Stainless steel of length required to secure pressure plates to sealing elements. Include one (1) for each sealing element.

PART 3 - EXECUTION

3.1 RACEWAY APPLICATION

- A. Outdoors: Apply raceway products as specified below, unless otherwise indicated:
 1. Exposed Conduit: Rigid steel conduit, IMC.
 2. Concealed Conduit, Aboveground: Rigid steel conduit, IMC, RNC, Type EPC-40-PVC, RNC, Type EPC-80-PVC.
 3. Connection to Vibrating Equipment (Including Transformers and Hydraulic, Pneumatic, Electric Solenoid, or Motor-Driven Equipment): LFMC.
 4. Boxes and Enclosures, Aboveground: NEMA 250, Type 4.
 5. Application of Handholes and Boxes for Underground Wiring:
- B. Comply with the following indoor applications, unless otherwise indicated:

1. Exposed, Not Subject to Physical Damage: EMT, Surface metal raceway, surface nonmetallic raceway (where specifically noted).
 2. Exposed, Not Subject to Severe Physical Damage: EMT.
 3. Exposed and Subject to Severe Physical Damage: Rigid steel conduit. Includes raceways in the following locations:
 - a. Corridors used for traffic of mechanized carts, forklifts, and pallet-handling units.
 - b. Mechanical rooms.
 4. Concealed in Ceilings and Interior Walls and Partitions: EMT.
 5. Connection to Vibrating Equipment (Including Transformers and Hydraulic, Pneumatic, Electric Solenoid, or Motor-Driven Equipment): FMC, except use LFMC in damp or wet locations.
 6. Damp or Wet Locations: Rigid steel conduit.
 7. Raceways for Communications Cable in Spaces Used for Environmental Air: Plenum-type, communications cable raceway, EMT.
 8. Raceways for or Communications Cable Risers in Vertical Shafts: Riser-type, communications cable raceway, EMT.
 9. Raceways for Concealed General-Purpose Distribution of Communications Cable: General-use, communications cable raceway, Riser-type, communications cable raceway, Plenum-type, communications cable raceway, EMT.
 10. Boxes and Enclosures: NEMA 250, Type 1, except use NEMA 250, Type 4, stainless steel or nonmetallic in damp or wet locations.
- C. Minimum Raceway Size: $\frac{3}{4}$ -inch trade size.
- D. Raceway Fittings: Compatible with raceways and suitable for use and location.
1. Rigid and Intermediate Steel Conduit: Use threaded rigid steel conduit fittings, unless otherwise indicated.
 2. PVC Externally Coated, Rigid Steel Conduits: Use only fittings listed for use with that material. Patch and seal all joints, nicks, and scrapes in PVC coating after installing conduits and fittings. Use sealant recommended by fitting manufacturer.
- E. Install nonferrous conduit or tubing for circuits operating above 60 Hz. Where aluminum raceways are installed for such circuits and pass through concrete, install in nonmetallic sleeve.
- F. Do not install aluminum conduits in contact with concrete.
- 3.2 INSTALLATION
- A. Comply with NECA 1 for installation requirements applicable to products specified in Part 2 except where requirements on Drawings or in this Article are stricter.
 - B. Keep raceways at least 6 inches away from parallel runs of flues and steam or hot-water pipes. Install horizontal raceway runs above water and steam piping.
 - C. Complete raceway installation before starting conductor installation.
 - D. Support raceways as specified in Section 260529 "Hangers and Supports for Electrical Systems."
 - E. Arrange stub-ups so curved portions of bends are not visible above the finished slab.

RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS

- F. Install no more than the equivalent of four (4) 90-degree bends in any conduit run except for communications conduits, for which fewer bends are allowed.
- G. Conceal conduit and EMT within finished walls, ceilings, and floors, unless otherwise indicated.
- H. Raceways Embedded in Slabs:
 - 1. Run conduit larger than 1-inch trade size, parallel or at right angles to main reinforcement. Where at right angles to reinforcement, place conduit close to slab support.
 - 2. Arrange raceways to cross building expansion joints at right angles with expansion fittings.
 - 3. Change from RNC, Type EPC-40-PVC, to rigid steel conduit, or IMC before rising above the floor.
- I. Threaded Conduit Joints, Exposed to Wet, Damp, Corrosive, or Outdoor Conditions: Apply listed compound to threads of raceway and fittings before making up joints. Follow compound manufacturer's written instructions.
- J. Raceway Terminations at Locations Subject to Moisture or Vibration: Use insulating bushings to protect conductors, including conductors smaller than No. 4 AWG.
- K. Install pull wires in empty raceways. Use polypropylene or monofilament plastic line with not less than 200-lb tensile strength. Leave at least 12 inches of slack at each end of pull wire.
- L. Raceways for Communications Cable: Install raceways, metallic and nonmetallic, rigid and flexible, as follows:
 - 1. ¾-Inch Trade Size and Smaller: Install raceways in maximum lengths of 50 feet.
 - 2. 1-Inch Trade Size and Larger: Install raceways in maximum lengths of 75 feet.
 - 3. Install with a maximum of two (2) 90-degree bends or equivalent for each length of raceway unless Drawings show stricter requirements. Separate lengths with pull or junction boxes or terminations at distribution frames or cabinets where necessary to comply with these requirements.
- M. Install raceway sealing fittings at suitable, approved, and accessible locations and fill them with listed sealing compound. For concealed raceways, install each fitting in a flush steel box with a blank cover plate having a finish similar to that of adjacent plates or surfaces. Install raceway sealing fittings at the following points:
 - 1. Where conduits pass from warm to cold locations, such as boundaries of refrigerated spaces.
 - 2. Where otherwise required by NFPA 70.
- N. Expansion-Joint Fittings for RNC: Install in each run of aboveground conduit that is located where environmental temperature change may exceed 30 deg F (17 deg C), and that has straight-run length that exceeds 25 feet.
 - 1. Install expansion-joint fittings for each of the following locations, and provide type and quantity of fittings that accommodate temperature change listed for location:
 - a. Outdoor Locations Not Exposed to Direct Sunlight: 125 deg F (70 deg C) temperature change.
 - b. Outdoor Locations Exposed to Direct Sunlight: 155 deg F (86 deg C) temperature change.

- c. Indoor Spaces: Connected with the Outdoors without Physical Separation: 125 deg F (70 deg C) temperature change.
 - d. Attics: 135 deg F (75 deg C) temperature change.
 - 2. Install fitting(s) that provide expansion and contraction for at least 0.00041 inch per foot of length of straight run per deg F (0.06 mm per meter of length of straight run per deg C) of temperature change.
 - 3. Install each expansion-joint fitting with position, mounting, and piston setting selected according to manufacturer's written instructions for conditions at specific location at the time of installation.
- O. Flexible Conduit Connections: Use maximum of 72 inches of flexible conduit for recessed and semi-recessed lighting fixtures, equipment subject to vibration, noise transmission, or movement; and for transformers and motors.
- 1. Use LFMC in damp or wet locations subject to severe physical damage.
 - 2. Use LFMC in damp or wet locations not subject to severe physical damage.
- P. Recessed Boxes in Masonry Walls: Saw-cut opening for box in center of cell of masonry block, and install box flush with surface of wall.

3.3 SLEEVE INSTALLATION FOR ELECTRICAL PENETRATIONS

- A. Coordinate sleeve selection and application with selection and application of firestopping.
- B. Concrete Slabs and Walls: Install sleeves for penetrations unless core-drilled holes or formed openings are used. Install sleeves during erection of slabs and walls.
- C. Use pipe sleeves unless penetration arrangement requires rectangular sleeved opening.
- D. Rectangular Sleeve Minimum Metal Thickness:
 - 1. For sleeve cross-section rectangle perimeter less than 50 inches and no side greater than 16 inches, thickness shall be 0.052-inch.
 - 2. For sleeve cross-section rectangle perimeter equal to, or greater than, 50 inches and one (1) or more sides equal to, or greater than, 16 inches, thickness shall be 0.138-inch.
- E. Fire-Rated Assemblies: Install sleeves for penetrations of fire-rated floor and wall assemblies unless openings compatible with firestop system used are fabricated during construction of floor or wall.
- F. Cut sleeves to length for mounting flush with both surfaces of walls.
- G. Extend sleeves installed in floors 2 inches above finished floor level.
- H. Size pipe sleeves to provide ¼-inch annular clear space between sleeve and raceway unless sleeve seal is to be installed or unless seismic criteria require different clearance.
- I. Seal space outside of sleeves with grout for penetrations of concrete and masonry and with approved joint compound for gypsum board assemblies.
- J. Interior Penetrations of Non-Fire-Rated Walls and Floors: Seal annular space between sleeve and raceway, using joint sealant appropriate for size, depth, and location of joint. Refer to Section 079200 "Joint Sealants" for materials and installation.

- K. Fire-Rated-Assembly Penetrations: Maintain indicated fire rating of walls, partitions, ceilings, and floors at raceway penetrations. Install sleeves and seal with firestop materials.
- L. Roof-Penetration Sleeves: Seal penetration of individual raceways with flexible, boot-type flashing units applied in coordination with roofing work.
- M. Aboveground, Exterior-Wall Penetrations: Seal penetrations using sleeves and mechanical sleeve seals. Select sleeve size to allow for 1-inch annular clear space between pipe and sleeve for installing mechanical sleeve seals.

3.4 SLEEVE-SEAL INSTALLATION

- A. Use type and number of sealing elements recommended by manufacturer for raceway material and size. Position raceway in center of sleeve. Assemble mechanical sleeve seals and install in annular space between raceway and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.

3.5 FIRESTOPPING

- A. Apply firestopping to electrical penetrations of fire-rated floor and wall assemblies to restore original fire-resistance rating of assembly.

3.6 PROTECTION

- A. Provide final protection and maintain conditions that ensure coatings, finishes, and cabinets are without damage or deterioration at time of Substantial Completion.
 - 1. Repair damage to galvanized finishes with zinc-rich paint recommended by manufacturer.
 - 2. Repair damage to PVC or paint finishes with matching touchup coating recommended by manufacturer.

END OF SECTION 260533

SECTION 260548 - VIBRATION AND SEISMIC CONTROLS FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following:
 - 1. Isolation pads.
 - 2. Spring isolators.
 - 3. Restrained spring isolators.
 - 4. Channel support systems.
 - 5. Restraint cables.
 - 6. Hanger rod stiffeners.
 - 7. Anchorage bushings and washers.
- B. Related Sections include the following:
 - 1. Section 260529 "Hangers and Supports for Electrical Systems" for commonly used electrical supports and installation requirements.

1.3 DEFINITIONS

- A. The IBC: International Building Code.
- B. ICC-ES: ICC-Evaluation Service.
- C. OSHPD: Office of Statewide Health Planning and Development for the State of California.

1.4 PERFORMANCE REQUIREMENTS

- A. Seismic-Restraint Loading:
 - 1. Site Class as Defined in the IBC: D.
 - 2. Assigned Seismic Use Group or Building Category as Defined in the IBC: III.
 - a. Component Importance Factor: 1.5.
 - b. Component Response Modification Factor: 5.5.
 - c. Component Amplification Factor: 1.0.
 - 3. Design Spectral Response Acceleration at Short Periods (0.2 Second).

1.5 ACTION SUBMITTALS

- A. Product Data: For the following:
 - 1. Include rated load, rated deflection, and overload capacity for each vibration isolation device.

2. Illustrate and indicate style, material, strength, fastening provision, and finish for each type and size of seismic-restraint component used.
 - a. Tabulate types and sizes of seismic restraints, complete with report numbers and rated strength in tension and shear as evaluated by an agency acceptable to authorities having jurisdiction.
 - b. Annotate to indicate application of each product submitted and compliance with requirements.
 3. Restrained-Isolation Devices: Include ratings for horizontal, vertical, and combined loads.
- B. Delegated-Design Submittal: For vibration isolation and seismic-restraint details indicated to comply with performance requirements and design criteria, including analysis data signed and sealed by the qualified professional engineer responsible for their preparation.
1. Design Calculations: Calculate static and dynamic loading due to equipment weight and operation, seismic forces required to select vibration isolators and seismic restraints.
 - a. Coordinate design calculations with wind-load calculations required for equipment mounted outdoors. Comply with requirements in other electrical Sections for equipment mounted outdoors.
 2. Indicate materials and dimensions and identify hardware, including attachment and anchorage devices.
 3. Field-fabricated supports.
 4. Seismic-Restraint Details:
 - a. Design Analysis: To support selection and arrangement of seismic restraints. Include calculations of combined tensile and shear loads.
 - b. Details: Indicate fabrication and arrangement. Detail attachments of restraints to the restrained items and to the structure. Show attachment locations, methods, and spacings. Identify components, list their strengths, and indicate directions and values of forces transmitted to the structure during seismic events. Indicate association with vibration isolation devices.
 - c. Preapproval and Evaluation Documentation: By an agency acceptable to authorities having jurisdiction, showing maximum ratings of restraint items and the basis for approval (tests or calculations).
- 1.6 INFORMATIONAL SUBMITTALS
- A. Coordination Drawings: Show coordination of seismic bracing for electrical components with other systems and equipment in the vicinity, including other supports and seismic restraints.
 - B. Qualification Data: For professional engineer and testing agency.
 - C. Welding certificates.
 - D. Field quality-control test reports.
- 1.7 QUALITY ASSURANCE
- A. Testing Agency Qualifications: An independent agency, with the experience and capability to conduct the testing indicated, that is a nationally recognized testing laboratory (NRTL) as defined by OSHA in 29 CFR 1910.7, and that is acceptable to authorities having jurisdiction.

- B. Comply with seismic-restraint requirements in the IBC unless requirements in this Section are more stringent.
- C. Welding: Qualify procedures and personnel according to AWS D1.1, "Structural Welding Code - Steel."
- D. Seismic-restraint devices shall have horizontal and vertical load testing and analysis and shall bear anchorage preapproval OPA number from OSHPD, preapproval by ICC-ES, or preapproval by another agency acceptable to authorities having jurisdiction, showing maximum seismic-restraint ratings. Ratings based on independent testing are preferred to ratings based on calculations. If preapproved ratings are not available, submittals based on independent testing are preferred. Calculations (including combining shear and tensile loads) to support seismic-restraint designs must be signed and sealed by a qualified professional engineer.
- E. Comply with NFPA 70.

PART 2 - PRODUCTS

2.1 VIBRATION ISOLATORS

- A. Manufacturers: Subject to compliance with requirements, provide products by one (1) of the following:
 - 1. Ace Mountings Co., Inc.
 - 2. Amber/Booth Company, Inc.
 - 3. California Dynamics Corporation
 - 4. Isolation Technology, Inc.
 - 5. Kinetics Noise Control
 - 6. Mason Industries
 - 7. Vibration Eliminator Co., Inc.
 - 8. Vibration Isolation
 - 9. Vibration Mountings & Controls, Inc.
- B. Pads: Arrange in single or multiple layers of sufficient stiffness for uniform loading over pad area, molded with a nonslip pattern and galvanized-steel baseplates, and factory cut to sizes that match requirements of supported equipment.
 - 1. Resilient Material: Oil- and water-resistant neoprene.
- C. Spring Isolators: Freestanding, laterally stable, open-spring isolators.
 - 1. Outside Spring Diameter: Not less than eighty percent (80%) of the compressed height of the spring at rated load.
 - 2. Minimum Additional Travel: Fifty percent (50%) of the required deflection at rated load.
 - 3. Lateral Stiffness: More than eighty percent (80%) of rated vertical stiffness.
 - 4. Overload Capacity: Support two hundred percent (200%) of rated load, fully compressed, without deformation or failure.
 - 5. Baseplates: Factory drilled for bolting to structure and bonded to ¼-inch thick, rubber isolator pad attached to baseplate underside. Baseplates shall limit floor load to 500 psig.
 - 6. Top Plate and Adjustment Bolt: Threaded top plate with adjustment bolt and cap screw to fasten and level equipment.

- D. Restrained Spring Isolators: Freestanding, steel, open-spring isolators with seismic or limit-stop restraint.
1. Housing: Steel with resilient vertical-limit stops to prevent spring extension due to weight being removed; factory-drilled baseplate bonded to ¼-inch-thick, neoprene or rubber isolator pad attached to baseplate underside; and adjustable equipment mounting and leveling bolt that acts as blocking during installation.
 2. Restraint: Seismic or limit-stop as required for equipment and authorities having jurisdiction.
 3. Outside Spring Diameter: Not less than eighty percent (80%) of the compressed height of the spring at rated load.
 4. Minimum Additional Travel: Fifty percent (50%) of the required deflection at rated load.
 5. Lateral Stiffness: More than eighty percent (80%) of rated vertical stiffness.
 6. Overload Capacity: Support two hundred percent (200%) of rated load, fully compressed, without deformation or failure.

2.2 SEISMIC-RESTRAINT DEVICES

- A. Manufacturers: Subject to compliance with requirements, provide products by one (1) of the following:
1. Amber/Booth Company, Inc.
 2. California Dynamics Corporation
 3. Cooper B-Line, Inc.; a division of Cooper Industries
 4. Hilti Inc.
 5. Loos & Co.; Seismic Earthquake Division
 6. Mason Industries
 7. TOLCO Incorporated; a brand of NIBCO INC.
 8. Unistrut; Tyco International, Ltd.
- B. General Requirements for Restraint Components: Rated strengths, features, and application requirements shall be as defined in reports by an agency acceptable to authorities having jurisdiction.
1. Structural Safety Factor: Allowable strength in tension, shear, and pullout force of components shall be at least four (4) times the maximum seismic forces to which they will be subjected.
- C. Channel Support System: MFMA-3, shop- or field-fabricated support assembly made of slotted steel channels with accessories for attachment to braced component at one end and to building structure at the other end and other matching components and with corrosion-resistant coating; and rated in tension, compression, and torsion forces.
- D. Restraint Cables: ASTM A 603 galvanized-steel cables with end connections made of steel assemblies with thimbles, brackets, swivels, and bolts designed for restraining cable service; and with a minimum of two (2) clamping bolts for cable engagement.
- E. Hanger Rod Stiffener: Steel tube or steel slotted-support-system sleeve with internally bolted connections to hanger rod. Do not weld stiffeners to rods.
- F. Bushing Assemblies for Wall-Mounted Equipment Anchorage: Assemblies of neoprene elements and steel sleeves designed for rigid equipment mountings, and matched to type and size of attachment devices.

- G. Resilient Isolation Washers and Bushings: One-piece, molded, oil- and water-resistant neoprene, with a flat washer face.
- H. Mechanical Anchor: Drilled-in and stud-wedge or female-wedge type in zinc-coated steel for interior applications and stainless steel for exterior applications. Select anchors with strength required for anchor and as tested according to ASTM E 488. Minimum length of eight (8) times diameter.
- I. Adhesive Anchor: Drilled-in and capsule anchor system containing polyvinyl or urethane methacrylate-based resin and accelerator, or injected polymer or hybrid mortar adhesive. Provide anchor bolts and hardware with zinc-coated steel for interior applications and stainless steel for exterior applications. Select anchor bolts with strength required for anchor and as tested according to ASTM E 488.

2.3 FACTORY FINISHES

- A. Finish: Manufacturer's standard paint applied to factory-assembled and -tested equipment before shipping.
 - 1. Powder coating on springs and housings.
 - 2. All hardware shall be galvanized. Hot-dip galvanize metal components for exterior use.
 - 3. Baked enamel or powder coat for metal components on isolators for interior use.
 - 4. Color-code or otherwise mark vibration isolation and seismic-control devices to indicate capacity range.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine areas and equipment to receive vibration isolation and seismic-control devices for compliance with requirements for installation tolerances and other conditions affecting performance.
- B. Examine roughing-in of reinforcement and cast-in-place anchors to verify actual locations before installation.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 APPLICATIONS

- A. Multiple Raceways or Cables: Secure raceways and cables to trapeze member with clamps approved for application by an agency acceptable to authorities having jurisdiction.
- B. Hanger Rod Stiffeners: Install hanger rod stiffeners where indicated or scheduled on Drawings to receive them and where required to prevent buckling of hanger rods due to seismic forces.
- C. Strength of Support and Seismic-Restraint Assemblies: Where not indicated, select sizes of components so strength will be adequate to carry present and future static and seismic loads within specified loading limits.

3.3 SEISMIC-RESTRAINT DEVICE INSTALLATION

- A. Equipment and Hanger Restraints:

1. Install restrained isolators on electrical equipment.
 2. Install resilient, bolt-isolation washers on equipment anchor bolts where clearance between anchor and adjacent surface exceeds 0.125-inch.
 3. Install seismic-restraint devices using methods approved by an agency acceptable to authorities having jurisdiction providing required submittals for component.
- B. Install bushing assemblies for mounting bolts for wall-mounted equipment, arranged to provide resilient media where equipment or equipment-mounting channels are attached to wall.
- C. Attachment to Structure: If specific attachment is not indicated, anchor bracing to structure at flanges of beams, at upper truss chords of bar joists, or at concrete members.
- D. Drilled-in Anchors:
1. Identify position of reinforcing steel and other embedded items prior to drilling holes for anchors. Do not damage existing reinforcing or embedded items during coring or drilling. Notify the structural engineer if reinforcing steel or other embedded items are encountered during drilling. Locate and avoid prestressed tendons, electrical and telecommunications conduit, and gas lines.
 2. Do not drill holes in concrete or masonry until concrete, mortar, or grout has achieved full design strength.
 3. Wedge Anchors: Protect threads from damage during anchor installation. Heavy-duty sleeve anchors shall be installed with sleeve fully engaged in the structural element to which anchor is to be fastened.
 4. Adhesive Anchors: Clean holes to remove loose material and drilling dust prior to installation of adhesive. Place adhesive in holes proceeding from the bottom of the hole and progressing toward the surface in such a manner as to avoid introduction of air pockets in the adhesive.
 5. Set anchors to manufacturer's recommended torque, using a torque wrench.
 6. Install zinc-coated steel anchors for interior and stainless-steel anchors for exterior applications.

3.4 ACCOMMODATION OF DIFFERENTIAL SEISMIC MOTION

- A. Install flexible connections in runs of raceways, cables, wireways, cable trays, and busways where they cross seismic joints, where adjacent sections or branches are supported by different structural elements, and where they terminate with connection to equipment that is anchored to a different structural element from the one supporting them as they approach equipment.

3.5 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
- B. Tests and Inspections:
1. Provide evidence of recent calibration of test equipment by a testing agency acceptable to authorities having jurisdiction.
 2. Schedule test with Owner, through Architect, before connecting anchorage device to restrained component (unless post connection testing has been approved), and with at least seven (7) days' advance notice.
 3. Obtain Architect's approval before transmitting test loads to structure. Provide temporary load-spreading members.
 4. Test at least four (4) of each type and size of installed anchors and fasteners selected by Architect.
 5. Test to ninety percent (90%) of rated proof load of device.

6. Measure isolator restraint clearance.
7. Measure isolator deflection.
8. Verify snubber minimum clearances.
9. If a device fails test, modify all installations of same type and retest until satisfactory results are achieved.

C. Remove and replace malfunctioning units and retest as specified above.

D. Prepare test and inspection reports.

3.6 ADJUSTING

A. Adjust isolators after isolated equipment is at operating weight.

B. Adjust limit stops on restrained spring isolators to mount equipment at normal operating height. After equipment installation is complete, adjust limit stops so they are out of contact during normal operation.

C. Adjust active height of spring isolators.

D. Adjust restraints to permit free movement of equipment within normal mode of operation.

END OF SECTION 260548

SECTION 260553 - IDENTIFICATION FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Identification for raceways.
 - 2. Identification of power and control cables.
 - 3. Identification for conductors.
 - 4. Underground-line warning tape.
 - 5. Warning labels and signs.
 - 6. Instruction signs.
 - 7. Equipment identification labels.
 - 8. Miscellaneous identification products.

1.3 SUBMITTALS

- A. Product Data: For each electrical identification product indicated.
- B. Samples: For each type of label and sign to illustrate size, colors, lettering style, mounting provisions, and graphic features of identification products.
- C. Identification Schedule: An index of nomenclature of electrical equipment and system components used in identification signs and labels.

1.4 QUALITY ASSURANCE

- A. Comply with ANSI A13.1 and IEEE C2.
- B. Comply with NFPA 70.
- C. Comply with 29 CFR 1910.144 and 29 CFR 1910.145.
- D. Comply with ANSI Z535.4 for safety signs and labels.
- E. Adhesive-attached labeling materials, including label stocks, laminating adhesives, and inks used by label printers, shall comply with UL 969.

1.5 COORDINATION

- A. Coordinate identification names, abbreviations, colors, and other features with requirements in other Sections requiring identification applications, Drawings, Shop Drawings, manufacturer's wiring diagrams, and the Operation and Maintenance Manual; and with those required by codes, standards, and 29 CFR 1910.145. Use consistent designations throughout Project.

- B. Coordinate installation of identifying devices with completion of covering and painting of surfaces where devices are to be applied.
- C. Coordinate installation of identifying devices with location of access panels and doors.
- D. Install identifying devices before installing acoustical ceilings and similar concealment.

PART 2 - PRODUCTS

2.1 POWER RACEWAY IDENTIFICATION MATERIALS

- A. Comply with ANSI A13.1 for minimum size of letters for legend and for minimum length of color field for each raceway size.
- B. Colors for Raceways Carrying Circuits at 600 V or Less:
 - 1. Black letters on an orange field.
 - 2. Legend: Indicate voltage and system or service type.
- C. Colors for Raceways Carrying Circuits at More Than 600 V:
 - 1. Black letters on an orange field.
 - 2. Legend: "DANGER CONCEALED HIGH VOLTAGE WIRING" with 3-inch-high letters on 20-inch centers.
- D. Self-Adhesive Vinyl Labels for Raceways Carrying Circuits at 600 V or Less: Preprinted, flexible label laminated with a clear, weather- and chemical-resistant coating and matching wraparound adhesive tape for securing ends of legend label.
- E. Snap-Around Labels for Raceways Carrying Circuits at 600 V or Less: Slit, pre-tensioned, flexible, preprinted, color-coded acrylic sleeve, with diameter sized to suit diameter of raceway or cable it identifies and to stay in place by gripping action.
- F. Snap-Around, Color-Coding Bands for Raceways Carrying Circuits at 600 V or Less: Slit, pre-tensioned, flexible, solid-colored acrylic sleeve, 2 inches long, with diameter sized to suit diameter of raceway or cable it identifies and to stay in place by gripping action.
- G. Tape and Stencil for Raceways Carrying Circuits More Than 600 V: 4-inch-wide black stripes on 10-inch centers diagonally over orange background that extends full length of raceway or duct and is 12 inches wide. Stop stripes at legends.
- H. Metal Tags: Brass or aluminum, 2 by 2 by 0.05 inch, with stamped legend, punched for use with self-locking cable tie fastener.
- I. Write-On Tags: Polyester tag, 0.015-inch-thick, with corrosion-resistant grommet and cable tie for attachment to conductor or cable.
 - 1. Marker for Tags: Machine-printed, permanent, waterproof, black ink marker recommended by printer manufacturer.

2.2 METAL-CLAD CABLE IDENTIFICATION MATERIALS

- A. Comply with ANSI A13.1 for minimum size of letters for legend and for minimum length of color field for each raceway and cable size.

- B. Colors for Raceways Carrying Circuits at 600 V and Less:
 - 1. Black letters on an orange field.
 - 2. Legend: Indicate voltage and system or service type.
- C. Colors for Raceways Carrying Circuits at More Than 600 V:
 - 1. Black letters on an orange field.
 - 2. Legend: "DANGER CONCEALED HIGH VOLTAGE WIRING" with 3-inch-high letters on 20-inch centers.
- D. Self-Adhesive Vinyl Labels: Preprinted, flexible label laminated with a clear, weather- and chemical-resistant coating and matching wraparound adhesive tape for securing ends of legend label.

2.3 POWER AND CONTROL CABLE IDENTIFICATION MATERIALS

- A. Comply with ANSI A13.1 for minimum size of letters for legend and for minimum length of color field for each raceway and cable size.
- B. Self-Adhesive Vinyl Labels: Preprinted, flexible label laminated with a clear, weather- and chemical-resistant coating and matching wraparound adhesive tape for securing ends of legend label.
- C. Metal Tags: Brass or aluminum, 2 by 2 by 0.05 inch, with stamped legend, punched for use with self-locking cable tie fastener.
- D. Write-On Tags: Polyester tag, 0.015-inch-thick, with corrosion-resistant grommet and cable tie for attachment to conductor or cable.
 - 1. Marker for Tags: Machine-printed, permanent, waterproof, black ink marker recommended by printer manufacturer.
- E. Snap-Around Labels: Slit, pre-tensioned, flexible, preprinted, color-coded acrylic sleeve, with diameter sized to suit diameter of raceway or cable it identifies and to stay in place by gripping action.
- F. Snap-Around, Color-Coding Bands: Slit, pre-tensioned, flexible, solid-colored acrylic sleeve, 2 inches long, with diameter sized to suit diameter of raceway or cable it identifies and to stay in place by gripping action.

2.4 CONDUCTOR IDENTIFICATION MATERIALS

- A. Color-Coding Conductor Tape: Colored, self-adhesive vinyl tape not less than 3 mils thick by 1 to 2 inches wide.
- B. Self-Adhesive Vinyl Labels: Preprinted, flexible label laminated with a clear, weather- and chemical-resistant coating and matching wraparound adhesive tape for securing ends of legend label.
- C. Snap-Around Labels: Slit, pre-tensioned, flexible, preprinted, color-coded acrylic sleeve, with diameter sized to suit diameter of raceway or cable it identifies and to stay in place by gripping action.

- D. Snap-Around, Color-Coding Bands: Slit, pre-tensioned, flexible, solid-colored acrylic sleeve, 2 inches long, with diameter sized to suit diameter of raceway or cable it identifies and to stay in place by gripping action.
- E. Marker Tapes: Vinyl or vinyl-cloth, self-adhesive wraparound type, with circuit identification legend machine printed by thermal transfer or equivalent process.
- F. Write-On Tags: Polyester tag, 0.015-inch-thick, with corrosion-resistant grommet and cable tie for attachment to conductor or cable.
 - 1. Marker for Tags: Machine-printed, permanent, waterproof, black ink marker recommended by printer manufacturer.

2.5 FLOOR MARKING TAPE

- A. 2-inch-wide, 5-mil pressure-sensitive vinyl tape, with black and white stripes and clear vinyl overlay.
- B. Furnish and install tape at location in accordance with NEC 110.26 for all electrical distribution equipment.

2.6 UNDERGROUND-LINE WARNING TAPE

- A. Tape:
 - 1. Recommended by manufacturer for the method of installation and suitable to identify and locate underground electrical and communications utility lines.
 - 2. Printing on tape shall be permanent and shall not be damaged by burial operations.
 - 3. Tape material and ink shall be chemically inert, and not subject to degrading when exposed to acids, alkalis, and other destructive substances commonly found in soils.
- B. Color and Printing:
 - 1. Comply with ANSI Z535.1 through ANSI Z535.5.
 - 2. Inscriptions for Red-Colored Tapes: ELECTRIC LINE, HIGH VOLTAGE.
 - 3. Inscriptions for Orange-Colored Tapes: TELEPHONE CABLE, CATV CABLE, COMMUNICATIONS CABLE, OPTICAL FIBER CABLE.
- C. Tag: Type ID:
 - 1. Detectable three-layer laminate, consisting of a printed pigmented polyolefin film, a solid aluminum-foil core, and a clear protective film that allows inspection of the continuity of the conductive core, bright-colored, continuous-printed on one (1) side with the inscription of the utility, compounded for direct-burial service.
 - 2. Overall Thickness: 5 mils.
 - 3. Foil Core Thickness: 0.35 mil.
 - 4. Weight: 28 lb/1000 sq. ft.
 - 5. 3-Inch Tensile According to ASTM D 882: 70 lbf, and 4600 psi.

2.7 WARNING LABELS AND SIGNS

- A. Comply with NFPA 70 and 29 CFR 1910.145.

- B. Self-Adhesive Warning Labels: Factory-printed, multicolor, pressure-sensitive adhesive labels, configured for display on front cover, door, or other access to equipment unless otherwise indicated.
- C. Baked-Enamel Warning Signs:
 - 1. Preprinted aluminum signs, punched or drilled for fasteners, with colors, legend, and size required for application.
 - 2. ¼-inch grommets in corners for mounting.
 - 3. Nominal size, 7 by 10 inches.
- D. Metal-Backed, Butyrate Warning Signs:
 - 1. Weather-resistant, nonfading, preprinted, cellulose-acetate butyrate signs with 0.0396-inch galvanized-steel backing; and with colors, legend, and size required for application.
 - 2. ¼-inch grommets in corners for mounting.
 - 3. Nominal size, 10 by 14 inches.
- E. Warning label and sign shall include, but are not limited to, the following legends:
 - 1. Multiple Power Source Warning: "DANGER - ELECTRICAL SHOCK HAZARD - EQUIPMENT HAS MULTIPLE POWER SOURCES."
 - 2. Workspace Clearance Warning: "WARNING - OSHA REGULATION - AREA IN FRONT OF ELECTRICAL EQUIPMENT MUST BE KEPT CLEAR FOR 36 INCHES."

2.8 INSTRUCTION SIGNS

- A. Engraved, laminated acrylic or melamine plastic, minimum 1/16-inch-thick for signs up to 20 sq. inches and 1/8-inch-thick for larger sizes.
 - 1. Engraved legend with black letters on white face.
 - 2. Punched or drilled for mechanical fasteners.
 - 3. Framed with mitered acrylic molding and arranged for attachment at applicable equipment.
- B. Adhesive Film Label: Machine printed, in black, by thermal transfer or equivalent process. Minimum letter height shall be 3/8-inch.
- C. Adhesive Film Label with Clear Protective Overlay: Machine printed, in black, by thermal transfer or equivalent process. Minimum letter height shall be 3/8-inch. Overlay shall provide a weatherproof and UV-resistant seal for label.

2.9 EQUIPMENT IDENTIFICATION LABELS

- A. Adhesive Film Label: Machine printed, in black, by thermal transfer or equivalent process. Minimum letter height shall be 3/8-inch.
- B. Adhesive Film Label with Clear Protective Overlay: Machine printed, in black, by thermal transfer or equivalent process. Minimum letter height shall be 3/8-inch. Overlay shall provide a weatherproof and UV-resistant seal for label.
- C. Self-Adhesive, Engraved, Laminated Acrylic or Melamine Label: Adhesive backed, with white letters on a dark-gray background. Minimum letter height shall be 3/8-inch.

- D. Engraved, Laminated Acrylic or Melamine Label: Punched or drilled for screw mounting. White letters on a dark-gray background. Minimum letter height shall be 3/8-inch.
- E. Stenciled Legend: In nonfading, waterproof, black ink or paint. Minimum letter height shall be 1-inch.

2.10 CABLE TIES

- A. General-Purpose Cable Ties: Fungus inert, self extinguishing, one piece, self locking, Type 6/6 nylon.
 - 1. Minimum Width: 3/16-inch.
 - 2. Tensile Strength at 73 deg F (23 deg C), According to ASTM D 638: 12,000 psi.
 - 3. Temperature Range: Minus 40 to plus 185 deg F (Minus 40 to plus 85 deg C).
 - 4. Color: Black except where used for color-coding.
- B. UV-Stabilized Cable Ties: Fungus inert, designed for continuous exposure to exterior sunlight, self extinguishing, one piece, self locking, Type 6/6 nylon.
 - 1. Minimum Width: 3/16-inch.
 - 2. Tensile Strength at 73 deg F (23 deg C), According to ASTM D 638: 12,000 psi.
 - 3. Temperature Range: Minus 40 to plus 185 deg F (Minus 40 to plus 85 deg C).
 - 4. Color: Black.
- C. Plenum-Rated Cable Ties: Self extinguishing, UV stabilized, one piece, self locking.
 - 1. Minimum Width: 3/16-inch.
 - 2. Tensile Strength at 73 deg F (23 deg C), According to ASTM D 638: 7000 psi.
 - 3. UL 94 Flame Rating: 94V-0.
 - 4. Temperature Range: Minus 50 to plus 284 deg F (Minus 46 to plus 140 deg C).
 - 5. Color: Black.

2.11 DATA RECEPTACLES

- A. Adhesive Film Label: Machine printed, in black, by thermal transfer or equivalent process. It should read "DATA ONLY". Minimum letter height shall be 3/8-inch.
- B. Adhesive Film Label with Clear Protective Overlay: Machine printed, in black, by thermal transfer or equivalent process. Minimum letter height shall be 3/8-inch. Overlay shall provide a weatherproof and UV-resistant seal for label.
- C. Self-Adhesive, Engraved, Laminated Acrylic or Melamine Label: Adhesive backed, with white letters on a dark-gray background. Minimum letter height shall be 3/8-inch.

2.12 RECEPTACLES ON EMERGENCY POWER

- A. Adhesive Film Label with Clear Protective Overlay: Machine printed, in orange, by thermal transfer or equivalent process. Minimum letter height shall be 3/8-inch. Overlay shall provide a weatherproof and UV-resistant seal for label. Install orange label with receptacle device for identification.

2.13 MISCELLANEOUS IDENTIFICATION PRODUCTS

- A. Fasteners for Labels and Signs: Self-tapping, stainless-steel screws or stainless-steel machine screws with nuts and flat and lock washers.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Verify identity of each item before installing identification products.
- B. Location: Install identification materials and devices at locations for most convenient viewing without interference with operation and maintenance of equipment.
- C. Apply identification devices to surfaces that require finish after completing finish work.
- D. Self-Adhesive Identification Products: Clean surfaces before application, using materials and methods recommended by manufacturer of identification device.
- E. Attach signs and plastic labels that are not self-adhesive type with mechanical fasteners appropriate to the location and substrate.
- F. System Identification Color-Coding Bands for Raceways and Cables: Each color-coding band shall completely encircle cable or conduit. Place adjacent bands of two-color markings in contact, side by side. Locate bands at changes in direction, at penetrations of walls and floors, at 50-foot maximum intervals in straight runs, and at 25-foot maximum intervals in congested areas.
- G. Aluminum Wraparound Marker Labels and Metal Tags: Secure tight to surface of conductor or cable at a location with high visibility and accessibility.
- H. Cable Ties: For attaching tags. Use general-purpose type, except as listed below:
 - 1. Outdoors: UV-stabilized nylon.
 - 2. In Spaces Handling Environmental Air: Plenum rated.
- I. Underground-Line Warning Tape: During backfilling of trenches install continuous underground-line warning tape directly above line at 6 to 8 inches below finished grade. Use multiple tapes where width of multiple lines installed in a common trench or concrete envelope exceeds 16 inches overall.

3.2 IDENTIFICATION SCHEDULE

- A. Concealed Raceways, Duct Banks, More Than 600 V, within Buildings: Tape and stencil 4-inch-wide black stripes on 10-inch centers over orange background that extends full length of raceway or duct and is 12 inches wide. Stencil legend "DANGER CONCEALED HIGH VOLTAGE WIRING" with 3-inch-high black letters on 20-inch centers. Stop stripes at legends. Apply to the following finished surfaces:
 - 1. Floor surface directly above conduits running beneath and within 12 inches of a floor that is in contact with earth or is framed above unexcavated space.
 - 2. Wall surfaces directly external to raceways concealed within wall.
 - 3. Accessible surfaces of concrete envelope around raceways in vertical shafts, exposed in the building, or concealed above suspended ceilings.
- B. Accessible Raceways, Armored and Metal-Clad Cables, More Than 600 V: Self-adhesive vinyl labels. Install labels at 30-foot maximum intervals.

- C. Accessible Raceways and Metal-Clad Cables, 600 V or Less, for Service, Feeder, and Branch Circuits More Than 30 A, and 120 V to ground: Identify with self-adhesive vinyl label. Install labels at 30-foot maximum intervals.
- D. Accessible Raceways and Cables within Buildings: Identify the covers of each junction and pull box of the following systems with self-adhesive vinyl labels with the wiring system legend and system voltage. System legends shall be as follows:
 - 1. Emergency Power.
 - 2. Standby Power.
 - 3. Normal Power.
- E. Power-Circuit Conductor Identification, 600 V or Less: For conductors in vaults, pull and junction boxes, manholes, and handholes, use color-coding conductor tape to identify the phase.
 - 1. Color-Coding for Phase and Voltage Level Identification, 600 V or Less: Use colors listed below for ungrounded service, feeder, and branch-circuit conductors.
 - a. Color shall be factory applied or field applied for sizes larger than No. 8 AWG, if authorities having jurisdiction permit.
 - b. Colors for 208/120-V Circuits:
 - 1) Phase A: Black.
 - 2) Phase B: Red.
 - 3) Phase C: Blue.
 - c. Colors for 480/277-V Circuits:
 - 1) Phase A: Brown.
 - 2) Phase B: Orange.
 - 3) Phase C: Yellow.
 - d. Field-Applied, Color-Coding Conductor Tape: Apply in half-lapped turns for a minimum distance of 6 inches from terminal points and in boxes where splices or taps are made. Apply last two (2) turns of tape with no tension to prevent possible unwinding. Locate bands to avoid obscuring factory cable markings.
- F. Power-Circuit Conductor Identification, more than 600 V: For conductors in vaults, pull and junction boxes, manholes, and handholes, use write-on tags, nonmetallic plastic tag holder with adhesive-backed phase tags, and a separate tag with the circuit designation.
- G. Install instructional sign including the color-code for grounded and ungrounded conductors using adhesive-film-type labels.
- H. Conductors to Be Extended in the Future: Attach marker tape to conductors and list source.
- I. Auxiliary Electrical Systems Conductor Identification: Identify field-installed alarm, control, and signal connections.
 - 1. Identify conductors, cables, and terminals in enclosures and at junctions, terminals, and pull points. Identify by system and circuit designation.
 - 2. Use system of marker tape designations that is uniform and consistent with system used by manufacturer for factory-installed connections.

3. Coordinate identification with Project Drawings, manufacturer's wiring diagrams, and the Operation and Maintenance Manual.
- J. Locations of Underground Lines: Identify with underground-line warning tape for power, lighting, communication, and control wiring and optical fiber cable.
1. Limit use of underground-line warning tape to direct-buried cables.
 2. Install underground-line warning tape for both direct-buried cables and cables in raceway.
- K. Workspace Indication: Install floor marking tape to show working clearances in the direction of access to live parts. Workspace shall be as required by NFPA 70 and 29 CFR 1926.403 unless otherwise indicated. Do not install at flush-mounted panelboards and similar equipment in finished spaces.
- L. Warning Labels for Indoor Cabinets, Boxes, and Enclosures for Power and Lighting: Self-adhesive warning labels.
1. Comply with 29 CFR 1910.145.
 2. Identify system voltage with black letters on an orange background.
 3. Apply to exterior of door, cover, or other access.
 4. For equipment with multiple power or control sources, apply to door or cover of equipment including, but not limited to, the following:
 - a. Power transfer switches.
 - b. Controls with external control power connections.
- M. Operating Instruction Signs: Install instruction signs to facilitate proper operation and maintenance of electrical systems and items to which they connect. Install instruction signs with approved legend where instructions are needed for system or equipment operation.
- N. Emergency Operating Instruction Signs: Install instruction signs with white legend on a red background with minimum 3/8-inch-high letters for emergency instructions at equipment used for power transfer and load shedding.
- O. Equipment Identification Labels: On each unit of equipment, install unique designation label that is consistent with wiring diagrams, schedules, and the Operation and Maintenance Manual. Apply labels to disconnect switches and protection equipment, central or master units, control panels, control stations, terminal cabinets, and racks of each system. Systems include power, lighting, control, communication, signal, monitoring, and alarm systems unless equipment is provided with its own identification.
1. Labeling Instructions:
 - a. Indoor Equipment: Adhesive film label. Unless otherwise indicated, provide a single line of text with 1/2-inch-high letters on 1 1/2-inch-high label; where two (2) lines of text are required, use labels 2 inches high.
 - b. Outdoor Equipment: Engraved, laminated acrylic or melamine label. Stenciled legend 4 inches high.
 - c. Elevated Components: Increase sizes of labels and letters to those appropriate for viewing from the floor.
 - d. Unless provided with self-adhesive means of attachment, fasten labels with appropriate mechanical fasteners that do not change the NEMA or NRTL rating of the enclosure.
 2. Equipment to Be Labeled:

- a. Panelboards: Typewritten directory of circuits in the location provided by panelboard manufacturer. Panelboard identification shall be self-adhesive and engraved laminated acrylic or melamine label.
- b. Enclosures and electrical cabinets.
- c. Access doors and panels for concealed electrical items.
- d. Switchgear.
- e. Switchboards.
- f. Transformers: Label that includes tag designation shown on Drawings for the transformer, feeder, and panelboards or equipment supplied by the secondary.
- g. Emergency system boxes and enclosures.
- h. Enclosed switches.
- i. Enclosed circuit breakers.
- j. Enclosed controllers.
- k. Variable-speed controllers.
- l. Push-button stations.
- m. Power transfer equipment.
- n. Contactors.
- o. Remote-controlled switches, dimmer modules, and control devices.
- p. Power-generating units.
- q. Monitoring and control equipment.
- r. UPS equipment.

END OF SECTION 260553

SECTION 262726 - WIRING DEVICES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following:
 - 1. Receptacles, receptacles with integral GFCI, and associated device plates.
 - 2. Twist-locking receptacles.
 - 3. EPO mushroom switches

1.3 DEFINITIONS

- A. EMI: Electromagnetic interference.
- B. GFCI: Ground-fault circuit interrupter.
- C. Pigtail: Short lead used to connect a device to a branch-circuit conductor.
- D. RFI: Radio-frequency interference.
- E. TVSS: Transient voltage surge suppressor.
- F. UTP: Unshielded twisted pair.

1.4 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: List of legends and description of materials and process used for premarking wall plates.
- C. Samples: One (1) for each type of device and wall plate specified, in each color specified.
- D. Field quality-control test reports.
- E. Operation and Maintenance Data: For wiring devices to include in all manufacturers' packing label warnings and instruction manuals that include labeling conditions.

1.5 QUALITY ASSURANCE

- A. Source Limitations: Obtain each type of wiring device and associated wall plate through one (1) source from a single manufacturer. Insofar as they are available, obtain all wiring devices and associated wall plates from a single manufacturer and one (1) source.

- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- C. Comply with NFPA 70.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Manufacturers' Names: Shortened versions (shown in parentheses) of the following manufacturers' names are used in other Part 2 articles:
 - 1. Cooper Wiring Devices; a division of Cooper Industries, Inc. (Cooper)
 - 2. Hubbell Incorporated; Wiring Device-Kellems (Hubbell)
 - 3. Leviton Mfg. Company Inc. (Leviton)
 - 4. Pass & Seymour/Legrand; Wiring Devices & Accessories (Pass & Seymour)

2.2 STRAIGHT BLADE RECEPTACLES

- A. Convenience Receptacles, 125 V, 20 A: Comply with NEMA WD 1, NEMA WD 6 configuration 5-20R, and UL 498.
 - 1. Available Products: Subject to compliance with requirements, products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Cooper; **5351** (single), **5352** (duplex)
 - b. Hubbell; **HBL5351** (single), **CR5352** (duplex)
 - c. Leviton; **5891** (single), **5352** (duplex)
 - d. Pass & Seymour; **5381** (single), **5352** (duplex)

2.3 GFCI RECEPTACLES

- A. General Description: Straight blade, feed-through type. Comply with NEMA WD 1, NEMA WD 6, UL 498, and UL 943, Class A, and include indicator light that is lighted when device is tripped.
- B. Duplex GFCI Convenience Receptacles, 125 V, 20 A:
 - 1. Available Products: Subject to compliance with requirements, products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Cooper; **GF20**
 - b. Pass & Seymour; **2084**

2.4 EPO MUSHROOM SWITCHES

- A. Pushbuttons: NEMA ICS 2; Heavy-duty, oil-tight and dust-tight without boot, chrome-plated bezel, EMERG. STOP in front cover, red mushroom style actuator.
- B. Contact Blocks: Stacked mounting with single screw installation, color coded with clear window for contact status. Furnish with two (2) N.O. and two (2) N.C. contacts.
- C. Activation: Two-position, push to activate, key to return to normal state.

- D. Cover: Clear stopper shield with integral alarm and red label with lettering "EMERG. STOP".

2.5 FINISHES

- A. Color: Wiring device catalog numbers in Section Text do not designate device color.
 - 1. Wiring Devices Connected to Normal Power System: Ivory and/or as selected by Architect and Owner from manufacturer's entire range, unless otherwise indicated or required by NFPA 70 or device listing.
 - 2. Wiring Devices Connected to Emergency Power System: Red.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Comply with NECA 1, including the mounting heights listed in that standard, unless otherwise noted.
- B. Conductors:
 - 1. Do not strip insulation from conductors until just before they are spliced or terminated on devices.
 - 2. Strip insulation evenly around the conductor using tools designed for the purpose. Avoid scoring or nicking of solid wire or cutting strands from stranded wire.
 - 3. The length of free conductors at outlets for devices shall meet provisions of NFPA 70, Article 300, without pigtails.
 - 4. Existing Conductors:
 - a. Cut back and pigtail, or replace all damaged conductors.
 - b. Straighten conductors that remain and remove corrosion and foreign matter.
 - c. Pig tailing existing conductors is permitted provided the outlet box is large enough.
- C. Device Installation:
 - 1. Replace all devices that have been in temporary use during construction or that show signs that they were installed before building finishing operations were complete.
 - 2. Keep each wiring device in its package or otherwise protected until it is time to connect conductors.
 - 3. Do not remove surface protection, such as plastic film and smudge covers, until the last possible moment.
 - 4. Connect devices to branch circuits using pigtails that are not less than 6 inches in length.
 - 5. When there is a choice, use side wiring with binding-head screw terminals. Wrap solid conductor tightly clockwise, 2/3 to 3/4 of the way around terminal screw.
 - 6. Use a torque screwdriver when a torque is recommended or required by the manufacturer.
 - 7. When conductors larger than No. 12 AWG are installed on 15- or 20-A circuits, splice No. 12 AWG pigtails for device connections.
 - 8. Tighten unused terminal screws on the device.
 - 9. When mounting into metal boxes, remove the fiber or plastic washers used to hold device mounting screws in yokes, allowing metal-to-metal contact.
 - 10. Install GFCI devices in all wet locations.
- D. Receptacle Orientation:

1. Install ground pin of vertically mounted receptacles up, and on horizontally mounted receptacles to the right.
 - E. Device Plates: Do not use oversized or extra-deep plates. Repair wall finishes and remount outlet boxes when standard device plates do not fit flush or do not cover rough wall opening.
 - F. Arrangement of Devices: Unless otherwise indicated, mount flush, with long dimension vertical and with grounding terminal of receptacles on top.
 - G. EPO Switches: Pressing the EPO switch shall immediately shut down the designated loads by activating the assigned shunt trip or contactor device(s). As part of the EPO circuit, an interface shall also be provided for connecting one (1) or more normally open or normally closed remote EPO switches to the EPO circuit. Reset shall be by key operation.
- 3.2 IDENTIFICATION
- A. Comply with Section 260553 "Identification for Electrical Systems."
 1. Receptacles and Switches: Identify panelboard and circuit number from which served. Use self-adhesive labels with black lettering on white field mounted on face of plate, and durable wire markers or tags inside outlet boxes.
- 3.3 FIELD QUALITY CONTROL
- A. Perform tests and inspections and prepare test reports.
 1. Test Instruments: Use instruments that comply with UL 1436.
 2. Test Instrument for Convenience Receptacles: Digital wiring analyzer with digital readout or illuminated LED indicators of measurement.
 - B. Tests for Convenience Receptacles:
 1. Line Voltage: Acceptable range is 105 to 132 V.
 2. Percent Voltage Drop under 15-A Load: A value of six percent (6%) or higher is not acceptable.
 3. Ground Impedance: Values of up to 2 ohms are acceptable.
 4. GFCI Trip: Test for tripping values specified in UL 1436 and UL 943.
 5. Using the test plug, verify that the device and its outlet box are securely mounted.
 6. The tests shall be diagnostic, indicating damaged conductors, high resistance at the circuit breaker, poor connections, inadequate fault current path, defective devices, or similar problems. Correct circuit conditions, remove malfunctioning units and replace with new ones, and retest as specified above.

END OF SECTION 262726

SECTION 262816 - ENCLOSED SWITCHES AND CIRCUIT BREAKERS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Non-Fusible switches.
 - 2. Molded-case circuit breakers (MCCBs).
 - 3. Molded-case switches.
 - 4. Enclosures.

1.3 DEFINITIONS

- A. NC: Normally closed.
- B. NO: Normally open.
- C. SPDT: Single pole, double throw.

1.4 PERFORMANCE REQUIREMENTS

- A. Seismic Performance: Enclosed switches and circuit breakers shall withstand the effects of earthquake motions determined according to ASCE/SEI 7.
 - 1. The term "withstand" means "the unit will remain in place without separation of any parts from the device when subjected to the seismic forces specified and the unit will be fully operational after the seismic event."

1.5 SUBMITTALS

- A. Product Data: For each type of enclosed switch, circuit breaker, accessory, and component indicated. Include dimensioned elevations, sections, weights, and manufacturers' technical data on features, performance, electrical characteristics, ratings, accessories, and finishes.
 - 1. Enclosure types and details for types other than NEMA 250, Type 1.
 - 2. Current and voltage ratings.
 - 3. Short-circuit current ratings (interrupting and withstand, as appropriate).
 - 4. Include evidence of NRTL listing for series rating of installed devices.
 - 5. Detail features, characteristics, ratings, and factory settings of individual overcurrent protective devices, accessories, and auxiliary components.
 - 6. Include time-current coordination curves (average melt) for each type and rating of overcurrent protective device; include selectable ranges for each type of overcurrent protective device. Submit on translucent log-log graph paper.
- B. Shop Drawings: For enclosed switches and circuit breakers. Include plans, elevations, sections, details, and attachments to other work.

1. Wiring Diagrams: For power, signal, and control wiring.
- C. Qualification Data: For qualified testing agency.
- D. Seismic Qualification Certificates: For enclosed switches and circuit breakers, accessories, and components, from manufacturer.
 1. Basis for Certification: Indicate whether withstand certification is based on actual test of assembled components or on calculation.
 2. Dimensioned Outline Drawings of Equipment Unit: Identify center of gravity and locate and describe mounting and anchorage provisions.
 3. Detailed description of equipment anchorage devices on which the certification is based and their installation requirements.
- E. Field quality-control reports.
 1. Test procedures used.
 2. Test results that comply with requirements.
 3. Results of failed tests and corrective action taken to achieve test results that comply with requirements.
- F. Manufacturer's field service report.
- G. Operation and Maintenance Data: For enclosed switches and circuit breakers to include in emergency, operation, and maintenance manuals. In addition to items specified in Section 017823 "Operation and Maintenance Data," include the following:
 1. Manufacturer's written instructions for testing and adjusting enclosed switches and circuit breakers.
 2. Time-current coordination curves (average melt) for each type and rating of overcurrent protective device; include selectable ranges for each type of overcurrent protective device. Submit on translucent log-log graph paper.

1.6 QUALITY ASSURANCE

- A. Testing Agency Qualifications: Member company of NETA or an NRTL.
 1. Testing Agency's Field Supervisor: Currently certified by NETA to supervise on-site testing.
- B. Source Limitations: Obtain enclosed switches and circuit breakers, overcurrent protective devices, components, and accessories, within same product category, from single source from single manufacturer.
- C. Product Selection for Restricted Space: Drawings indicate maximum dimensions for enclosed switches and circuit breakers, including clearances between enclosures, and adjacent surfaces and other items. Comply with indicated maximum dimensions.
- D. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- E. Comply with NFPA 70.

1.7 PROJECT CONDITIONS

- A. Environmental Limitations: Rate equipment for continuous operation under the following conditions unless otherwise indicated:
 - 1. Ambient Temperature: Not less than minus 22 deg F (minus 30 deg C) and not exceeding 104 deg F (40 deg C).
 - 2. Altitude: Not exceeding 6600 feet.
- B. Interruption of Existing Electric Service: Do not interrupt electric service to facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide temporary electric service according to requirements indicated:
 - 1. Notify Architect and Construction Manager no fewer than seven (7) days in advance of proposed interruption of electric service.
 - 2. Indicate method of providing temporary electric service.
 - 3. Do not proceed with interruption of electric service without Architect and Construction Manager written permission.
 - 4. Comply with NFPA 70E.

1.8 COORDINATION

- A. Coordinate layout and installation of switches, circuit breakers, and components with equipment served and adjacent surfaces. Maintain required workspace clearances and required clearances for equipment access doors and panels.

1.9 EXTRA MATERIALS

- A. Furnish extra materials that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.

PART 2 - PRODUCTS

2.1 NONFUSIBLE SWITCHES

- A. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one (1) of the following:
 - 1. Eaton Electrical Inc.; Cutler-Hammer Business Unit
 - 2. General Electric Company; GE Consumer & Industrial - Electrical Distribution
 - 3. Siemens Energy & Automation, Inc.
 - 4. Square D; a brand of Schneider Electric
- B. Type HD, Heavy Duty, Single Throw, 600-V ac and 240-V ac, 1200 A and Smaller: UL 98 and NEMA KS 1, horsepower rated, lockable handle with capability to accept three (3) padlocks, and interlocked with cover in closed position.
- C. Type HD, Heavy Duty, Six Pole, Single Throw, 600-V ac and 240-V ac, 200 A and Smaller: UL 98 and NEMA KS 1, horsepower rated, lockable handle with capability to accept three (3) padlocks, and interlocked with cover in closed position.
- D. Type HD, Heavy Duty, Double Throw, 600-V ac and 240-V ac, 1200 A and Smaller: UL 98 and NEMA KS 1, horsepower rated, lockable handle with capability to accept three (3) padlocks, and interlocked with cover in closed position.

E. Accessories:

1. Equipment Ground Kit: Internally mounted and labeled for copper and aluminum ground conductors.
2. Neutral Kit: Internally mounted; insulated, capable of being grounded and bonded; labeled for copper and aluminum neutral conductors.
3. Isolated Ground Kit: Internally mounted; insulated, capable of being grounded and bonded; labeled for copper and aluminum neutral conductors.
4. Auxiliary Contact Kit: Two (2) NO/NC (Form "C") auxiliary contact(s), arranged to activate before switch blades open.
5. Hookstick Handle: Allows use of a hookstick to operate the handle.
6. Lugs: Mechanical and/or Compression type, suitable for number, size, and conductor material.

2.2 MOLDED-CASE CIRCUIT BREAKERS

- A. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one (1) of the following:
1. Eaton Electrical Inc.; Cutler-Hammer Business Unit
 2. General Electric Company; GE Consumer & Industrial - Electrical Distribution
 3. Siemens Energy & Automation, Inc.
 4. Square D; a brand of Schneider Electric
- B. General Requirements: Comply with UL 489, NEMA AB 1, and NEMA AB 3, with interrupting capacity to comply with available fault currents.
- C. Thermal-Magnetic Circuit Breakers: Inverse time-current element for low-level overloads and instantaneous magnetic trip element for short circuits. Adjustable magnetic trip setting for circuit-breaker frame sizes 250 A and larger.
- D. Adjustable, Instantaneous-Trip Circuit Breakers: Magnetic trip element with front-mounted, field-adjustable trip setting.
- E. Electronic Trip Circuit Breakers: Field-replaceable rating plug, rms sensing, with the following field-adjustable settings:
1. Instantaneous trip.
 2. Long- and short-time pickup levels.
 3. Long- and short-time time adjustments.
 4. Ground-fault pickup level, time delay, and I^2t response.
- F. Current-Limiting Circuit Breakers: Frame sizes 400 A and smaller, and let-through ratings less than NEMA FU 1, RK-5.
- G. Integrally Fused Circuit Breakers: Thermal-magnetic trip element with integral limiter-style fuse listed for use with circuit breaker and trip activation on fuse opening or on opening of fuse compartment door.
- H. Ground-Fault, Circuit-Interrupter (GFCI) Circuit Breakers: Single- and two-pole configurations with Class A ground-fault protection (6-mA trip).
- I. Ground-Fault, Equipment-Protection (GFEP) Circuit Breakers: With Class B ground-fault protection (30-mA trip).

J. Features and Accessories:

1. Standard frame sizes, trip ratings, and number of poles.
2. Lugs: Mechanical and/or Compression type, suitable for number, size, trip ratings, and conductor material.
3. Ground-Fault Protection: Comply with UL 1053; remote-mounted and powered type with mechanical ground-fault indicator; relay with adjustable pickup and time-delay settings, push-to-test feature, internal memory, and shunt trip unit; and three-phase, zero-sequence current transformer/sensor.
4. Undervoltage Trip: Set to operate at thirty-five to seventy-five percent (35-75%) of rated voltage without intentional time delay.
5. Auxiliary Contacts: Two (2) SPDT switches with "a" and "b" contacts; "a" contacts mimic circuit-breaker contacts, "b" contacts operate in reverse of circuit-breaker contacts.
6. Alarm Switch: One (1) NC contact that operates only when circuit breaker has tripped.
7. Key Interlock Kit: Externally mounted to prohibit circuit-breaker operation; key shall be removable only when circuit breaker is in off position.
8. Zone-Selective Interlocking: Integral with electronic and/or ground-fault trip unit; for interlocking ground-fault protection function.
9. Electrical Operator: Provide remote control for on, off, and reset operations.

2.3 MOLDED-CASE SWITCHES

A. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one (1) of the following:

1. Eaton Electrical Inc.; Cutler-Hammer Business Unit
2. General Electric Company; GE Consumer & Industrial - Electrical Distribution
3. Siemens Energy & Automation, Inc.
4. Square D; a brand of Schneider Electric

B. General Requirements: MCCB with fixed, high-set instantaneous trip only, and short-circuit withstand rating equal to equivalent breaker frame size interrupting rating.

C. Features and Accessories:

1. Standard frame sizes and number of poles.
2. Lugs: Mechanical and/or Compression type, suitable for number, size, trip ratings, and conductor material.
3. Ground-Fault Protection: Comply with UL 1053; remote-mounted and powered type with mechanical ground-fault indicator; relay with adjustable pickup and time-delay settings, push-to-test feature, internal memory, and shunt trip unit; and three-phase, zero-sequence current transformer/sensor.
4. Undervoltage Trip: Set to operate at thirty-five to seventy-five percent (35-75%) of rated voltage without intentional time delay.
5. Auxiliary Contacts: Two (2) SPDT switches with "a" and "b" contacts; "a" contacts mimic switch contacts, "b" contacts operate in reverse of switch contacts.
6. Alarm Switch: One (1) NC contact that operates only when switch has tripped.
7. Key Interlock Kit: Externally mounted to prohibit switch operation; key shall be removable only when switch is in off position.
8. Zone-Selective Interlocking: Integral with ground-fault shunt trip unit; for interlocking ground-fault protection function.
9. Electrical Operator: Provide remote control for on, off, and reset operations.
10. Accessory Control Power Voltage: Integrally mounted, self-powered; 120-V ac and 24-V dc.

2.4 ENCLOSURES

- A. Enclosed Switches and Circuit Breakers: NEMA AB 1, NEMA KS 1, NEMA 250, and UL 50, to comply with environmental conditions at installed location.
 - 1. Indoor, Dry and Clean Locations: NEMA 250, Type 1.
 - 2. Outdoor Locations: NEMA 250, Type 3R.
 - 3. Other Wet or Damp, Indoor Locations: NEMA 250, Type 4.
 - 4. Indoor Locations Subject to Dust, Falling Dirt, and Dripping Noncorrosive Liquids: NEMA 250, Type 12.
 - 5. Hazardous Areas Indicated on Drawings: NEMA 250, Type 9.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine elements and surfaces to receive enclosed switches and circuit breakers for compliance with installation tolerances and other conditions affecting performance of the Work.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

- A. Install individual wall-mounted switches and circuit breakers with tops at uniform height unless otherwise indicated.
- B. Comply with mounting and anchoring requirements specified in Section 260548 "Vibration and Seismic Controls for Electrical Systems."
- C. Temporary Lifting Provisions: Remove temporary lifting eyes, channels, and brackets and temporary blocking of moving parts from enclosures and components.
- D. Comply with NECA 1.

3.3 IDENTIFICATION

- A. Comply with requirements in Section 260553 "Identification for Electrical Systems."
 - 1. Identify field-installed conductors, interconnecting wiring, and components; provide warning signs.
 - 2. Label each enclosure with engraved metal or laminated-plastic nameplate indicating load served.

3.4 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
 - 1. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect components, assemblies, and equipment installations, including connections, and to assist in testing.
- B. Acceptance Testing Preparation:

1. Test insulation resistance for each enclosed switch and circuit breaker, component, connecting supply, feeder, and control circuit.
2. Test continuity of each circuit.

C. Tests and Inspections:

1. Perform each visual and mechanical inspection and electrical test stated in NETA Acceptance Testing Specification. Certify compliance with test parameters.
2. Correct malfunctioning units on-site, where possible, and retest to demonstrate compliance; otherwise, replace with new units and retest.
3. Perform the following infrared scan tests and inspections and prepare reports:
 - a. Initial Infrared Scanning: After Substantial Completion, but not more than sixty (60) days after Final Acceptance, perform an infrared scan of each enclosed switch and circuit breaker. Remove front panels so joints and connections are accessible to portable scanner.
 - b. Follow-up Infrared Scanning: Perform an additional follow-up infrared scan of each enclosed switch and circuit breaker eleven (11) months after date of Substantial Completion.
 - c. Instruments and Equipment: Use an infrared scanning device designed to measure temperature or to detect significant deviations from normal values. Provide calibration record for device.
4. Test and adjust controls, remote monitoring, and safeties. Replace damaged and malfunctioning controls and equipment.

D. Enclosed switches and circuit breakers will be considered defective if they do not pass tests and inspections.

E. Prepare test and inspection reports, including a certified report that identifies enclosed switches and circuit breakers and that describes scanning results. Include notation of deficiencies detected, remedial action taken, and observations after remedial action.

3.5 ADJUSTING

- A. Adjust moving parts and operable components to function smoothly, and lubricate as recommended by manufacturer.
- B. Set field-adjustable circuit-breaker trip ranges as specified.

END OF SECTION 262816

SECTION 262923 - VARIABLE-FREQUENCY MOTOR CONTROLLERS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes separately enclosed, pre-assembled, combination VFCs, rated 600 V and less, for speed control of three-phase, squirrel-cage induction motors.

1.3 DEFINITIONS

- A. BAS: Building automation system.
- B. CE: Conformance Europeene (European Compliance).
- C. CPT: Control power transformer.
- D. EMI: Electromagnetic interference.
- E. IGBT: Insulated-gate bipolar transistor.
- F. LAN: Local area network.
- G. LED: Light-emitting diode.
- H. MCP: Motor-circuit protector.
- I. NC: Normally closed.
- J. NO: Normally open.
- K. OCPD: Overcurrent protective device.
- L. PCC: Point of common coupling.
- M. PID: Control action, proportional plus integral plus derivative.
- N. PWM: Pulse-width modulated.
- O. RFI: Radio-frequency interference.
- P. TDD: Total demand (harmonic current) distortion.
- Q. THD(V): Total harmonic voltage demand.
- R. VFC: Variable-frequency motor controller.

1.4 PERFORMANCE REQUIREMENTS

- A. Seismic Performance: VFCs shall withstand the effects of earthquake motions determined according to ASCE/SEI 7.
 - 1. The term "withstand" means "the unit will remain in place without separation of any parts from the device when subjected to the seismic forces specified and the unit will be fully operational after the seismic event."

1.5 SUBMITTALS

- A. Product Data: For each type and rating of VFC indicated. Include features, performance, electrical ratings, operating characteristics, shipping and operating weights, and furnished specialties and accessories.
- B. Shop Drawings: For each VFC indicated. Include dimensioned plans, elevations, and sections; and conduit entry locations and sizes, mounting arrangements, and details, including required clearances and service space around equipment.
 - 1. Show tabulations of installed devices, equipment features, and ratings. Include the following:
 - a. Each installed unit's type and details.
 - b. Factory-installed devices.
 - c. Enclosure types and details.
 - d. Nameplate legends.
 - e. Short-circuit current (withstand) rating of enclosed unit.
 - f. Features, characteristics, ratings, and factory settings of each VFC and installed devices.
 - g. Specified modifications.
 - 2. Schematic and Connection Wiring Diagrams: For power, signal, and control wiring.
- C. Coordination Drawings: Floor plans, drawn to scale, showing dimensioned layout, required working clearances, and required area above and around VFCs. Show VFC layout and relationships between electrical components and adjacent structural and mechanical elements. Show support locations, type of support, and weight on each support. Indicate field measurements.
- D. Seismic Qualification Certificates: For VFCs, accessories, and components, from manufacturer.
 - 1. Basis for Certification: Indicate whether withstand certification is based on actual test of assembled components or on calculation.
 - 2. Dimensioned Outline Drawings of Equipment Unit: Identify center of gravity and locate and describe mounting and anchorage provisions.
 - 3. Detailed description of equipment anchorage devices on which the certification is based, and their installation requirements.
- E. Product Certificates: For each VFC, from manufacturer.
- F. Source quality-control reports.
- G. Field quality-control reports.

- H. Operation and Maintenance Data: For VFCs to include in emergency, operation, and maintenance manuals. In addition to items specified in Section 017823 "Operation and Maintenance Data," include the following:
 - 1. Manufacturer's written instructions for testing and adjusting thermal-magnetic circuit breaker and MCP trip settings.
 - 2. Manufacturer's written instructions for setting field-adjustable overload relays.
 - 3. Manufacturer's written instructions for testing, adjusting, and reprogramming microprocessor control modules.
 - 4. Manufacturer's written instructions for setting field-adjustable timers, controls, and status and alarm points.
- I. Load-Current and Overload-Relay Heater List: Compile after motors have been installed, and arrange to demonstrate that selection of heaters suits actual motor nameplate, full-load currents.
- J. Load-Current and List of Settings of Adjustable Overload Relays: Compile after motors have been installed and arrange to demonstrate that switch settings for motor-running overload protection suit actual motors to be protected.

1.6 QUALITY ASSURANCE

- A. Testing Agency Qualifications: Member company of NETA or an NRTL.
 - 1. Testing Agency's Field Supervisor: Currently certified by NETA to supervise on-site testing.
- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- C. Comply with NFPA 70.
- D. IEEE Compliance: Fabricate and test VFC according to IEEE 344 to withstand seismic forces defined in Section 260548 "Vibration and Seismic Controls for Electrical Systems."

1.7 DELIVERY, STORAGE, AND HANDLING

- A. If stored in space that is not permanently enclosed and air conditioned, remove loose packing and flammable materials from inside controllers and connect factory-installed space heaters to temporary electrical service.

1.8 PROJECT CONDITIONS

- A. Environmental Limitations: Rate equipment for continuous operation, capable of driving full load without derating, under the following conditions unless otherwise indicated:
 - 1. Ambient Temperature: Not less than 14 deg F and not exceeding 104 deg F.
 - 2. Ambient Storage Temperature: Not less than minus 4 deg F and not exceeding 140 deg F.
 - 3. Humidity: Less than ninety-five percent (<95%) (noncondensing).
 - 4. Altitude: Not exceeding 3300 feet.

1.9 COORDINATION

- A. Coordinate features of motors, load characteristics, installed units, and accessory devices to be compatible with the following:
 - 1. Torque, speed, and horsepower requirements of the load.
 - 2. Ratings and characteristics of supply circuit and required control sequence.
 - 3. Ambient and environmental conditions of installation location.

1.10 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace VFCs that fail in materials or workmanship within specified warranty period.
 - 1. Warranty Period: Five (5) years from date of Substantial Completion.

1.11 EXTRA MATERIALS

- A. Furnish extra materials described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
 - 1. Indicating Lights: Two (2) of each type and color installed.
 - 2. Auxiliary Contacts: Furnish one (1) spare for each size and type of magnetic controller installed.
 - 3. Power Contacts: Furnish three (3) spares for each size and type of magnetic contactor installed.

PART 2 - PRODUCTS

2.1 GENERAL REQUIREMENTS

- A. None.

2.2 ENCLOSURES

- A. VFC Enclosures: NEMA 250, to comply with environmental conditions at installed location.
 - 1. Dry and Clean Indoor Locations: Type 1.
 - 2. Outdoor Locations: Type 3R.
 - 3. Kitchen Areas: Type 4X, stainless steel.
 - 4. Indoor Locations Subject to Dust, Falling Dirt, and Dripping Noncorrosive Liquids: Type 12.
- B. Plenum Rating: UL 1995; NRTL certification label on enclosure, clearly identifying VFC as "Plenum Rated."

2.3 SOURCE QUALITY CONTROL

- A. Testing: Test and inspect VFCs according to requirements in NEMA ICS 61800-2.
 - 1. Test each VFC while connected to a motor that is comparable to that for which the VFC is rated.
 - 2. Verification of Performance: Rate VFCs according to operation of functions and features specified.

- B. VFCs will be considered defective if they do not pass tests and inspections.
- C. Prepare test and inspection reports.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine areas, surfaces, and substrates to receive VFCs, with Installer present, for compliance with requirements for installation tolerances, and other conditions affecting performance.
- B. Examine VFC before installation. Reject VFCs that are wet, moisture damaged, or mold damaged.
- C. Examine roughing-in for conduit systems to verify actual locations of conduit connections before VFC installation.
- D. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

- A. Coordinate layout and installation of VFCs with other construction including conduit, piping, equipment, and adjacent surfaces. Maintain required workspace clearances and required clearances for equipment access doors and panels.
- B. Wall-Mounting Controllers: Install VFCs on walls with tops at uniform height and with disconnect operating handles not higher than 79 inches above finished floor unless otherwise indicated, and by bolting units to wall or mounting on lightweight structural-steel channels bolted to wall. For controllers not on walls, provide freestanding racks complying with Section 260529 "Hangers and Supports for Electrical Systems."
- C. Roof-Mounting Controllers: Install VFC on roofs with tops at uniform height and with disconnect operating handles not higher than 79 inches above finished roof surface unless otherwise indicated, and by bolting units to curbs or mounting on freestanding, lightweight, structural-steel channels bolted to curbs. Seal roof penetrations after raceways are installed.
 - 1. Curbs and roof penetrations are specified in Section 077200 "Roof Accessories."
 - 2. Structural-steel channels are specified in Section 260529 "Hangers and Supports for Electrical Systems."
- D. Seismic Bracing: Comply with requirements specified in Section 260548 "Vibration and Seismic Controls for Electrical Systems."
- E. Temporary Lifting Provisions: Remove temporary lifting eyes, channels, and brackets and temporary blocking of moving parts from enclosures and components.
- F. Install heaters in thermal-overload relays. Select heaters based on actual nameplate full-load amperes after motors have been installed.
- G. Install, connect, and fuse thermal-protector monitoring relays furnished with motor-driven equipment.
- H. Comply with NECA 1.

3.3 IDENTIFICATION

- A. Identify VFCs, components, and control wiring. Comply with requirements for identification specified in Section 260553 "Identification for Electrical Systems."
 - 1. Identify field-installed conductors, interconnecting wiring, and components; provide warning signs.
 - 2. Label each VFC with engraved nameplate.
 - 3. Label each enclosure-mounted control and pilot device.
- B. Operating Instructions: Frame printed operating instructions for VFCs, including control sequences and emergency procedures. Fabricate frame of finished metal, and cover instructions with clear acrylic plastic. Mount on front of VFC units.

3.4 CONTROL WIRING INSTALLATION

- A. Install wiring between VFCs and remote devices and facility's central-control system. Comply with requirements in Section 260523 "Control-Voltage Electrical Power Cables."
- B. Bundle, train, and support wiring in enclosures.
- C. Connect selector switches and other automatic control devices where applicable.
 - 1. Connect selector switches to bypass only those manual- and automatic control devices that have no safety functions when switches are in manual-control position.
 - 2. Connect selector switches with control circuit in both manual and automatic positions for safety-type control devices such as low- and high-pressure cutouts, high-temperature cutouts, and motor overload protectors.

3.5 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
 - 1. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect components, assemblies, and equipment installations, including connections, and to assist in testing.
- B. Acceptance Testing Preparation:
 - 1. Test insulation resistance for each VFC element, bus, component, connecting supply, feeder, and control circuit.
 - 2. Test continuity of each circuit.
- C. Tests and Inspections:
 - 1. Inspect VFC, wiring, components, connections, and equipment installation. Test and adjust controllers, components, and equipment.
 - 2. Test insulation resistance for each VFC element, component, connecting motor supply, feeder, and control circuits.
 - 3. Test continuity of each circuit.
 - 4. Verify that voltages at VFC locations are within ten percent (10%) of motor nameplate rated voltages. If outside this range for any motor, notify Architect and Construction Manager before starting the motor(s).
 - 5. Test each motor for proper phase rotation.

6. Perform each electrical test and visual and mechanical inspection stated in NETA Acceptance Testing Specification. Certify compliance with test parameters.
7. Correct malfunctioning units on-site, where possible, and retest to demonstrate compliance; otherwise, replace with new units and retest.
8. Perform the following infrared (thermographic) scan tests and inspections and prepare reports:
 - a. Initial Infrared Scanning: After Substantial Completion, but not more than sixty (60) days after Final Acceptance, perform an infrared scan of each VFC. Remove front panels so joints and connections are accessible to portable scanner.
 - b. Follow-up Infrared Scanning: Perform an additional follow-up infrared scan of each VFC eleven (11) months after date of Substantial Completion.
 - c. Instruments and Equipment: Use an infrared scanning device designed to measure temperature or to detect significant deviations from normal values. Provide calibration record for device.
9. Test and adjust controls, remote monitoring, and safeties. Replace damaged and malfunctioning controls and equipment.

D. VFCs will be considered defective if they do not pass tests and inspections.

E. Prepare test and inspection reports, including a certified report that identifies the VFC and describes scanning results. Include notation of deficiencies detected, remedial action taken, and observations made after remedial action.

3.6 STARTUP SERVICE

A. Engage a factory-authorized service representative to perform startup service.

1. Complete installation and startup checks according to manufacturer's written instructions.

3.7 ADJUSTING

A. Program microprocessors for required operational sequences, status indications, alarms, event recording, and display features. Clear events memory after final acceptance testing and prior to Substantial Completion.

B. Set field-adjustable switches, auxiliary relays, time-delay relays, timers, and overload-relay pickup and trip ranges.

C. Adjust the trip settings of MCPs and thermal-magnetic circuit breakers with adjustable, instantaneous trip elements. Initially adjust to six (6) times the motor nameplate full-load amperes and attempt to start motors several times, allowing for motor cool-down between starts. If tripping occurs on motor inrush, adjust settings in increments until motors start without tripping. Do not exceed eight (8) times the motor full-load amperes (or eleven (11) times for NEMA Premium Efficient motors if required). Where these maximum settings do not allow starting of a motor, notify Architect and Construction Manager before increasing settings.

D. Set the taps on reduced-voltage autotransformer controllers.

3.8 PROTECTION

A. Temporary Heating: Apply temporary heat to maintain temperature according to manufacturer's written instructions until controllers are ready to be energized and placed into service.

- B. Replace VFCs whose interiors have been exposed to water or other liquids prior to Substantial Completion.

3.9 DEMONSTRATION

- A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, reprogram, and maintain VFCs.

END OF SECTION 262923

INSURANCE REQUIREMENTS

INSURANCE REQUIREMENTS

The General Contractor and all Subcontractors shall carry the following insurances for the duration of the Project, in coordination with the GENERAL CONDITIONS OF THE CONTRACTOR FOR CONSTRUCTION AND THE SUPPLEMENTARY CONDITIONS OF THE CONTRACT FOR CONSTRUCTION. Insurance companies shall be licensed to do business in the State of Connecticut.

		(Minimum Limits)
General Liability*	Each Occurrence	\$1,000,000
	General Aggregate	\$2,000,000
	Products/Completed Operations Aggregate	\$2,000,000
Auto Liability*	Combined Single Limit (Each Accident)	\$1,000,000
Umbrella* (Excess Liability)	Combined single Limit (Each Occurrence)	\$1,000,000
	Aggregate	\$1,000,000
Professional Liability	Each Occurrence	\$2,000,000
	Aggregate	\$2,000,000

* The Town of Cheshire and State of Connecticut shall be named as "Additional Insured." Coverage is to be provided on a primary, noncontributory basis. Waiver of subrogation must be provided.

If any policy is written on a "Claims Made" basis, the policy must be continually renewed for a minimum of two (2) years from the completion date of the Contract. If the policy is replaced and/or the retroactive date is changed, then the expiring policy must be endorsed to extend the reporting period for claims for the policy in effect during the Contract for two (2) years from the completion date.

Workers Compensation and Employers' Liability:

- a. Projects not involving roofing work: Statutory limits.
- b. Projects involving roofing work: Statutory limits Including employers' liability of \$500,000.00/\$500,000.00/\$500,000.00.

Special Hazards: For projects involving underground work or explosives provide per the limit of general liability insurance the following:

- a. Type C - Collapse or Structural Integrity
- b. Type U - Underground Damage
- c. Type X - Explosion or Blasting

Original, completed Certificates of Insurance must be presented to the Town prior to Contract execution. The successful bidder agrees to provide replacement/renewal certificates at least 60 days prior to the expiration of the policy. Should any of the above described policies be cancelled before the expiration date, written notice must be given to the Town thirty (30) days prior to cancellation.

END OF INSURANCE REQUIREMENTS

TOWN OF CHESHIRE - CONNECTICUT

BID SUBMISSION DOCUMENTS

BID FORM

BIDDER'S FULL LEGAL NAME: _____

Pursuant to and in full compliance with this ITB, the proposer, having visited the site or property if applicable, and having thoroughly examined each and every document comprising this ITB, including any addenda, hereby offers and agrees as follows:

A. BASE BID – HVAC UPGRADES TO THE ADMINISTRATION BUILDING (PHASE 1):

To provide the products and/or services specified in, and upon the terms and conditions of, the ITB and shall be for all work as outlined in the bidding documents for the total LUMP SUM BID of:

_____/100 Dollars
(write out in words)

(\$ _____) (in numbers)

B. BASE BID – HVAC UPGRADES TO THE LABORATORY (PHASE 2):

To provide the products and/or services specified in, and upon the terms and conditions of, the ITB and shall be for all work as outlined in the bidding documents for the total LUMP SUM BID of:

_____/100 Dollars
(write out in words)

(\$ _____) (in numbers)

C. ALTERNATE TOTAL PROJECT BASE BID (BASE BID "A" & BASE BID "B") - OPTIONAL

Contractor is encouraged to provide an alternate approach to the individual Base Bids above which can demonstrate a more efficient and cost-effective procurement and construction of this project by performing both base bids (BASE BID "A" & BASE BID "B") concurrently.

_____/100 Dollars
(write out in words)

(\$ _____) (in numbers)

Note: The Town of Cheshire may elect to award each of the Base Bids separately or together if, in its sole discretion and judgement, will be in the Town's best interest.

ACKNOWLEDGEMENT

In submitting this Bid Form, the undersigned bidder acknowledges that the price(s) include all labor, materials, transportation, hauling, overhead, fees and insurances, bonds or letters of credit, profit, security, permits and licenses, and all other costs to cover the completed work called for in the ITB. Except as otherwise expressly stated in the ITB, no additional payment of any kind will be made for work accomplished under the price(s) as proposed.

REQUIRED DISCLOSURES1. Exceptions to the ITB (Check One)

_____ This bid does not take exception to any requirement of the ITB, including but not only any of the Contract Terms set forth in Section 27 of the Standard Instructions to Bidders.

- OR -

_____ This bid takes exception(s) to certain of the ITB requirements, including but not only the following Contract Terms set forth in Section 27 of the Standard Instructions to Bidders.

Exceptions Taken: _____

(Attach additional sheets necessary to fully describing each such exception)

2. State Debarment List (Check One)

Is the bidder on the State of Connecticut's Debarment List? ☐ YES ☐ NO

3. Occupational Safety and Health Law Violations

Has the bidder or any firm, corporation, partnership or association in which it has an interest (1) been cited for three (3) or more willful or serious violations of any occupational safety and health act or of any standard, order or regulation promulgated pursuant to such act, during the three-year period preceding the bid (provided such violations were cited in accordance with the provisions of any state occupational safety and health act or the Occupational Safety and Health Act of 1970, and not abated within the time fixed by the citation and such citation has not been set aside following appeal to the appropriate agency or court having jurisdiction) or (2) received one or more criminal convictions related to the injury or death of any employee in the three-year period preceding the bid?

☐ YES* ☐ NO * (If checked YES, attach a sheet fully describing each such matter)

4. Arbitration/Litigation

Has either the bidder or any of its principals (regardless of place of employment) been involved for the most recent ten (10) years in any resolved or pending arbitration or litigation?

☐ YES* ☐ NO * (If checked YES, attach a sheet fully describing each such matter)

5. Criminal Proceedings

Has the bidder or any of its principals (regardless of place of employment) ever been the subject of any criminal proceedings?

☐ YES* ☐ NO **(If checked YES, attach a sheet fully describing each such matter)*

6. Ethics and Offenses in Public Projects or Contracts

Has either the bidder or any of its principals (regardless of place of employment) ever been found to have violated any state or local ethics law, regulation, ordinance, code, policy or standard, or to have committed any other offense arising out of the submission of bids or bids or the performance of work on public works projects or contracts?

☐ YES* ☐ NO **(If checked YES, attach a sheet fully describing each such matter)*

PROPOSAL (BID) SECURITY *(Check One)*

☐ YES ☐ NO The bidder has included herein the required certified check or proposal (bid) bond in the amount of 5% of the bid amount.

NOTE: THIS DOCUMENT, IN ORDER TO BE CONSIDERED A VALID BID, MUST BE SIGNED BY A PRINCIPAL OFFICER OR OWNER OF THE BUSINESS ENTITY THAT IS SUBMITTING THE BID. SUCH SIGNATURE CONSTITUTES THE BIDDER'S REPRESENTATIONS THAT IT HAS READ, UNDERSTOOD AND FULLY ACCEPTED EACH AND EVERY PROVISION OF EACH DOCUMENT COMPROMISING THE ITB, UNLESS AN EXCEPTION IS DESCRIBED ABOVE. BIDDER AGREES THAT IT WILL SIGN CONTRACT PROVIDED BY THE TOWN, WITHOUT MODIFICATIONS OR ALTERATIONS, WITHIN FIVE (5) DAYS OF AWARD.

BY _____
(PRINT NAME)

TITLE: _____

(SIGNATURE)

DATE: _____

END OF BID FORM

LEGAL STATUS DISCLOSURE FORM

Fully complete the applicable section below, attaching a separate sheet if you need additional space.

For purposes of this disclosure, "permanent place of business" means an office continuously maintained, occupied and used by the bidder's regular employees regularly in attendance to carry on the bidder's business in the bidder's own name. An office maintained, occupied and used by a bidder only for the duration of a contract will not be considered a permanent place of business. An office maintained, occupied and used by a person affiliated with a bidder will not be considered a permanent place of business of the bidder.

IF A SOLELY OWNED BUSINESS:

Bidder's Full Legal Name: _____

Street Address: _____

Mailing Address (*if different from Street Address*): _____

Owner's Full Legal Name: _____

Number of years engaged in business under sole proprietor or trade name: _____

Does the bidder have a "permanent place of business" in Connecticut, as defined above?

☐ YES* ☐ NO *(If YES, please state the full street address (not a post office box) of that "permanent place of business.") _____

IF A CORPORATION:

Bidder's Full Legal Name: _____

Street Address: _____

Mailing Address (*if different from Street Address*): _____

Owner's Full Legal Name: _____

Number of years engaged in business: _____

Names of Current Officers:

President

Secretary

Chief Financial Officer

Does the bidder have a "permanent place of business" in Connecticut, as defined above?

☐ YES* ☐ NO *(If YES, please state the full street address (not a post office box) of that "permanent place of business.") _____

IF A LIMITED LIABILITY COMPANY:

Bidder's Full Legal Name: _____

Street Address: _____

Mailing Address (if different from Street Address): _____

Owner's Full Legal Name: _____

Number of years engaged in business: _____

Names of Current Manager(s) and Member(s):

*Name & Title (if any)*_____
*Residential Address (street only)*_____
*Name & Title (if any)*_____
*Residential Address (street only)*_____
*Name & Title (if any)*_____
*Residential Address (street only)*_____
*Name & Title (if any)*_____
*Residential Address (street only)*_____
*Name & Title (if any)*_____
Residential Address (street only)

Does the bidder have a "permanent place of business" in Connecticut, as defined above?

☐ YES* ☐ NO *(If YES, please state the full street address (not a post office box) of that "permanent place of business.") _____**IF A PARTNERSHIP:**

Bidder's Full Legal Name: _____

Street Address: _____

Mailing Address (if different from Street Address): _____

Owner's Full Legal Name: _____

Number of years engaged in business: _____

Names of Current Partners:

Name & Title (if any)

Residential Address (street only)

Name & Title (if any)

Residential Address (street only)

Name & Title (if any)

Residential Address (street only)

Name & Title (if any)

Residential Address (street only)

Does the bidder have a "permanent place of business" in Connecticut, as defined above?

☐ YES* ☐ NO *(If YES, please state the full street address (not a post office box) of that "permanent place of business.") _____

Legal Name of Bidder (*print*)

Bidder's Representative, Duly Authorized (*signature*)

Name of Bidder's Authorized Representative (*print*)

Title of Bidder's Authorized Representative

Date

END OF LEGAL STATUS DISCLOSURE FORM

TOWN OF CHESHIRE - CONNECTICUT

BIDDER'S CERTIFICATION
**Concerning Equal Employment Opportunities
And Affirmative Action Policy**

I/we, the bidder, certify that:

- 1) I/we are in compliance with the equal opportunity clause as set forth in Connecticut state law (Executive Order No. Three, <http://www.cslib.org/exeorder3.htm>) and will comply with applicable federal Executive Orders.
- 2) I/we do not maintain segregated facilities.
- 3) I/we have filed all required employer's information reports.
- 4) I/we have developed and maintain written affirmative action programs.
- 5) I/we list job openings with federal and state employment services.
- 6) I/we attempt to employ and advance in employment qualified handicapped individuals.
- 7) I/we are in compliance with the Americans with Disabilities Act.
- 8) I/we (*check one*):
_____ have an Affirmative Action Program, or
_____ employ 10 people or fewer.
- 9) I/we have read and understand the ITB Documents and all addenda, and our bid has been made on the basis thereof.

Legal Name of Bidder (*print*)

Bidder's Representative, Duly Authorized (*signature*)

Name of Bidder's Authorized Representative (*print*)

Title of Bidder's Authorized Representative

Date

BIDDER'S NON COLLUSION AFFIDAVIT

The undersigned bidder, having fully informed himself/herself/itself regarding the accuracy of the statements made herein, certifies that:

- (1) the bid is genuine; it is not a collusive or sham bid;
- (2) the bidder developed the bid independently and submitted it without collusion with, and without any agreement, understanding, communication or planned common course of action with, any other person or entity designed to limit independent competition;
- (3) the bidder, its employees and agents have not communicated the contents of the bid to any person not an employee or agent of the bidder and will not communicate the bid to any such person prior to the official opening of the bid; and
- (4) no elected or appointed official or other officer or employee of the Town of Cheshire is directly or indirectly interested in the bidder's bid, or in the supplies, materials, equipment, work or labor to which it relates, or in any of the profits thereof.

The undersigned bidder further certifies that this affidavit is executed for the purpose of inducing the Town of Cheshire to consider its bid and make an award in accordance therewith.

Legal Name of Bidder (*print*)

Bidder's Representative, Duly Authorized (*signature*)

Name of Bidder's Authorized Representative (*print*)

Title of Bidder's Authorized Representative

Date

Subscribed and sworn to before me this _____ day of _____, 2024.

Notary Public

My Commission Expires:

BIDDER'S STATEMENT OF REFERENCES

Provide at least three (3) references:

1. BUSINESS NAME _____
ADDRESS _____
CITY _____ STATE _____ ZIP _____
TELEPHONE: _____
INDIVIDUAL CONTACT NAME AND POSITION _____

2. BUSINESS NAME _____
ADDRESS _____
CITY _____ STATE _____ ZIP _____
TELEPHONE: _____
INDIVIDUAL CONTACT NAME AND POSITION _____

3. BUSINESS NAME _____
ADDRESS _____
CITY _____ STATE _____ ZIP _____
TELEPHONE: _____
INDIVIDUAL CONTACT NAME AND POSITION _____

END OF STATEMENT OF REFERENCES

TOWN OF CHESHIRE - CONNECTICUT

BIDDER'S CONTACT INFORMATION

Provide the Bidder's point of contact information:

Contact Name: _____

Title: _____

Mailing Address: _____

BusinessTelephone: _____

Cell Phone: _____

Email: _____

CONTRACT

(Draft in the form attached)

DRAFT AIA® Document A101™ – 2017

Standard Form of Agreement Between Owner and Contractor where the basis of payment is a Stipulated Sum

AGREEMENT made as of the «**1**» day of «**1**» in the year «**1**»
(In words, indicate day, month and year.)

BETWEEN the Owner:
(Name, legal status, address and other information)

«**1**» «**1**» «**1**» Town of Cheshire
»84 South Main Street
Cheshire, CT 06410 »

and the Contractor:
(Name, legal status, address and other information)

«
« for the following Project:
(Name, location and detailed description)

«
The Architect:
(Name, legal status, address and other information)

«**1**»
« The Owner and Contractor agree as follows.

ADDITIONS AND DELETIONS:

The author of this document has added information needed for its completion. The author may also have revised the text of the original AIA standard form. An *Additions and Deletions Report* that notes added information as well as revisions to the standard form text is available from the author and should be reviewed.

This document has important legal consequences. Consultation with an attorney is encouraged with respect to its completion or modification.

The parties should complete A101™-2017, Exhibit A, Insurance and Bonds, contemporaneously with this Agreement. AIA Document A201™-2017, General Conditions of the Contract for Construction, is adopted in this document by reference. Do not use with other general conditions unless this document is modified.

ELECTRONIC COPYING of any portion of this AIA® Document to another electronic file is prohibited and constitutes a violation of copyright laws as set forth in the footer of this document.

TABLE OF ARTICLES

- 1 THE CONTRACT DOCUMENTS
- 2 THE WORK OF THIS CONTRACT
- 3 DATE OF COMMENCEMENT AND SUBSTANTIAL COMPLETION
- 4 CONTRACT SUM
- 5 PAYMENTS
- 6 DISPUTE RESOLUTION
- 7 TERMINATION OR SUSPENSION
- 8 MISCELLANEOUS PROVISIONS
- 9 ENUMERATION OF CONTRACT DOCUMENTS

EXHIBIT A INSURANCE AND BONDS

ARTICLE 1 THE CONTRACT DOCUMENTS

The Contract Documents consist of this Agreement, Conditions of the Contract (General, Supplementary, and other Conditions), Drawings, Specifications, Addenda issued prior to execution of this Agreement, the Bidding Documents (including Owner's Instructions to Bidders, Owner's Invitation to Bid # and all Bidding Documents issued in conjunction therewith, including Addendum #1), Contractor's Bid dated _____, other documents listed in this Agreement, and Modifications issued after execution of this Agreement, all of which form the Contract, and are as fully a part of the Contract as if attached to this Agreement or repeated herein. The Contract represents the entire and integrated agreement between the parties hereto and supersedes prior negotiations, representations, or agreements, either written or oral. An enumeration of the Contract Documents, other than a Modification, appears in Article 9.

ARTICLE 2 THE WORK OF THIS CONTRACT

The Contractor shall fully execute the Work described in the Contract Documents, except as specifically indicated in the Contract Documents to be the responsibility of others.

ARTICLE 3 DATE OF COMMENCEMENT AND SUBSTANTIAL COMPLETION

§ 3.1 The date of commencement of the Work shall be:

(Check one of the following boxes.)

☐ The date of this Agreement.

☒ A date set forth in a notice to proceed issued by the Owner or Architect. Contractor shall coordinate the scheduling and performance of the Work with the Owner.

☐ Established as follows:

(Insert a date or a means to determine the date of commencement of the Work.)

☐

If a date of commencement of the Work is not selected, then the date of commencement shall be the date of this Agreement.

§ 3.2 The Contract Time shall be measured from the date of commencement of the Work.

§ 3.3 Substantial Completion

§ 3.3.1 Subject to adjustments of the Contract Time as provided in the Contract Documents, the Contractor shall achieve Substantial Completion of the entire Work:

(Check one of the following boxes and complete the necessary information.)

[☐] Not later than «ten» («10») months from the date of commencement of the Work.

[☒] By the following date: «_____»

TIME IS OF THE ESSENCE WITH REGARD TO THE TIMELY PERFORMANCE OF THE AGREEMENT, ACHIEVEMENT OF ALL MILESTONES, SUBSTANTIAL COMPLETION AND FINAL COMPLETION OF THE PROJECT BY THE CONTRACTOR. If, in the sole opinion of the Owner, the Contractor is not adhering to the Project schedule and/or is not supplying sufficient labor and/or equipment to complete the Work by the Substantial Completion date contained herein, upon forty-eight (48) hours written notice, the Town shall have the right to direct the Contractor to increase its labor and/or equipment to meet established project schedules without additional compensation provided the Town is not responsible or in any way liable for the Contractor not adhering to the Project schedule. Any and all such additional labor or supervision shall be at Contractor's sole cost and expense and may include, but shall not be limited to, Town directing the Contractor to increase the workers on its crews, supply additional equipment, work overtime, work a second shift during a single day, work weekends, or any combination thereof, without any additional compensation being due to Contractor for such additional personnel. Any costs incurred or arising due to the Contractor's failure to achieve timely Substantial Completion shall be borne solely by the Contractor.

§ 3.3.1.1 Contractor expressly agrees, notwithstanding any provision in this Agreement to the contrary, that: (i) a COVID-19 pandemic exists worldwide as of the execution date of this Agreement; (ii) the existence of such pandemic, and its effects, now, and for the duration of Contractor's performance under the Agreement, shall not in and of itself be cause for Contractor to rely upon, invoke, or avail itself to, any rights or remedies under this Agreement, at law, or in equity, for a claim, or an adjustment to the price, schedule, quantities, specifications, or other material terms of this Agreement; (iii) the material terms of this Agreement, particularly terms relating to price, schedule, quantities, availability and specifications, take into consideration, and fully account for, the existence of such pandemic and its effects, as of the date of this Agreement; and (iv) such pandemic shall not render Contractor unable to fulfill any of its obligations under the Agreement, and Contractor shall not have any claim, action, or cause of action against the Owner in connection with such pandemic, including any claim for frustration of purpose change in circumstances, economic balance, or impossibility. This provision shall survive the completion or earlier termination of this Agreement.

§ 3.3.2 Subject to adjustments of the Contract Time as provided in the Contract Documents, if portions of the Work are to be completed prior to Substantial Completion of the entire Work, the Contractor shall achieve Substantial Completion of such portions by the following dates:

Portion of Work

« »

Substantial Completion Date

§ 3.3.3 If the Contractor fails to achieve Substantial Completion as provided in this Section 3.3, liquidated damages, if any, shall be assessed as set forth in Section 4.5.

ARTICLE 4 CONTRACT SUM

§ 4.1 The Owner shall pay the Contractor the Contract Sum in current funds for the Contractor's performance of the Contract. The Contract Sum shall be «_____» (\$ «_____»), subject to additions and deductions as provided in the Contract Documents.

§ 4.2 Alternates

§ 4.2.1 Alternates, if any, included in the Contract Sum:

Item

«None »

Price

§ 4.2.2 Subject to the conditions noted below, the following alternates may be accepted by the Owner following execution of this Agreement. Upon acceptance, the Owner shall issue a Modification to this Agreement.
(Insert below each alternate and the conditions that must be met for the Owner to accept the alternate.)

Item	Price	Conditions for Acceptance
«N/A »		

§ 4.3 Allowances, if any, included in the Contract Sum:
(Identify each allowance.)

Item	Price
«As indicated in the Bid Proposal »	

§ 4.4 Unit prices, if any:
(Identify the item and state the unit price and quantity limitations, if any, to which the unit price will be applicable.)

Item	Units and Limitations	Price per Unit (\$0.00)
«As indicated in the Bid Proposal »		

§ 4.5 Liquidated damages, if any:
(Insert terms and conditions for liquidated damages, if any.)

«See A201 as modified. »

§ 4.6 Other:
(Insert provisions for bonus or other incentives, if any, that might result in a change to the Contract Sum.)

« »

ARTICLE 5 PAYMENTS

§ 5.1 Progress Payments

§ 5.1.1 Based upon Applications for Payment submitted to the Architect by the Contractor and Certificates for Payment issued by the Architect, the Owner shall make progress payments on account of the Contract Sum to the Contractor as provided below and elsewhere in the Contract Documents.

§ 5.1.2 The period covered by each Application for Payment shall be one calendar month ending on the last day of the month, or as follows:

« »

§ 5.1.3 Provided that an Application for Payment is received by the Architect not later than the «25th» day of a month, the Owner shall make payment of the amount certified to the Contractor not later than thirty (30) days after the Owner approves the Application for Payment. If an Application for Payment is received by the Architect after the application date fixed above, payment of the amount certified shall be made by the Owner not later than «thirty» («30») days after the approves the Application for Payment certified by the Architect.
(Federal, state or local laws may require payment within a certain period of time.)

§ 5.1.4 Each Application for Payment shall be based on the most recent schedule of values submitted by the Contractor in accordance with the Contract Documents. The schedule of values shall allocate the entire Contract Sum among the various portions of the Work. The schedule of values shall be prepared in such form, and supported by such data to substantiate its accuracy, as the Architect may require. This schedule of values shall be used as a basis for reviewing the Contractor's Applications for Payment.

§ 5.1.5 Applications for Payment shall show the percentage of completion of each portion of the Work as of the end of the period covered by the Application for Payment.

§ 5.1.6 In accordance with AIA Document A201™–2017, General Conditions of the Contract for Construction, and subject to other provisions of the Contract Documents, the amount of each progress payment shall be computed as follows:

§ 5.1.6.1 The amount of each progress payment shall first include:

- .1 That portion of the Contract Sum properly allocable to completed Work;
- .2 That portion of the Contract Sum properly allocable to materials and equipment delivered and suitably stored at the site for subsequent incorporation in the completed construction, or, if approved in advance by the Owner, suitably stored off the site at a location agreed upon in writing; and
- .3 That portion of Construction Change Directives that the Architect determines, in the Architect's professional judgment, to be reasonably justified.

§ 5.1.6.2 The amount of each progress payment shall then be reduced by:

- .1 The aggregate of any amounts previously paid by the Owner;
- .2 The amount, if any, for Work that remains uncorrected and for which the Architect has previously withheld a Certificate for Payment as provided in Article 9 of AIA Document A201–2017;
- .3 Any amount for which the Contractor does not intend to pay a Subcontractor or material supplier, unless the Work has been performed by others the Contractor intends to pay;
- .4 For Work performed or defects discovered since the last payment application, any amount for which the Architect may withhold payment, or nullify a Certificate of Payment in whole or in part, as provided in Article 9 of AIA Document A201–2017; and
- .5 Retainage withheld pursuant to Section 5.1.7.

§ 5.1.7 Retainage

§ 5.1.7.1 For each progress payment made prior to Substantial Completion of the Work, the Owner may withhold the following amount, as retainage, from the payment otherwise due:

(Insert a percentage or amount to be withheld as retainage from each Application for Payment. The amount of retainage may be limited by governing law.)

« Five percent (5%) »

§ 5.1.7.1.1 The following items are not subject to retainage:

(Insert any items not subject to the withholding of retainage, such as general conditions, insurance, etc.)

«N/A »

§ 5.1.7.2 Reduction or limitation of retainage, if any, shall be as follows:

(If the retainage established in Section 5.1.7.1 is to be modified prior to Substantial Completion of the entire Work, including modifications for Substantial Completion of portions of the Work as provided in Section 3.3.2, insert provisions for such modifications.)

«At the Owner's sole discretion. »

§ 5.1.7.3 Except as set forth in this Section 5.1.7.3, upon Substantial Completion of the Work, the Contractor may submit an Application for Payment that includes the retainage withheld from prior Applications for Payment pursuant to this Section 5.1.7. The Application for Payment submitted at Substantial Completion shall not include retainage as follows:

(Insert any other conditions for release of retainage upon Substantial Completion.)

Owner shall be entitled to retain two hundred percent (200%) of the estimated cost to complete punchlist items to reach Final Completion.

« »

§ 5.1.8 If final completion of the Work is materially delayed through no fault of the Contractor, the Owner shall pay the Contractor any additional amounts in accordance with Article 9 of AIA Document A201–2017.

§ 5.1.9 Except with the Owner's prior approval, the Contractor shall not make advance payments to suppliers for materials or equipment which have not been delivered and stored at the site.

§ 5.2 Final Payment

§ 5.2.1 Final payment, constituting the entire unpaid balance of the Contract Sum, shall be made by the Owner to the Contractor when

- .1 the Contractor has fully performed the Contract except for the Contractor's responsibility to correct Work as provided in Article 12 of AIA Document A201–2017, and to satisfy other requirements, if any, which extend beyond final payment; and
- .2 a final Certificate for Payment has been issued by the Architect and all conditions precedent to final payment have been satisfied.

§ 5.2.2 The Owner's final payment to the Contractor shall be made no later than 30 days after the issuance of the Architect's final Certificate for Payment, or as follows:

« »

§ 5.3 Intentionally Deleted.

ARTICLE 6 DISPUTE RESOLUTION

§ 6.1 Initial Decision Maker

The Architect will serve as the Initial Decision Maker pursuant to Article 15 of AIA Document A201–2017, unless the parties appoint below another individual, not a party to this Agreement, to serve as the Initial Decision Maker. *(If the parties mutually agree, insert the name, address and other contact information of the Initial Decision Maker, if other than the Architect.)*

« »

« »

« »

« »

§ 6.2 Binding Dispute Resolution

For any Claim subject to, but not resolved by, mediation pursuant to Article 15 of AIA Document A201–2017, the method of binding dispute resolution shall be as follows:

(Check the appropriate box.)

[☐] Arbitration pursuant to Section 15.4 of AIA Document A201–2017

[☐] Litigation in a court of competent jurisdiction

[☒] Other *(Specify)*

«Litigation in Connecticut Superior Court in and for the Judicial District of New Haven unless the Owner, in its sole discretion, elects to arbitrate a dispute..»

If the Owner and Contractor do not select a method of binding dispute resolution, or do not subsequently agree in writing to a binding dispute resolution method other than litigation, Claims will be resolved by litigation in a court of competent jurisdiction.

ARTICLE 7 TERMINATION OR SUSPENSION

§ 7.1 The Contract may be terminated by the Owner or the Contractor as provided in Article 14 of AIA Document A201–2017.

§ 7.1.1 Intentionally Deleted.

§ 7.2 The Work may be suspended by the Owner as provided in Article 14 of AIA Document A201–2017.

ARTICLE 8 MISCELLANEOUS PROVISIONS

§ 8.1 Where reference is made in this Agreement to a provision of AIA Document A201–2017 or another Contract Document, the reference refers to that provision as amended or supplemented by other provisions of the Contract Documents.

§ 8.2 The Owner's representative:

(Name, address, email address, and other information)

«To be named by the Owner in writing within ten (10) days of the execution of this Agreement. »

« »
« »
« »
« »
« »

§ 8.3 The Contractor's representative:

(Name, address, email address, and other information)

« To be named by the Contractor in writing within ten (10) days of the execution of this Agreement »

« »
« »
« »
« »
« »

§ 8.4 Neither the Owner's nor the Contractor's representative shall be changed without ten days' prior notice to the other party.

§ 8.5 Insurance and Bonds

§ 8.5.1 The Owner and the Contractor shall purchase and maintain insurance as set forth in AIA Document A101™–2017, Standard Form of Agreement Between Owner and Contractor where the basis of payment is a Stipulated Sum, Exhibit A, Insurance and Bonds, and elsewhere in the Contract Documents.

§ 8.5.2 The Contractor shall provide bonds as set forth in AIA Document A101™–2017 Exhibit A, and elsewhere in the Contract Documents.

§ 8.6 Notice in electronic format, pursuant to Article 1 of AIA Document A201–2017, may be given in accordance with AIA Document E203™–2013, Building Information Modeling and Digital Data Exhibit, if completed, or as otherwise set forth below:

(If other than in accordance with AIA Document E203–2013, insert requirements for delivering notice in electronic format such as name, title, and email address of the recipient and whether and how the system will be required to generate a read receipt for the transmission.)

« »

§ 8.7 Other provisions:

« »

ARTICLE 9 ENUMERATION OF CONTRACT DOCUMENTS

§ 9.1 This Agreement is comprised of the following documents:

- .1 AIA Document A101™–2017, Standard Form of Agreement Between Owner and Contractor
- .2 AIA Document A101™–2017, Exhibit A, Insurance and Bonds
- .3 AIA Document A201™–2017, General Conditions of the Contract for Construction, as modified
- .4 AIA Document E203™–2013, Building Information Modeling and Digital Data Exhibit, dated as indicated below:

(Insert the date of the E203-2013 incorporated into this Agreement.)

« »

.5 Drawings

Number	Title	Date
«See List of Drawings »		

.6 Specifications

Section	Title	Date	Pages
«See Table of Contents »			

.7 Addenda, if any:

Number	Date	Pages
« »		

Portions of Addenda relating to bidding or proposal requirements are not part of the Contract Documents unless the bidding or proposal requirements are also enumerated in this Article 9.

.8 Other Exhibits:

(Check all boxes that apply and include appropriate information identifying the exhibit where required.)

[« »] AIA Document E204™–2017, Sustainable Projects Exhibit, dated as indicated below:
(Insert the date of the E204-2017 incorporated into this Agreement.)

« »

[« »] The Sustainability Plan:

Title	Date	Pages
« »		

[« »] Supplementary and other Conditions of the Contract:

Document	Title	Date	Pages
« »			

.9 Other documents, if any, listed below:

(List here any additional documents that are intended to form part of the Contract Documents. AIA Document A201™–2017 provides that the advertisement or invitation to bid, Instructions to Bidders, sample forms, the Contractor's bid or proposal, portions of Addenda relating to bidding or proposal requirements, and other information furnished by the Owner in anticipation of receiving bids or proposals, are not part of the Contract Documents unless enumerated in this Agreement. Any such documents should be listed here only if intended to be part of the Contract Documents.)

« Town of Cheshire, Invitation to Bid
Instructions to Bidders, AIA A701, and Supplemental Instructions to Bidders
State of CT, Prevailing Wage Rates
Contractor's Bid Proposal

This Agreement entered into as of the day and year first written above.

« »

OWNER (Signature)

« »« »

(Printed name and title)

« »

CONTRACTOR (Signature)

«

»« »

(Printed name and title)



DRAFT AIA® Document A201™ – 2017

General Conditions of the Contract for Construction

for the following PROJECT:
(Name and location or address)

THE OWNER:
(Name, legal status and address)

«Town of Cheshire
84 South Main Street
Cheshire, CT 06410

THE ARCHITECT:
(Name, legal status and address)

TABLE OF ARTICLES

- 1 GENERAL PROVISIONS
- 2 OWNER
- 3 CONTRACTOR
- 4 ARCHITECT
- 5 SUBCONTRACTORS
- 6 CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS
- 7 CHANGES IN THE WORK
- 8 TIME
- 9 PAYMENTS AND COMPLETION
- 10 PROTECTION OF PERSONS AND PROPERTY
- 11 INSURANCE AND BONDS
- 12 UNCOVERING AND CORRECTION OF WORK
- 13 MISCELLANEOUS PROVISIONS

ADDITIONS AND DELETIONS:

The author of this document has added information needed for its completion. The author may also have revised the text of the original AIA standard form. An *Additions and Deletions Report* that notes added information as well as revisions to the standard form text is available from the author and should be reviewed.

This document has important legal consequences. Consultation with an attorney is encouraged with respect to its completion or modification.

For guidance in modifying this document to include supplementary conditions, see AIA Document A503™, *Guide for Supplementary Conditions*.

ELECTRONIC COPYING of any portion of this AIA® Document to another electronic file is prohibited and constitutes a violation of copyright laws as set forth in the footer of this document.

14 TERMINATION OR SUSPENSION OF THE CONTRACT

15 CLAIMS AND DISPUTES



INDEX

(Topics and numbers in bold are Section headings.)

Acceptance of Nonconforming Work

9.6.6, 9.9.3, **12.3**

Acceptance of Work

9.6.6, 9.8.2, 9.9.3, 9.10.1, 9.10.3, **12.3**

Access to Work

3.16, 6.2.1, **12.1**

Accident Prevention

10

Acts and Omissions

3.2, 3.3.2, 3.12.8, 3.18, 4.2.3, 8.3.1, 9.5.1, 10.2.5, 10.2.8, 13.3.2, 14.1, 15.1.2, **15.2**

Addenda

1.1.1

Additional Costs, Claims for

3.7.4, 3.7.5, 10.3.2, **15.1.5**

Additional Inspections and Testing

9.4.2, 9.8.3, **12.2.1**, **13.4**

Additional Time, Claims for

3.2.4, 3.7.4, 3.7.5, 3.10.2, 8.3.2, **15.1.6**

Administration of the Contract

3.1.3, **4.2**, 9.4, 9.5

Advertisement or Invitation to Bid

1.1.1

Aesthetic Effect

4.2.13

Allowances

3.8

Applications for Payment

4.2.5, 7.3.9, 9.2, **9.3**, 9.4, 9.5.1, 9.5.4, 9.6.3, 9.7, 9.10

Approvals

2.1.1, 2.3.1, 2.5, 3.1.3, 3.10.2, 3.12.8, 3.12.9,

3.12.10.1, 4.2.7, 9.3.2, 13.4.1

Arbitration

8.3.1, 15.3.2, **15.4**

ARCHITECT

4

Architect, Definition of

4.1.1

Architect, Extent of Authority

2.5, 3.12.7, 4.1.2, 4.2, 5.2, 6.3, 7.1.2, 7.3.4, 7.4, 9.2, 9.3.1, 9.4, 9.5, 9.6.3, 9.8, 9.10.1, 9.10.3, 12.1, 12.2.1, 13.4.1, 13.4.2, 14.2.2, 14.2.4, 15.1.4, 15.2.1

Architect, Limitations of Authority and

Responsibility

2.1.1, 3.12.4, 3.12.8, 3.12.10, 4.1.2, 4.2.1, 4.2.2, 4.2.3, 4.2.6, 4.2.7, 4.2.10, 4.2.12, 4.2.13, 5.2.1, 7.4, 9.4.2, 9.5.4, 9.6.4, 15.1.4, **15.2**

Architect's Additional Services and Expenses

2.5, 12.2.1, 13.4.2, 13.4.3, 14.2.4

Architect's Administration of the Contract

3.1.3, 3.7.4, 15.2, 9.4.1, 9.5

Architect's Approvals

2.5, 3.1.3, 3.5, 3.10.2, 4.2.7

Architect's Authority to Reject Work

3.5, 4.2.6, 12.1.2, 12.2.1

Architect's Copyright

1.1.7, 1.5

Architect's Decisions

3.7.4, 4.2.6, 4.2.7, 4.2.11, 4.2.12, 4.2.13, 4.2.14, 6.3, 7.3.4, 7.3.9, 8.1.3, 8.3.1, 9.2, 9.4.1, 9.5, 9.8.4, 9.9.1, 13.4.2, **15.2**

Architect's Inspections

3.7.4, 4.2.2, 4.2.9, 9.4.2, 9.8.3, 9.9.2, 9.10.1, **13.4**

Architect's Instructions

3.2.4, 3.3.1, 4.2.6, 4.2.7, **13.4.2**

Architect's Interpretations

4.2.11, 4.2.12

Architect's Project Representative

4.2.10

Architect's Relationship with Contractor

1.1.2, 1.5, 2.3.3, 3.1.3, 3.2.2, 3.2.3, 3.2.4, 3.3.1, 3.4.2, 3.5, 3.7.4, 3.7.5, 3.9.2, 3.9.3, 3.10, 3.11, 3.12, 3.16, 3.18, 4.1.2, 4.2, 5.2, 6.2.2, 7, 8.3.1, 9.2, 9.3, 9.4, 9.5, 9.7, 9.8, 9.9, 10.2.6, 10.3, 11.3, 12, 13.3.2, 13.4, **15.2**

Architect's Relationship with Subcontractors

1.1.2, 4.2.3, 4.2.4, 4.2.6, 9.6.3, 9.6.4, **11.3**

Architect's Representations

9.4.2, 9.5.1, 9.10.1

Architect's Site Visits

3.7.4, 4.2.2, 4.2.9, 9.4.2, 9.5.1, 9.9.2, 9.10.1, **13.4**

Asbestos

10.3.1

Attorneys' Fees

3.18.1, 9.6.8, 9.10.2, **10.3.3**

Award of Separate Contracts

6.1.1, 6.1.2

Award of Subcontracts and Other Contracts for Portions of the Work

5.2

Basic Definitions

1.1

Bidding Requirements

1.1.1

Binding Dispute Resolution

8.3.1, 9.7, 11.5, 13.1, 15.1.2, 15.1.3, 15.2.1, 15.2.5, 15.2.6.1, 15.3.1, 15.3.2, 15.3.3, 15.4.1

Bonds, Lien

7.3.4.4, 9.6.8, 9.10.2, 9.10.3

Bonds, Performance, and Payment

7.3.4.4, 9.6.7, 9.10.3, **11.1.2**, **11.1.3**, **11.5**

Building Information Models Use and Reliance

1.8

Building Permit

3.7.1

Capitalization

1.3

Certificate of Substantial Completion

9.8.3, 9.8.4, 9.8.5

Certificates for Payment

4.2.1, 4.2.5, 4.2.9, 9.3.3, **9.4**, 9.5, 9.6.1, 9.6.6, 9.7, 9.10.1, 9.10.3, 14.1.1.3, 14.2.4, **15.1.4**

Certificates of Inspection, Testing or Approval

13.4.4
Certificates of Insurance
9.10.2
Change Orders
1.1.1, 3.4.2, 3.7.4, 3.8.2.3, 3.11, 3.12.8, 4.2.8, 5.2.3,
7.1.2, 7.1.3, **7.2**, 7.3.2, 7.3.7, 7.3.9, 7.3.10, 8.3.1,
9.3.1.1, 9.10.3, 10.3.2, 11.2, 11.5, 12.1.2
Change Orders, Definition of
7.2.1
CHANGES IN THE WORK
2.2.2, 3.11, 4.2.8, 7, 7.2.1, 7.3.1, 7.4, 8.3.1, 9.3.1.1,
11.5
Claims, Definition of
15.1.1
Claims, Notice of
1.6.2, 15.1.3
CLAIMS AND DISPUTES
3.2.4, 6.1.1, 6.3, 7.3.9, 9.3.3, 9.10.4, 10.3.3, **15**, 15.4
Claims and Timely Assertion of Claims
15.4.1
Claims for Additional Cost
3.2.4, 3.3.1, 3.7.4, 7.3.9, 9.5.2, 10.2.5, 10.3.2, **15.1.5**
Claims for Additional Time
3.2.4, 3.3.1, 3.7.4, 6.1.1, 8.3.2, 9.5.2, 10.3.2, **15.1.6**
Concealed or Unknown Conditions, Claims for
3.7.4
Claims for Damages
3.2.4, 3.18, 8.3.3, 9.5.1, 9.6.7, 10.2.5, 10.3.3, 11.3,
11.3.2, 14.2.4, 15.1.7
Claims Subject to Arbitration
15.4.1
Cleaning Up
3.15, 6.3
Commencement of the Work, Conditions Relating to
2.2.1, 3.2.2, 3.4.1, 3.7.1, 3.10.1, 3.12.6, 5.2.1, 5.2.3,
6.2.2, 8.1.2, 8.2.2, 8.3.1, 11.1, 11.2, **15.1.5**
Commencement of the Work, Definition of
8.1.2
Communications
3.9.1, **4.2.4**
Completion, Conditions Relating to
3.4.1, 3.11, 3.15, 4.2.2, 4.2.9, 8.2, 9.4.2, 9.8, 9.9.1,
9.10, 12.2, 14.1.2, 15.1.2
COMPLETION, PAYMENTS AND
9
Completion, Substantial
3.10.1, 4.2.9, 8.1.1, 8.1.3, 8.2.3, 9.4.2, 9.8, 9.9.1,
9.10.3, 12.2, 15.1.2
Compliance with Laws
2.3.2, 3.2.3, 3.6, 3.7, 3.12.10, 3.13, 9.6.4, 10.2.2,
13.1, 13.3, 13.4.1, 13.4.2, 13.5, 14.1.1, 14.2.1.3,
15.2.8, 15.4.2, 15.4.3
Concealed or Unknown Conditions
3.7.4, 4.2.8, 8.3.1, 10.3
Conditions of the Contract
1.1.1, 6.1.1, 6.1.4
Consent, Written

3.4.2, 3.14.2, 4.1.2, 9.8.5, 9.9.1, 9.10.2, 9.10.3, 13.2,
15.4.4.2
Consolidation or Joinder
15.4.4
**CONSTRUCTION BY OWNER OR BY
SEPARATE CONTRACTORS**
1.1.4, **6**
Construction Change Directive, Definition of
7.3.1
Construction Change Directives
1.1.1, 3.4.2, 3.11, 3.12.8, 4.2.8, 7.1.1, 7.1.2, 7.1.3,
7.3, 9.3.1.1
Construction Schedules, Contractor's
3.10, 3.11, 3.12.1, 3.12.2, 6.1.3, 15.1.6.2
Contingent Assignment of Subcontracts
5.4, 14.2.2.2
Continuing Contract Performance
15.1.4
Contract, Definition of
1.1.2
**CONTRACT, TERMINATION OR
SUSPENSION OF THE**
5.4.1.1, 5.4.2, 11.5, **14**
Contract Administration
3.1.3, 4, 9.4, 9.5
Contract Award and Execution, Conditions Relating
to
3.7.1, 3.10, 5.2, 6.1
Contract Documents, Copies Furnished and Use of
1.5.2, 2.3.6, 5.3
Contract Documents, Definition of
1.1.1
Contract Sum
2.2.2, 2.2.4, 3.7.4, 3.7.5, 3.8, 3.10.2, 5.2.3, 7.3, 7.4,
9.1, 9.2, 9.4.2, 9.5.1.4, 9.6.7, 9.7, 10.3.2, 11.5, 12.1.2,
12.3, 14.2.4, 14.3.2, 15.1.4.2, **15.1.5**, **15.2.5**
Contract Sum, Definition of
9.1
Contract Time
1.1.4, 2.2.1, 2.2.2, 3.7.4, 3.7.5, 3.10.2, 5.2.3, 6.1.5,
7.2.1.3, 7.3.1, 7.3.5, 7.3.6, 7, 7.3.10, 7.4, 8.1.1,
8.2.1, 8.2.3, 8.3.1, 9.5.1, 9.7, 10.3.2, 12.1.1, 12.1.2,
14.3.2, 15.1.4.2, 15.1.6.1, 15.2.5
Contract Time, Definition of
8.1.1
CONTRACTOR
3
Contractor, Definition of
3.1, **6.1.2**
**Contractor's Construction and Submittal
Schedules**
3.10, 3.12.1, 3.12.2, 4.2.3, 6.1.3, 15.1.6.2
Contractor's Employees
2.2.4, 3.3.2, 3.4.3, 3.8.1, 3.9, 3.18.2, 4.2.3, 4.2.6,
10.2, 10.3, 11.3, 14.1, 14.2.1.1
Contractor's Liability Insurance
11.1

Contractor's Relationship with Separate Contractors and Owner's Forces
3.12.5, 3.14.2, 4.2.4, 6, 11.3, 12.2.4

Contractor's Relationship with Subcontractors
1.2.2, 2.2.4, 3.3.2, 3.18.1, 3.18.2, 4.2.4, 5, 9.6.2, 9.6.7, 9.10.2, 11.2, 11.3, 11.4

Contractor's Relationship with the Architect
1.1.2, 1.5, 2.3.3, 3.1.3, 3.2.2, 3.2.3, 3.2.4, 3.3.1, 3.4.2, 3.5.1, 3.7.4, 3.10, 3.11, 3.12, 3.16, 3.18, 4.2, 5.2, 6.2.2, 7, 8.3.1, 9.2, 9.3, 9.4, 9.5, 9.7, 9.8, 9.9, 10.2.6, 10.3, 11.3, 12, 13.4, 15.1.3, 15.2.1

Contractor's Representations
3.2.1, 3.2.2, 3.5, 3.12.6, 6.2.2, 8.2.1, 9.3.3, 9.8.2

Contractor's Responsibility for Those Performing the Work
3.3.2, 3.18, 5.3, 6.1.3, 6.2, 9.5.1, 10.2.8

Contractor's Review of Contract Documents
3.2

Contractor's Right to Stop the Work
2.2.2, 9.7

Contractor's Right to Terminate the Contract
14.1

Contractor's Submittals
3.10, 3.11, 3.12, 4.2.7, 5.2.1, 5.2.3, 9.2, 9.3, 9.8.2, 9.8.3, 9.9.1, 9.10.2, 9.10.3

Contractor's Superintendent
3.9, 10.2.6

Contractor's Supervision and Construction Procedures
1.2.2, 3.3, 3.4, 3.12.10, 4.2.2, 4.2.7, 6.1.3, 6.2.4, 7.1.3, 7.3.4, 7.3.6, 8.2, 10, 12, 14, 15.1.4

Coordination and Correlation
1.2, 3.2.1, 3.3.1, 3.10, 3.12.6, 6.1.3, 6.2.1

Copies Furnished of Drawings and Specifications
1.5, 2.3.6, 3.11

Copyrights
1.5, **3.17**

Correction of Work
2.5, 3.7.3, 9.4.2, 9.8.2, 9.8.3, 9.9.1, 12.1.2, **12.2**, 12.3, 15.1.3.1, 15.1.3.2, 15.2.1

Correlation and Intent of the Contract Documents
1.2

Cost, Definition of
7.3.4

Costs
2.5, 3.2.4, 3.7.3, 3.8.2, 3.15.2, 5.4.2, 6.1.1, 6.2.3, 7.3.3.3, 7.3.4, 7.3.8, 7.3.9, 9.10.2, 10.3.2, 10.3.6, 11.2, 12.1.2, 12.2.1, 12.2.4, 13.4, 14

Cutting and Patching
3.14, 6.2.5

Damage to Construction of Owner or Separate Contractors
3.14.2, 6.2.4, 10.2.1.2, 10.2.5, 10.4, 12.2.4

Damage to the Work
3.14.2, 9.9.1, 10.2.1.2, 10.2.5, 10.4, 12.2.4

Damages, Claims for
3.2.4, 3.18, 6.1.1, 8.3.3, 9.5.1, 9.6.7, 10.3.3, 11.3.2, 11.3, 14.2.4, 15.1.7

Damages for Delay
6.2.3, 8.3.3, 9.5.1.6, 9.7, 10.3.2, 14.3.2

Date of Commencement of the Work, Definition of
8.1.2

Date of Substantial Completion, Definition of
8.1.3

Day, Definition of
8.1.4

Decisions of the Architect
3.7.4, 4.2.6, 4.2.7, 4.2.11, 4.2.12, 4.2.13, 6.3, 7.3.4, 7.3.9, 8.1.3, 8.3.1, 9.2, 9.4, 9.5.1, 9.8.4, 9.9.1, 13.4.2, 14.2.2, 14.2.4, 15.1, 15.2

Decisions to Withhold Certification
9.4.1, **9.5**, 9.7, 14.1.1.3

Defective or Nonconforming Work, Acceptance, Rejection and Correction of
2.5, 3.5, 4.2.6, 6.2.3, 9.5.1, 9.5.3, 9.6.6, 9.8.2, 9.9.3, 9.10.4, 12.2.1

Definitions
1.1, 2.1.1, 3.1.1, 3.5, 3.12.1, 3.12.2, 3.12.3, 4.1.1, 5.1, 6.1.2, 7.2.1, 7.3.1, 8.1, 9.1, 9.8.1, 15.1.1

Delays and Extensions of Time
3.2, **3.7.4**, 5.2.3, 7.2.1, 7.3.1, **7.4**, **8.3**, 9.5.1, **9.7**, 10.3.2, **10.4**, 14.3.2, **15.1.6**, 15.2.5

Digital Data Use and Transmission
1.7

Disputes
6.3, 7.3.9, 15.1, 15.2

Documents and Samples at the Site
3.11

Drawings, Definition of
1.1.5

Drawings and Specifications, Use and Ownership of
3.11

Effective Date of Insurance
8.2.2

Emergencies
10.4, 14.1.1.2, **15.1.5**

Employees, Contractor's
3.3.2, 3.4.3, 3.8.1, 3.9, 3.18.2, 4.2.3, 4.2.6, 10.2, 10.3.3, 11.3, 14.1, 14.2.1.1

Equipment, Labor, or Materials
1.1.3, 1.1.6, 3.4, 3.5, 3.8.2, 3.8.3, 3.12, 3.13, 3.15.1, 4.2.6, 4.2.7, 5.2.1, 6.2.1, 7.3.4, 9.3.2, 9.3.3, 9.5.1.3, 9.10.2, 10.2.1, 10.2.4, 14.2.1.1, 14.2.1.2

Execution and Progress of the Work
1.1.3, 1.2.1, 1.2.2, 2.3.4, 2.3.6, 3.1, 3.3.1, 3.4.1, 3.7.1, 3.10.1, 3.12, 3.14, 4.2, 6.2.2, 7.1.3, 7.3.6, 8.2, 9.5.1, 9.9.1, 10.2, 10.3, 12.1, 12.2, 14.2, 14.3.1, 15.1.4

Extensions of Time
3.2.4, 3.7.4, 5.2.3, 7.2.1, 7.3, 7.4, 9.5.1, 9.7, 10.3.2, 10.4, 14.3, 15.1.6, **15.2.5**

Failure of Payment
9.5.1.3, **9.7**, 9.10.2, 13.5, 14.1.1.3, 14.2.1.2

Faulty Work
(See Defective or Nonconforming Work)

Final Completion and Final Payment
4.2.1, 4.2.9, 9.8.2, **9.10**, 12.3, 14.2.4, 14.4.3

Financial Arrangements, Owner's
2.2.1, 13.2.2, 14.1.1.4

GENERAL PROVISIONS

1

Governing Law

13.1

Guarantees (See Warranty)

Hazardous Materials and Substances

10.2.4, 10.3

Identification of Subcontractors and Suppliers

5.2.1

Indemnification

3.1.7, **3.18**, 9.6.8, 9.10.2, 10.3.3, 11.3

Information and Services Required of the Owner

2.1.2, **2.2**, 2.3, 3.2.2, 3.12.10.1, 6.1.3, 6.1.4, 6.2.5,

9.6.1, 9.9.2, 9.10.3, 10.3.3, 11.2, 13.4.1, 13.4.2,

14.1.1.4, 14.1.4, 15.1.4

Initial Decision

15.2

Initial Decision Maker, Definition of

1.1.8

Initial Decision Maker, Decisions

14.2.4, 15.1.4.2, 15.2.1, 15.2.2, 15.2.3, 15.2.4, 15.2.5

Initial Decision Maker, Extent of Authority

14.2.4, 15.1.4.2, 15.2.1, 15.2.2, 15.2.3, 15.2.4, 15.2.5

Injury or Damage to Person or Property

10.2.8, 10.4

Inspections

3.1.3, 3.3.3, 3.7.1, 4.2.2, 4.2.6, 4.2.9, 9.4.2, 9.8.3,

9.9.2, 9.10.1, 12.2.1, 13.4

Instructions to Bidders

1.1.1

Instructions to the Contractor

3.2.4, 3.3.1, 3.8.1, 5.2.1, 7, 8.2.2, 12, 13.4.2

Instruments of Service, Definition of

1.1.7

Insurance

6.1.1, 7.3.4, 8.2.2, 9.3.2, 9.8.4, 9.9.1, 9.10.2, 10.2.5,

11

Insurance, Notice of Cancellation or Expiration

11.1.4, 11.2.3

Insurance, Contractor's Liability

11.1

Insurance, Effective Date of

8.2.2, 14.4.2

Insurance, Owner's Liability

11.2

Insurance, Property

10.2.5, 11.2, 11.4, 11.5

Insurance, Stored Materials

9.3.2

INSURANCE AND BONDS

11

Insurance Companies, Consent to Partial Occupancy

9.9.1

Insured loss, Adjustment and Settlement of

11.5

Intent of the Contract Documents

1.2.1, 4.2.7, 4.2.12, 4.2.13

Interest

13.5

Interpretation

1.1.8, 1.2.3, **1.4**, 4.1.1, 5.1, 6.1.2, 15.1.1

Interpretations, Written

4.2.11, 4.2.12

Judgment on Final Award

15.4.2

Labor and Materials, Equipment

1.1.3, 1.1.6, **3.4**, 3.5, 3.8.2, 3.8.3, 3.12, 3.13, 3.15.1,

5.2.1, 6.2.1, 7.3.4, 9.3.2, 9.3.3, 9.5.1.3, 9.10.2, 10.2.1,

10.2.4, 14.2.1.1, 14.2.1.2

Labor Disputes

8.3.1

Laws and Regulations

1.5, 2.3.2, 3.2.3, 3.2.4, 3.6, 3.7, 3.12.10, 3.13, 9.6.4,

9.9.1, 10.2.2, 13.1, 13.3.1, 13.4.2, 13.5, 14, 15.2.8,

15.4

Liens

2.1.2, 9.3.1, 9.3.3, 9.6.8, 9.10.2, 9.10.4, 15.2.8

Limitations, Statutes of

12.2.5, 15.1.2, 15.4.1.1

Limitations of Liability

3.2.2, 3.5, 3.12.10, 3.12.10.1, 3.17, 3.18.1, 4.2.6,

4.2.7, 6.2.2, 9.4.2, 9.6.4, 9.6.7, 9.6.8, 10.2.5, 10.3.3,

11.3, 12.2.5, 13.3.1

Limitations of Time

2.1.2, 2.2, 2.5, 3.2.2, 3.10, 3.11, 3.12.5, 3.15.1, 4.2.7,

5.2, 5.3, 5.4.1, 6.2.4, 7.3, 7.4, 8.2, 9.2, 9.3.1, 9.3.3,

9.4.1, 9.5, 9.6, 9.7, 9.8, 9.9, 9.10, 12.2, 13.4, 14, 15,

15.1.2, 15.1.3, 15.1.5

Materials, Hazardous

10.2.4, 10.3

Materials, Labor, Equipment and

1.1.3, 1.1.6, 3.4.1, 3.5, 3.8.2, 3.8.3, 3.12, 3.13, 3.15.1,

5.2.1, 6.2.1, 7.3.4, 9.3.2, 9.3.3, 9.5.1.3, 9.10.2,

10.2.1.2, 10.2.4, 14.2.1.1, 14.2.1.2

Means, Methods, Techniques, Sequences and

Procedures of Construction

3.3.1, 3.12.10, 4.2.2, 4.2.7, 9.4.2

Mechanic's Lien

2.1.2, 9.3.1, 9.3.3, 9.6.8, 9.10.2, 9.10.4, 15.2.8

Mediation

8.3.1, 15.1.3.2, 15.2.1, 15.2.5, 15.2.6, **15.3**, 15.4.1,

15.4.1.1

Minor Changes in the Work

1.1.1, 3.4.2, 3.12.8, 4.2.8, 7.1, **7.4**

MISCELLANEOUS PROVISIONS

13

Modifications, Definition of

1.1.1

Modifications to the Contract

1.1.1, 1.1.2, 2.5, 3.11, 4.1.2, 4.2.1, 5.2.3, 7, 8.3.1, 9.7,

10.3.2

Mutual Responsibility

6.2

Nonconforming Work, Acceptance of

9.6.6, 9.9.3, **12.3**

Nonconforming Work, Rejection and Correction of
2.4, 2.5, 3.5, 4.2.6, 6.2.4, 9.5.1, 9.8.2, 9.9.3, 9.10.4,
12.2

Notice

1.6, 1.6.1, 1.6.2, 2.1.2, 2.2.2., 2.2.3, 2.2.4, 2.5, 3.2.4,
3.3.1, 3.7.4, 3.7.5, 3.9.2, 3.12.9, 3.12.10, 5.2.1, 7.4,
8.2.2 9.6.8, 9.7, 9.10.1, 10.2.8, 10.3.2, 11.5, 12.2.2.1,
13.4.1, 13.4.2, 14.1, 14.2.2, 14.4.2, 15.1.3, 15.1.5,
15.1.6, 15.4.1

Notice of Cancellation or Expiration of Insurance
11.1.4, 11.2.3

Notice of Claims

1.6.2, 2.1.2, 3.7.4, 9.6.8, 10.2.8, **15.1.3**, 15.1.5,
15.1.6, 15.2.8, 15.3.2, 15.4.1

Notice of Testing and Inspections
13.4.1, 13.4.2

Observations, Contractor's

3.2, 3.7.4

Occupancy

2.3.1, 9.6.6, 9.8

Orders, Written

1.1.1, 2.4, 3.9.2, 7, 8.2.2, 11.5, 12.1, 12.2.2.1, 13.4.2,
14.3.1

OWNER

2

Owner, Definition of

2.1.1

Owner, Evidence of Financial Arrangements

2.2, 13.2.2, 14.1.1.4

Owner, Information and Services Required of the

2.1.2, **2.2**, 2.3, 3.2.2, 3.12.10, 6.1.3, 6.1.4, 6.2.5,
9.3.2, 9.6.1, 9.6.4, 9.9.2, 9.10.3, 10.3.3, 11.2, 13.4.1,
13.4.2, 14.1.1.4, 14.1.4, 15.1.4

Owner's Authority

1.5, 2.1.1, 2.3.32.4, 2.5, 3.4.2, 3.8.1, 3.12.10, 3.14.2,
4.1.2, 4.2.4, 4.2.9, 5.2.1, 5.2.4, 5.4.1, 6.1, 6.3, 7.2.1,
7.3.1, 8.2.2, 8.3.1, 9.3.2, 9.5.1, 9.6.4, 9.9.1, 9.10.2,
10.3.2, 11.4, 11.5, 12.2.2, 12.3, 13.2.2, 14.3, 14.4,
15.2.7

Owner's Insurance

11.2

Owner's Relationship with Subcontractors

1.1.2, 5.2, 5.3, 5.4, 9.6.4, 9.10.2, 14.2.2

Owner's Right to Carry Out the Work

2.5, 14.2.2

Owner's Right to Clean Up

6.3

**Owner's Right to Perform Construction and to
Award Separate Contracts**

6.1

Owner's Right to Stop the Work

2.4

Owner's Right to Suspend the Work

14.3

Owner's Right to Terminate the Contract

14.2, 14.4

Ownership and Use of Drawings, Specifications

and Other Instruments of Service

1.1.1, 1.1.6, 1.1.7, **1.5**, 2.3.6, 3.2.2, 3.11, 3.17, 4.2.12,
5.3

Partial Occupancy or Use

9.6.6, **9.9**

Patching, Cutting and

3.14, 6.2.5

Patents

3.17

Payment, Applications for

4.2.5, 7.3.9, 9.2, **9.3**, 9.4, 9.5, 9.6.3, 9.7, 9.8.5, 9.10.1,
14.2.3, 14.2.4, 14.4.3

Payment, Certificates for

4.2.5, 4.2.9, 9.3.3, **9.4**, 9.5, 9.6.1, 9.6.6, 9.7, 9.10.1,
9.10.3, 14.1.1.3, 14.2.4

Payment, Failure of

9.5.1.3, **9.7**, 9.10.2, 13.5, 14.1.1.3, 14.2.1.2

Payment, Final

4.2.1, 4.2.9, **9.10**, 12.3, 14.2.4, 14.4.3

Payment Bond, Performance Bond and

7.3.4.4, 9.6.7, 9.10.3, **11.1.2**

Payments, Progress

9.3, **9.6**, 9.8.5, 9.10.3, 14.2.3, 15.1.4

PAYMENTS AND COMPLETION

9

Payments to Subcontractors

5.4.2, 9.5.1.3, 9.6.2, 9.6.3, 9.6.4, 9.6.7, 14.2.1.2

PCB

10.3.1

Performance Bond and Payment Bond

7.3.4.4, 9.6.7, 9.10.3, **11.1.2**

Permits, Fees, Notices and Compliance with Laws

2.3.1, **3.7**, 3.13, 7.3.4.4, 10.2.2

PERSONS AND PROPERTY, PROTECTION

OF

10

Polychlorinated Biphenyl

10.3.1

Product Data, Definition of

3.12.2

Product Data and Samples, Shop Drawings

3.11, **3.12**, 4.2.7

Progress and Completion

4.2.2, **8.2**, 9.8, 9.9.1, 14.1.4, 15.1.4

Progress Payments

9.3, **9.6**, 9.8.5, 9.10.3, 14.2.3, 15.1.4

Project, Definition of

1.1.4

Project Representatives

4.2.10

Property Insurance

10.2.5, **11.2**

Proposal Requirements

1.1.1

PROTECTION OF PERSONS AND PROPERTY

10

Regulations and Laws

1.5, 2.3.2, 3.2.3, 3.6, 3.7, 3.12.10, 3.13, 9.6.4, 9.9.1, 10.2.2, 13.1, 13.3, 13.4.1, 13.4.2, 13.5, 14, 15.2.8, 15.4
Rejection of Work
4.2.6, 12.2.1
Releases and Waivers of Liens
9.3.1, 9.10.2
Representations
3.2.1, 3.5, 3.12.6, 8.2.1, 9.3.3, 9.4.2, 9.5.1, 9.10.1
Representatives
2.1.1, 3.1.1, 3.9, 4.1.1, 4.2.10, 13.2.1
Responsibility for Those Performing the Work
3.3.2, 3.18, 4.2.2, 4.2.3, 5.3, 6.1.3, 6.2, 6.3, 9.5.1, 10
Retainage
9.3.1, 9.6.2, 9.8.5, 9.9.1, 9.10.2, 9.10.3
Review of Contract Documents and Field Conditions by Contractor
3.2, 3.12.7, 6.1.3
Review of Contractor's Submittals by Owner and Architect
3.10.1, 3.10.2, 3.11, 3.12, 4.2, 5.2, 6.1.3, 9.2, 9.8.2
Review of Shop Drawings, Product Data and Samples by Contractor
3.12
Rights and Remedies
1.1.2, 2.4, 2.5, 3.5, 3.7.4, 3.15.2, 4.2.6, 5.3, 5.4, 6.1, 6.3, 7.3.1, 8.3, 9.5.1, 9.7, 10.2.5, 10.3, 12.2.1, 12.2.2, 12.2.4, **13.3**, 14, 15.4
Royalties, Patents and Copyrights
3.17
Rules and Notices for Arbitration
15.4.1
Safety of Persons and Property
10.2, 10.4
Safety Precautions and Programs
3.3.1, 4.2.2, 4.2.7, 5.3, **10.1**, 10.2, 10.4
Samples, Definition of
3.12.3
Samples, Shop Drawings, Product Data and
3.11, **3.12**, 4.2.7
Samples at the Site, Documents and
3.11
Schedule of Values
9.2, 9.3.1
Schedules, Construction
3.10, 3.12.1, 3.12.2, 6.1.3, 15.1.6.2
Separate Contracts and Contractors
1.1.4, 3.12.5, 3.14.2, 4.2.4, 4.2.7, 6, 8.3.1, 12.1.2
Separate Contractors, Definition of
6.1.1
Shop Drawings, Definition of
3.12.1
Shop Drawings, Product Data and Samples
3.11, **3.12**, 4.2.7
Site, Use of
3.13, 6.1.1, 6.2.1
Site Inspections
3.2.2, 3.3.3, 3.7.1, 3.7.4, 4.2, 9.9.2, 9.4.2, 9.10.1, 13.4

Site Visits, Architect's
3.7.4, 4.2.2, 4.2.9, 9.4.2, 9.5.1, 9.9.2, 9.10.1, 13.4
Special Inspections and Testing
4.2.6, 12.2.1, 13.4
Specifications, Definition of
1.1.6
Specifications
1.1.1, **1.1.6**, 1.2.2, 1.5, 3.12.10, 3.17, 4.2.14
Statute of Limitations
15.1.2, 15.4.1.1
Stopping the Work
2.2.2, 2.4, 9.7, 10.3, 14.1
Stored Materials
6.2.1, 9.3.2, 10.2.1.2, 10.2.4
Subcontractor, Definition of
5.1.1
SUBCONTRACTORS
5
Subcontractors, Work by
1.2.2, 3.3.2, 3.12.1, 3.18, 4.2.3, 5.2.3, 5.3, 5.4, 9.3.1.2, 9.6.7
Subcontractual Relations
5.3, 5.4, 9.3.1.2, 9.6, 9.10, 10.2.1, 14.1, 14.2.1
Submittals
3.10, 3.11, 3.12, 4.2.7, 5.2.1, 5.2.3, 7.3.4, 9.2, 9.3, 9.8, 9.9.1, 9.10.2, 9.10.3
Submittal Schedule
3.10.2, 3.12.5, 4.2.7
Subrogation, Waivers of
6.1.1, **11.3**
Substances, Hazardous
10.3
Substantial Completion
4.2.9, 8.1.1, 8.1.3, 8.2.3, 9.4.2, **9.8**, 9.9.1, 9.10.3, 12.2, 15.1.2
Substantial Completion, Definition of
9.8.1
Substitution of Subcontractors
5.2.3, 5.2.4
Substitution of Architect
2.3.3
Substitutions of Materials
3.4.2, 3.5, 7.3.8
Sub-subcontractor, Definition of
5.1.2
Subsurface Conditions
3.7.4
Successors and Assigns
13.2
Superintendent
3.9, 10.2.6
Supervision and Construction Procedures
1.2.2, **3.3**, 3.4, 3.12.10, 4.2.2, 4.2.7, 6.1.3, 6.2.4, 7.1.3, 7.3.4, 8.2, 8.3.1, 9.4.2, 10, 12, 14, 15.1.4
Suppliers
1.5, 3.12.1, 4.2.4, 4.2.6, 5.2.1, 9.3, 9.4.2, 9.5.4, 9.6, 9.10.5, 14.2.1
Surety

5.4.1.2, 9.6.8, 9.8.5, 9.10.2, 9.10.3, 11.1.2, 14.2.2, 15.2.7

Surety, Consent of
9.8.5, 9.10.2, 9.10.3

Surveys
1.1.7, 2.3.4

Suspension by the Owner for Convenience 14.3

Suspension of the Work
3.7.5, 5.4.2, 14.3
Suspension or Termination of the Contract
5.4.1.1, 14

Taxes
3.6, 3.8.2.1, 7.3.4.4

**Termination by the Contractor
14.1, 15.1.7**

**Termination by the Owner for Cause
5.4.1.1, 14.2, 15.1.7**

**Termination by the Owner for Convenience
14.4**

Termination of the Architect
2.3.3
Termination of the Contractor Employment
14.2.2

TERMINATION OR SUSPENSION OF THE CONTRACT 14

Tests and Inspections
3.1.3, 3.3.3, 3.7.1, 4.2.2, 4.2.6, 4.2.9, 9.4.2, 9.8.3,
9.9.2, 9.10.1, 10.3.2, 12.2.1, **13.4**

TIME 8

Time, Delays and Extensions of
3.2.4, 3.7.4, 5.2.3, 7.2.1, 7.3.1, 7.4, **8.3**, 9.5.1, 9.7,
10.3.2, 10.4, 14.3.2, 15.1.6, 15.2.5
Time Limits
2.1.2, 2.2, 2.5, 3.2.2, 3.10, 3.11, 3.12.5, 3.15.1, 4.2,
5.2, 5.3, 5.4, 6.2.4, 7.3, 7.4, 8.2, 9.2, 9.3.1, 9.3.3,
9.4.1, 9.5, 9.6, 9.7, 9.8, 9.9, 9.10, 12.2, 13.4, 14,
15.1.2, 15.1.3, 15.4

Time Limits on Claims
3.7.4, 10.2.8, 15.1.2, 15.1.3

Title to Work
9.3.2, 9.3.3

UNCOVERING AND CORRECTION OF WORK 12

Uncovering of Work 12.1

Unforeseen Conditions, Concealed or Unknown
3.7.4, 8.3.1, 10.3
Unit Prices
7.3.3.2, 9.1.2
Use of Documents
1.1.1, 1.5, 2.3.6, 3.12.6, 5.3

**Use of Site
3.13, 6.1.1, 6.2.1**

**Values, Schedule of
9.2, 9.3.1**

Waiver of Claims by the Architect
13.3.2

Waiver of Claims by the Contractor
9.10.5, 13.3.2, **15.1.7**

Waiver of Claims by the Owner
9.9.3, 9.10.3, 9.10.4, 12.2.2.1, 13.3.2, 14.2.4, **15.1.7**
Waiver of Consequential Damages
14.2.4, 15.1.7

Waiver of Liens
9.3, 9.10.2, 9.10.4

**Waivers of Subrogation
6.1.1, 11.3**

**Warranty
3.5, 4.2.9, 9.3.3, 9.8.4, 9.9.1, 9.10.2, 9.10.4, 12.2.2,
15.1.2**

Weather Delays
8.3, 15.1.6.2

**Work, Definition of
1.1.3**

Written Consent
1.5.2, 3.4.2, 3.7.4, 3.12.8, 3.14.2, 4.1.2, 9.3.2, 9.10.3,
13.2, 13.3.2, 15.4.4.2

Written Interpretations
4.2.11, 4.2.12

Written Orders
1.1.1, 2.4, 3.9, 7, 8.2.2, 12.1, 12.2, 13.4.2, 14.3.1

ARTICLE 1 GENERAL PROVISIONS

§ 1.1 Basic Definitions

§ 1.1.1 The Contract Documents

The Contract Documents are enumerated in the Agreement between the Owner and Contractor (hereinafter the Agreement) and consist of the Agreement, Conditions of the Contract (General, Supplementary and other Conditions), Drawings, Specifications, Addenda issued prior to execution of the Contract, the Bidding Documents (including the Owner's Invitation to Bid # _____ and Instructions to Bidders), Contractor's Proposal, other documents listed in the Agreement, and Modifications issued after execution of the Contract. A Modification is (1) a written amendment to the Contract signed by both parties, (2) a Change Order, (3) a Construction Change Directive, or (4) a written order for a minor change in the Work issued by the Architect. Unless specifically enumerated in the Agreement, the Contract Documents do not include sample forms, other information furnished by the Owner in anticipation of receiving bids or proposals, or portions of Addenda relating to bidding or proposal requirements.

§ 1.1.2 The Contract

The Contract Documents form the Contract for Construction. The Contract represents the entire and integrated agreement between the parties hereto and supersedes prior negotiations, representations, or agreements, either written or oral. The Contract may be amended or modified only by a Modification. The Contract Documents shall not be construed to create a contractual relationship of any kind (1) between the Contractor and the Architect or the Architect's consultants, (2) between the Owner and a Subcontractor or a Sub-subcontractor, (3) between the Owner and the Architect or the Architect's consultants, or (4) between any persons or entities other than the Owner and the Contractor. The Architect shall, however, be entitled to performance and enforcement of obligations under the Contract intended to facilitate performance of the Architect's duties. Subcontractors are not intended third-party beneficiaries to the Contract and shall have no direct cause of action against the Owner.

In the event of conflicts or discrepancies among the Contract Documents, interpretations will be based on the following priorities:

- .1 Modifications, with those of later date having precedence over those of earlier date.
- .2 The Agreement, including any amendment to the Agreement included in the bid package.
- .3 Addenda to the Specifications and Drawings, with those of later date having precedence over those of earlier date.
- .4 The General Conditions of the Contract for Construction.
- .5 Specifications and Drawings.

Further, stated dimensions shall take precedence over scaled dimensions; large-scale detail drawings shall take precedence over small-scale drawings; schedules shall take precedence over other data on the drawings.

In the case of an inconsistency between Drawings and Specifications or within either Document in describing the Work, the better quality, greater quantity, or more costly work shall be provided in accordance with the Architect's interpretation.

§ 1.1.3 The Work

The term "Work" means the construction and services required by the Contract Documents, whether performed on or off the site of the Project and whether completed or partially completed, and includes all other labor, materials, equipment, and services provided or to be provided by the Contractor, its Subcontractors, Sub-Subcontractors, material suppliers or any other entity for whom the Contractor is responsible to fulfill the Contractor's obligations. The Work may constitute the whole or a part of the Project.

§ 1.1.4 The Project

The Project is the total construction of which the Work performed under the Contract Documents may be the whole or a part and which may include construction by the Owner and by Separate Contractors.

§ 1.1.5 The Drawings

The Drawings are the graphic and pictorial portions of the Contract Documents showing the design, location and dimensions of the Work, generally including plans, elevations, sections, details, schedules, and diagrams.

§ 1.1.6 The Specifications

The Specifications are that portion of the Contract Documents consisting of the written requirements for materials, equipment, systems, standards and workmanship for the Work, and performance of related services.

§ 1.1.7 Instruments of Service

Instruments of Service are representations, in any medium of expression now known or later developed, of the tangible and intangible creative work performed by the Architect and the Architect's consultants under their respective professional services agreements. Instruments of Service may include, without limitation, studies, surveys, models, sketches, drawings, specifications, and other similar materials.

§ 1.1.8 Contractor's Standard of Care

The Contractor shall be responsible for the performance of the Work as an independent contractor and in a good and workmanlike manner (i) consistent with the Contract Documents; (ii) consistent with the instructions, guidance and direction of the Owner and Architect; (iii) consistent with the highest prevailing applicable professional or industry standards; (iv) consistent with sound practices; (v) as expeditiously as is consistent with such professional skill and care and the orderly progress of the Work and with the Contract Documents and the instructions, guidance and direction of the Owner and Architect; (vi) in a manner that will not exceed the Contract Sum as set forth in the Agreement, and (vii) in strict compliance with applicable laws (the standards of this Section 1.1.8 shall be referred to herein as the "Contractor's Standard of Care"). The Contractor shall exercise the Contractor's Standard of Care in performing all aspects of the Work. All references in the Contract Documents to the knowledge, inference, reliance, awareness, determination, belief, observation, recognition or discovery of the Contractor or reference to any similar term shall include the constructive knowledge, inference, reliance, awareness, determination, belief, observation and recognition attributed to the Contractor ("constructive knowledge"). Such constructive knowledge shall include the knowledge, inference, reliance, awareness, determination, belief, observation and recognition the Contractor would have obtained upon the exercise of the Contractor's Standard of Care.

§ 1.1.9 Initial Decision Maker

The Initial Decision Maker is the person identified in the Agreement to render initial decisions on Claims in accordance with Section 15.2. The Initial Decision Maker shall not show partiality to the Owner or Contractor and shall not be liable for results of interpretations or decisions rendered in good faith.

§ 1.2 Correlation and Intent of the Contract Documents

§ 1.2.1 The intent of the Contract Documents is to include all items necessary for the proper execution and completion of the Work by the Contractor. The Contract Documents are complementary, and what is required by one shall be as binding as if required by all; performance by the Contractor shall be required only to the extent consistent with the Contract Documents and reasonably inferable from them as being necessary to produce the indicated results.

.1 Before ordering materials or doing any Work, the Contractor and each Subcontractor shall verify measurements at the Project site and shall be responsible for the correctness of such measurements. No extra charge or compensation will be allowed on account of minor differences between actual dimensions and the dimensions indicated on the Drawings. Any difference which may be found shall be submitted to the Architect for resolution before proceeding with the Work.

.2 If a minor change in the Work is found necessary due to actual field conditions, the Contractor shall submit detailed drawings of such departure for the approval by the Architect before making the change.

§ 1.2.1.2 The Architect may, as he deems desirable, issue additional drawings or instructions indicating in greater detail the construction or design of the various parts of the Work reasonably inferable from the Contract Documents; such drawings or instructions may be effected by notice to the Contractor without modification of the contract Time or contract Sum. If the Contractor claims additional cost or delay on account of such additional drawings or instructions, he shall give notice as provided in Subparagraph 15.1.

§ 1.2.1.1 The invalidity of any provision of the Contract Documents shall not invalidate the Contract or its remaining provisions. If it is determined that any provision of the Contract Documents violates any law, or is otherwise invalid or unenforceable, then that provision shall be revised to the extent necessary to make that provision legal and enforceable. In such case the Contract Documents shall be construed, to the fullest extent permitted by law, to give effect to the parties' intentions and purposes in executing the Contract.

§ 1.2.2 Organization of the Specifications into divisions, sections and articles, and arrangement of Drawings shall not control the Contractor in dividing the Work among Subcontractors or in establishing the extent of Work to be performed by any trade.

§ 1.2.3 Unless otherwise stated in the Contract Documents, words that have well-known technical or construction industry meanings are used in the Contract Documents in accordance with such recognized meanings.

§ 1.2.4 The Contractor and all Subcontractors shall refer to all of the Drawings, including those showing primarily the Work of the mechanical, electrical and other specialized trades, and to all of the sections of the Specifications, and shall perform all Work reasonably inferable there from as being necessary to produce the indicated results.

§ 1.3 Capitalization

Terms capitalized in these General Conditions include those that are (1) specifically defined, (2) the titles of numbered articles, or (3) the titles of other documents published by the American Institute of Architects.

§ 1.4 Interpretation

In the interest of brevity the Contract Documents frequently omit modifying words such as "all" and "any" and articles such as "the" and "an," but the fact that a modifier or an article is absent from one statement and appears in another is not intended to affect the interpretation of either statement.

§ 1.5 Ownership and Use of Drawings, Specifications, and Other Instruments of Service

§ 1.5.1 The Instruments of Service, including the Drawings and Specifications, are and shall be the property of the Owner. The Contractor, Subcontractors, Sub-subcontractors, and suppliers shall not own or claim a copyright in the Instruments of Service. Submittal or distribution to meet official regulatory requirements or for other purposes in connection with the Project is not to be construed as publication in derogation of the reserved rights of the Owner.

§ 1.5.2 The Contractor, Subcontractors, Sub-subcontractors, and suppliers are authorized to use and reproduce the Instruments of Service provided to them, subject to any protocols established pursuant to Sections 1.7 and 1.8, solely and exclusively for execution of the Work. All copies made under this authorization shall bear the copyright notice, if any, shown on the Instruments of Service. The Contractor, Subcontractors, Sub-subcontractors, and suppliers may not use the Instruments of Service for any purpose outside the scope of the Work without the specific written consent of the Owner

§ 1.5.3 Prior to execution of the Agreement, the Contractor evaluated and satisfied itself as to the condition and limitations under which the Work is to be performed, including, without limitation, (i) the location, condition, layout, and nature of the Project site and surrounding areas, (ii) generally prevailing climatic conditions, (iii) anticipated labor supply and costs, (iv) availability and cost of materials, tools, and equipment, and (v) other similar issues. The Owner assumes no responsibility or liability for the physical condition or safety of the Project site or any improvements located on the Project site. The Contractor shall be solely responsible for providing a safe place for the performance of the Work. The Owner shall not be required to make any adjustment in either the Contract Sum or the Contract Time in connection with any failure by the Contractor or any Subcontractor to have complied with the requirements of this Subparagraph 1.5.3.

§ 1.6 Notice

§ 1.6.1 Except as otherwise provided in Section 1.6.2, where the Contract Documents require one party to notify or give notice to the other party, such notice shall be provided in writing to the designated representative of the party to whom the notice is addressed and shall be deemed to have been duly served if delivered in person, by mail, by courier, or by electronic transmission if a method for electronic transmission is set forth in the Agreement.

§ 1.6.2 Notice of Claims as provided in Section 15.1.3 shall be provided in writing and shall be deemed to have been duly served only if delivered to the designated representative of the party to whom the notice is addressed by certified or registered mail, or by courier providing proof of delivery.

§ 1.7 Digital Data Use and Transmission

The parties shall agree upon protocols governing the transmission and use of Instruments of Service or any other information or documentation in digital form. The parties will use AIA Document E203™–2013, Building Information Modeling and Digital Data Exhibit, to establish the protocols for the development, use, transmission, and exchange of digital data.

§ 1.8 Building Information Models Use and Reliance

Any use of, or reliance on, all or a portion of a building information model without agreement to protocols governing the use of, and reliance on, the information contained in the model and without having those protocols set forth in AIA Document E203™–2013, Building Information Modeling and Digital Data Exhibit, and the requisite AIA Document G202™–2013, Project Building Information Modeling Protocol Form, shall be at the using or relying party's sole risk and without liability to the other party and its contractors or consultants, the authors of, or contributors to, the building information model, and each of their agents and employees.

§ 1.9 Any information obtained by the Contractor from the Owner or Architect may not be used, published, distributed, sold or divulged by the Contractor or its Subcontractor or Sub-subcontractors for such party's own purposes or for the benefit of any person, firm, corporation or other entity other than the Owner, without the prior written consent of the Owner. Any information obtained by the Contractor of its Subcontractors or Sub-Subcontractors that is designated by the Owner in accordance with applicable law as confidential shall not be disclosed to any other parties without the prior written consent of the Owner.

ARTICLE 2 OWNER

§ 2.1 General

§ 2.1.1 INTENTIONALLY OMITTED

§ 2.1.2 INTENTIONALLY OMITTED

§ 2.2 Evidence of the Owner's Financial Arrangements

§ 2.2.1

INTENTIONALLY OMITTED

§ 2.3 Information and Services Required of the Owner

§ 2.3.1 Except for permits and fees that are the responsibility of the Contractor under the Contract Documents, including those required under Section 3.7.1, the Owner shall secure and pay for necessary approvals, easements, assessments and charges required for construction, use or occupancy of permanent structures or for permanent changes in existing facilities. The Owner has agreed to waive the fees of all required building permits related to the completion of this project

§ 2.3.2 The Owner shall retain an architect lawfully licensed to practice architecture, or an entity lawfully practicing architecture, in the jurisdiction where the Project is located. That person or entity is identified as the Architect in the Agreement and is referred to throughout the Contract Documents as if singular in number.

§ 2.3.3 If the employment of the Architect terminates, the Owner shall employ a successor to whom the Contractor has no reasonable objection and whose status under the Contract Documents shall be that of the Architect.

§ 2.3.4 The Owner shall furnish surveys describing physical characteristics, legal limitations and utility locations for the site of the Project, and a legal description of the site.

§ 2.3.5 The Owner shall furnish information or services required of the Owner by the Contract Documents with reasonable promptness. The Owner shall also furnish any other information or services under the Owner's control and relevant to the Contractor's performance of the Work with reasonable promptness after receiving the Contractor's written request for such information or services.

§ 2.3.6 Unless otherwise provided in the Contract Documents, the Owner shall furnish to the Contractor one copy of the Contract Documents for purposes of making reproductions pursuant to Section 1.5.2.

§ 2.4 Owner's Right to Stop the Work

If the Contractor fails to correct Work that is not in accordance with the requirements of the Contract Documents as required by Section 12.2 or fails to carry out Work in accordance with the Contract Documents, the Owner may issue a written order to the Contractor to stop the Work, or any portion thereof, however, the right of the Owner to stop the Work shall not give rise to a duty on the part of the Owner to exercise this right for the benefit of the Contractor or any other person or entity, except to the extent required by Section 6.1.3.

§ 2.5 Owner's Right to Carry Out the Work

If the Contractor defaults or neglects to carry out the Work in accordance with the Contract Documents and fails within a seven-day period after receipt of notice from the Owner to commence and continue correction of such default or neglect with diligence and promptness, the Owner may, without prejudice to other remedies the Owner may have, correct such default or neglect. The Architect may, pursuant to Section 9.5.1, withhold or nullify a Certificate for Payment in whole or in part, to the extent reasonably necessary to reimburse the Owner for the reasonable cost of correcting such deficiencies, including Owner's expenses and compensation for the Architect's additional services made necessary by such default, neglect, or failure. If current and future payments are not sufficient to cover such amounts, the Contractor shall pay the difference to the Owner. If the Contractor disagrees with the actions of the Owner or the Architect, or the amounts claimed as costs to the Owner, the Contractor may file a Claim pursuant to Article 15. The Owner's right to stop the Work is in addition to and not in restriction or derogation of any and all remedies available to the Owner. The Owner shall have full access to and the right to inspect all portions of the Work for quality, progress, and conformance of the Contract Documents. Any testing or inspections (including commissioning) performed by or on behalf of the Owner shall in no way relieve or replace the obligations of the Contractor in its fulfillment of its obligations hereunder. Any commissioning activities are at the sole discretion of the Owner and shall not be a requirement of the Agreement.

§ 2.6 In no event shall the Owner have control over, charge or any responsibility for construction means, methods, techniques, sequences, or procedures or for safety precautions and programs in connection with the Work, notwithstanding any of the rights and authority granted the Owner in the Contract Documents.

ARTICLE 3 CONTRACTOR

§ 3.1 General

§ 3.1.1 The Contractor is the person or entity identified as such in the Agreement and is referred to throughout the Contract Documents as if singular in number. The Contractor shall be lawfully licensed, if required in the jurisdiction where the Project is located. The Contractor shall designate in writing a representative who shall have express authority to bind the Contractor with respect to all matters under this Contract. The term "Contractor" means the Contractor or the Contractor's authorized representative.

§ 3.1.2 The Contractor shall perform the Work in accordance with the Contract Documents.

§ 3.1.3 The Contractor shall not be relieved of its obligations to perform the Work in accordance with the Contract Documents either by activities or duties of the Architect in the Architect's administration of the Contract, or by tests, inspections or approvals required or performed by persons or entities other than the Contractor.

§ 3.1.4 The Contractor shall comply with the Conditions and all local, state, and federal laws, rules and regulations applicable to the Contractor, including without limitation those relating to equal opportunity, labor, wage (including prevailing wage laws) and employment.

§ 3.2 Review of Contract Documents and Field Conditions by Contractor

§ 3.2.1 Execution of the Contract by the Contractor is a representation that the Contractor has visited the site, become generally familiar with local conditions under which the Work is to be performed, conducted its own due diligence, and correlated personal observations with requirements of the Contract Documents.

§ 3.2.2 Because the Contract Documents are complementary and extensive, the Contractor shall, before starting each portion of the Work, carefully study and compare the various Contract Documents relative to that portion of the Work, as well as the information furnished by the Owner pursuant to Section 2.3.4, shall take field measurements of

any existing conditions related to that portion of the Work, and shall observe any conditions at the site affecting it. These obligations are for the purpose of facilitating coordination and construction by the Contractor and are not for the purpose of discovering errors, omissions, or inconsistencies in the Contract Documents; however, the Contractor shall promptly report to the Architect any errors, inconsistencies or omissions discovered by or made known to the Contractor as a request for information in such form as the Architect may require. It is recognized that the Contractor's review is made in the Contractor's capacity as a contractor and not as a licensed design professional, unless otherwise specifically provided in the Contract Documents. . The exactness of grades, elevations, dimensions, or locations given on any Drawings issued by the Architect, or surveys furnished by the Owner, is not guaranteed by the Architect or the Owner. The Contractor shall, therefore, satisfy itself as to the accuracy of all grades, elevations, dimensions, and locations. Any errors due to the Contractor's failure to so verify all such grades, elevations, dimensions, or locations shall be promptly rectified by the Contractor without any additional cost to the Owner.

§ 3.2.3 Owner assumes no contractual liability or responsibility for the physical condition or safety of the Project site or of any improvement thereon. Except as set forth in Section 10.3, the Contractor shall be solely responsible for providing a safe place for the performance of the Work.

§ 3.2.4 If the Contractor believes that additional cost or time is involved because of clarifications or instructions the Architect issues in response to the Contractor's notices or requests for information pursuant to Sections 3.2.2 or 3.2.3, the Contractor shall submit Claims as provided in Article 15. If the Contractor fails to perform the obligations of Sections 3.2.2 or 3.2.3, the Contractor shall pay such costs and damages to the Owner, subject to Section 15.1.7, as would have been avoided if the Contractor had performed such obligations. If the Contractor performs those obligations, the Contractor shall not be liable to the Owner or Architect for damages resulting from errors, inconsistencies, or omissions in the Contract Documents, for differences between field measurements or conditions and the Contract Documents, or for nonconformities of the Contract Documents to applicable laws, statutes, ordinances, codes, rules and regulations, and lawful orders of public authorities. . If the Contractor or a Subcontractor fails to submit a Claim in accordance with the requirements of Article 15, the Contractor or Subcontractor knowingly and irrevocably waives any Claim for additional compensation or time.

§ 3.2.5 The Contractor shall give the Architect timely notice of any additional Drawings, Specifications, or instructions required to define the Work in greater detail, or to permit the proper progress of the Work.

§ 3.2.6 The Contractor shall not proceed with any Work not clearly and consistently defined in detail in the Contract Documents, but shall request additional drawings or instructions from the Architect as provided in subparagraph 3.2.5. If the Contractor proceeds with such Work without obtaining further Drawings, Specifications or instructions, the Contractor shall correct Work incorrectly done at the Contractor's own expense.

§ 3.2.7 Except as to any reported errors, inconsistencies or omissions, and as to any concealed or unknown conditions as defined in Paragraph 3.7.4. by executing the Agreement, the Contractor represents the following:

1. The Contract Documents are sufficiently complete and detailed for the Contractor to (1) perform the Work required to produce the results intended by the Contract Documents and (2) comply with all the requirements of the Contract Documents.
2. The Work required by the Contract Documents, including, without limitation, all construction details, construction means, methods, procedures and techniques necessary to perform the Work, use of materials, selection of equipment and requirements of product manufacturers are consistent with: (1) good and sound practices within the construction industry; (2) generally prevailing and accepted industry standards applicable to the Work; and (3) requirements of any warranties applicable to the Work.

§ 3.3 Supervision and Construction Procedures

§ 3.3.1 The Contractor shall supervise and direct the Work, using the Contractor's best skill and attention. The Contractor shall be solely responsible for, and have control over, construction means, methods, techniques, sequences, and procedures, and for coordinating all portions of the Work under the Contract. If the Contract Documents give specific instructions concerning construction means, methods, techniques, sequences, or procedures, the Contractor shall evaluate the jobsite safety thereof and shall be solely responsible for the jobsite safety of such means, methods, techniques, sequences, or procedures. If the Contractor determines that such means,

methods, techniques, sequences or procedures may not be safe, the Contractor shall give timely notice to the Owner and Architect, and shall propose alternative means, methods, techniques, sequences, or procedures. The Architect shall evaluate the proposed alternative solely for conformance with the design intent for the completed construction. Unless the Architect objects to the Contractor's proposed alternative, the Contractor shall perform the Work using its alternative means, methods, techniques, sequences, or procedures.

§ 3.3.2 The Contractor shall be responsible to the Owner for acts and omissions of the Contractor's employees, Subcontractors and their agents and employees, and other persons or entities performing portions of the Work for, or on behalf of, the Contractor or any of its Subcontractors.

§ 3.3.3 The Contractor shall be responsible for inspection of portions of Work already performed to determine that such portions are in proper condition to receive subsequent Work.

§ 3.3.4 The Contractor shall schedule and perform the Work so as not to unreasonably interfere with any other related or unrelated work being performed by the Owner in or about the Project premises or with the Owner's continued use and operation of the Project premises as a fully operational _____. The Contractor shall protect and prevent damage to all unfinished phases of the Work.

§ 3.4 Labor and Materials

§ 3.4.1 Unless otherwise provided in the Contract Documents, the Contractor shall provide and pay for labor, materials, equipment, tools, construction equipment and machinery, water, heat, utilities, transportation, and other facilities and services necessary for proper execution and completion of the Work, whether temporary or permanent and whether or not incorporated or to be incorporated in the Work.

§ 3.4.2 Except in the case of minor changes in the Work approved by the Architect in accordance with Section 3.12.8 or ordered by the Architect in accordance with Section 7.4, the Contractor may make substitutions only with the consent of the Owner, after evaluation by the Architect and in accordance with a Change Order or Construction Change Directive.

§ 3.4.2.1 Approval by the Owner or Architect of any such substitution shall not relieve the Contractor requesting the substitution of responsibility for any additional costs incurred by other trades for changes made necessary to accommodate the substituted item.

§ 3.4.2.2 By making requests for substitutions based on subparagraph 3.4.2 above, the Contractor:

- .1 represents that the Contractor has personally investigated the proposed substitute product and determined that it is equal or superior in all respects to that specified;
- .2 represents that the Contractor will provide the same warranty for the substitution that the Contractor would for that specified;
- .3 certifies that the cost data presented is complete and includes all related costs under this Contract except the Architect's redesign costs, and waives all claims for additional costs related to substitution which subsequently become apparent; and
- .4 shall coordinate the installation of the accepted substitution, making such changes as may be required for the Work to be complete in all respects.

§ 3.4.3 The Contractor shall enforce strict discipline and good order among the Contractor's employees and other persons carrying out the Work. The Contractor shall not permit employment of unfit persons or persons not properly skilled in tasks assigned to them.

§ 3.4.4 The Contractor shall be responsible for determining that all materials furnished for the Work meet all requirements of the Contract Documents. The Architect may require the Contractor to produce reasonable evidence that a material meets such requirements, such as certified reports of past tests by qualified testing laboratories, reports of studies by qualified experts, or other evidence which, in the opinion of the Architect, would lead to a reasonable certainty that any material used, or proposed to be used, in the Work meets the requirements of the Contract Documents. All such data shall be furnished at the Contractor's expense.

§ 3.4.5 In all cases in which a manufacturer's name, trade name or other proprietary designation is used in connection with materials or articles to be furnished under this Contract, the Contractor shall furnish the product of

the named manufacturer(s) without substitution.

§ 3.4.6 The Contractor shall only employ or use labor in connection with the Work capable of working harmoniously with all trades, crafts, and any other individuals associated with the Project. The Contractor shall also use best efforts to minimize the likelihood of any strike, work stoppage, or other labor disturbance.

§ 3.5 Warranty

§ 3.5.1 The Contractor warrants to the Owner and Architect that materials and equipment furnished under the Contract will be of good quality and new unless the Contract Documents require or permit otherwise. The Contractor further warrants that the Work will conform to the requirements of the Contract Documents and will be free from defects, except for those inherent in the quality of the Work the Contract Documents require or permit. Work, materials, or equipment not conforming to these requirements may be considered defective. The Contractor's warranty excludes remedy for damage or defect caused by abuse, alterations to the Work not executed by the Contractor, improper or insufficient maintenance, improper operation, or normal wear and tear and normal usage. If required by the Architect, the Contractor shall furnish satisfactory evidence as to the kind and quality of materials and equipment.

§ 3.5.2 All material, equipment, or other special warranties required by the Contract Documents shall be issued in the name of the Owner, or shall be transferable to the Owner, and shall commence in accordance with Section 9.8.4.

§ 3.5.2 Contractor agrees to assign to the Owner as a condition precedent to Substantial Completion of the Work any and all manufacturer's warranties relating to materials and equipment installed in the Work and further agrees to perform the Work in such manner so as to preserve any and all such manufacturer's warranties.

§ 3.5.3 The warranty provided in this Paragraph 3.5 shall be in addition to and not in limitation of any other warranty or guaranty required by the Contract Documents or otherwise prescribed by law.

§ 3.5.4 The Contractor shall procure and deliver to the Architect, no later than thirty (30) calendar days after the Date of Substantial Completion, all warranties required by the Contract Documents.

§ 3.5.5 The Warranty shall include the repair and/or replacement of all damaged materials resulting from the defective materials and/or workmanship. This shall include but not be limited to furniture, fixtures, equipment, finishes or any other affected materials or property.

§ 3.6 Taxes

The Owner is a tax-exempt entity. The Contractor shall be familiar with the current regulations of the Connecticut Department of Revenue Services and the sales or use tax on materials or supplies exempted by such regulations shall not be included as part of the bid or the Contract Sum. A sales tax certificate is available upon written request.

§ 3.7 Permits, Fees, Notices and Compliance with Laws

§ 3.7.1 Unless otherwise provided in the Contract Documents, the Contractor shall secure the building permit as well as for other permits, licenses, and inspections by government agencies necessary for proper execution and completion of the Work, including, without limitation, all building permits, subsidiary trade permits, and occupancy permits. All inspection fees as may be imposed by any municipal agency are waived by the Owner.

§ 3.7.1.1 The "Agencies" are the Department of Public Works for the Town of Cheshire (the "Department"), and all other governmental authorities having regulatory or administrative jurisdiction over the Work and/or Project and all representatives or designees of the Department or such other governmental authorities. The term "Agencies" shall also include an individuals or entities designated by the Owner to monitor or oversee compliance of the Project's design with the requirements of governmental authorities having jurisdiction over the Project.

§ 3.7.1.2 The term "Agencies" shall also include an individual or entity not described in Section 3.7.1.1 from whom the Owner intends to request certification of the Project's design, to the extent included in the Contract Documents.

§ 3.7.2 The Contractor shall comply with and give notices required by applicable laws, statutes, ordinances, codes, rules and regulations, and lawful orders of public authorities applicable to performance of the Work. The Contractor shall procure and obtain all bonds required of the Owner or the Contractor by the municipality in which the Project is located or any public or private body with jurisdiction over the Project. In connection with such bonds, the Contractor shall prepare all applications, supply all necessary backup material, and furnish the surety with any required personal undertakings. The Owner will pay the price of all such bond premiums.

§ 3.7.3

If the Contractor performs Work which it knows or should know is contrary to applicable laws, statutes, ordinances, codes, rules and regulations, or lawful orders of public authorities, the Contractor shall bear responsibility for such Work and shall bear the costs attributable to correction.

§ 3.7.4 Concealed or Unknown Conditions

If the Contractor encounters conditions at the site that are (1) subsurface or otherwise concealed physical conditions that differ materially from those indicated in the Contract Documents or (2) unknown physical conditions of an unusual nature that differ materially from those ordinarily found to exist and generally recognized as inherent in construction activities of the character provided for in the Contract Documents, the Contractor shall promptly provide written notice to the Owner and the Architect before conditions are disturbed and in no event later than 14 days after first observance of the conditions. The Architect will promptly investigate such conditions and, if the Architect determines that they differ materially and cause an increase or decrease in the Contractor's cost of, or time required for, performance of any part of the Work, will recommend that an equitable adjustment be made in the Contract Sum or Contract Time, or both. If the Architect determines that the conditions at the site are not materially different from those indicated in the Contract Documents and that no change in the terms of the Contract is justified, the Architect shall promptly notify the Owner and Contractor, stating the reasons. If either party disputes the Architect's determination or recommendation, that party may submit a Claim as provided in Article 15.

§ 3.7.5 If, in the course of the Work, the Contractor encounters human remains or recognizes the existence of burial markers, archaeological sites or wetlands not indicated in the Contract Documents, the Contractor shall immediately suspend any operations that would affect them and shall notify the Owner and Architect. Upon receipt of such notice, the Owner shall promptly take any action necessary to obtain governmental authorization required to resume the operations. The Contractor shall continue to suspend such operations until otherwise instructed by the Owner but shall continue with all other operations that do not affect those remains or features. Requests for adjustments in the Contract Sum and Contract Time arising from the existence of such remains or features may be made as provided in Article 15.

§ 3.7.6 If any governmental body having jurisdiction over the Work requires licenses or registrations for the performance of the Work or any part thereof, the Contractor shall hold such valid licenses or registrations as may be required by law to prosecute the Work to completion. If any part of the Work for which such a license or registration is required is to be performed by Subcontractors of any tier, the Contractor shall ensure that such Subcontractors hold such valid licenses or registrations as may be required by law to prosecute said Work to completion.

§ 3.8 Allowances

§ 3.8.1 The Contractor shall include in the Contract Sum all allowances stated in the Contract Documents. Items covered by allowances shall be supplied for such amounts and by such persons or entities as the Owner may direct, but the Contractor shall not be required to employ persons or entities to whom the Contractor has reasonable objection.

§ 3.8.2 Unless otherwise provided in the Contract Documents,

- .1 allowances shall cover the cost to the Contractor of materials and equipment delivered at the site and all required taxes, less applicable trade discounts;
- .2 Contractor's costs for unloading and handling at the site, labor, installation costs, overhead, profit, and other expenses contemplated for stated allowance amounts shall be included in the Contract Sum but not in the allowances; and
- .3 whenever costs are more than or less than allowances, the Contract Sum shall be adjusted accordingly by Change Order. The amount of the Change Order shall reflect (1) the difference between actual

costs and the allowances under Section 3.8.2.1 and (2) changes in Contractor's costs under Section 3.8.2.2.

§ 3.8.3 Materials and equipment under an allowance shall be selected by the Owner with reasonable promptness.

§ 3.9 Superintendent

§ 3.9.1 The Contractor shall employ a competent superintendent and necessary assistants who shall be in attendance at the Project site during performance of the Work. The superintendent shall represent the Contractor, and communications given to the superintendent shall be as binding as if given to the Contractor.

§ 3.9.2 The Contractor, as soon as practicable after award of the Contract, shall notify the Owner and Architect of the name and qualifications of a proposed superintendent. Within 14 days of receipt of the information, the Architect may notify the Contractor, stating whether the Owner or the Architect (1) has reasonable objection to the proposed superintendent or (2) requires additional time for review. Failure of the Owner or Architect to provide notice within the 14-day period shall constitute notice of no reasonable objection.

§ 3.9.3 The Contractor shall not employ a proposed superintendent to whom the Owner or Architect has made reasonable objection. The Contractor shall not change the superintendent without the Owner's consent, which shall not unreasonably be withheld or delayed.

§ 3.9.4 The Contractor shall coordinate and supervise the Work performed by Subcontractors to the end that the Work is carried out without conflict between trades and so that no trade, at any time, causes delay to the general progress of the Work. The Contractor and all Subcontractors shall at all times afford each trade, any separate contractor, or the Owner, every reasonable opportunity for the installation of Work and the storage of materials.

§ 3.9.5 Contractor shall at all times enforce strict discipline and good order among its employees (and those of its Subcontractors) and shall not employ on the Work any unfit person or anyone not skilled in the task assigned to them. All labor shall be performed by workmen skilled in their respective trades and workmanship shall be of good quality in accordance with the standards of construction set forth in the Contract Documents.

§ 3.10 Contractor's Construction and Submittal Schedules

§ 3.10.1 The Contractor, promptly after being awarded the Contract, shall submit for the Owner's and Architect's information and approval a Contractor's construction schedule for the Work. The schedule shall contain detail appropriate for the Project, including (1) the date of commencement of the Work, interim schedule milestone dates, and the date of Substantial Completion; (2) an apportionment of the Work by construction activity; and (3) the time required for completion of each portion of the Work. The schedule shall provide for the orderly progression of the Work to completion and shall not exceed time limits current under the Contract Documents. The schedule shall be revised at appropriate intervals as required by the conditions of the Work and Project. The schedule shall set forth milestone dates agreed to by the parties and the failure of the Contractor to achieve a milestone shall constitute a material default hereunder. Failure to meet a milestone date shall entitle but not require the Owner to supplement the Contractor's forces, at the sole cost and expense of the Contractor, and the Contractor shall be solely responsible for coordinating its efforts with and supervising the work of any supplemental manpower.

§ 3.10.2 The Contractor, promptly after being awarded the Contract and thereafter as necessary to maintain a current submittal schedule, shall submit a submittal schedule for the Architect's approval. The Architect's approval shall not be unreasonably delayed or withheld. The submittal schedule shall (1) be coordinated with the Contractor's construction schedule, and (2) allow the Architect reasonable time to review submittals. If the Contractor fails to submit a submittal schedule, or fails to provide submittals in accordance with the approved submittal schedule, the Contractor shall not be entitled to any increase in Contract Sum or extension of Contract Time based on the time required for review of submittals.

§ 3.10.3 The Contractor shall perform the Work in general accordance with the most recent schedules submitted to the Owner and Architect.

§ 3.10.4 The construction schedule shall be in a detailed precedence-style critical path management ("CPM") format satisfactory to the Owner and the Architect that shall also (i) provide a graphic representation of all activities and events that will occur during performance of the Work; (ii) identify each phase of construction and occupancy; and

(iii) set forth dates that are critical in ensuring the timely and orderly completion of the Work in accordance with the requirements of the Contract Documents (hereinafter referred to as “Milestone Dates”). Upon review and acceptance by the Owner and the Architect of the Milestone Dates, the construction schedule shall be deemed part of the Contract Documents. If not accepted, the construction schedule shall be promptly revised by the Contractor in accordance with the recommendations of the Owner and the Architect and resubmitted for acceptance. The Contractor shall monitor the progress of the Work for conformance with the requirements of the construction schedule and shall promptly advise the Owner of any delays or potential delays. The accepted construction schedule shall be updated to reflect actual conditions, as set forth in Subparagraph 3.10.1 or if requested by either the Owner or the Architect. In the event any progress report indicates any delays, the Contractor shall propose an affirmative plan to correct the delay, including overtime and/or additional labor, if necessary. In no event shall any progress report constitute an adjustment in the Contract Time, any Milestone Date, or the Contract Sum unless any such adjustment is agreed to by the Owner and authorized pursuant to Change Order.

§ 3.10.5 In the event the Owner determines that the performance of the Work, as of a Milestone Date, has not progressed or reached the level of completion required by the Contract Documents, the Owner shall have the right to order the Contractor to take corrective measures necessary to expedite the progress of construction, including, without limitation, (i) working additional shifts or overtime, (ii) supplying additional manpower, equipment, and facilities, and (iii) other similar measures (hereinafter referred to collectively as “Extraordinary Measures”). Such Extraordinary Measures shall continue until the progress of the Work complies with the stage of completion required by the Contract Documents. The Owner’s right to require Extraordinary Measures is solely for the purpose of ensuring the Contractor’s compliance with the construction schedule.

1. The Contractor shall not be entitled to an adjustment in the Contract Sum in connection with Extraordinary Measures required by the Owner under or pursuant to this Subparagraph 3.10.5.
2. The Owner may exercise the rights furnished the Owner under or pursuant to this Subparagraph 3.10.5 as frequently as the Owner deems necessary to ensure that the Contractor’s performance of the Work will comply with the completion date set forth in the Contract Documents.

§ 3.10.6 The Owner shall have the right to direct a postponement or rescheduling of any date or time for the performance of any part of the Work that may interfere with the operation of the Owner’s premises or any invitees thereof. The Contractor shall, upon the Owner’s request, reschedule any portion of the Work affecting operation of the premises during hours when the premises are in operation. Any postponement or rescheduling under Subparagraph 3.10.5. may be grounds for an extension of the Contract Time if permitted under Subparagraph 8.3.1.

§ 3.10.7 The Contractor shall schedule and conduct construction and progress meetings, on a frequency required to effect coordination, to discuss such matters as procedures, progress, problems, and scheduling. The Contractor shall prepare and distribute minutes within three working days of such meetings.

§ 3.10.8 The Contractor shall record the progress of the Project, including information on each Subcontractor and each Subcontractor’s Work, as well as the entire Project, showing percentages of completion and the number and amounts of Change Orders. The Contractor will keep a daily log containing a record of weather, Subcontractors’ Work on the site, number of workers, Work accomplished, problems encountered and other similar relevant data as the Owner may require. Upon request, Contractor shall make the logs available to the Owner and the Architect.

§ 3.11 Documents and Samples at the Site

The Contractor shall make available, at the Project site, the Contract Documents, including Change Orders, Construction Change Directives, and other Modifications, in good order and marked currently to indicate field changes and selections made during construction, and the approved Shop Drawings, Product Data, Samples, and similar required submittals. These shall be in electronic form or paper copy, available to the Architect and Owner, and delivered to the Architect for submittal to the Owner upon completion of the Work as a record of the Work as constructed.

§ 3.12 Shop Drawings, Product Data and Samples

§ 3.12.1 Shop Drawings are drawings, diagrams, schedules, and other data specially prepared for the Work by the Contractor or a Subcontractor, Sub-subcontractor, manufacturer, supplier, or distributor to illustrate some portion of the Work.

§ 3.12.2 Product Data are illustrations, standard schedules, performance charts, instructions, brochures, diagrams, and other information furnished by the Contractor to illustrate materials or equipment for some portion of the Work.

§ 3.12.3 Samples are physical examples that illustrate materials, equipment, or workmanship, and establish standards by which the Work will be judged.

§ 3.12.4 Shop Drawings, Product Data, Samples, and similar submittals are not Contract Documents. Their purpose is to demonstrate how the Contractor proposes to conform to the information given and the design concept expressed in the Contract Documents for those portions of the Work for which the Contract Documents require submittals. Review by the Architect is subject to the limitations of Section 4.2.7. Informational submittals upon which the Architect is not expected to take responsive action may be so identified in the Contract Documents. Submittals that are not required by the Contract Documents may be returned by the Architect without action. The Contractor's approval shall be noted on the submitted item or in its transmittal letter, together with written notice of any deviation in the submitted item from the requirements of the Work and of the Contract Documents. In collaboration with the Architect, Contractor shall establish and implement procedures for expediting the processing and approval of Shop Drawings, Product Data, Samples, and other submittals.

§ 3.12.5 The Contractor shall review for compliance with the Contract Documents, approve, and submit to the Architect, Shop Drawings, Product Data, Samples, and similar submittals required by the Contract Documents, in accordance with the submittal schedule approved by the Architect or, in the absence of an approved submittal schedule, with reasonable promptness and in such sequence as to cause no delay in the Work or in the activities of the Owner or of Separate Contractors. Each Shop Drawing, Product Data, Sample, and similar submittals shall have a cover sheet identifying the project name and address, contractor information, drawing and/or specification reference, submission date and contents of the submittal. Ample space shall be provided on this cover sheet to allow for the Contractor's and Architect's review stamps. The Contractor's approval shall be noted on the submitted items or in its transmittal letter, together with written notice of any deviation in the submitted item from the requirements of the Work and of the Contract Documents.

§ 3.12.6 By submitting and approving Shop Drawings, Product Data, Samples, and similar submittals, the Contractor represents to the Owner and Architect that the Contractor has (1) reviewed and approved them, (2) determined and verified materials, field measurements and field construction criteria related thereto, or will do so, and (3) checked and coordinated the information contained within such submittals with the requirements of the Work and of the Contract Documents. The Contractor shall indicate approval on the submittals as evidence of such review and coordinate submittals made to the Architect without such indications of approval may be returned to the Contractor for resubmission. The accuracy of all such information is the responsibility of the Contractor. In approving Shop Drawings, Product Data, Samples, and similar submittals, the Architect shall be entitled to rely upon the Contractor's representation that such information is accurate and in compliance with the Contract.

§ 3.12.7 The Contractor shall perform no portion of the Work for which the Contract Documents require submittal and review of Shop Drawings, Product Data, Samples, or similar submittals, until the respective submittal has been approved by the Architect. If the Contractor procures, performs, or installs portions of the Work without required approvals, the Contractor does so at its own risk and such Work may be removed or replaced with approved Work at no cost to the Owner.

§ 3.12.8 The Work shall be in accordance with approved submittals except that the Contractor shall not be relieved of responsibility for deviations from the requirements of the Contract Documents by the Architect's approval of Shop Drawings, Product Data, Samples, or similar submittals, unless the Contractor has specifically notified the Architect of such deviation at the time of submittal and (1) the Architect has given written approval to the specific deviation as a minor change in the Work, or (2) a Change Order or Construction Change Directive has been issued authorizing the deviation. Any submittals forwarded to the Architect for review that include a deviation from the requirements of the Contract Documents or is not the specific make, model or manufacturer that was listed in the Contract

Documents shall have a completed Substitution Request Form attached to the submittal. This Substitution Request Form shall be provided by the Owner. Unless such deviation is identified by utilizing the Substitution Request Form, the Contractor shall not be relieved of the responsibility for the specific requirements of the Contract Documents even though the subject submittal was approved by the Architect. The Contractor shall not be relieved of responsibility for the Contractor's subcontractor's or vendor's errors or omissions in Shop Drawings, Product Data, Samples, or similar submittals, by the Architect's approval thereof.

§ 3.12.9 The Contractor shall direct specific attention, in writing or on resubmitted Shop Drawings, Product Data, Samples, or similar submittals, to revisions other than those requested by the Architect on previous submittals. In the absence of such notice, the Architect's approval of a resubmission shall not apply to such revisions.

§ 3.12.10 The Contractor shall not be required to provide professional services that constitute the practice of architecture or engineering unless such services are specifically required by the Contract Documents for a portion of the Work or unless the Contractor needs to provide such services in order to carry out the Contractor's responsibilities for construction means, methods, techniques, sequences, and procedures. The Contractor shall not be required to provide professional services in violation of applicable law.

§ 3.12.10.1 If professional design services or certifications by a design professional related to systems, materials, or equipment are specifically required of the Contractor by the Contract Documents, the Owner and the Architect will specify all performance and design criteria that such services must satisfy. The Contractor shall cause such services or certifications to be provided by a properly licensed design professional who shall have and maintain reasonable limits of insurance, whose signature and seal shall appear on all drawings, calculations, specifications, certifications, Shop Drawings, and other submittals prepared by such professional. Shop Drawings, and other submittals related to the Work, designed or certified by such professional, if prepared by others, shall bear such professional's written approval when submitted to the Architect. The Owner shall be entitled to rely upon the adequacy and accuracy of the services, certifications, and approvals performed or provided by such design professionals. Pursuant to this Section 3.12.10, the Architect will review and approve or take other appropriate action on submittals only for the limited purpose of checking for conformance with information given and the design concept expressed in the Contract Documents.

§ 3.12.10.2 If the Contract Documents require the Contractor's design professional to certify that the Work has been performed in accordance with the design criteria, the Contractor shall furnish such certifications to the Architect at the time and in the form specified by the Architect.

§ 3.12.10.3 Services provided by the Architect to evaluate Contractor product substitution requests or to review shop drawings or other project submittals which are required to be submitted more than three (3) times shall be paid for by the Contractor to the Owner.

§ 3.13 Use of Site

§ 3.13.1 The Contractor shall confine operations at the site to areas permitted by applicable laws, statutes, ordinances, codes, rules and regulations, lawful orders of public authorities, and the Contract Documents and shall not unreasonably encumber the site with materials or equipment.

§ 3.13.2 Only materials and equipment that are to be used directly in the Work shall be brought to and stored on the Project site by the Contractor. After equipment is no longer required for the Work, it shall be promptly removed from the Project site. Protection of construction materials and equipment stored at the Project site from weather, theft, damage, and all other adversity is solely the responsibility of the Contractor. The Contractor shall ensure that the Work, at all times, is performed in a manner that affords reasonable access, both vehicular and pedestrian, to the site of the Work and all adjacent areas. The Work shall be performed, to the fullest extent reasonably possible, in such a manner that occupied areas adjacent to the site of the Work shall at all time remain free from all debris and building materials.

§ 3.13.3 Other than those reasonably required for safety purposes, the Contractor and any entity for whom the Contractor is responsible shall not erect any sign on the Project site without the prior written consent of the Owner, which may be withheld in the sole discretion of the Owner.

§ 3.13.4 Without limitation of any other provision of the Contract Documents, the Contractor shall use best efforts to

minimize any interference with the occupancy or beneficial use of any areas and buildings adjacent to the site of the Work. Without prior written approval of the Owner, the Contractor shall not permit any workers to use any existing facilities at the Project site, including, without limitation, lavatories, toilets, entrances, and parking areas other than those designated by the Owner.

§ 3.14 Cutting and Patching

§ 3.14.1 The Contractor shall be responsible for cutting, fitting, or patching required to complete the Work or to make its parts fit together properly. All areas requiring cutting, fitting, or patching shall be restored to the condition existing prior to the cutting, fitting, or patching, unless otherwise required by the Contract Documents.

§ 3.14.2 The Contractor shall not damage or endanger a portion of the Work or fully or partially completed construction of the Owner or Separate Contractors by cutting, patching, or otherwise altering such construction, or by excavation. The Contractor shall not cut or otherwise alter construction by the Owner or a Separate Contractor except with written consent of the Owner and of the Separate Contractor. Consent shall not be unreasonably withheld. The Contractor shall not unreasonably withhold, from the Owner or a Separate Contractor, its consent to cutting or otherwise altering the Work.

§ 3.15 Cleaning Up

§ 3.15.1 The Contractor shall keep the premises and surrounding area free from accumulation of waste materials and rubbish caused by operations under the Contract. At completion of the Work, the Contractor shall remove waste materials, rubbish, the Contractor's tools, construction equipment, machinery, and surplus materials from and about the Project and shall clean and/or remove all stains, spots, work, blemishes, foreign matter and dirt from other surfaces not part of the Work but where such conditions resulted from the Contractor's operations.

§ 3.15.2 If the Contractor fails to clean up as provided in the Contract Documents, the Owner may do so and the Owner shall be entitled to reimbursement from the Contractor for the full cost of such cleanup.

§ 3.16 Access to Work

The Contractor shall provide the Owner and Architect with access to the Work in preparation and progress wherever located.

§ 3.17 Royalties, Patents and Copyrights

The Contractor shall pay all royalties and license fees. The Contractor shall defend suits or claims for infringement of copyrights and patent rights and shall hold the Owner and Architect harmless from loss on account thereof, but shall not be responsible for defense or loss when a particular design, process, or product of a particular manufacturer or manufacturers is required by the Contract Documents, or where the copyright violations are contained in Drawings, Specifications, or other documents prepared by the Owner or Architect. However, if an infringement of a copyright or patent is discovered by, or made known to, the Contractor, the Contractor shall be responsible for the loss unless the information is promptly furnished to the Architect.

§ 3.18 Indemnification

§ 3.18.1 To the fullest extent permitted by law, the Contractor shall indemnify, defend and hold harmless the Owner, Architect, Architect's consultants, and agents and employees of any of them from and against claims, damages, losses, and expenses, including but not limited to attorneys' fees, arising out of or resulting from performance of the Work, provided that such claim, damage, loss, or expense is attributable to bodily injury, sickness, disease or death, or to injury to or destruction of tangible property (other than the Work itself), but only to the extent caused by the negligent acts or omissions of the Contractor, a Subcontractor, anyone directly or indirectly employed by them, or anyone for whose acts they may be liable, regardless of whether or not such claim, damage, loss, or expense is caused in part by a party indemnified hereunder. Such obligation shall not be construed to negate, abridge, or reduce other rights or obligations of indemnity that would otherwise exist as to a party or person described in this Section 3.18.

§ 3.18.2 The Contractor's indemnity obligations under this Paragraph 3.18 shall also specifically include, without limitation, all fines, penalties, damages, liability, costs, expenses (including, without limitation, reasonable attorneys' fees), and punitive damages (if any) arising out of, or in connection with, any (i) violation of or failure to comply with any law, statute, ordinance, rule, regulation, code, or requirement of a public authority that bears upon the performance of the Work by the Contractor, a Subcontractor, or any person or entity for whom either is

responsible, (ii) means, methods, procedures, techniques, or sequences of execution or performance of the Work, and (iii) failure to secure and pay for permits, fees, approvals, licenses, and inspections as required under the Contract Documents, or any violation of any permit or other approval of a public authority applicable to the Work, by the Contractor, a Subcontractor, or any person or entity for whom either is responsible.

§ 3.18.3 The Contractor acknowledges that the subject property upon which the Project is being performed is not lienable because it is municipal government property used for governmental purposes. The Contractor shall indemnify, defend and hold harmless the Owner and the Architect against any and all mechanic's liens placed on the premises or on Owner's interest in the premises by any Subcontractor of any tier or material supplier. In the event that a Subcontractor of any tier or material supplier places a mechanic's lien on the premises, the Contractor shall, with thirty (30) days of the filing of any mechanic's lien, substitute a bond for such lien or cause the lien to be discharged. If the Contractor shall fail to do so, the Owner may, at its option and at the expense of the Contractor, bond such lien or cause the lien to be discharged, and the Contractor will reimburse the Owner for all costs and expenses incurred, including but not limited to attorneys' fees and court costs.

§ 3.18.4 The Contractor shall indemnify, defend, and hold harmless the Owner and the Architect from and against any additional costs or expenses incurred by Owner, including attorneys' fees and court costs, as a result of any claim or cause of action by any Subcontractor or supplier of any tier asserted directly against the Owner to recover payment for labor or materials supplied to the Project, unless such claim or cause of action arises from the failure of the Owner to make payments in accordance with the applicable provisions of the Contract Documents.

§ 3.18.5 The Contractor shall indemnify and hold harmless the Owner, its agents and employees from and against any costs and expenses, including attorneys' fees and court costs, incurred in enforcing any of the Contractor's defense, indemnity, and hold harmless obligations under this Contract.

§ 3.18.6 The Contractor, for itself, its insurers and all subcontractors and their insurers, shall waive governmental immunity as a defense and shall not use the defense of governmental immunity in the adjustment of claims or in the defense of any suit, action or claim brought against the Owner. Nothing herein shall limit the Owner from utilizing the defense of governmental immunity.

§ 3.19 MEETINGS

The Contractor shall send a qualified representative to periodic progress meetings held at such time and at such place as the Architect or the Owner shall designate in accordance with the Contract Documents and to such other meetings as are necessary to comply with the Contract Documents.

ARTICLE 4 ARCHITECT

§ 4.1 General

§ 4.1.1 The Architect is the person or entity retained by the Owner pursuant to Section 2.3.2 and identified as such in the Agreement.

§ 4.1.2 Duties, responsibilities, and limitations of authority of the Architect as set forth in the Contract Documents shall not be restricted, modified, or extended without written consent of the Owner, Contractor, and Architect. Consent shall not be unreasonably withheld.

§ 4.2 Administration of the Contract

§ 4.2.1 The Architect will provide administration of the Contract as described in the Contract Documents and will be an Owner's representative during construction, (i) until the final payment is due, (ii) from time to time during the one year period described in Section 12.2, and (iii) while review or certification of the Project from any of the Agencies is pending. The Architect will have authority to act on behalf of the Owner only to the extent specified in the Contract Documents.

§ 4.2.2 The Architect will visit the site at intervals appropriate to the stage of construction, or as otherwise agreed with the Owner, to become generally familiar with the progress and quality of the portion of the Work completed, and to determine in general if the Work observed is being performed in a manner indicating that the Work, when fully completed, will be in accordance with the Contract Documents. However, the Architect will not be required to make exhaustive or continuous on-site inspections to check the quality or quantity of the Work. The Architect will

not have control over, charge of, or responsibility for the construction means, methods, techniques, sequences or procedures, or for the safety precautions and programs in connection with the Work, since these are solely the Contractor's rights and responsibilities under the Contract Documents.

§ 4.2.3 On the basis of the site visits, the Architect will keep the Owner reasonably informed about the progress and quality of the portion of the Work completed, and promptly report to the Owner (1) known deviations from the Contract Documents, (2) known deviations from the most recent construction schedule submitted by the Contractor, and (3) defects and deficiencies observed in the Work. The Architect will not be responsible for the Contractor's failure to perform the Work in accordance with the requirements of the Contract Documents. The Architect will not have control over or charge of, and will not be responsible for acts or omissions of, the Contractor, Subcontractors, or their agents or employees, or any other persons or entities performing portions of the Work.

§ 4.2.4 Communications

The Owner and Contractor shall include the Architect in all communications that relate to or affect the Architect's services or professional responsibilities. The Owner shall promptly notify the Architect of the substance of any direct communications between the Owner and the Contractor otherwise relating to the Project. Communications by and with the Architect's consultants shall be through the Architect. Communications by and with Subcontractors and suppliers shall be through the Contractor. Communications by and with Separate Contractors shall be through the Owner. The Contract Documents may specify other communication protocols.

§ 4.2.5 Based on the Architect's evaluations of the Contractor's Applications for Payment, the Architect will review and certify the amounts due the Contractor and will issue Certificates for Payment in such amounts.

§ 4.2.6 The Architect has authority to reject Work that does not conform to the Contract Documents. Whenever the Architect considers it necessary or advisable, the Architect will have authority to require inspection or testing of the Work in accordance with Sections 13.4.2 through 13.4.4, whether or not the Work is fabricated, installed or completed.

§ 4.2.7 The Architect will review and approve, or take other appropriate action upon, the Contractor's submittals such as Shop Drawings, Product Data, and Samples, but only for the limited purpose of assuring conformity with information given and the design concept expressed in the Contract Documents. The Architect's action will be taken in accordance with the submittal schedule approved by the Architect or, in the absence of an approved submittal schedule, with reasonable promptness while allowing sufficient time in the Architect's professional judgment to permit adequate review. Review of such submittals is not conducted for the purpose of determining the accuracy and completeness of other details such as dimensions and quantities, or for substantiating instructions for installation or performance of equipment or systems, all of which remain the responsibility of the Contractor as required by the Contract Documents. The Architect's review of the Contractor's submittals shall not relieve the Contractor of the obligations under Sections 3.3, 3.5, and 3.12. The Architect's review shall not constitute approval of safety precautions or of any construction means, methods, techniques, sequences, or procedures. The Architect's approval of a specific item shall not indicate approval of an assembly of which the item is a component.

§ 4.2.8 The Architect will prepare Change Orders and Construction Change Directives, and may order minor changes in the Work as provided in Section 7.4. The Architect will investigate and make determinations and recommendations regarding concealed and unknown conditions as provided in Section 3.7.4.

§ 4.2.9 The Architect will conduct inspections to determine the date or dates of Substantial Completion and the date of final completion; issue Certificates of Substantial Completion pursuant to Section 9.8; receive and forward to the Owner, for the Owner's review and records, written warranties and related documents required by the Contract Documents and assembled by the Contractor pursuant to Section 9.10; and issue a final Certificate for Payment pursuant to Section 9.10.

§ 4.2.10 The Architect will provide one or more Project representatives to assist in carrying out the Architect's responsibilities at the site. The Owner shall notify the Contractor of any change in the duties, responsibilities and limitations of authority of the Project representatives.

§ 4.2.11 The Architect will interpret and decide matters concerning performance under, and requirements of, the Contract Documents on written request of either the Owner or Contractor. The Architect's response to such requests will be made in writing within any time limits agreed upon or otherwise with reasonable promptness.

§ 4.2.12 Interpretations and decisions of the Architect will be consistent with the intent of, and reasonably inferable from, the Contract Documents and will be in writing or in the form of drawings. When making such interpretations and decisions, the Architect will endeavor to secure faithful performance by both Owner and Contractor, will not show partiality to either, and will not be liable for results of these interpretations or decisions rendered in good faith which were necessitated by a reason other than an act or omission of the Architect.

§ 4.2.13 The Architect's decisions on matters relating to aesthetic effect will be final if consistent with the intent expressed in the Contract Documents.

§ 4.2.14 The Architect will review and respond to requests for information about the Contract Documents. The Architect's response to such requests will be made in writing within any time limits agreed upon or otherwise with reasonable promptness. Requests for information shall include, at a minimum, a detailed written statement that indicates the specific element of the Contract Documents in need of clarification and the nature of the clarification requested. If appropriate, the Architect will prepare and issue supplemental Drawings and Specifications in response to the requests for information.

§ 4.2.15 Each Subcontract executed by the Contractor shall include language that instructs the Subcontractor that the Subcontractor is to submit written information requests regarding Contract Document interpretation only to the Contractor and not the Architect. The Contractor shall timely review each such information request and only as necessary, submit to the Architect any information request that in the Contractor's professional judgment is not clearly and unambiguously answered in the Contract Documents.

ARTICLE 5 SUBCONTRACTORS

§ 5.1 Definitions

§ 5.1.1 A Subcontractor is a person or entity who has a direct contract with the Contractor to perform a portion of the Work at the site. The term "Subcontractor" is referred to throughout the Contract Documents as if singular in number and means a Subcontractor or an authorized representative of the Subcontractor. The term "Subcontractor" does not include a Separate Contractor or the subcontractors of a Separate Contractor.

§ 5.1.2 A Sub-subcontractor is a person or entity who has a direct or indirect contract with a Subcontractor to perform a portion of the Work at the site. The term "Sub-subcontractor" is referred to throughout the Contract Documents as if singular in number and means a Sub-subcontractor or an authorized representative of the Sub-subcontractor.

§ 5.2 Award of Subcontracts and Other Contracts for Portions of the Work

§ 5.2.1 Unless otherwise stated in the Contract Documents, the Contractor, as soon as practicable after award of the Contract, shall notify the Owner and Architect of the persons or entities proposed for each principal portion of the Work, including those who are to furnish materials or equipment fabricated to a special design. Within 14 days of receipt of the information, the Owner or Architect may notify the Contractor whether the Owner or the Architect (1) has reasonable objection to any such proposed person or entity or (2) either requires additional time for review. Failure of the Architect to provide notice within the 14-day period shall constitute notice of no reasonable objection.

§ 5.2.1.1 To facilitate and expedite the investigations of such proposed persons or entities, the Contractor shall submit a statement in writing in sufficient detail to establish that each has the capacity to carry out the portion of the Work such person or entity is proposing to provide. All such submittals shall include a list of principal personnel of any such entity, and an analysis of the financial condition, construction plant, equipment and facilities of any such person or entity. The Contractor shall terminate, at no cost to Owner, any contract with a person or entity to whom the Owner has a reasonable objection if such proposed and rejected subcontractor or such terminated.

§ 5.2.2 The Contractor shall not contract with a proposed person or entity to whom the Owner or Architect has made reasonable and timely objection. The Contractor shall not be required to contract with anyone to whom the Contractor has made reasonable objection.

§ 5.2.3 If the Owner or Architect has reasonable objection to a person or entity proposed by the Contractor, the Contractor shall propose another to whom the Owner or Architect has no reasonable objection. If the proposed but

rejected Subcontractor was reasonably capable of performing the Work, the Contract Sum and Contract Time shall be increased or decreased by the difference, if any, occasioned by such change, and an appropriate Change Order shall be issued before commencement of the substitute Subcontractor's Work. However, no increase in the Contract Sum or Contract Time shall be allowed for such change unless the Contractor has acted promptly and responsively in submitting names as required.

§ 5.2.4 If the Contractor proposes to substitute a Subcontractor, person, or entity for one previously selected, the parties shall follow the procedures outlined in Section 5.2.1.

§ 5.3 Subcontractual Relations

§ 5.3.1 Any part of the Work performed for the Contractor by a Subcontractor shall be pursuant to a written Subcontract between the Contractor and Subcontractor, which shall be prepared on a form of Subcontract reasonably satisfactory to the Owner in all respects. The Owner shall be a third party beneficiary of all contracts between the Contractor and Subcontractor and all such contracts shall require that the Owner be a third party beneficiary of all contracts between Subcontractors and Sub-Subcontractors. Copies of all Subcontractor bids or proposals shall, upon request of Owner, be submitted to the Owner and Architect.

§ 5.3.2 By appropriate agreement, written where legally required for validity, the Contractor shall require each Subcontractor, to the extent of the Work to be performed by the Subcontractor, to be bound to the Contractor by terms of the Contract Documents, and to assume toward the Contractor all the obligations and responsibilities, including the responsibility for safety of the Subcontractor's Work, which the Contractor, by these Documents, assumes toward the Owner and Architect. Each subcontract agreement shall preserve and protect the rights of the Owner and Architect under the Contract Documents with respect to the Work to be performed by the Subcontractor so that subcontracting thereof will not prejudice such rights, and shall allow to the Subcontractor, unless specifically provided otherwise in the subcontract agreement, the benefit of all rights, remedies and remedies against the Contractor that the Contractor, by the Contract Documents, has against the Owner. Where appropriate, the Contractor shall require each Subcontractor to enter into similar agreements with Sub-subcontractors. The Contractor shall make available to each proposed Subcontractor, prior to the execution of the subcontract agreement, copies of the Contract Documents to which the Subcontractor will be bound, and, upon written request of the Subcontractor, identify to the Subcontractor terms and conditions of the proposed subcontract agreement that may be at variance with the Contract Documents. Subcontractors will similarly make copies of applicable portions of such documents available to their respective proposed Sub-subcontractors.

§ 5.3.3 The Contractor shall be fully responsible for coordinating and expediting the work of all Subcontractors, and shall employ the necessary and qualified personnel to produce the required quality of labor and materials and to prevent delays in the progress of the Project. The Contractor shall afford each trade with all reasonable opportunities for the installation of its work and for the storage and handling of its materials. The Contractors shall include in the Contractor's bid, any work, in connection with the mechanical trades, to be done by other trades under the Contractor's direct control.

§ 5.3.4 Within thirty (30) calendar days after payment to Contractor by the Owner, the Contractor shall pay any amounts due any Subcontractor, whether for labor performed or materials furnished when such labor or material has been included in requisition submitted by such Contractor and paid by Owner. The Contractor shall promptly give notice to the Owner of any claim or demand by a Subcontractor claiming that any amount is due to such Subcontractor or claiming any default by the Contractor in any of the Contractor's obligations to such Subcontractor.

§ 5.3.5 The Contractor shall include in each of the subcontracts a provision requiring each Subcontractor to pay amounts due to any Sub-Subcontractors, whether for labor performed or materials furnished, within thirty (30) days after such Subcontractor receives a payment from the Contractor which encompasses labor or materials furnished by such Sub-subcontractor and a provision requiring each Subcontractor to promptly any claim or demand by a Sub-subcontractor claiming that any amount is due to such Sub-Subcontractor or claiming any default by such Subcontractor in any of its obligations to such Sub-subcontractor which notice the Contractor shall promptly relay to the Owner.

§ 5.4 Contingent Assignment of Subcontracts

§ 5.4.1 Each subcontract agreement for a portion of the Work is assigned by the Contractor to the Owner, provided that

- .1 assignment is effective only after termination of the Contract by the Owner for cause pursuant to Section 14.2 and only for those subcontract agreements that the Owner accepts by notifying the Subcontractor and Contractor; and
- .2 assignment is subject to the prior rights of the surety, if any, obligated under bond relating to the Contract.

When the Owner accepts the assignment of a subcontract agreement, the Owner assumes the Contractor's rights and obligations under the subcontract but does not accept and shall not be liable for Contractor's obligations prior to the effective date of the assignment. The Contractor agrees to execute any and all other documents required to affect this assignment.

§ 5.4.2 Upon such assignment, if the Work has been suspended for more than 30 days, the Subcontractor's compensation shall be equitably adjusted for increases in direct costs resulting from the suspension, provided, however, that no such adjustment will be made to the compensation of a Subcontractor who is compensated as a proportion of the total project cost or a Subcontractor who is in default of its subcontract at the time of assignment.

§ 5.4.3 Upon assignment to the Owner under this Section 5.4, the Owner may further assign the subcontract to a successor contractor or other entity.

ARTICLE 6 CONSTRUCTION BY OWNER OR BY SEPARATE CONTRACTORS

§ 6.1 Owner's Right to Perform Construction and to Award Separate Contracts

§ 6.1.1 The term "Separate Contractor(s)" shall mean other contractors retained by the Owner under separate agreements.. The Owner reserves the right to perform construction or operations related to the Project with the Owner's own forces, to supplement the Contractor's forces and to award separate contracts in connection with other portions of the Project or other construction or operations on the site. If the Contractor claims that delay or is involved because of such action by the Owner, the Contractor shall make such Claim as is permitted in Articles 8 and 15.

§ 6.1.2 When separate contracts are awarded for different portions of the Project or other construction or operations on the site, the term "Contractor" in the Contract Documents in each case shall mean the Contractor who executes each separate Owner-Contractor Agreement.

§ 6.1.3 The Owner shall provide for coordination of the activities of the Owner's own forces and of each Separate Contractor with the Work of the Contractor, who shall cooperate with them. The Contractor shall participate with any Separate Contractors and the Owner in reviewing their construction schedules. The Contractor shall make any revisions to its construction schedule deemed necessary after a joint review and mutual agreement. The construction schedules shall then constitute the schedules to be used by the Contractor, Separate Contractors, and the Owner until subsequently revised.

§ 6.1.4 INTENTIONALLY OMITTED

§ 6.2 Mutual Responsibility

§ 6.2.1 The Contractor shall afford the Owner and Separate Contractors reasonable opportunity for introduction and storage of their materials and equipment and performance of their activities, and shall connect and coordinate the Contractor's construction and operations with theirs as required by the Contract Documents.

§ 6.2.2 If part of the Contractor's Work depends for proper execution or results upon construction or operations by the Owner or a Separate Contractor, the Contractor shall, prior to proceeding with that portion of the Work, promptly notify the Architect of apparent discrepancies or defects in the construction or operations by the Owner or Separate Contractor that would render it unsuitable for proper execution and results of the Contractor's Work. Failure of the Contractor to notify the Architect of apparent discrepancies or defects prior to proceeding with the Work shall constitute an acknowledgment that the Owner's or Separate Contractor's completed or partially completed construction is fit and proper to receive the Contractor's Work. The Contractor shall not be responsible for discrepancies or defects in the construction or operations by the Owner or Separate Contractor that are not apparent.

§ 6.2.3 The Contractor shall reimburse the Owner for costs the Owner incurs that are payable to a Separate Contractor because of the Contractor's delays, improperly timed activities or defective construction. The Owner shall be responsible to the Contractor for costs the Contractor incurs because of a Separate Contractor's delays, improperly timed activities, damage to the Work or defective construction.

§ 6.2.4 The Contractor shall promptly remedy damage that the Contractor wrongfully causes to completed or partially completed construction or to property of the Owner or Separate Contractor as provided in Section 10.2.5. If such separate contractor sues or initiates an arbitration proceeding against the Owner on account of any damage alleged to have been caused by the Contractor, the Owner shall notify the Contractor, who shall defend such proceedings at the Contractor's expense, and if any judgment or award against the Owner arises therefrom, the Contractor shall pay or satisfy it and shall reimburse the Owner for all attorneys' fees and court or arbitration costs which the Owner has incurred.

§ 6.2.5 The Owner and each Separate Contractor shall have the same responsibilities for cutting and patching as are described for the Contractor in Section 3.14.

§ 6.3 Owner's Right to Clean Up

If a dispute arises among the Contractor, Separate Contractors, and the Owner as to the responsibility under their respective contracts for maintaining the premises and surrounding area free from waste materials and rubbish, the Owner may clean up and the Architect will allocate the cost among those responsible.

ARTICLE 7 CHANGES IN THE WORK

§ 7.1 General

§ 7.1.1 Changes in the Work may be accomplished after execution of the Contract, and without invalidating the Contract, by Change Order, Construction Change Directive or order for a minor change in the Work, subject to the limitations stated in this Article 7 and elsewhere in the Contract Documents. The decision as to whether the Change Work is executed via a Change Order, Construction Change Directive, or a minor change in the Work is the decision of the Owner.

§ 7.1.2 A Change Order shall be based upon agreement among the Owner, Contractor, and Architect. A Construction Change Directive requires agreement by the Owner and Architect and may or may not be agreed to by the Contractor. An order for a minor change in the Work may be issued by the Architect alone.

§ 7.1.3 Changes in the Work shall be performed under applicable provisions of the Contract Documents. The Contractor shall proceed promptly with changes in the Work, unless otherwise provided in the Change Order, Construction Change Directive, or order for a minor change in the Work.

§ 7.1.4 Except as permitted in Paragraph 7.3, a change in the Contract Sum or the Contract Time shall be accomplished only by a written Change Order executed before the Work is performed. Accordingly, no course of conduct or dealings between the parties, nor express or implied acceptance of alterations or additions to the Work, and no claim that Owner has been unjustly enriched by any alteration of or addition to the Work, whether or not there is, in fact, any unjust enrichment to the Work, shall be the basis of any claim to an increase in any amounts due under the Contract Documents or a change in any time period provided for in the Contract Documents.

§ 7.2 Change Orders

§ 7.2.1 A Change Order is a written instrument prepared by the Architect and signed by the Owner, Contractor, and Architect stating their agreement upon all of the following:

- .1 The change in the Work;
- .2 The amount of the adjustment, if any, in the Contract Sum; and
- .3 The extent of the adjustment, if any, in the Contract Time.

§ 7.2.2 Agreement on any Change Order shall constitute a final settlement of all matters relating to the change in the Work that is the subject of the Change Order, including, but not limited to, all direct and indirect costs associated with such change and any and all adjustments to the Contract Sum and the Contract Time.

§7.2.3 Proposed changes in the Work requested during the construction phase shall be priced by the Contractor and submitted to the Architect and Owner for review, in such form as the Architect and Owner may require, within ten (10) calendar days following the Contractor's receipt of the request. The Contractor shall promptly revise and resubmit such proposal if the Architect and Owner determine that it is not in compliance with the requirements of this Article, or that contains errors of fact or mathematical errors. If required by the Architect or Owner, in order to establish the exact cost of new Work added or previously required Work omitted, the Contractor shall obtain and furnish to the Architect and Owner bona fide proposals from recognized suppliers for furnishing and material included in such Work. Such proposals shall be furnished at the Contractor's expense.

§ 7.2.4 The Contractor's proposal for a change in the Work (Change Order Proposal) shall be itemized completely and shall include: Specific number of calendar days for additional time (if applicable); all material costs and quantities accompanied by the original manufacturer invoices; labor wages; unit prices; subcontractor costs; mark ups; equipment costs, profit, overhead, general conditions, fees, bond costs and approved daily time sheet tickets for work performed under the utilization of labor rates. The Architect's and Owner's refusal to approve a Change Order or Change Order Proposal due to the Contractor's lack of itemized backup information shall not be used to substantiate a claim for additional time.

§ 7.2.5 If the method utilized to execute the Change in the Work is based on labor rates, unit prices and material costs, then actual daily time sheets / tickets, approved by the Superintendent and the Owner, must accompany the Change Order, Construction Change Directive, or minor change in the Work. Not including the actual daily time sheets / tickets, approved by the Superintendent and the Owner, with the Change Order, Construction Change Directive, or minor change in the Work may be cause for their rejection.

§ 7.2.6 The amount of credit to be allowed by the Contractor to the Owner for a deletion or change which results in a net decrease in the Contract Sum shall be actual net cost as confirmed by the Architect. When both addition and credits covering related Work or substitutions are involved in a change, the allowance for overhead and profit shall be figured on the basis of net increase, if any, with respect to that change.

§ 7.3 Construction Change Directives

§ 7.3.1 A Construction Change Directive is a written order prepared by the Architect and signed by the Owner and Architect, directing a change in the Work prior to agreement on adjustment, if any, in the Contract Sum or Contract Time, or both. The Owner may by Construction Change Directive, without invalidating the Contract, order changes in the Work within the general scope of the Contract consisting of additions, deletions, or other revisions, the Contract Sum and Contract Time being adjusted accordingly. The Owner may also by Construction Change Directive order work to be performed that has been interpreted by the Owner and Architect to be part of the Work but is disputed by the Contractor through submission of a Claim.

§ 7.3.2 A Construction Change Directive shall be used in the absence of total agreement on the terms of a Change Order or work interpreted by the Owner or Architect to be part of the Contract.

§ 7.3.3 If the Construction Change Directive provides for an adjustment to the Contract Sum, the adjustment shall be based on one of the following methods:

- .1 Mutual acceptance of a lump sum properly itemized and supported by sufficient substantiating data to permit evaluation;
- .2 Unit prices and rates stated in the Contract Documents or subsequently agreed upon;
- .3 Cost to be determined in a manner agreed upon by the parties and a mutually acceptable fixed or percentage fee; or
- .4 As provided in Section 7.3.4.

§ 7.3.4 If the Contractor does not respond promptly or disagrees with the method for adjustment in the Contract Sum, the Architect shall determine the adjustment on the basis of reasonable expenditures and savings of those performing the Work attributable to the change, including, in case of an increase in the Contract Sum, an amount for overhead and profit as set forth in the Agreement, or if no such amount is set forth in the Agreement, a reasonable amount. In such case, and also under Section 7.3.3.3, the Contractor shall keep and present, in such form as the Architect may prescribe, an itemized accounting together with appropriate supporting data. Unless otherwise provided in the Contract Documents, costs for the purposes of this Section 7.3.4 shall be limited to the following:

- .1 Costs of labor, including applicable payroll taxes, fringe benefits required by agreement or custom, workers' compensation insurance, and other employee costs approved by the Architect;
- .2 Costs of materials, supplies, and equipment, including cost of transportation, whether incorporated or consumed;
- .3 Rental costs of machinery and equipment, exclusive of hand tools, whether rented from the Contractor or others;
- .4 Costs of premiums for all bonds and insurance, permit fees, and sales, use, or similar taxes, directly related to the change; and
- .5 Costs of supervision and field office personnel directly attributable to the change.

§ 7.3.5 If the Contractor disagrees with the adjustment in the Contract Time, the Contractor may make a Claim in accordance with applicable provisions of Article 15.

§ 7.3.6 Upon receipt of a Construction Change Directive, the Contractor shall promptly proceed with the change in the Work involved and advise the Architect, in writing, of the Contractor's agreement or disagreement with the method, if any, provided in the Construction Change Directive for determining the proposed adjustment in the Contract Sum or Contract Time.

§ 7.3.7 A Construction Change Directive signed by the Contractor indicates the Contractor's agreement therewith, including adjustment in Contract Sum and Contract Time or the method for determining them. Such agreement shall be effective immediately and shall be recorded as a Change Order.

§ 7.3.8 The amount of credit to be allowed by the Contractor to the Owner for a deletion or change that results in a net decrease in the Contract Sum shall be actual net cost as confirmed by the Architect. When both additions and credits covering related Work or substitutions are involved in a change, the allowance for overhead and profit shall be figured on the basis of net increase, if any, with respect to that change.

§ 7.3.9 Pending final determination of the total cost of a Construction Change Directive to the Owner, the Contractor may request payment for Work completed under the Construction Change Directive in Applications for Payment. The Architect will make an interim determination for purposes of monthly certification for payment for those costs and certify for payment the amount that the Architect determines, in the Architect's professional judgment, to be necessary for the Contractor to proceed with the Work. The Architect's interim determination of cost shall adjust the Contract Sum on the same basis as a Change Order, subject to the right of either party to disagree and assert a Claim in accordance with Article 15.

§ 7.3.10 When the Owner and Contractor agree with a determination made by the Architect concerning the adjustments in the Contract Sum and Contract Time, or otherwise reach agreement upon the adjustments, such agreement shall be effective immediately and the Architect will prepare a Change Order. Change Orders may be issued for all or any part of a Construction Change Directive.

§ 7.4 Minor Changes in the Work

The Architect may order minor changes in the Work that are consistent with the intent of the Contract Documents and do not involve an adjustment in the Contract Sum or an extension of the Contract Time. The Architect's order for minor changes shall be in writing. If the Contractor believes that the proposed minor change in the Work will affect the Contract Sum or Contract Time, the Contractor shall notify the Architect and shall not proceed to implement the change in the Work. If the Contractor performs the Work set forth in the Architect's order for a minor change without prior notice to the Architect that such change will affect the Contract Sum or Contract Time, the Contractor waives any adjustment to the Contract Sum or extension of the Contract Time.

ARTICLE 8 TIME

§ 8.1 Definitions

§ 8.1.1 Unless otherwise provided, Contract Time is the period of time, including authorized adjustments, allotted in the Contract Documents for Substantial Completion of the Work.

§ 8.1.2 The date of commencement of the Work is the date established in the Agreement.. **TIME IS OF THE ESSENCE** of all Milestone Dates, the Substantial Completion date and the Final Completion date in the accepted Construction Schedule, as such Schedule may be revised and approved by the Owner.

§ 8.1.3 The date of Substantial Completion is the date certified by the Architect in accordance with Section 9.8.

§ 8.1.4 The term “day” as used in the Contract Documents shall mean calendar day unless otherwise specifically defined.

§ 8.2 Progress and Completion

§ 8.2.1 Time limits stated in the Contract Documents are of the essence of the Contract. By executing the Agreement, the Contractor confirms that the Contract Time is a reasonable period for performing the Work.

§ 8.2.2 The Contractor shall not commence the Work prior to receiving written notice to commence from the Owner or prior to the effective date of insurance required to be furnished by the Contractor and Owner.

§ 8.2.3 The Contractor shall proceed expeditiously with adequate forces and shall achieve Substantial Completion within the Contract Time.

§ 8.2.4 The Contractor shall proceed expeditiously in accordance with the construction schedule with adequate forces and shall achieve Substantial Completion within the Contract Time. The Contractor shall at all times ensure that each Subcontractor is providing and maintaining sufficient skilled workmen, materials and equipment to achieve Substantial Completion within the Contract Time. Absent Change Orders signed by the Owner or a delay for which the Contractor is entitled to an extension of time by § 8.3.1, the Contractor shall not make any claims for additional payment of straight time, overtime or premium time in undertaking to achieve Substantial Completion of the Work in accordance with the construction schedule. The burden of lost time and costs related to any Subcontractor's nonperformance shall not be charged to Owner.

§ 8.3 Delays and Extensions of Time

§ 8.3.1 If the Contractor is delayed at any time in the commencement or progress of the Work by (1) an act or neglect of the Owner or Architect, of an employee of either, or of a Separate Contractor; (2) by changes ordered in the Work; (3) by labor disputes, fire, unusual delay in deliveries, unavoidable casualties, adverse weather conditions documented in accordance with Section 15.1.6.2, or other causes beyond the Contractor's control; (4) by delay authorized by the Owner pending mediation and binding dispute resolution; or (5) by other causes that the Contractor asserts, and the Architect determines, justify delay, then the Contract Time shall be extended for such reasonable time as the Architect may determine. Nothing in this Section 8.3.1 shall absolve the Architect of liability for delays due to the negligence of the Architect or its employees or consultants, or failure to comply with the agreement between the Owner and the Architect or the Contract Documents by the Architect or by the Architect's employees or consultants. Under no circumstances shall Owner be responsible or liable for any delay damages, including any *Eichleay* or other type of extended overhead or lost profit claims or damages, idle equipment costs, lost productivity or labor inefficiency costs, acceleration damages, suspension damages, consequential damages, incidental damages, or lost opportunity costs. Contractor acknowledges that it is aware of and considered this provision when submitting and pricing its Proposal and Contractor accepts the risk of delays.

§ 8.3.2 Claims relating to time shall be made in accordance with applicable provisions of Article 15. Extensions of time shall be Contractor's sole remedy in the event of delays.

§ 8.3.3 Notwithstanding anything to the contrary in the Contract Documents, an extension of the Contract Time, to the extent permitted under Subparagraph 8.3.1, shall be the sole and exclusive remedy of the Contractor for any delay, hindrance, disruption, interference or obstruction to the Work (collectively referred to in this Subparagraph 8.3.3 as “Delays”). Except as provided in Section 6.2.6 of the Contract, in no event shall the Contractor be entitled to any compensation or recovery of any damages in connection with any Delay, including, without limitation, consequential damages, loss of efficiency or productivity costs, acceleration costs, lost opportunity costs, impact damages, extended overhead costs, or other similar remuneration.

§ 8.3.4 TIME IS OF THE ESSENCE in the completion of the Work by the Contractor.

§ 8.3.5 No extension of time, or increase in the Contract Sum, shall be granted because of seasonal variations in temperature, humidity or precipitation, which conditions, excepting force majeure, shall be wholly at the risk of the Contractor.

§ 8.3.6 The Contractor shall not be entitled to an adjustment of the Contract Time on account of delays: (i) that it could have avoided or mitigated using its best professional efforts; (ii) that do not impact the critical path; (iii) for which there is available float in the chain of activities affected by the delay; (iv) that were caused by or could have been reasonably anticipated by the Contractor or those for whom it is responsible; or (v) that could have been mitigated or avoided by the Contractor's timely notice to the Owner as required hereunder.

ARTICLE 9 PAYMENTS AND COMPLETION

§ 9.1 Contract Sum

§ 9.1.1 The Contract Sum is stated in the Agreement and, including authorized adjustments, is the total amount payable by the Owner to the Contractor for performance of the Work under the Contract Documents.

§ 9.1.2 If unit prices are stated in the Contract Documents or subsequently agreed upon, and if quantities originally contemplated are materially changed so that application of such unit prices to the actual quantities causes substantial inequity to the Owner or Contractor, the applicable unit prices shall be equitably adjusted.

§ 9.2 Schedule of Values

The Contractor shall submit a schedule of values to the Architect within thirty (30) days of the first of the Contract Award or Preconstruction Meeting, allocating the entire Contract Sum to the various portions of the Work. The schedule of values shall be prepared in the form, and supported by the data to substantiate its accuracy, required by the Architect. This schedule, unless objected to by the Architect, shall be used as a basis for reviewing the Contractor's Applications for Payment. **The description of the Work shall be sufficiently broken down to indicate labor and material costs associated with each area of Work. Any breakdown that fails to include sufficient detail, is unbalanced, or exhibits "front-loading" of the value of the Work, will be rejected. The Schedule of Values shall be revised if later determined by the Owner or Architect to be inaccurate.** Any changes to the schedule of values shall be submitted to the Architect and supported by such data to substantiate its accuracy as the Architect may require, and unless objected to by the Architect, shall be used as a basis for reviewing the Contractor's subsequent Applications for Payment.

§ 9.3 Applications for Payment

§ 9.3.1 At least ten days before the date established for each progress payment, the Contractor shall submit to the Architect an itemized Application for Payment prepared in accordance with the schedule of values, if required under Section 9.2, for completed portions of the Work. The application shall be notarized and supported by all data substantiating the Contractor's right to payment that the Owner or Architect require, such as copies of requisitions, and releases and waivers of liens from Subcontractors and suppliers, and shall reflect retainage if provided for in the Contract Documents.

§ 9.3.1.1 As provided in Section 7.3.9, such applications may include requests for payment on account of changes in the Work that have been properly authorized by Construction Change Directives, or by interim determinations of the Architect, but not yet included in Change Orders.

§ 9.3.1.2 Applications for Payment shall not include requests for payment for portions of the Work for which the Contractor does not intend to pay a Subcontractor or supplier, unless such Work has been performed by others whom the Contractor intends to pay.

§ 9.3.1.3 Each application for payment shall be accompanied by the following, all in form and substance satisfactory to the Owner: (i) a duly executed Contractor's partial lien waiver; (ii) duly executed partial lien waivers from all Subcontractors and, when reasonably required, from material suppliers and lower tier Subcontractors establishing payment or satisfaction of payment of all amounts requested by the Contractor on behalf of such entities or persons in any previous Application for Payment; and (iii) all information and materials required to comply with the requirements of the Contract Documents or reasonably requested by the Owner or the Architect.

§ 9.3.2 Unless otherwise provided in the Contract Documents, payments shall be made on account of materials and equipment delivered and suitably stored at the site for subsequent incorporation in the Work. If approved in advance by the Owner, payment may similarly be made for materials and equipment suitably stored off the site at a location agreed upon in writing. Payment for materials and equipment stored on or off the site shall be conditioned upon

compliance by the Contractor with procedures satisfactory to the Owner to establish the Owner's title to such materials and equipment or otherwise protect the Owner's interest, and shall include the costs of applicable insurance, storage, and transportation to the site, for such materials and equipment stored off the site.

§ 9.3.3 The Contractor warrants that title to all Work covered by an Application for Payment will pass to the Owner no later than the time of payment. The Contractor further warrants that upon submittal of an Application for Payment all Work for which Certificates for Payment have been previously issued and payments received from the Owner shall be free and clear of liens, claims, security interests, or encumbrances, in favor of the Contractor, Subcontractors, suppliers, or other persons or entities that provided labor, materials, and equipment relating to the Work.

§ 9.4 Certificates for Payment

§ 9.4.1 The Architect will, within seven days after receipt of the Contractor's Application for Payment, either (1) issue to the Owner a Certificate for Payment in the full amount of the Application for Payment, with a copy to the Contractor; or (2) issue to the Owner a Certificate for Payment for such amount as the Architect determines is properly due, and notify the Contractor and Owner of the Architect's reasons for withholding certification in part as provided in Section 9.5.1; or (3) withhold certification of the entire Application for Payment, and notify the Contractor and Owner of the Architect's reason for withholding certification in whole as provided in Section 9.5.1.

§ 9.4.2 The issuance of a Certificate for Payment will constitute a representation by the Architect solely to the Owner, based on the Architect's evaluation of the Work as provided in the Contract Documents and/or the data in the Application for Payment, that, to the best of the Architect's knowledge, information, and belief, the Work has progressed to the point indicated, the quality of the Work is in accordance with the Contract Documents, and that the Contractor is entitled to payment in the amount certified. The foregoing representations are subject to an evaluation of the Work for conformance with the Contract Documents upon Substantial Completion, to results of subsequent tests and inspections, to correction of minor deviations from the Contract Documents prior to completion, and to specific qualifications expressed by the Architect. However, the issuance of a Certificate for Payment will not be a representation that the Architect has (1) made exhaustive or continuous on-site inspections to check the quality or quantity of the Work; (2) reviewed construction means, methods, techniques, sequences, or procedures; or (3) made examination to ascertain how or for what purpose the Contractor has used money previously paid on account of the Contract Sum. Notwithstanding anything herein to the contrary, issuance of a Certificate for Payment by the Architect is a recommendation only; payment to the Contractor of amounts certified in a Certificate for Payment is subject to the Owner's approval.

§ 9.5 Decisions to Withhold Certification

§ 9.5.1 The Architect may withhold a Certificate for Payment in whole or in part, to the extent reasonably necessary to protect the Owner, if in the Architect's opinion the representations to the Owner required by Section 9.4.2 cannot be made. If the Architect is unable to certify payment in the amount of the Application, the Architect will notify the Contractor and Owner as provided in Section 9.4.1. If the Contractor and Architect cannot agree on a revised amount, the Architect will promptly issue a Certificate for Payment for the amount for which the Architect is able to make such representations to the Owner. The Architect may also withhold a Certificate for Payment or, because of subsequently discovered evidence, may nullify the whole or a part of a Certificate for Payment previously issued, to such extent as may be necessary in the Architect's opinion to protect the Owner from loss for which the Contractor is responsible, including loss resulting from acts and omissions described in Section 3.3.2, because of

- .1 defective Work not remedied;
- .2 third party claims filed or reasonable evidence indicating probable filing of such claims, unless security acceptable to the Owner is provided by the Contractor;
- .3 failure of the Contractor to make payments properly to Subcontractors or suppliers for labor, materials or equipment;
- .4 reasonable evidence that the Work cannot be completed for the unpaid balance of the Contract Sum;
- .5 damage to the Owner or a Separate Contractor;
- .6 reasonable evidence that the Work will not be completed within the Contract Time, and that the unpaid balance would not be adequate to cover actual or liquidated damages for the anticipated delay;
- .7 repeated failure to carry out the Work in accordance with the Contract Documents; or
- .8 failure to comply with or adhere to the requirements of the Contract Documents.

§ 9.5.2 When either party disputes the Architect's decision regarding a Certificate for Payment under Section 9.5.1, in whole or in part, that party may submit a Claim in accordance with Article 15. The Owner shall not be deemed to be in default by reason of withholding payment while any of the above grounds remain uncured, nor shall any interest accrue or be payable with respect to any payments so withheld.

§ 9.5.3 When the reasons for withholding certification are removed, certification will be made for amounts previously withheld.

§ 9.5.4 If the Architect withholds certification for payment under Section 9.5.1.3, the Owner may, at its sole option, issue joint checks to the Contractor and to any Subcontractor or supplier to whom the Contractor failed to make payment for Work properly performed or material or equipment suitably delivered. If the Owner makes payments by joint check, the Owner shall notify the Architect and the Contractor shall reflect such payment on its next Application for Payment.

§ 9.6 Progress Payments

§ 9.6.1 After the Architect has issued a Certificate for Payment, the Owner shall make payment in the manner and within the time provided in the Contract Documents, and shall so notify the Architect.

§ 9.6.2 The Contractor shall pay each Subcontractor, no later than five (5) days after receipt of payment from the Owner, the amount to which the Subcontractor is entitled, reflecting percentages actually retained from payments to the Contractor on account of the Subcontractor's portion of the Work. The Contractor shall, by appropriate agreement with each Subcontractor, require each Subcontractor to make payments to Sub-subcontractors in a similar manner. Notwithstanding anything in this Subparagraph 9.6.2 to the contrary, the Owner may elect, in the Owner's reasonable discretion, to make any payment requested by the Contractor on behalf of a Subcontractor or material supplier of any tier jointly payable to the Contractor and such Subcontractor or material supplier, or directly payable to such Subcontractor or material supplier. The Contractor and such Subcontractor or material supplier shall be responsible for the allocation and disbursement of funds included as part of any such joint payment. In no event shall any joint payment be construed to create any (i) contract between the Owner and a subcontractor or material supplier of any tier, (ii) obligations from the Owner to such subcontractor or material supplier, or (iii) rights in such subcontractor or material supplier against the Owner. All such payments by the Owner shall be a pro tanto discharge of sums due the Contractor.

§ 9.6.3 The Architect will, on request, furnish to a Subcontractor, if practicable, information regarding percentages of completion or amounts applied for by the Contractor and action taken thereon by the Architect and Owner on account of portions of the Work done by such Subcontractor.

§ 9.6.4 The Owner has the right to request written evidence from the Contractor that the Contractor has properly paid Subcontractors and suppliers amounts paid by the Owner to the Contractor for subcontracted Work. The Owner may contact Subcontractors and suppliers to ascertain whether they have been properly paid. Neither the Owner nor Architect shall have an obligation to pay, or to see to the payment of money to, a Subcontractor or supplier, except as may otherwise be required by law.

§ 9.6.5 The Contractor's payments to suppliers shall be treated in a manner similar to that provided in Sections 9.6.2, 9.6.3 and 9.6.4.

§ 9.6.6 A Certificate for Payment, a progress payment, or partial or entire use or occupancy of the Project by the Owner shall not constitute acceptance of Work not in accordance with the Contract Documents.

§ 9.6.7 Unless the Contractor provides the Owner with a payment bond in the full penal sum of the Contract Sum, payments received by the Contractor for Work properly performed by Subcontractors or provided by suppliers shall be held by the Contractor for those Subcontractors or suppliers who performed Work or furnished materials, or both, under contract with the Contractor for which payment was made by the Owner. Nothing contained herein shall require money to be placed in a separate account and not commingled with money of the Contractor, create any fiduciary liability or tort liability on the part of the Contractor for breach of trust, or entitle any person or entity to an award of punitive damages against the Contractor for breach of the requirements of this provision.

§ 9.6.8 Provided the Owner has fulfilled its payment obligations under the Contract Documents, the Contractor shall defend and indemnify the Owner from all loss, liability, damage or expense, including reasonable attorney's fees and litigation expenses, arising out of any lien claim or other claim for payment by any Subcontractor or supplier of any tier. Upon receipt of notice of a lien claim or other claim for payment, the Owner shall notify the Contractor. If approved by the applicable court, when required, the Contractor may substitute a surety bond for the property against which the lien or other claim for payment has been asserted.

§ 9.7 Failure of Payment

If the Architect does not issue a Certificate for Payment or provide the Contractor with a written explanation for the reason for withholding such Certificate for Payment, through no fault of the Contractor, within seven days after receipt of the properly submitted Application for Payment, or if the Owner does not pay the Contractor or provide the Contractor with a written explanation of the reason for withholding payment within seven days after the date established in the Contract Documents, the amount certified by the Architect or if the Owner does not so pay an amount awarded by binding dispute resolution, then the Contractor may, upon seven additional days' notice to the Owner and Architect, stop the Work until payment of the amount owing or an explanation of the reason for withholding such payments has been received. The Contract Time shall be extended appropriately and the Contract Sum shall be increased by the amount of the Contractor's reasonable costs of shutdown, delay and start-up, plus interest as provided for in the Contract Documents.

§ 9.8 Substantial Completion

§ 9.8.1 Substantial Completion is the stage in the progress of the Work when the Work or designated portion thereof is sufficiently complete in accordance with the Contract Documents so that the Owner can occupy or utilize the Work for its intended use. As a condition precedent to Substantial Completion, the Contractor shall assemble and deliver to the Owner (1) all maintenance and operating manuals; (2) marked sets of field record drawings and specifications reflecting as-built conditions; (3) drawings reflecting the location of any concealed utilities, mechanical or electrical systems and components; (4) any special guaranties or warranties required by the Contract Documents; (5) all guaranties and warranties from Subcontractors, vendors, suppliers or manufacturers; (6) a list of the names, addresses and telephone numbers of all subcontractors and any other persons providing guaranties or warranties; (7) a permanent Certificate of Occupancy; (8) Operating permits for any mechanical equipment; and (9) any other permits, approvals, licenses, and other documents from any governmental authority having jurisdiction thereof necessary for the beneficial use and occupancy of the Project.

§ 9.8.2 When the Contractor considers that the Work, or a portion thereof which the Owner agrees to accept separately, is substantially complete, the Contractor shall notify the Architect and the Owner in writing and shall prepare and submit to the Architect (1) a comprehensive list of items to be completed or corrected prior to final payment and (2) all Certificates of Occupancy and applicable permits required by the Contract Documents, endorsed by the Contractor and in a form reasonably acceptable to the Architect and Owner. Promptly after receiving such notice, the Architect will conduct a preliminary review to determine whether or not the Documents are generally complete and correct. If the Architect finds on the basis of this review that the Contractor's notice and supporting documents are not generally complete or correct, the Architect will return them to the Contractor for revision and resubmittal, describing in general the additions or corrections required. If the Architect finds on one preliminary review of the Contractor's resubmittal that the resubmitted notice and supporting documents are still not generally complete and correct, the Contractor shall again correct and resubmit them, and shall, in addition, reimburse the Owner for the cost of any change in the Architect's services resulting from such a second and any subsequent preliminary reviews. When the Architect finds on the basis of a preliminary review that the Contractor's notice and supporting documents are substantially complete, the Architect will proceed as stated in Section 9.8.3 below. Failure to include an item on such list does not alter the responsibility of the Contractor to complete all Work in accordance with the Contract Documents.

§ 9.8.3 Upon receipt of the Contractor's list, the Architect will make an inspection to determine whether the Work or designated portion thereof is substantially complete. If the Architect's inspection discloses any item, whether or not included on the Contractor's list, which is not sufficiently complete in accordance with the Contract Documents so that the Owner can occupy or utilize the Work or designated portion thereof for its intended use, the Contractor shall, before issuance of the Certificate of Substantial Completion, complete or correct such item upon notification by the Architect. In such case, the Contractor shall then submit a request for another inspection by the Architect to determine Substantial Completion.

§ 9.8.4 When the Work or designated portion thereof is substantially complete, the Architect will prepare a Certificate of Substantial Completion that shall establish the date of Substantial Completion; establish responsibilities of the Owner and Contractor for security, maintenance, heat, utilities, damage to the Work and insurance; and fix the time within which the Contractor shall finish all items on the list accompanying the Certificate. Warranties required by the Contract Documents shall commence on the date of Substantial Completion of the Work or designated portion thereof unless otherwise provided in the Certificate of Substantial Completion.

§ 9.8.5 The Certificate of Substantial Completion shall be submitted to the Owner and Contractor for their written acceptance of responsibilities assigned to them in the Certificate. Upon such acceptance, and consent of surety if any, the Owner shall make payment of retainage applying to the Work or designated portion thereof. Such payment shall be adjusted for Work that is incomplete or not in accordance with the requirements of the Contract Documents. Owner shall be entitled to retain two hundred percent (200%) of the estimated cost of incomplete or unsatisfactory Work to reach Final Completion.

§ 9.9 Partial Occupancy or Use

§ 9.9.1 The Owner may occupy or use any completed or partially completed portion of the Work at any stage when such portion is designated by separate agreement with the Contractor, provided such occupancy or use is consented to by the insurer and authorized by public authorities having jurisdiction over the Project. Such partial occupancy or use may commence whether or not the portion is substantially complete, provided the Owner and Contractor have accepted in writing the responsibilities assigned to each of them for payments, retainage, if any, security, maintenance, heat, utilities, damage to the Work and insurance, and have agreed in writing concerning the period for correction of the Work and commencement of warranties required by the Contract Documents. When the Contractor considers a portion substantially complete, the Contractor shall prepare and submit a list to the Architect as provided under Section 9.8.2. Consent of the Contractor to partial occupancy or use shall not be unreasonably withheld. The stage of the progress of the Work shall be determined by written agreement between the Owner and Contractor or, if no agreement is reached, by decision of the Architect.

§ 9.9.2 Immediately prior to such partial occupancy or use, the Owner, Contractor, and Architect shall jointly inspect the area to be occupied or portion of the Work to be used in order to determine and record the condition of the Work.

§ 9.9.3 Unless otherwise agreed upon, partial occupancy or use of a portion or portions of the Work shall not constitute acceptance of Work not complying with the requirements of the Contract Documents.

§ 9.10 Final Completion and Final Payment

§ 9.10.1 Upon receipt of the Contractor's notice that the Work is ready for final inspection and acceptance and upon receipt of a final Application for Payment, the Architect will promptly make such inspection. When the Architect finds the Work acceptable under the Contract Documents and the Contract fully performed, the Architect will promptly issue a final Certificate for Payment stating that to the best of the Architect's knowledge, information and belief, and on the basis of the Architect's on-site visits and inspections, the Work has been completed in accordance with the Contract Documents and that the entire balance found to be due the Contractor and noted in the final Certificate is due and payable. The Architect's final Certificate for Payment will constitute a further representation that conditions listed in Section 9.10.2 as precedent to the Contractor's being entitled to final payment have been fulfilled.

§ 9.10.2 Neither final payment nor any remaining retained percentage shall become due until the Contractor submits to the Architect (1) an affidavit that payrolls, bills for materials and equipment, and other indebtedness connected with the Work for which the Owner or the Owner's property might be responsible or encumbered (less amounts withheld by Owner) have been paid or otherwise satisfied, (2) a certificate evidencing that insurance required by the Contract Documents to remain in force after final payment is currently in effect and will not be canceled or allowed to expire until at least 30 days' prior written notice has been given to the Owner, (3) a written statement that the Contractor knows of no substantial reason that the insurance will not be renewable to cover the period required by the Contract Documents, (4) consent of surety, if any, to final payment and (5), statements in a form satisfactory to the Owner that in consideration of all prior payments and of final payment, the Contractor and its Subcontractors release and forever discharge the Owner from all mechanic's liens, claims, demands, obligations and liabilities of every kind arising out of or relating to the Contract or the Project other than those Claims specifically enumerated in the statement. If a Subcontractor refuses to furnish a release or waiver required by the Owner, the Contractor may

furnish a bond satisfactory to the Owner to indemnify the Owner against such lien. If such lien remains unsatisfied after payments are made, the Contractor shall refund to the Owner all money that the Owner may be compelled to pay in discharging such lien, including all costs and attorneys' fees.

§ 9.10.3 If, after Substantial Completion of the Work, final completion thereof is materially delayed through no fault of the Contractor or by issuance of Change Orders affecting final completion, and the Architect so confirms, the Owner shall, upon application by the Contractor and certification by the Architect, and without terminating the Contract, make payment of the balance due for that portion of the Work fully completed, corrected, and accepted. If the remaining balance for Work not fully completed or corrected is less than retainage stipulated in the Contract Documents, and if bonds have been furnished, the written consent of the surety to payment of the balance due for that portion of the Work fully completed and accepted shall be submitted by the Contractor to the Architect prior to certification of such payment. Such payment shall be made under terms and conditions governing final payment, except that it shall not constitute a waiver of Claims.

§ 9.10.4 INTENTIONALLY OMITTED

§ 9.10.5 Acceptance of final payment by the Contractor, a Subcontractor, or a supplier, shall constitute a waiver of claims by that payee except those previously made in writing and identified by that payee as unsettled at the time of final Application for Payment.

ARTICLE 10 PROTECTION OF PERSONS AND PROPERTY

§ 10.1 Safety Precautions and Programs

The Contractor shall be responsible for initiating, maintaining, and supervising all safety precautions and programs in connection with the performance of the Contract.

§ 10.2 Safety of Persons and Property

§ 10.2.1 The Contractor shall take reasonable precautions for safety of, and shall provide reasonable protection to prevent damage, injury, or loss to

- .1 employees on the Work and other persons who may be affected thereby;
- .2 the Work and materials and equipment to be incorporated therein, whether in storage on or off the site, under care, custody, or control of the Contractor, a Subcontractor, or a Sub-subcontractor; and
- .3 other property at the site or adjacent thereto, such as trees, shrubs, lawns, walks, pavements, roadways, structures, and utilities not designated for removal, relocation, or replacement in the course of construction.

§ 10.2.2 The Contractor shall comply with, and give notices required by the Conditions and applicable laws, statutes, ordinances, codes, rules and regulations, and lawful orders of public authorities, bearing on safety of persons or property or their protection from damage, injury, or loss. Contractor acknowledges that public health, safety, and security are of the utmost importance in connection with its performance of the Work. Contractor shall, at all times, implement and maintain commercially reasonable safety, health, and security protocol with respect to its personnel on site, including implementing best practices as defined by the United States Centers for Disease Control and state and local public health agencies to avoid exposure to and protection against severe acute respiratory syndrome coronavirus 2 (SARS-CoV-2) aka COVID-19. Contractor shall also take such actions as are necessary to protect the health, safety and security of the occupants and users of the subject property in connection with the Work and the Project, including adherence to guidelines promulgated by the State of Connecticut. »

§ 10.2.3 The Contractor shall implement, erect, and maintain, as required by existing conditions and performance of the Contract, reasonable safeguards for safety and protection, including posting danger signs and other warnings against hazards; promulgating safety regulations; and notifying the owners and users of adjacent sites and utilities of the safeguards. The Contractor shall also be responsible, at the Contractor's sole cost and expense, for all measures necessary to protect any property adjacent to the Project and improvements thereon. Any damage to such property or improvements shall be promptly repaired by the Contractor at its sole cost and expense.

§ 10.2.4.1 When there are indications that the use of explosives or other hazardous material, equipment or unusual methods is necessary for execution of the Work, the Contractor shall give the Owner and Architect reasonable advance notice of the conditions.

§ 10.2.4.2 The Contractor shall be solely responsible for the handling, storage and use of explosive or other hazardous

materials when their use is permitted.

§ 10.2.4.3 The Contractor shall not bring explosives onto the site or use such in the Work without the prior written permission of the Architect and the Owner. For such use, the Contractor shall obtain necessary permits with copies to the Architect and the Owner. The Contractor shall furnish the Owner and Architect with certificates indicating proper and adequate insurance.

§ 10.2.4 When use or storage of explosives or other hazardous materials or equipment, or unusual methods are necessary for execution of the Work, the Contractor shall exercise utmost care and carry on such activities under supervision of properly qualified personnel.

§ 10.2.5 The Contractor shall promptly remedy damage and loss to property referred to in subparagraphs 10.2.1.2, 10.2.1.3 and 10.2.1.4. If the damage or loss is due in whole or in part to the Contractor's failure to take the precautions required by this paragraph 10.2, the Contractor shall bear the cost. The foregoing obligations of the Contractor are in addition to the Contractor's obligations under Section 3.18.

§ 10.2.6 The Contractor shall designate a responsible member of the Contractor's organization at the site whose duty shall be the prevention of accidents. This person shall be the Contractor's superintendent unless otherwise designated by the Contractor in writing to the Owner and Architect.

§ 10.2.7 The Contractor shall not permit any part of the construction or site to be loaded so as to cause damage or create an unsafe condition.

§ 10.2.8 The Contractor shall at all times provide protection against weather (snow, rain, wind, storms or heat) so as to maintain all Work, materials, apparatus and fixtures free from damage. At the end of the day's work, all new Work likely to be damaged shall be reasonably protected against such weather.

§ 10.2.9 The Contractor shall provide adequate fire protection for all operations associated with the Work, and such protection must meet all applicable federal (including OSHA), State and municipal regulations.

§ 10.2.10 The Contractor shall remove and replace with new work at the Contractor's own expense, any Work damaged by failure to provide protection.

§ 10.2.11 The Contractor shall be responsible, to the extent not covered by insurance, for damage, loss, or liability due to theft or vandalism to the Work and stored materials when work is not in progress at night, on weekends or holidays.

§ 10.2.12 No visitors shall be allowed on the work site without prior written permission from the Owner.

§ 10.2.13 Cutting and welding to be performed in or immediately adjacent to existing spaces shall not be performed without written approval of the Owner for each instance.

§ 10.2.14 All employees at the worksite shall have successfully completed a course in construction safety and health approved by the United States Occupational Safety and Health Administration that is at least 10 hours in duration at the time the employee begins work. The Contractor and all Subcontractors shall furnish documentation of successful completion of said course with the first certified payroll report for each employee. The Contractor shall indemnify and hold harmless the Owner from any and all fines, costs and expenses, including but not limited to reasonable attorney's fees, incurred by Owner due to the Contractor's violation of such Acts, standards and/or regulations. Such indemnity shall not be construed to limit the indemnity required under Subparagraph 3.18.1.

§ 10.2.15 The Contractor shall comply with the requirements of the Occupational Safety and Health Act and the Construction Safety Act of 1969, including all standards and regulations which have been promulgated by the governmental authorities which administer such Acts and said requirements, standards and regulations are incorporated herein by reference. The Contractor shall be directly responsible for compliance therewith on the part of its agents, employees, subcontractors, and material suppliers and shall directly receive and be responsible for all citations, assessments, fines, or penalties which may be incurred by reason of its agents, employees, material suppliers or subcontractors, to so comply.

§ 10.2.16 The Contractor shall at all times protect excavations, trenches, buildings, and materials from rainwater, ground water, ice, snow, back-up or leakage of sewers, drains, or other piping, and from water of any other origin and shall remove promptly any accumulation of water. The Contractor shall provide and operate all pumps, piping, and other equipment necessary to this end.

§ 10.2.17 MOLD GROWTH. The Contractor shall establish and maintain a program and safeguards to prevent growth of mold.

§10.2.18 Contractor and its Subcontractors shall not make news releases or publicize or issue advertising pertaining to the Work of this Agreement without first obtaining the written approval of the Owner.

§ 10.2.19 If either party suffers injury or damage to person or property because of an act or omission of the other party, or of others for whose acts such party is legally responsible, notice of the injury or damage, whether or not insured, shall be given to the other party within a reasonable time not exceeding 21 days after discovery. The notice shall provide sufficient detail to enable the other party to investigate the matter.

§ 10.2.20 The Contractor shall promptly report in writing to the Owner and Architect all accidents arising out of or in connection with the Work that cause death, personal injury, or property damage, giving full details and statements of any witnesses. In addition, if death, serious personal injuries, or serious damages are caused, the accident shall be reported immediately by telephone or messenger to the Owner and the Architect.

§ 10.2.21 The Contractor shall provide and maintain in good operating condition suitable and adequate fire protection equipment and services and shall comply with all reasonable recommendations regarding fire protection made by the representatives of the fire insurance company carrying insurance on the Work or by the local fire chief or fire marshal. The area within the site limits shall be kept orderly and clean, and all combustible rubbish shall be promptly removed from the site.

§ 10.2.22 When all or a portion of the Work is suspended for any reason, the Contractor shall securely fasten down all coverings and protect the Work, as necessary, from injury by any cause.

§ 10.2.23 The Contractor shall at all times protect excavations, trenches, buildings and materials, from rainwater, ground water, backup or leakage of sewers, drains and other piping, and shall remove promptly any accumulation of water. The Contractor shall provide and operate all pumps, piping and other equipment necessary to this end.

§ 10.2.24 The Contractor shall remove snow and ice which might result in damage or delay to the Work.

§ 10.2.25 During the progress of the Work and at all times prior to the date of Substantial Completion or occupancy of the Work by the Owner, whichever is earlier, the Contractor shall provide temporary heat, ventilation, and enclosure, adequate to permit the Work to proceed in a timely fashion, and to prevent damage to completed Work or Work in progress, or to materials stored on the premises. The permanent heating and ventilation systems may be used for these purposes when available and appropriate, but the fuel cost shall be paid by the Owner.

§ 10.3 Hazardous Materials and Substances

§ 10.3.1 The Contractor is responsible for compliance with any requirements included in the Contract Documents regarding hazardous materials or substances. If the Contractor encounters a hazardous material or substance not addressed in the Contract Documents the Contractor shall immediately report the condition to the Owner and the Architect in writing and take reasonable precautions to prevent foreseeable bodily injury or death to persons resulting from a material or substance, including but not limited to asbestos or polychlorinated biphenyl (PCB). If such reasonable precautions will be inadequate to prevent foreseeable bodily injury and death, the Contractor shall immediately stop Work in the affected area and notify the Owner and Architect of the condition.

§ 10.3.2 Upon receipt of the Contractor's notice, the Owner shall obtain the services of a licensed laboratory to verify the presence or absence of the material or substance reported by the Contractor and, in the event such material or substance is found to be present, to cause it to be rendered harmless. When the material or substance has been rendered harmless, any Work that has been stopped in the affected area shall resume. By Change Order, the Contract

Time shall be extended appropriately. appropriately. Termination of the Contract by the Owner due to the discovery of Hazardous Materials on the Project site shall be Termination for Cause. The term "rendered harmless" shall be interpreted to mean that levels of hazardous materials including, but not limited to asbestos and polychlorinated biphenyl, are less than any applicable exposure standards set forth in OSHA regulations. In no event, however, shall the Owner have any responsibility for any substance or material that is brought to the Project site by the Contractor, any Subcontractor or any materialman or supplier or any entity for whom any of them is responsible. The Contractor agrees not to use any fill or other materials to be incorporated into the Work which are hazardous, toxic or comprised of any items that are hazardous or toxic except to the extent provided in Section 10.3.7.

§ 10.3.3 The Contractor shall not be liable for pre-existing, environmental matters on, under or about the premises which constitute the Project, including without limitation, those relating to fines, orders, injunctions, penalties, damages, contribution, cost recovery compensation, losses or injuries resulting from the release or threatened release of hazardous materials, special wastes or other contaminants into the environment, the development or growth of mold within or on any structures, air quality levels, and to the generation, use, storage, transportation or illegal disposal of solid wastes, hazardous materials, special wastes or other contaminants. This disclaimer of liability shall apply to all such claims against the Contractor, whether direct or indirect, including without limitation, third party claims for which the Owner is seeking indemnification from the Contractor, excluding, however, any such claims that are caused by the negligence of the Contractor or subcontractor for which the Contractor is responsible.

§ 10.3.4 The Owner shall not be responsible under this Section 10.3 for hazardous materials or substances the Contractor brings to the site unless such materials or substances are required by the Contract Documents. The Owner shall be responsible for hazardous materials or substances required by the Contract Documents, except to the extent of the Contractor's fault or negligence in the use and handling of such materials or substances.

§ 10.3.5 The Contractor shall reimburse the Owner for the cost and expense the Owner incurs (1) for remediation of hazardous materials or substances the Contractor brings to the site and negligently handles, or (2) where the Contractor fails to perform its obligations under Section 10.3.1, except to the extent that the cost and expense are due to the Owner's fault or negligence.

§ 10.3.6 If, without negligence or intentional acts on the part of the Contractor, the Contractor is held liable by a government agency for the cost of remediation of a hazardous material or substance solely by reason of properly performing Work as required by the Contract Documents, the Owner shall reimburse the Contractor for all cost and expense thereby incurred.

§ 10.3.7 The Contractor will be solely responsible for compliance with laws and regulations governing the handling, storage, use or disposal of hazardous materials or wastes used, stored, generated, or disposed of in connection with construction of the Work, and shall obtain all permits and approvals, give all required notices, and observe all applicable procedures prescribed by the U.S. Environmental Protection Agency, the State of Connecticut and other governmental authorities having jurisdiction with respect to such activities. At Owner's request, Contractor shall furnish the Owner promptly with evidence satisfactory to Owner demonstrating the Contractor's compliance with such procedures, the giving of such notices, and the issuance of such permits and approvals, and shall indemnify Owner and hold Owner harmless with respect to any loss, damage or liability resulting from Contractor's failure to observe such procedures, give such notices, or obtain such permits and approvals. Contractor will be responsible for removal and disposal only of such "hazardous material" as is required to be removed by the Contract Documents or any such materials placed on the site by the Contractor or any party for which the Contractor is responsible.

§ 10.3.8 All material and equipment furnished under the Contract shall be free of asbestos and polychlorinated biphenyl (PCB). Any material or equipment containing these hazardous materials shall be considered defective and shall be removed by the Contractor at the Contractor's sole expense.

§ 10.4 Emergencies

In an emergency affecting safety of persons or property, the Contractor shall act, at the Contractor's discretion, to prevent threatened damage, injury, or loss. Additional compensation or extension of time claimed by the Contractor on account of an emergency shall be determined as provided in Article 15 and Article 7. The Contractor shall promptly notify insurers as applicable, the Architect and the Owner of the nature of the emergency. Immediately thereafter, the Contractor shall submit to the Architect and the Owner a written report including a description of circumstances of the emergency and details of action taken.

ARTICLE 11 INSURANCE AND BONDS

§ 11.1 Contractor's Insurance and Bonds

§ 11.1.1 The Contractor shall purchase and maintain insurance of the types and limits of liability, containing the endorsements, and subject to the terms and conditions, as described in the Agreement or elsewhere in the Contract Documents. The Contractor shall purchase and maintain the required insurance from an insurance company or insurance companies that are acceptable to the Owner and that are lawfully authorized to issue insurance in Connecticut. The Owner, Architect, and Architect's consultants shall be named as additional insureds under the Contractor's commercial general liability policy or as otherwise described in the Contract Documents.

The insurance required shall be maintained without interruption from the date of commencement of the Work until the date of final payment and termination of any coverage required to be maintained after final payment, and with respect to Contractor's completed operations coverages, as specified in the Contract Documents.

§ 11.1.2 The Contractor shall provide surety bonds of the types, for such penal sums, and subject to such terms and conditions as required by the Contract Documents. The Contractor shall purchase and maintain the required bonds from a company or companies that are acceptable to the Owner and that are lawfully authorized to issue surety bonds in Connecticut.

§ 11.1.3 Upon the request of any person or entity appearing to be a potential beneficiary of bonds covering payment of obligations arising under the Contract, the Contractor shall promptly furnish a copy of the bonds or shall authorize a copy to be furnished.

§ 11.1.4 Notice of Cancellation or Expiration of Contractor's Required Insurance. Within three (3) business days of the date the Contractor becomes aware of an impending or actual cancellation or expiration of any insurance required by the Contract Documents, the Contractor shall provide notice to the Owner of such impending or actual cancellation or expiration. Upon receipt of notice from the Contractor, the Owner shall, unless the lapse in coverage arises from an act or omission of the Owner, have the right to stop the Work until the lapse in coverage has been cured by the procurement of replacement coverage by the Contractor. The furnishing of notice by the Contractor shall not relieve the Contractor of any contractual obligation to provide any required coverage.

§ 11.1.5 The limits specified in the Contract Documents are minimum requirements and shall not be construed in any way as limits of liability or as constituting acceptance by the Owner of responsibility for losses in excess of such limits. The Contractor shall be responsible for all deductibles applicable to any insurance. No acceptance and/or approval of any insurance by Owner shall be construed as relieving or excusing Contractor from any liability or obligation imposed by the provisions of the Contract Documents.

§ 11.1.6 The Contractor shall not commence the Work under the Contract nor permit any Subcontractor to commence work on a subcontract until all the insurance required is obtained. The Contractor may carry, at its own expense, such additional coverage as it may deem necessary. The Contractor shall not be deemed to be relieved of any responsibility by the fact it carries insurance. Should the Contractor at any time neglect or refuse to provide the insurance required herein or should such insurance be cancelled or should the full annual aggregate or any policy not be available to satisfy the requirements of the Contract, the Owner shall have the right to procure such insurance and the cost thereof shall be deducted from monies then due or thereafter to become due the Contractor.

§ 11.2 Owner's Insurance

§ 11.2.1 The Owner shall purchase and maintain insurance of the types and limits of liability, containing the endorsements, and subject to the terms and conditions, as described in the Agreement or elsewhere in the Contract Documents. The Owner shall purchase and maintain the required insurance from an insurance company or insurance companies lawfully authorized to issue insurance in Connecticut.

§ 11.2.2 Failure to Purchase Required Property Insurance. If the Owner does not intend to purchase and maintain the required property insurance, with all of the coverages and in the amounts described in the Agreement or elsewhere in the Contract Documents, the Owner shall inform the Contractor in writing prior to commencement of the Work. Upon receipt of notice from the Owner, the Contractor may delay commencement of the Work and may obtain insurance that will protect the interests of the Contractor, Subcontractors, and Sub-Subcontractors in the Work. When the failure to provide coverage has been cured or resolved, the Contract Sum and Contract Time shall be equitably adjusted. In the event the Owner fails to procure coverage, the Owner waives all rights against the Contractor, Subcontractors, and Sub-subcontractors to the extent the loss to the Owner would have been covered by the insurance to have been procured by the Owner. The cost of the insurance shall be charged to the Owner by a Change Order. If the Owner does not provide written notice, and the Contractor is damaged by the failure or neglect of the Owner to purchase or maintain the required insurance, the Owner shall reimburse the Contractor for all reasonable costs and damages attributable thereto.

§ 11.2.3 Notice of Cancellation or Expiration of Owner's Required Property Insurance. Within three (3) business days of the date the Owner becomes aware of an impending or actual cancellation or expiration of any property insurance required by the Contract Documents, the Owner shall provide notice to the Contractor of such impending or actual cancellation or expiration. Unless the lapse in coverage arises from an act or omission of the Contractor: (1) the Contractor, upon receipt of notice from the Owner, shall have the right to stop the Work until the lapse in coverage has been cured by the procurement of replacement coverage by either the Owner or the Contractor; (2) the Contract Time and Contract Sum shall be equitably adjusted; and (3) the Owner waives all rights against the Contractor, Subcontractors, and Sub-subcontractors to the extent any loss to the Owner would have been covered by the insurance had it not expired or been cancelled. If the Contractor purchases replacement coverage, the cost of the insurance shall be charged to the Owner by an appropriate Change Order. The furnishing of notice by the Owner shall not relieve the Owner of any contractual obligation to provide required insurance.

§ 11.3 Waivers of Subrogation

§ 11.3.1 The Owner and Contractor waive all rights against (1) each other and any of their subcontractors, sub-subcontractors, agents, and employees, each of the other; (2) the Architect and Architect's consultants; and (3) Separate Contractors, if any, and any of their subcontractors, sub-subcontractors, agents, and employees, for damages caused by fire, or other causes of loss, to the extent those losses are covered by property insurance required by the Agreement or other property insurance applicable to the Project, except such rights as they have to proceeds of such insurance. The Owner or Contractor, as appropriate, shall require similar written waivers in favor of the individuals and entities identified above from the Architect, Architect's consultants, Separate Contractors, subcontractors, and sub-subcontractors. The policies of insurance purchased and maintained by each person or entity agreeing to waive claims pursuant to this section 11.3.1 shall not prohibit this waiver of subrogation. This waiver of subrogation shall be effective as to a person or entity (1) even though that person or entity would otherwise have a duty of indemnification, contractual or otherwise, (2) even though that person or entity did not pay the insurance premium directly or indirectly, or (3) whether or not the person or entity had an insurable interest in the damaged property.

§ 11.3.2 If during the Project construction period the Owner insures properties, real or personal or both, at or adjacent to the site by property insurance under policies separate from those insuring the Project, or if after final payment property insurance is to be provided on the completed Project through a policy or policies other than those insuring the Project during the construction period, to the extent permissible by such policies, the Owner waives all rights in accordance with the terms of Section 11.3.1 for damages caused by fire or other causes of loss covered by this separate property insurance.

§ 11.4 Loss of Use, Business Interruption, and Delay in Completion Insurance

The Owner, at the Owner's option, may purchase and maintain insurance that will protect the Owner against loss of use of the Owner's property, or the inability to conduct normal operations, due to fire or other causes of loss. The Owner waives all rights of action against the Contractor and Architect for loss of use of the Owner's property, due to fire or other hazards however caused.

§11.5 Adjustment and Settlement of Insured Loss

§ 11.5.1 A loss insured under the property insurance required by the Agreement shall be adjusted by the Owner as fiduciary and made payable to the Owner in good faith for the insureds, as their interests may appear, subject to requirements of any applicable mortgagee clause and of Section 11.5.2. The Owner shall pay the Architect and Contractor their just shares of insurance proceeds received by the Owner, and by appropriate agreements the Architect and Contractor shall make payments to their consultants and Subcontractors in similar manner.

§ 11.5.2 Prior to settlement of an insured loss, the Owner shall notify the Contractor of the terms of the proposed settlement as well as the proposed allocation of the insurance proceeds. The Contractor shall have 14 days from receipt of notice to object to the proposed settlement or allocation of the proceeds. If the Contractor does not object, the Owner shall settle the loss and the Contractor shall be bound by the settlement and allocation. Upon receipt, the Owner shall deposit the insurance proceeds in a separate account and make the appropriate distributions. Thereafter, if no other agreement is made or the Owner does not terminate the Contract for convenience, the Owner and Contractor shall execute a Change Order for reconstruction of the damaged or destroyed Work in the amount allocated for that purpose. If the Contractor timely objects to either the terms of the proposed settlement or the allocation of the proceeds, the Owner may proceed to settle the insured loss, and any dispute between the Owner and Contractor arising out of the settlement or allocation of the proceeds shall be resolved pursuant to Article 15. Pending resolution of any dispute, the Owner may issue a Construction Change Directive for the reconstruction of the damaged or destroyed Work.

ARTICLE 12 UNCOVERING AND CORRECTION OF WORK

§ 12.1 Uncovering of Work

§ 12.1.1 If a portion of the Work is covered contrary to the Architect's request or to requirements specifically expressed in the Contract Documents, it must, if requested in writing by the Architect, be uncovered for the Architect's examination and be replaced at the Contractor's expense without change in the Contract Time.

§ 12.1.2 If a portion of the Work has been covered that the Architect has not specifically requested to examine prior to its being covered, the Architect may request to see such Work and it shall be uncovered by the Contractor. If such Work is in accordance with the Contract Documents, the Contractor shall be entitled to an equitable adjustment to the Contract Sum and Contract Time as may be appropriate. If such Work is not in accordance with the Contract Documents, the costs of uncovering the Work, and the cost of correction, shall be at the Contractor's expense.

§ 12.2 Correction of Work

§ 12.2.1 Before Substantial Completion

The Contractor shall promptly and at its own expense correct Work rejected by the Architect or failing to conform to the requirements of the Contract Documents, discovered before Substantial Completion and whether or not fabricated, installed or completed. Costs of correcting such rejected Work, including additional testing and inspections, the cost of uncovering and replacement, and compensation for the Architect's services and expenses made necessary thereby, shall be at the Contractor's expense. This obligation shall survive termination of the Contract under Paragraph 14 of the General Conditions. Nothing in this Section 12.2.1 shall absolve the Architect of its liability for failure to fulfill its obligations under the agreement between the Owner and the Architect.

§ 12.2.2 After Substantial Completion

§ 12.2.2.1 In addition to the Contractor's obligations under Section 3.5, if, within one year after the date of Substantial Completion of the Work or designated portion thereof or after the date for commencement of warranties established under Section 9.9.1, or by terms of any applicable special warranty required by the Contract Documents, any of the Work is found to be not in accordance with the requirements of the Contract Documents, the Contractor shall correct it promptly after receipt of notice from the Owner to do so, unless the Owner has previously given the Contractor a written acceptance of such condition. The Owner shall give such notice promptly after discovery of the condition. During the one-year period for correction of Work, if the Owner fails to notify the Contractor and give the Contractor an opportunity to make the correction, the Owner waives the rights to require correction by the Contractor and to make a claim for breach of warranty. If the Contractor fails to correct nonconforming Work within a reasonable time during that period after receipt of notice from the Owner or Architect, the Owner may correct it in accordance with Section 2.5.

§ 12.2.2.2 The one-year period for correction of Work shall be extended with respect to portions of Work first performed after Substantial Completion by the period of time between Substantial Completion and the actual completion of that portion of the Work.

§ 12.2.2.3 The one-year period for correction of Work shall not be extended by corrective Work performed by the Contractor pursuant to this Section 12.2. Upon completion of any work under or pursuant to this Section 12.2, the one-year correction period in connection with the Work requiring correction shall be renewed and recommence.

§ 12.2.3 The Contractor shall remove from the site portions of the Work that are not in accordance with the requirements of the Contract Documents and are neither corrected by the Contractor nor accepted by the Owner.

§ 12.2.4 The Contractor shall bear the cost of correcting destroyed or damaged construction of the Owner or Separate Contractors, whether completed or partially completed, caused by the Contractor's correction or removal of Work that is not in accordance with the requirements of the Contract Documents.

§ 12.2.5 Nothing contained in this Section 12.2 shall be construed to establish a period of limitation with respect to other obligations the Contractor has under the Contract Documents. Establishment of the one-year period for correction of Work as described in Section 12.2.2 relates only to the specific obligation of the Contractor to correct the Work, and has no relationship to the time within which the obligation to comply with the Contract Documents may be sought to be enforced, nor to the time within which proceedings may be commenced to establish the Contractor's liability with respect to the Contractor's obligations other than specifically to correct the Work.

§ 12.2.6 AUDITS

Upon request of the Owner or the Architect, the Contractor will cooperate, and secure the cooperation of all Subcontractors and Sub-subcontractors and assist the Owner and Architect during any audit of the Project conducted by the Owner at any time after Substantial Completion.

§ 12.3 Acceptance of Nonconforming Work

If the Owner prefers to accept Work that is not in accordance with the requirements of the Contract Documents, the Owner may do so instead of requiring its removal and correction, in which case the Contract Sum will be reduced as appropriate and equitable. Such adjustment shall be effected whether or not final payment has been made.

ARTICLE 13 MISCELLANEOUS PROVISIONS

§ 13.1 Governing Law

The Contract shall be governed by the law of the State of Connecticut.

§ 13.2 Successors and Assigns

§ 13.2.1 The Owner and Contractor respectively bind themselves, their partners, successors, assigns, and legal representatives to covenants, agreements, and obligations contained in the Contract Documents. The Contractor may not assign the Contract without the Owner's prior written consent, which consent the Owner may withhold in its absolute discretion. If the Contractor attempts to make an assignment without such consent, the Contractor shall nevertheless remain legally responsible for all of the Contractor's obligations under the Contract.

§ 13.2.2 Contractor shall execute all consents reasonably required to facilitate an assignment by the Owner.

§ 13.3 Rights and Remedies

§ 13.3.1 Duties and obligations imposed by the Contract Documents and rights and remedies available thereunder shall be in addition to and not a limitation of duties, obligations, rights, and remedies otherwise imposed or available by law or in equity.

§ 13.3.2 No action or failure to act by the Owner, Architect, or Contractor shall constitute a waiver of a right or duty afforded them under the Contract, nor shall such action or failure to act constitute approval of or acquiescence in a breach thereunder, except as may be specifically agreed upon in writing.

§ 13.3.3 No provision contained in the Contract Documents shall create or give to third parties any claim or right of action against the Owner or the Contractor except as specifically provided herein.

§ 13.4 Tests and Inspections

§ 13.4.1 Tests, inspections, certifications and approvals of portions of the Work shall be made as required by the Contract Documents and by the Conditions, applicable laws, statutes, ordinances, codes, rules, and regulations or lawful orders of public authorities. Unless otherwise provided, the Contractor shall make arrangements for such tests, inspections, and approvals with an independent testing laboratory or entity acceptable to the Owner, or with the appropriate public authority, and shall bear all related costs of tests, inspections, and approvals. The Contractor shall give the Architect timely notice of when and where tests and inspections are to be made so that the Architect may be present for such procedures. The Owner shall bear costs of tests, inspections, or approvals that do not become requirements until after bids are received or negotiations concluded. The Owner shall directly arrange and pay for tests, inspections, or approvals where building codes or applicable laws or regulations so require.

§ 13.4.2 If the Architect, Owner, or public authorities having jurisdiction determine that portions of the Work require additional testing, inspection, or approval not included under Section 13.4.1, the Architect will, upon written authorization from the Owner, instruct the Contractor to make arrangements for such additional testing, inspection, or approval, by an entity acceptable to the Owner, and the Contractor shall give timely notice to the Architect of when and where tests and inspections are to be made so that the Architect may be present for such procedures. Such costs, except as provided in Section 13.4.3 and 13.4.4, shall be at the Owner's expense.

§ 13.4.3 If inspections and tests conducted under this Section 13.4 reveal failure in a portion of the Work, the Owner may order the inspection and testing, at the Contractor's expense, of any and all portions of the Work that are identical or similar to the failing portion.

§ 13.4.4 Required certificates of testing, certification, inspection or approval shall, unless otherwise required by the Contract Documents, be secured by the Contractor and promptly delivered to the Architect.

§ 13.4.5 If the Architect is to observe tests, inspections, or approvals required by the Contract Documents, the Architect will do so promptly and, where practicable, at the normal place of testing.

§ 13.4.6 Tests or inspections conducted pursuant to the Contract Documents shall be made promptly to avoid unreasonable delay in the Work.

§ 13.4.7 If any of the Work is required to be inspected or approved by any public authority, the Contractor shall cause such inspection or approval to be performed. No inspection performed or failed to be performed by the Owner hereunder shall be a waiver of any of the Contractor's obligations hereunder or be construed as an approval or acceptance of the work or any parts thereof.

§ 13.5 Interest

INTENTIONALLY OMITTED

§ 13.6 Wherever possible, each provision of this Agreement shall be interpreted in a manner as to be effective and valid under applicable law. If, however, any provision of this Agreement, or portion thereof, is prohibited by law or found invalid under any law, only such provision or portion thereof shall be ineffective, without in any manner invalidating or affecting the remaining provisions of this Agreement or valid portion of such provision, which are hereby deemed severable.

§ 13.7 The parties expressly understand and agree that any provision in this Contract related to job site safety, supervision, inspections or compliance with ordinances, laws, statutes, rules, regulations and/or protocols are solely for the benefit of the Contractor and Owner and do not create any rights, claims, or causes of action in third parties, separate contractors, Subcontractors or Sub-subcontractors, or any of their employees performing work on or at the Project. Nothing in this Agreement is intended to confer any rights in any other contractor, Subcontractor of any tier material supplier, or their employees, as there are no intended third party beneficiaries of this Agreement.

§ 13.8 Each and every provision of law and clause required by law to be inserted in this contract shall be deemed to be inserted herein and the contract shall be read and enforced as though it were included herein.

§ 13.9 If the Contractor is a "nonresident contractor" as defined in Section 12-430(7)(A) of the Connecticut General Statutes, as revised, the Contractor shall comply fully with the provisions of Section 12-430(7) and, prior to commencing the Work, shall furnish the Owner with a copy of the requisite certificate of compliance set forth in

subparagraph (E) of Section 12-430(7). Contractor agrees to indemnify Owner as to any and all taxes, interest and penalties that the State of Connecticut asserts are due with respect to the Contractor's activities.

§ 13.10 Contractor shall comply with the requirements of Connecticut General Statutes Section 31-52. Specifically, Contractor agrees that in the employment of labor to perform the work specified herein, preference shall be given to citizens of the United States, who are, and continuously for at least three months prior to the date hereof have been, residents of the labor market area, as established by the Labor Commissioner, in which such work is to be done, and if no such qualified person is available, then to citizens who have continuously resided in the county in which the work is to be performed for at least three months prior to the date hereof, and then to citizens of the state who have continuously resided in the state at least three months prior to the date hereof.

§ 13.11 The wages paid on an hourly basis to any person performing the work of any mechanic, laborer or worker on the work herein contracted to be done and the amount of payment or contribution paid or payable on behalf of each such person to any employee welfare fund, as defined in Section 31-53 of the Connecticut General Statutes, shall be at a rate equal to the rate customary or prevailing for the same work in the same trade or occupation in the town in which such public works project is being constructed. Any contractor who is not obligated by agreement to make payment or contribution on behalf of such persons to any such employee welfare fund shall pay to each mechanic, laborer or worker as part of such person's wages the amount of payment or contribution for such person's classification on each pay day.

§ 13.12 Contractor and each of its Subcontractors shall furnish proof that each employee performing the work of a mechanic, laborer or worker on the Project has completed a course of at least ten (10) hours in construction safety and health approved by the federal Occupational Safety and Health Administration (OSHA) or has completed a new miner training program approved by the Federal Mine Safety and Health Administration. Such proof shall be provided with the certified payroll submitted for the first week each such employee, mechanic, laborer, or worker, begins work on the Project.

§ 13.13 Contractor hereby confirms that it has complied with the obligations under the Immigration Reform and Control Act (IRCA) and that the workers provided under this Agreement are authorized for employment in the United States. Contractor further confirms that it has properly completed I-9's for all of its workers assigned to the Project and that it will require each of its Subcontractors to confirm that they have properly completed I-9's for all of their workers assigned to the Project. Contractor agrees to indemnify, defend, and hold harmless the Owner in the event that any of the workers assigned to the Project are found not to be authorized to work under the law or in the event that there is a determination that the obligations set forth under IRCA, including the obligation to correctly prepare and maintain I-9s, have not been complied with, including but not limited to all damages, fines and penalties, punitive damages, attorneys' fees and costs.

§ 13.14 Since the Contractor was required to be prequalified by the Connecticut Department of Administrative Services in the bidding for this Project, in the event the surety assumes the contract or obtains a bid or bids for completion of the contract, the surety shall ensure that the contractor chosen to complete the contract is prequalified pursuant to section 4a-100 of the Connecticut General Statutes in the requisite classification and has the aggregate work capacity rating and single project limit necessary to complete the contract.

§ 13.15 Each payment application shall be accompanied by a statement showing the status of all pending Change Orders, pending Change Directives and approved changes to the Contract. Such statement shall identify the pending Change Orders and pending Change Directives, and shall include the date such Change Orders and Change Directives were initiated, additional cost and/or time associated with their performance and a description of any work completed. The Contractor shall require each of its Subcontractors and suppliers to include a similar statement with each of their payment applications or invoices.

ARTICLE 14 TERMINATION OR SUSPENSION OF THE CONTRACT

§ 14.1 Termination by the Contractor

§ 14.1.1 The Contractor may terminate the Contract if the Work is stopped for a period of 30 consecutive days through no act or fault of the Contractor, a Subcontractor, a Sub-subcontractor, their agents or employees, or any other persons or entities performing portions of the Work, for any of the following reasons:

- .1 Issuance of an order of a court or other public authority having jurisdiction that requires all Work to be stopped;
- .2 An act of government, such as a declaration of national emergency, that requires all Work to be stopped; or
- .3 Because the Architect has not issued a Certificate for Payment and has not notified the Contractor of the reason for withholding certification as provided in Section 9.4.1, or because the Owner has not made payment on a Certificate for Payment within the time stated in the Contract Documents and has not notified the Contractor of the reason for withholding payment.

§ 14.1.2 The Contractor may terminate the Contract if, through no act or fault of the Contractor, a Subcontractor, a Sub-subcontractor, their agents or employees, or any other persons or entities performing portions of the Work, repeated suspensions, delays, or interruptions of the entire Work by the Owner as described in Section 14.3, constitute in the aggregate more than 100 percent of the total number of days scheduled for completion, or 120 days in any 365-day period, whichever is less.

§ 14.1.3 If one of the reasons described in Section 14.1.1 or 14.1.2 exists, the Contractor may, upon thirty (30) additional days' notice to the Owner and Architect, terminate the Contract and recover from the Owner payment for Work executed. The notice of termination must state with specificity the means by which the Owner may cure its nonperformance, and the Contractor shall not terminate this Agreement if, within thirty (30) days of the notice, the Owner substantially undertakes such curative measures.

§ 14.1.4 INTENTIONALLY OMITTED

§ 14.2 Termination by the Owner for Cause

§ 14.2.1 The Owner may, without prejudice to any right or remedy available to the Owner under the Contract Documents or at law or in equity terminate the Contract if the Contractor:

- .1 institutes proceedings or consents to proceedings requesting relief or arrangement under the Federal Bankruptcy Act or any similar or applicable Federal or state law, or if a petition under any Federal or state bankruptcy or insolvency law is filed against the Contractor and such petition is not dismissed within sixty (60) days from the date of said filing, or if the Contractor admits in writing its inability to pay its debts generally as they become due, or if it makes a general assignment for the benefit of its creditors, or if a receiver, liquidator, trustee or assignee is appointed on account of bankruptcy or insolvency; or if a receiver of all or any substantial portion of the Contractor's properties is appointed;
- .2 abandons the Work; or if it fails, except in cases for which extension of time prosecute promptly and diligently the Work;
- .3 fails to supply enough properly skilled workers or proper materials for the Work;
- .4 submits an Application for Payment, sworn statement, waiver of lien, affidavit or document of any nature whatsoever which is intentionally falsified;
- .5 fails to make payment to Subcontractors for materials or labor in accordance with the Contract Documents and the respective agreements between the Contractor and the Subcontractors;
- .6 disregards the Conditions, applicable laws, statutes, ordinances, codes; rules and regulations, or lawful orders of a public and appropriate authority;
- .7 otherwise commits a substantial breach of a provision of the Contract Documents or
- .8 if a mechanic's or materialmen's lien or notice of lien is filed against any part of the Work or the site of the Project and not promptly bonded or insured over by the Contractor after the receipt of notice thereof in a manner reasonably satisfactory to the Owner.

§ 14.2.2 When any of the reasons described in Section 14.2.1 exist, may, without prejudice to any other rights or remedies of the Owner and after giving the Contractor and the Contractor's surety, if any, seven days' notice, terminate employment of the Contractor and may, subject to any prior rights of the surety:

- .1 Exclude the Contractor from the site and take possession of all materials, equipment, tools, and construction equipment and machinery thereon owned by the Contractor;
- .2 Accept assignment of subcontracts pursuant to Section 5.4; and

- .3 Finish the Work by whatever reasonable method the Owner may deem expedient. Upon written request of the Contractor, the Owner shall furnish to the Contractor a detailed accounting of the costs incurred by the Owner in finishing the Work.

§ 14.2.3 When the Owner terminates the Contract for one of the reasons stated in Section 14.2.1, the Contractor shall not be entitled to receive further payment until the Work is finished.

§ 14.2.4 If the unpaid balance of the Contract Sum exceeds costs of finishing the Work, including compensation for the Architect's services and expenses made necessary thereby, and other damages incurred by the Owner and not expressly waived, such excess shall be paid to the Contractor. If such costs and damages exceed the unpaid balance, the Contractor shall pay the difference to the Owner. The amount to be paid to the Contractor or Owner, as the case may be, shall be certified by the Initial Decision Maker, upon application, and this obligation for payment shall survive termination of the Contract.

§ 14.2.5 If the Owner terminates the Contractor for cause and it is thereafter determined that the Owner did not have the right to terminate the Contractor for cause, such termination for cause shall automatically be converted into a termination for convenience under Article 14.4 hereto.

§ 14.3 Suspension by the Owner for Convenience

§ 14.3.1 The Owner may, without cause, order the Contractor in writing to suspend, delay or interrupt the Work, in whole or in part for such period of time as the Owner may determine.

§ 14.3.2 The Contract Sum and Contract Time shall be adjusted for increases in the direct costs and time caused by suspension, delay, or interruption under Section 14.3.1. No adjustment shall be made to the extent

- .1 that performance is, was, or would have been, so suspended, delayed, or interrupted, by another cause for which the Contractor is responsible; or
- .2 that an equitable adjustment is made or denied under another provision of the Contract.

§ 14.4 Termination by the Owner for Convenience

§ 14.4.1 The Owner may, at any time, terminate the Contract for the Owner's convenience and without cause.

§ 14.4.2 Upon receipt of notice from the Owner of such termination for the Owner's convenience, the Contractor shall

- .1 cease operations as directed by the Owner in the notice;
- .2 take actions necessary, or that the Owner may direct, for the protection and preservation of the Work; and
- .3 except for Work directed to be performed prior to the effective date of termination stated in the notice, terminate all existing subcontracts and purchase orders and enter into no further subcontracts and purchase orders.

§ 14.4.3 Upon such termination, the Contractor shall recover as its sole remedy payment for Work properly performed in connection with the terminated portion of the Work prior to the effective date of termination and for items properly and timely fabricated off the Project site, delivered and stored in accordance with the Owner's instructions. The Contractor hereby waives and forfeits all other claims for payment and damages, including, without limitation, anticipated profits and consequential damages. In no event shall Contractor claim or be entitled to payment of overhead or profit on Work not performed. The Owner shall be credited for (i) payments previously made to the Contractor for the terminated portion of the Work, (ii) claims that the Owner has against the Contractor under the Contract, and (iii) the value of the materials, supplies, equipment, or other items that are to be disposed of by the Contractor that are part of the Contract Sum

ARTICLE 15 CLAIMS AND DISPUTES

§ 15.1 Claims

§ 15.1.1 Definition

A Claim is a demand or assertion by one of the parties seeking, as a matter of right, payment of money, a change in the Contract Time, or other relief with respect to the terms of the Contract. The term "Claim" also includes other disputes and matters in question between the Owner and Contractor arising out of or relating to the Contract. The responsibility to substantiate Claims shall rest with the party making the Claim. This Section 15.1.1 does not require the Owner to file a Claim in order to impose liquidated damages in accordance with the Contract Documents.

Failure to give such timely written notice will bar any claims by the Contractor. The Owner's prior written consent

to proceed with any Work for which the Contractor will claim it is entitled to additional compensation is a condition precedent to recovery for such work. Any notice of Claim must clearly identify the alleged cause and the nature of the Claim and include date and information then available to the claimant that will facilitate prompt verification and evaluation of the Claim.

§ 15.1.2 Time Limits on Claims

The Owner and Contractor shall commence all Claims and causes of action against the other and arising out of or related to the Contract, whether in contract, tort, breach of warranty or otherwise, in accordance with the requirements of the binding dispute resolution method selected in the Agreement and within the period specified by applicable law, but in any case not more than 10 years after the date of Substantial Completion of the Work. The Owner and Contractor waive all Claims and causes of action not commenced in accordance with this Section 15.1.2.

§ 15.1.3 Notice of Claims

§ 15.1.3.1 Claims by either the Owner or Contractor, where the condition giving rise to the Claim is first discovered prior to expiration of the period for correction of the Work set forth in Section 12.2.2, shall be initiated by notice to the other party and to the Initial Decision Maker with a copy sent to the Architect, if the Architect is not serving as the Initial Decision Maker. Claims by either party under this Section 15.1.3.1 shall be initiated within 21 days after occurrence of the event giving rise to such Claim or within 21 days after the claimant first recognizes the condition giving rise to the Claim, whichever is later. Failure by the Contractor to give such notice within the time specified shall greatly prejudice the Owner, and the failure to submit proper and timely notice shall constitute a waiver and abandonment of such Claim.

§ 15.1.3.2 Claims by either the Owner or Contractor, where the condition giving rise to the Claim is first discovered after expiration of the period for correction of the Work set forth in Section 12.2.2, shall be initiated by notice to the other party. In such event, no decision by the Initial Decision Maker is required.

§ 15.1.4 Continuing Contract Performance

§ 15.1.4.1 Pending final resolution of a Claim, except as otherwise agreed in writing or as provided in Section 9.7 and Article 14, the Contractor shall proceed diligently with performance of the Contract and the Owner shall continue to make payments in accordance with the Contract Documents. The Owner shall have no obligation to make payments to the Contractor on or against such claims, disputes, or other matters in question during the pendency of any mediation, arbitration, or other proceedings to resolve such matters. Owner shall continue to make payments of undisputed amounts.

§ 15.1.4.2 The Contract Sum and Contract Time shall be adjusted in accordance with the Initial Decision Maker's decision, subject to the right of either party to proceed in accordance with this Article 15. The Architect will issue Certificates for Payment in accordance with the decision of the Initial Decision Maker.

§ 15.1.5 Claims for Additional Cost

If the Contractor wishes to make a Claim for an increase in the Contract Sum, notice as provided in Section 15.1.3 shall be given before proceeding to execute the portion of the Work that is the subject of the Claim. Prior notice is not required for Claims relating to an emergency endangering life or property arising under Section 10.4.

§ 15.1.6 Claims for Additional Time

§ 15.1.6.1 If the Contractor wishes to make a Claim for an increase in the Contract Time, written notice as provided herein shall be given. The Contractor's Claim shall include an estimate of cost and of probable effect of delay on progress of the Work. The Contractor shall have the burden of demonstrating the effect of the claimed delay on the Contract Time, and shall furnish the Owner and the Architect with such documentation relating thereto as the Owner and the Architect may reasonably require. In the case of a continuing delay, only one Claim is necessary. Any request seeking an extension of time contain:

- .1 a detailed description of the nature of each cause of delay, the date or dates upon which each cause of delay began and ended (as known or as projected), the number of days of delay attributable to each such cause, and the impact of such delay upon the construction schedule;
- .2 the construction schedule in effect at the start of the delay, showing that the portion of the Work that was, or will be, delayed is on the critical path and that no float remains or will be available for the delayed activities at the start of the delay;

- .3 a schedule analysis of the impact of the delay on the critical path in the construction schedule at the time of the delay, including any proposed adjustment to the Contract Time; and
- .4 such other supporting data that the Owner may request.

§ 15.1.6.2 If adverse weather conditions are the basis for a Claim for additional time, such Claim shall be documented by data substantiating that weather conditions were abnormal for the period of time, could not have been reasonably anticipated, and had an adverse effect on the scheduled construction.

§ 15.1.7 Waiver of Claims for Consequential Damages

INTENTIONALLY OMITTED

§ 15.1.6 LIQUIDATED DAMAGES

It is mutually agreed that if the Contractor fails to reach Substantial Completion of the Work by ten (10) months from the Owner's Notice to Proceed, the Owner will be damaged; and because the amount of the Owner's damages is difficult if not impossible to definitely ascertain and prove, it is hereby agreed that the amount of such damages shall be One Thousand Five Hundred Dollars (\$1,500) for each Day, or part thereof, of delay in substantially completing the Work. The Contractor agrees that said sum shall be deducted from monies due the Contractor under the Contract, or, if no money is due the Contractor, the Contractor hereby agrees to pay the Owner as liquidated damages, and not by way of penalty, such total sum as shall be due for such delay.

§ 15.2 Initial Decision

§ 15.2.1 Claims, excluding those where the condition giving rise to the Claim is first discovered after expiration of the period for correction of the Work set forth in Section 12.2.2 or arising under Sections 10.3, 10.4, and 11.5, shall be referred to the Initial Decision Maker for initial decision. The Architect will serve as the Initial Decision Maker, unless otherwise indicated in the Agreement. Except for those Claims excluded by this Section 15.2.1, an initial decision shall be required as a condition precedent to mediation of any Claim. If an initial decision has not been rendered within 30 days after the Claim has been referred to the Initial Decision Maker, the party asserting the Claim may demand mediation and binding dispute resolution without a decision having been rendered. Unless the Initial Decision Maker and all affected parties agree, the Initial Decision Maker will not decide disputes between the Contractor and persons or entities other than the Owner.

§ 15.2.2 The Initial Decision Maker will review Claims and within ten days of the receipt of a Claim take one or more of the following actions: (1) request additional supporting data from the claimant or a response with supporting data from the other party, (2) reject the Claim in whole or in part, (3) approve the Claim, (4) suggest a compromise, or (5) advise the parties that the Initial Decision Maker is unable to resolve the Claim if the Initial Decision Maker lacks sufficient information to evaluate the merits of the Claim or if the Initial Decision Maker concludes that, in the Initial Decision Maker's sole discretion, it would be inappropriate for the Initial Decision Maker to resolve the Claim.

§ 15.2.3 In evaluating Claims, the Initial Decision Maker may, but shall not be obligated to, consult with or seek information from either party or from persons with special knowledge or expertise who may assist the Initial Decision Maker in rendering a decision. The Initial Decision Maker may request the Owner to authorize retention of such persons at the Owner's expense.

§ 15.2.4 If the Initial Decision Maker requests a party to provide a response to a Claim or to furnish additional supporting data, such party shall respond, within ten days after receipt of the request, and shall either (1) provide a response on the requested supporting data, (2) advise the Initial Decision Maker when the response or supporting data will be furnished, or (3) advise the Initial Decision Maker that no supporting data will be furnished. Upon receipt of the response or supporting data, if any, the Initial Decision Maker will either reject or approve the Claim in whole or in part.

§ 15.2.5 The Initial Decision Maker will render an initial decision approving or rejecting the Claim, or indicating that the Initial Decision Maker is unable to resolve the Claim. This initial decision shall (1) be in writing; (2) state the reasons therefor; and (3) notify the parties and the Architect, if the Architect is not serving as the Initial Decision Maker, of any change in the Contract Sum or Contract Time or both. The initial decision shall be final and binding on the parties but subject to mediation and, if the parties fail to resolve their dispute through mediation, to binding dispute resolution.

§ 15.2.6 Either party may file for mediation of an initial decision at any time, subject to the terms of Section 15.2.6.1.

§ 15.2.6.1 Either party may demand or file for mediation of a Claim.

§ 15.2.7 In the event of a Claim against the Contractor, the Owner may, but is not obligated to, notify the surety, if any, of the nature and amount of the Claim. If the Claim relates to a possibility of a Contractor's default, the Owner may, but is not obligated to, notify the surety and request the surety's assistance in resolving the controversy.

§ 15.3 Mediation

§ 15.3.1 Claims, disputes, or other matters in controversy arising out of or related to the Contract, except those waived as provided for in Sections 9.10.4 shall be subject to mediation as a condition precedent to binding dispute resolution.

§ 15.3.2 The parties shall endeavor to resolve their Claims by mediation which, unless the parties mutually agree otherwise, shall be administered by the American Arbitration Association in accordance with its Construction Industry Mediation Procedures in effect on the date of the Agreement. A request for mediation shall be made in writing, delivered to the other party to the Contract, and filed with the person or entity administering the mediation. The request may be made concurrently with the filing of binding dispute resolution proceedings but, in such event, mediation shall proceed in advance of binding dispute resolution proceedings, which shall be stayed pending mediation for a period of 60 days from the date of filing, unless stayed for a longer period by agreement of the parties or court order. If an arbitration is stayed pursuant to this Section 15.3.2, the parties may nonetheless proceed to the selection of the arbitrator(s) and agree upon a schedule for later proceedings.

§ 15.3.3 Either party may, within 30 days from the date that mediation has been concluded without resolution of the dispute or 60 days after mediation has been demanded without resolution of the dispute, demand in writing that the other party file for binding dispute resolution. If such a demand is made and the party receiving the demand fails to file for binding dispute resolution within 60 days after receipt thereof, then both parties waive their rights to binding dispute resolution proceedings with respect to the initial decision.

§ 15.3.4 The parties shall share the mediator's fee and any filing fees equally. The mediation shall be held in the place where the Project is located, unless another location is mutually agreed upon. Agreements reached in mediation shall be enforceable as settlement agreements in any court having jurisdiction thereof.

§ 15.4 Arbitration

§ 15.4.1. All claims, disputes and other matters in question between the Owner and the Contractor arising out of or related to the Contract or the breach thereof, except for claims which have been waived by the making and acceptance of final payments, shall be decided, at the sole option of the Owner, by one of the following dispute resolution procedures: (1) arbitration in accordance with rules agreed to by the Owner and the Contractor, (2) arbitration in accordance with the Construction Industry Arbitration Rules of the American Arbitration Association then obtaining, or (3) litigation.

§ 15.4.1.1 INTENTIONALLY OMITTED **§ 15.4.2** If a demand for arbitration is filed by the Contractor, the Owner will advise the Contractor within thirty days after the receipt of such a demand for arbitration if the Owner elects to arbitrate or rejects arbitration; such election, once made, shall be binding. The filing of a demand for arbitration by the Owner shall be deemed an election to arbitrate and shall constitute the exercise of the option of the Owner to proceed with arbitration. The Owner, but not the Contractor, may join or consolidate with any arbitration with the Contractor any disputes with the Architect, any Subcontractor, or any other party having an interest in the proceeding. This agreement to arbitrate shall be specifically enforceable under applicable law in any court having jurisdiction thereof. The award rendered by the arbitrator or arbitrators shall be final and judgment may be entered upon it in accordance with the applicable law in any court having jurisdiction thereof. **§ 15.4.3** The Contractor agrees to continue performance of the Contract Work and shall proceed in accordance with the directives of the Owner, under protest, in the event of a dispute or controversy. Failure to so proceed shall constitute a material breach of the Contract, regardless of the ultimate decision on the dispute, it being understood and agreed that any controversy between the parties shall not be deemed a basis to delay or suspend the Contract Work, unless directed otherwise by the Owner.

§ 15.4.4 Consolidation or Joinder

§ 15.4.4.1 INTENTIONALLY OMITTED **§ 15.4.4.2** INTENTIONALLY OMITTED **§ 15.4.4.3** INTENTIONALLY OMITTED

PREVAILING WAGE INFORMATION

(SEE ATTACHED)



THIS IS A PUBLIC WORKS PROJECT

Covered by the

PREVAILING WAGE LAW

CT General Statutes Section 31-53

**If you have QUESTIONS regarding your wages
CALL (860) 263-6790**

Section 31-55 of the CT State Statutes requires every contractor or subcontractor performing work for the state to post in a prominent place the prevailing wages as determined by the Labor Commissioner.

Sec. 31-53b. Construction safety and health course. New miner training program. Proof of completion required for mechanics, laborers and workers on public works projects. Enforcement. Regulations. Exceptions. (a) Each contract for a public works project entered into on or after July 1, 2009, by the state or any of its agents, or by any political subdivision of the state or any of its agents, described in subsection (g) of section 31-53, shall contain a provision requiring that each contractor furnish proof with the weekly certified payroll form for the first week each employee begins work on such project that any person performing the work of a mechanic, laborer or worker pursuant to the classifications of labor under section 31-53 on such public works project, pursuant to such contract, has completed a course of at least ten hours in duration in construction safety and health approved by the federal Occupational Safety and Health Administration or, has completed a new miner training program approved by the Federal Mine Safety and Health Administration in accordance with 30 CFR 48 or, in the case of telecommunications employees, has completed at least ten hours of training in accordance with 29 CFR 1910.268.

(b) Any person required to complete a course or program under subsection (a) of this section who has not completed the course or program shall be subject to removal from the worksite if the person does not provide documentation of having completed such course or program by the fifteenth day after the date the person is found to be in noncompliance. The Labor Commissioner or said commissioner's designee shall enforce this section.

(c) Not later than January 1, 2009, the Labor Commissioner shall adopt regulations, in accordance with the provisions of chapter 54, to implement the provisions of subsections (a) and (b) of this section. Such regulations shall require that the ten-hour construction safety and health courses required under subsection (a) of this section be conducted in accordance with federal Occupational Safety and Health Administration Training Institute standards, or in accordance with Federal Mine Safety and Health Administration Standards or in accordance with 29 CFR 1910.268, as appropriate. The Labor Commissioner shall accept as sufficient proof of compliance with the provisions of subsection (a) or (b) of this section a student course completion card issued by the federal Occupational Safety and Health Administration Training Institute, or such other proof of compliance said commissioner deems appropriate, dated no earlier than five years before the commencement date of such public works project.

(d) This section shall not apply to employees of public service companies, as defined in section 16-1, or drivers of commercial motor vehicles driving the vehicle on the public works project and delivering or picking up cargo from public works projects provided they perform no labor relating to the project other than the loading and unloading of their cargo.

(P.A. 06-175, S. 1; P.A. 08-83, S. 1.)

History: P.A. 08-83 amended Subsec. (a) by making provisions applicable to public works project contracts entered into on or after July 1, 2009, replacing provision re total cost of work with reference to Sec. 31-53(g), requiring proof in certified payroll form that new mechanic, laborer or worker has completed a 10-hour or more construction safety course and adding provision re new miner training program, amended Subsec. (b) by substituting "person" for "employee" and adding "or program", amended Subsec. (c) by adding "or in accordance with Federal Mine Safety and Health Administration Standards" and setting new deadline of January 1, 2009, deleted former Subsec. (d) re "public building", added new Subsec. (d) re exemptions for public service company employees and delivery drivers who perform no labor other than delivery and made conforming and technical changes, effective January 1, 2009.

November 29, 2006

Notice
To All Mason Contractors and Interested Parties
Regarding Construction Pursuant to Section 31-53 of the
Connecticut General Statutes (Prevailing Wage)

The Connecticut Labor Department Wage and Workplace Standards Division is empowered to enforce the prevailing wage rates on projects covered by the above referenced statute.

Over the past few years the Division has withheld enforcement of the rate in effect for workers who operate a forklift on a prevailing wage rate project due to a potential jurisdictional dispute.

The rate listed in the schedules and in our Occupational Bulletin (see enclosed) has been as follows:

Forklift Operator:

- **Laborers (Group 4) Mason Tenders** - operates forklift solely to assist a mason to a maximum height of nine feet only.
- **Power Equipment Operator (Group 9)** - operates forklift to assist any trade and to assist a mason to a height over nine feet.

The U.S. Labor Department conducted a survey of rates in Connecticut but it has not been published and the rate in effect remains as outlined in the above Occupational Bulletin.

Since this is a classification matter and not one of jurisdiction, effective January 1, 2007 the Connecticut Labor Department will enforce the rate on each schedule in accordance with our statutory authority.

Your cooperation in filing appropriate and accurate certified payrolls is appreciated.

STATUTE 31-55a

- SPECIAL NOTICE -

To: All State and Political Subdivisions, Their Agents, and Contractors

Connecticut General Statute 31-55a - Annual adjustments to wage rates by contractors doing state work.

Each contractor that is awarded a contract on or after October 1, 2002, for (1) the construction of a state highway or bridge that falls under the provisions of section 31-54 of the general statutes, or (2) the construction, remodeling, refinishing, refurbishing, rehabilitation, alteration or repair of any public works project that falls under the provisions of section 31-53 of the general statutes shall contact the Labor Commissioner on or before July first of each year, for the duration of such contract, to ascertain the prevailing rate of wages on an hourly basis and the amount of payment or contributions paid or payable on behalf of each mechanic, laborer or worker employed upon the work contracted to be done, and shall make any necessary adjustments to such prevailing rate of wages and such payment or contributions paid or payable on behalf of each such employee, effective each July first.

- The prevailing wage rates applicable to any contract or subcontract awarded on or after October 1, 2002 are subject to annual adjustments each July 1st for the duration of any project which was originally advertised for bids on or after October 1, 2002.
- Each contractor affected by the above requirement shall pay the annual adjusted prevailing wage rate that is in effect each July 1st, as posted by the Department of Labor.
- It is the **contractor's** responsibility to obtain the annual adjusted prevailing wage rate increases directly from the Department of Labor's Web Site. The annual adjustments will be posted on the Department of Labor Web page: www.ctdol.state.ct.us. For those without internet access, please contact the division listed below.
- The Department of Labor will continue to issue the initial prevailing wage rate schedule to the Contracting Agency for the project. All subsequent annual adjustments will be posted on our Web Site for contractor access.

Any questions should be directed to the Contract Compliance Unit, Wage and Workplace Standards Division, Connecticut Department of Labor, 200 Folly Brook Blvd., Wethersfield, CT 06109 at (860)263-6790.

NOTICE

TO ALL CONTRACTING AGENCIES

Please be advised that Connecticut General Statutes Section 31-53, requires the contracting agency to certify to the Department of Labor, the total dollar amount of work to be done in connection with such public works project, regardless of whether such project consists of one or more contracts.

Please find the attached “Contracting Agency Certification Form” to be completed and returned to the Department of Labor, Wage and Workplace Standards Division, Public Contract Compliance Unit.

Inquiries can be directed to 860.263.6790.



CONNECTICUT DEPARTMENT OF LABOR
WAGE AND WORKPLACE STANDARDS DIVISION

Contracting Agency Certification Form

I, _____, acting in my official capacity as _____,
Authorized Representative Title
for _____, located at _____,
Contracting Agency Address

do hereby certify that the total dollar amount of work to be done in connection with

_____, located at _____,
Project name and number Address

shall be \$_____, which includes all work, regardless of whether such project
contains of one or more contracts.

Contractor Information

Name: _____

Address: _____

Authorized Representative: _____

Approximate Starting Date: _____

Approximate Completion Date: _____

Signature

Date

Return to:

Connecticut Department of Labor
Wage & Workplace Standards Division
200 Folly Brook Blvd.
Wethersfield, CT 06109

Rate Schedule Issued (Date): _____

CONNECTICUT DEPARTMENT OF LABOR
WAGE AND WORKPLACE STANDARDS DIVISION

CONTRACTORS WAGE CERTIFICATION FORM
Construction Manager at Risk/General Contractor/Prime Contractor

I, _____ of _____
Officer, Owner, Authorized Rep. Company Name

do hereby certify that the _____
Company Name

Street

City

and all of its subcontractors will pay all workers on the

Project Name and Number

Street and City

the wages as listed in the schedule of prevailing rates required for such project (a copy of which is attached hereto).

Signed

Subscribed and sworn to before me this _____ day of _____, _____.

Notary Public

Return to:

Connecticut Department of Labor
Wage & Workplace Standards Division
200 Folly Brook Blvd.
Wethersfield, CT 06109

Rate Schedule Issued (Date): _____

[New] In accordance with Section 31-53b(a) of the C.G.S. each contractor shall provide a copy of the OSHA 10 Hour Construction Safety and Health Card for each employee, to be attached to the first certified payroll on the project.

In accordance with Connecticut General Statutes, 31-53 Certified Payrolls with a statement of compliance shall be submitted monthly to the contracting agency.												PAYROLL CERTIFICATION FOR PUBLIC WORKS PROJECTS										Connecticut Department of Labor Wage and Workplace Standards Division 200 Folly Brook Blvd. Wethersfield, CT 06109							
CONTRACTOR NAME AND ADDRESS:												SUBCONTRACTOR NAME & ADDRESS						WORKER'S COMPENSATION INSURANCE CARRIER POLICY # EFFECTIVE DATE: EXPIRATION DATE:											
PAYROLL NUMBER		Week-Ending Date		PROJECT NAME & ADDRESS																									
PERSON/WORKER, ADDRESS and SECTION		APPR RATE %	MALE/ FEMALE AND RACE*	WORK CLASSIFICATION		DAY AND DATE						Total ST Hours	BASE HOURLY RATE	TYPE OF FRINGE BENEFITS Per Hour 1 through 6 (see back)	GROSS PAY FOR ALL WORK PERFORMED THIS WEEK	TOTAL DEDUCTIONS				GROSS PAY FOR THIS PREVAILING RATE JOB	CHECK # AND NET PAY								
						S	M	T	W	TH	F	S				Total O/T Hours	TOTAL FRINGE BENEFIT PLAN CASH	FICA	FEDERAL			STATE	LIST OTHER						
				Trade License Type & Number - OSHA 10 Certification Number		HOURS WORKED EACH DAY																							
												\$ Base Rate	1. \$ 2. \$ 3. \$																
												\$ Cash Fringe	4. \$ 5. \$ 6. \$																
												\$ Base Rate	1. \$ 2. \$ 3. \$																
												\$ Cash Fringe	4. \$ 5. \$ 6. \$																
												\$ Base Rate	1. \$ 2. \$ 3. \$																
												\$ Cash Fringe	4. \$ 5. \$ 6. \$																
												\$ Base Rate	1. \$ 2. \$ 3. \$																
												\$ Cash Fringe	4. \$ 5. \$ 6. \$																
12/9/2013												*IF REQUIRED																	
WWS-CP1												*SEE REVERSE SIDE												PAGE NUMBER ____OF					

***FRINGE BENEFITS EXPLANATION (P):**

Bona fide benefits paid to approved plans, funds or programs, except those required by Federal or State Law (unemployment tax, worker’s compensation, income taxes, etc.).

Please specify the type of benefits provided:

- 1) Medical or hospital care _____
- 4) Disability_____
- 2) Pension or retirement _____
- 5) Vacation, holiday_____
- 3) Life Insurance _____
- 6) Other (please specify) _____

CERTIFIED STATEMENT OF COMPLIANCE

For the week ending date of _____,

I, _____ of _____, (hereafter known as Employer) in my capacity as _____ (title) do hereby certify and state:

Section A:

1. All persons employed on said project have been paid the full weekly wages earned by them during the week in accordance with Connecticut General Statutes, section 31-53, as amended. Further, I hereby certify and state the following:

a) The records submitted are true and accurate;

b) The rate of wages paid to each mechanic, laborer or workman and the amount of payment or contributions paid or payable on behalf of each such person to any employee welfare fund, as defined in Connecticut General Statutes, section 31-53 (h), are not less than the prevailing rate of wages and the amount of payment or contributions paid or payable on behalf of each such person to any employee welfare fund, as determined by the Labor Commissioner pursuant to subsection Connecticut General Statutes, section 31-53 (d), and said wages and benefits are not less than those which may also be required by contract;

c) The Employer has complied with all of the provisions in Connecticut General Statutes, section 31-53 (and Section 31-54 if applicable for state highway construction);

d) Each such person is covered by a worker’s compensation insurance policy for the duration of his employment which proof of coverage has been provided to the contracting agency;

e) The Employer does not receive kickbacks, which means any money, fee, commission, credit, gift, gratuity, thing of value, or compensation of any kind which is provided directly or indirectly, to any prime contractor, prime contractor employee, subcontractor, or subcontractor employee for the purpose of improperly obtaining or rewarding favorable treatment in connection with a prime contract or in connection with a prime contractor in connection with a subcontractor relating to a prime contractor; and

f) The Employer is aware that filing a certified payroll which he knows to be false is a class D felony for which the employer may be fined up to five thousand dollars, imprisoned for up to five years or both.

2. OSHA~The employer shall affix a copy of the construction safety course, program or training completion document to the certified payroll required to be submitted to the contracting agency for this project on which such persons name first appears.

(Signature)

(Title)

Submitted on (Date)

Weekly Payroll Certification For Public Works Projects (Continued)				PAYROLL CERTIFICATION FOR PUBLIC WORKS PROJECTS										Week-Ending Date: Contractor or Subcontractor Business Name:					
WEEKLY PAYROLL																			
PERSON/WORKER, ADDRESS and SECTION	APPR RATE %	MALE/ FEMALE AND RACE*	WORK CLASSIFICATION	DAY AND DATE						Total ST Hours	BASE HOURLY RATE	TYPE OF FRINGE BENEFITS Per Hour 1 through 6 (see back)	GROSS PAY FOR ALL WORK PERFORMED THIS WEEK	TOTAL DEDUCTIONS				GROSS PAY FOR THIS PREVAILING RATE JOB	CHECK # AND NET PAY
				S	M	T	W	TH	F	S									
			Trade License Type & Number - OSHA 10 Certification Number								Total O/T Hours			TOTAL FRINGE BENEFIT PLAN CASH					
				HOURS WORKED EACH DAY															
											\$ Base Rate	1. \$ 2. \$ 3. \$							
											\$ Cash Fringe	4. \$ 5. \$ 6. \$							
											\$ Base Rate	1. \$ 2. \$ 3. \$							
											\$ Cash Fringe	4. \$ 5. \$ 6. \$							
											\$ Base Rate	1. \$ 2. \$ 3. \$							
											\$ Cash Fringe	4. \$ 5. \$ 6. \$							
											\$ Base Rate	1. \$ 2. \$ 3. \$							
											\$ Cash Fringe	4. \$ 5. \$ 6. \$							
											\$ Base Rate	1. \$ 2. \$ 3. \$							
											\$ Cash Fringe	4. \$ 5. \$ 6. \$							
*IF REQUIRED																			
12/9/2013 WWS-CP2																			
NOTICE: THIS PAGE MUST BE ACCOMPANIED BY A COVER PAGE (FORM # WWS-CP1)																			
PAGE NUMBER ____ OF																			

[New] In accordance with Section 31-53b(a) of the C.G.S. each contractor shall provide a copy of the OSHA 10 Hour Construction Safety and Health Card for each employee, to be attached to the first certified payroll on the project.

In accordance with Connecticut General Statutes, 31-53 Certified Payrolls with a statement of compliance shall be submitted monthly to the contracting agency.										PAYROLL CERTIFICATION FOR PUBLIC WORKS PROJECTS										Connecticut Department of Labor Wage and Workplace Standards Division 200 Folly Brook Blvd. Wethersfield, CT 06109									
CONTRACTOR NAME AND ADDRESS: Landon Corporation, 15 Connecticut Avenue, Northford, CT 06472										SUBCONTRACTOR NAME & ADDRESS XYZ Corporation 2 Main Street Yantic, CT 06389										WORKER'S COMPENSATION INSURANCE CARRIER Travelers Insurance Company POLICY # #BAC8888928 EFFECTIVE DATE: 1/1/09 EXPIRATION DATE: 12/31/09									
PAYROLL NUMBER 1		Week-Ending Date 9/26/09		PROJECT NAME & ADDRESS DOT 105-296, Route 82								Total ST Hours		BASE HOURLY RATE		TYPE OF FRINGE BENEFITS Per Hour 1 through 6 (see back)		GROSS PAY FOR ALL WORK PERFORMED THIS WEEK		TOTAL DEDUCTIONS				GROSS PAY FOR THIS PREVAILING RATE JOB		CHECK # AND NET PAY			
PERSON/WORKER, ADDRESS and SECTION		APPR RATE %		MALE/FEMALE AND RACE*		WORK CLASSIFICATION		DAY AND DATE								Total ST Hours		TOTAL FRINGE BENEFIT PLAN CASH		GROSS PAY FOR ALL WORK PERFORMED THIS WEEK		TOTAL DEDUCTIONS				GROSS PAY FOR THIS PREVAILING RATE JOB		CHECK # AND NET PAY	
								S	M	T	W	TH	F	S	Total O/T Hours														
						Trade License Type & Number - OSHA 10 Certification Number		20	21	22	23	24	25	26	Total O/T Hours														
						HOURS WORKED EACH DAY																							
Robert Craft 81 Maple Street Willimantic, CT 06226				M/C		Electrical Lineman E-1 1234567 Owner OSHA 123456			8	8	8	8	8		40	S-TIME \$ 30.75 Base Rate	1. \$ 5.80 2. \$ 3. \$ 2.01	\$1,582.80					P-xxxx	\$1,582.80	#123 \$ xxx.xx				
Ronald Jones 212 Elm Street Norwich, CT 06360		65%		M/B		Electrical Apprentice OSHA 234567			8	8	8	8	8		40	S-TIME \$ 19.99 Base Rate	1. \$ 2. \$ 3. \$	\$1,464.80		xx.xx	xxx.xx	xx.xx	G-xxx	\$1,464.80	#124 \$xxx.xx				
Franklin T. Smith 234 Washington Rd. New London, CT 06320 SECTION B				M/H		Project Manager				8					8	S-TIME \$ Base Rate	1. \$ 2. \$ 3. \$	\$1,500.00		xx.xx	xx.xx	xx.xx	M-xx.x	xxx.xx #125					
															S-TIME \$ Base Rate	1. \$ 2. \$ 3. \$													
															O-TIME \$ Cash Fringe	4. \$ 5. \$ 6. \$													

OSHA 10 ~ATTACH CARD TO 1ST CERTIFIED PAYROLL

***FRINGE BENEFITS EXPLANATION (P):**

Bona fide benefits paid to approved plans, funds or programs, except those required by Federal or State Law (unemployment tax, worker's compensation, income taxes, etc.).

Please specify the type of benefits provided:

- 1) Medical or hospital care Blue Cross 4) Disability _____
2) Pension or retirement _____ 5) Vacation, holiday _____
3) Life Insurance Utopia 6) Other (please specify) _____

CERTIFIED STATEMENT OF COMPLIANCE

For the week ending date of 9/26/09,

I, Robert Craft of XYZ Corporation, (hereafter known as
Employer) in my capacity as Owner (title) do hereby certify and state:

Section A:

1. All persons employed on said project have been paid the full weekly wages earned by them during the week in accordance with Connecticut General Statutes, section 31-53, as amended. Further, I hereby certify and state the following:

a) The records submitted are true and accurate;

b) The rate of wages paid to each mechanic, laborer or workman and the amount of payment or contributions paid or payable on behalf of each such employee to any employee welfare fund, as defined in Connecticut General Statutes, section 31-53 (h), are not less than the prevailing rate of wages and the amount of payment or contributions paid or payable on behalf of each such employee to any employee welfare fund, as determined by the Labor Commissioner pursuant to subsection Connecticut General Statutes, section 31-53 (d), and said wages and benefits are not less than those which may also be required by contract;

c) The Employer has complied with all of the provisions in Connecticut General Statutes, section 31-53 (and Section 31-54 if applicable for state highway construction);

d) Each such employee of the Employer is covered by a worker's compensation insurance policy for the duration of his employment which proof of coverage has been provided to the contracting agency;

e) The Employer does not receive kickbacks, which means any money, fee, commission, credit, gift, gratuity, thing of value, or compensation of any kind which is provided directly or indirectly, to any prime contractor, prime contractor employee, subcontractor, or subcontractor employee for the purpose of improperly obtaining or rewarding favorable treatment in connection with a prime contract or in connection with a prime contractor in connection with a subcontractor relating to a prime contractor; and

f) The Employer is aware that filing a certified payroll which he knows to be false is a class D felony for which the employer may be fined up to five thousand dollars, imprisoned for up to five years or both.

2. OSHA~The employer shall affix a copy of the construction safety course, program or training completion document to the certified payroll required to be submitted to the contracting agency for this project on which such employee's name first appears.

Robert Craft owner 10/2/09
(Signature) (Title) Submitted on (Date)

Section B: Applies to CONNDOT Projects ONLY

That pursuant to CONNDOT contract requirements for reporting purposes only, all employees listed under Section B who performed work on this project are not covered under the prevailing wage requirements defined in Connecticut General Statutes Section 31-53.

Robert Craft owner 10/2/09
(Signature) (Title) Submitted on (Date)

Note: CTDOL will assume all hours worked were performed under Section A unless clearly delineated as Section B WWS-CP1 as such. Should an employee perform work under both Section A and Section B, the hours worked and wages paid must be segregated for reporting purposes.

THIS IS A PUBLIC DOCUMENT
DO NOT INCLUDE SOCIAL SECURITY NUMBERS

Information Bulletin

Occupational Classifications

The Connecticut Department of Labor has the responsibility to properly determine "job classification" on prevailing wage projects covered under C.G.S. Section 31-53(d).

Note: This information is intended to provide a sample of some occupational classifications for guidance purposes only. It is not an all-inclusive list of each occupation's duties. This list is being provided only to highlight some areas where a contractor may be unclear regarding the proper classification. If unsure, the employer should seek guidelines for CTDOL.

Below are additional clarifications of specific job duties performed for certain classifications:

- **ASBESTOS WORKERS**

Applies all insulating materials, protective coverings, coatings and finishes to all types of mechanical systems.

- **ASBESTOS INSULATOR**

Handle, install apply, fabricate, distribute, prepare, alter, repair, dismantle, heat and frost insulation, including penetration and fire stopping work on all penetration fire stop systems.

- **BOILERMAKERS**

Erects hydro plants, incomplete vessels, steel stacks, storage tanks for water, fuel, etc. Builds incomplete boilers, repairs heat exchanges and steam generators.

- **BRICKLAYERS, CEMENT MASONS, CEMENT FINISHERS, MARBLE MASONS, PLASTERERS, STONE MASONS, PLASTERERS. STONE MASONS, TERRAZZO WORKERS, TILE SETTERS**

Lays building materials such as brick, structural tile and concrete cinder, glass, gypsum, terra cotta block. Cuts, tools and sets marble, sets stone, finishes concrete, applies decorative steel, aluminum and plastic tile, applies cements, sand, pigment and marble chips to floors, stairways, etc.

- **CARPENTERS, MILLWRIGHTS. PILEDRIVMEN. LATHERS. RESILEINT FLOOR LAYERS, DOCK BUILDERS, DIKERS, DIVER TENDERS**

Constructs, erects, installs and repairs structures and fixtures of wood, plywood and wallboard. Installs, assembles, dismantles, moves industrial machinery. Drives piling into ground to provide foundations for structures such as buildings and bridges, retaining walls for earth embankments, such as cofferdams. Fastens wooden, metal or rockboard lath to walls, ceilings and partitions of buildings, acoustical tile layer, concrete form builder. Applies firestopping materials on fire resistive joint systems only. Installation of curtain/window walls only where attached to wood or metal studs. Installation of insulated material of all types whether blown, nailed or attached in other ways to walls, ceilings and floors of buildings. Assembly and installation of modular furniture/furniture systems. Free-standing furniture is not covered. This includes free standing: student chairs, study top desks, book box desks, computer furniture, dictionary stand, atlas stand, wood shelving, two-position information access station, file cabinets, storage cabinets, tables, etc.

- **LABORER, CLEANING**

- The clean up of any construction debris and the general (heavy/light) cleaning, including sweeping, wash down, mopping, wiping of the construction facility and its furniture, washing, polishing, and dusting.

- **DELIVERY PERSONNEL**

- If delivery of supplies/building materials is to one common point and stockpiled there, prevailing wages are not required. If the delivery personnel are involved in the distribution of the material to multiple locations within the construction site then they would have to be paid prevailing wages for the type of work performed: laborer, equipment operator, electrician, ironworker, plumber, etc.

- An example of this would be where delivery of drywall is made to a building and the delivery personnel distribute the drywall from one "stockpile" location to further sub-locations on each floor. Distribution of material around a construction site is the job of a laborer or tradesman, and not a delivery personnel.

- **ELECTRICIANS**

Install, erect, maintenance, alteration or repair of any wire, cable, conduit, etc., which generates, transforms, transmits or uses electrical energy for light, heat, power or other purposes, including the Installation or maintenance of telecommunication, LAN wiring or computer equipment, and low voltage wiring. ****License required per Connecticut General Statutes: E-1,2 L-5,6 C-5,6 T-1,2 L-1,2 V-1,2,7,8,9.***

- **ELEVATOR CONSTRUCTORS**

Install, erect, maintenance and repair of all types of elevators, escalators, dumb waiters and moving walks. **License required by Connecticut General Statutes: R-1,2,5,6.*

- **FORK LIFT OPERATOR**

Laborers Group 4) Mason Tenders - operates forklift solely to assist a mason to a maximum height of nine (9) feet only.

Power Equipment Operator Group 9 - operates forklift to assist any trade, and to assist a mason to a height over nine (9) feet.

- **GLAZIERS**

Glazing wood and metal sash, doors, partitions, and 2 story aluminum storefronts. Installs glass windows, skylights, store fronts and display cases or surfaces such as building fronts, interior walls, ceilings and table tops and metal store fronts. Installation of aluminum window walls and curtain walls is the "joint" work of glaziers and ironworkers, which require equal composite workforce.

- **IRONWORKERS**

Erection, installation and placement of structural steel, precast concrete, miscellaneous iron, ornamental iron, metal curtain wall, rigging and reinforcing steel. Handling, sorting, and installation of reinforcing steel (rebar). Metal bridge rail (traffic), metal bridge handrail, and decorative security fence installation. Installation of aluminum window walls and curtain walls is the "joint" work of glaziers and ironworkers which require equal composite workforce.

- **INSULATOR**

- Installing fire stopping systems/materials for "Penetration Firestop Systems": transit to cables, electrical conduits, insulated pipes, sprinkler pipe penetrations, ductwork behind radiation, electrical cable trays, fire rated pipe penetrations, natural polypropylene, HVAC ducts, plumbing bare metal, telephone and communication wires, and boiler room ceilings.

- **LABORERS**

Acetylene burners, asphalt rakers, chain saw operators, concrete and power buggy operator, concrete saw operator, fence and guard rail erector (except metal bridge rail (traffic), decorative security fence (non-metal)).

installation.), hand operated concrete vibrator operator, mason tenders, pipelayers (installation of storm drainage or sewage lines on the street only), pneumatic drill operator, pneumatic gas and electric drill operator, powermen and wagon drill operator, air track operator, block paver, curb setters, blasters, concrete spreaders.

- **PAINTERS**

Maintenance, preparation, cleaning, blasting (water and sand, etc.), painting or application of any protective coatings of every description on all bridges and appurtenances of highways, roadways, and railroads. Painting, decorating, hardwood finishing, paper hanging, sign writing, scenic art work and drywall hhg for any and all types of building and residential work.

- **LEAD PAINT REMOVAL**

- Painter's Rate

1. Removal of lead paint from bridges.
2. Removal of lead paint as preparation of any surface to be repainted.
3. Where removal is on a Demolition project prior to reconstruction.

- Laborer's Rate

1. Removal of lead paint from any surface NOT to be repainted.
2. Where removal is on a *TOTAL* Demolition project only.

- **PLUMBERS AND PIPEFITTERS**

Installation, repair, replacement, alteration or maintenance of all plumbing, heating, cooling and piping. **License required per Connecticut General Statutes: P-1,2,6,7,8,9 J-1,2,3,4 SP-1,2 S-1,2,3,4,5,6,7,8 B-1,2,3,4 D-1,2,3,4.*

- **POWER EQUIPMENT OPERATORS**

Operates several types of power construction equipment such as compressors, pumps, hoists, derricks, cranes, shovels, tractors, scrapers or motor graders, etc. Repairs and maintains equipment. **License required, crane operators only, per Connecticut General Statutes.*

- **ROOFERS**

Covers roofs with composition shingles or sheets, wood shingles, slate or asphalt and gravel to waterproof roofs, including preparation of surface. (demolition or removal of any type of roofing and or clean-up of any and all areas where a roof is to be relaid.)

- **SHEETMETAL WORKERS**

Fabricate, assemble, install and repair sheetmetal products and equipment in such areas as ventilation, air-conditioning, warm air heating, restaurant equipment, architectural sheet metal work, sheetmetal roofing, and aluminum gutters. Fabrication, handling, assembling, erecting, altering, repairing, etc. of coated metal material panels and composite metal material panels when used on building exteriors and interiors as soffits, fascia, louvers, partitions, canopies, cornice, column covers, awnings, beam covers, cladding, sun shades, lighting troughs, spires, ornamental roofing, metal ceilings, mansards, copings, ornamental and ventilation hoods, vertical and horizontal siding panels, trim, etc. The sheet metal classification also applies to the vast variety of coated metal material panels and composite metal material panels that have evolved over the years as an alternative to conventional ferrous and non-ferrous metals like steel, iron, tin, copper, brass, bronze, aluminum, etc. Fabrication, handling, assembling, erecting, altering, repairing, etc. of architectural metal roof, standing seam roof, composite metal roof, metal and composite bathroom/toilet partitions, aluminum gutters, metal and composite lockers and shelving, kitchen equipment, and walk-in coolers. To include testing and air –balancing ancillary to installation and construction.

- **SPRINKLER FITTERS**

Installation, alteration, maintenance and repair of fire protection sprinkler systems.

****License required per Connecticut General Statutes: F-1,2,3,4.***

- **TILE MARBLE AND TERRAZZO FINISHERS**

Assists and tends the tile setter, marble mason and terrazzo worker in the performance of their duties.

- **TRUCK DRIVERS**

~How to pay truck drivers delivering asphalt is under REVISION~

Truck Drivers are required to be paid prevailing wage for time spent "working" directly on the site. These drivers remain covered by the prevailing wage for any time spent transporting between the actual construction location and facilities (such as fabrication, plants, mobile factories, batch plant, borrow pits, job headquarters, tool yards, etc.) dedicated exclusively, or nearly so, to performance of the contract or project, which are so located in proximity to the actual construction location that it is reasonable to include them. ****License required, drivers only, per Connecticut General Statutes.***

For example:

- Material men and deliverymen are not covered under prevailing wage as long as they are not directly involved in the construction process. If, they unload the material, they would then be covered by prevailing wage for the classification they are performing work in: laborer, equipment operator, etc.
- Hauling material off site is not covered provided they are not dumping it at a location outlined above.
- Driving a truck on site and moving equipment or materials on site would be considered covered work, as this is part of the construction process.

➤ *Any questions regarding the proper classification should be directed to:*
Public Contract Compliance Unit
Wage and Workplace Standards Division
Connecticut Department of Labor
200 Folly Brook Blvd, Wethersfield, CT 06109
(860) 263-6790.

**Connecticut Department of Labor
Wage and Workplace Standards Division
FOOTNOTES**

- ⇒ Please Note: If the “Benefits” listed on the schedule for the following occupations includes a letter(s) (+ a or + a+b for instance), refer to the information below.

Benefits to be paid at the appropriate prevailing wage rate for the listed occupation.

If the “Benefits” section for the occupation lists only a dollar amount, disregard the information below.

Bricklayers, Cement Masons, Cement Finishers, Concrete Finishers, Stone Masons
(Building Construction) and
(Residential- Hartford, Middlesex, New Haven, New London and Tolland Counties)

- a. Paid Holiday: Employees shall receive 4 hours for Christmas Eve holiday provided the employee works the regularly scheduled day before and after the holiday. Employers may schedule work on Christmas Eve and employees shall receive pay for actual hours worked in addition to holiday pay.

Elevator Constructors: Mechanics

- a. Paid Holidays: New Year’s Day, Memorial Day, Independence Day, Labor Day, Veterans’ Day, Thanksgiving Day, Christmas Day, plus the Friday after Thanksgiving.
- b. Vacation: Employer contributes 8% of basic hourly rate for 5 years or more of service or 6% of basic hourly rate for 6 months to 5 years of service as vacation pay credit.

Glaziers

- a. Paid Holidays: Labor Day and Christmas Day.

Power Equipment Operators
(Heavy and Highway Construction & Building Construction)

- a. Paid Holidays: New Year’s Day, Good Friday, Memorial day, Independence Day, Labor Day, Thanksgiving Day and Christmas Day, provided the employee works 3 days during the week in which the holiday falls, if scheduled, and if scheduled, the working day before and the working day after the holiday. Holidays falling on Saturday may be observed on Saturday, or if the employer so elects, on the preceding Friday.

Ironworkers

- a. Paid Holiday: Labor Day provided employee has been on the payroll for the 5 consecutive work days prior to Labor Day.

Laborers (Tunnel Construction)

- a. Paid Holidays: New Year's Day, Memorial Day, Independence Day, Labor Day, Thanksgiving Day and Christmas Day. No employee shall be eligible for holiday pay when he fails, without cause, to work the regular work day preceding the holiday or the regular work day following the holiday.

Roofers

- a. Paid Holidays: July 4th, Labor Day, and Christmas Day provided the employee is employed 15 days prior to the holiday.

Sprinkler Fitters

- a. Paid Holidays: Memorial Day, July 4th, Labor Day, Thanksgiving Day and Christmas Day, provided the employee has been in the employment of a contractor 20 working days prior to any such paid holiday.

Truck Drivers

(Heavy and Highway Construction & Building Construction)

- a. Paid Holidays: New Year's Day, Memorial Day, Independence Day, Labor Day, Thanksgiving Day, Christmas day, and Good Friday, provided the employee has at least 31 calendar days of service and works the last scheduled day before and the first scheduled day after the holiday, unless excused.

DESIGN PLANS

(SEE ATTACHED)

ABBREVIATIONS					
(NOT ALL SYMBOLS ARE USED)					
(###)	CFM	FA	FACE AREA	NO	NORMALLY OPEN
ABV	ABOVE	FBO	FURNISHED BY OTHERS	NTS	NOT TO SCALE
AC	AIR COMPRESSOR	OA	INSTALLED BY HVAC SUBCONTRACTOR	OA	OUTSIDE AIR
ACU-#	AIR CONDITIONING UNIT	FC	FORWARD CURVE	OAT	OUTDOOR AIR TEMPERATURE
AD	ACCESS DOOR	FCU	FAN COIL UNIT	OAI	OUTDOOR AIR INTAKE
AF	AIRFOIL	FD	FIRE DAMPER WITH ACCESS DOOR	ODD	OPPOSED BLADE DAMPER
AFC	ADJUSTABLE FREQUENCY CONTROLLER	FF	FINAL FILTER	OD	OUTSIDE DIMENSION
AFI	ABOVE FINISHED FLOOR	FIBO	FURNISHED AND INSTALLED BY OTHERS	O.E.T.D.	OPEN END TRANSFER DUCT
AFMS	AIR FLOW MEASURING STATION	FIN FL	FINISH FLOOR	P-#	PUMP
AHU-#	AIR HANDLING UNIT	FL	FLOOR	PB	PUSH BUTTON
AL	ACOUSTIC LINING	FLA	FULL LOAD AMPERES	PBD	PARALLEL BLADE DAMPER
ALD	AUTOMATIC LOUVER DAMPER	FLEX	FLEXIBLE	PD	PRESSURE DROP
APD	AIR PRESSURE DROP	FPF	FINS PER FOOT	PF	PREFILTER
AUTO	AUTOMATIC	FPV	FAN POWERED VAV BOX	PH	PHASE
B-#	BOILER	FT	FEET	PHC	PREHEAT COIL
BC	BACKWARD CURVED	F.T.	FLOAT & THERMOSTATIC TRAP	PPH	POUND PER HOUR
BD	BELT DRIVE	FTR	FIN TUBE RADIATION	PRV	PRESSURE REDUCING VALVE
BMCS	BUILDING MANAGEMENT & CONTROL SYSTEM	FV	FACE VELOCITY	PSI	POUND PER SQUARE INCH
IBT	INVERTED BUCKET TRAP	GC	GENERAL CONTRACTOR	RA	RETURN AIR
BTU	BRITISH THERMAL UNIT	GRAVITY	INTAKE HOOD	RAF-#	RETURN AIR FAN
C-#	CHILLER	GPH	GALLONS PER HOUR	RAT	RETURN AIR TEMPERATURE
CAP	CAPACITY	GPM	GALLONS PER MINUTE	REG	REGISTER
CB-#	CHILLED BEAM	GWL	GEO THERMAL WATER LOOP SUPPLY	RH	RELATIVE HUMIDITY
CC-#	COOLING COIL	GWLR	GEO THERMAL WATER LOOP RETURN	RHC	REHEAT COIL
CD	CONDENSATE DRAIN - GRAVITY	HC	HEATING/COOLING	RM	ROOM
CFM	CUBIC FEET PER MINUTE	H-#	HUMIDIFIER	RP	RADIANT PANEL
CG	CEILING GRILLE	H-O-A	HAND-OFF-AUTOMATIC	RPM	REVOLUTIONS PER MINUTE
CLG	CEILING	HC-#	HEATING COIL	RS	RISE
CONV-#	HOT WATER CONVECTOR	hd	FEET OF HEAD	RTU-#	ROOFTOP AIR CONDITIONING UNIT
CPD	CONDENSATE PUMPED DISCHARGE	HP	HORSEPOWER	SA	SUPPLY AIR
CR	CEILING REGISTER	HTG	HEATING	SAF-#	SUPPLY AIR FAN
CT-#	COOLING TOWER	HTR	HEATER	SAT	SUPPLY AIR TEMPERATURE
CTD	CEILING TRANSFER DUCT	HV-#	HEATING AND VENTILATING UNIT	SB	SECURITY BARS
CUH-#	CABINET UNIT HEATER HOT WATER	HVAC	HEATING, VENTILATING & AIR CONDITIONING	VSC	VERTICAL SPLIT CASE
CV	CONTROL VALVE	HX-#	HEAT EXCHANGER CONVERTOR	HSC	HORIZONTAL SPLIT CASE
CW	COLD WATER	ID	INSIDE DIMENSION OR IDENTIFICATION	SD	SMOKE DAMPER
D&T	DRIP AND TRAP	IN	INCHES	SG	SUPPLY GRILLE
dB	DECIBELS	IV	INLET GUIDE VANES	SP	STATIC PRESSURE
DB	DRY BULB	IL	INLET	SQ FT	SQUARE FOOT (AREA)
DD	DIRECT DRIVE	ILN	IN LINE	SS	STAINLESS S STEEL
DDC	DIRECT DIGITAL CONTROL	KW	KILOWATT	ST	SINGLE POLE SWITCH
DIFF	DIFFUSER	KWH	KILOWATT HOUR	SWR	WITHERMAL OVERLOAD
DL	DOOR LOUVER	LAT	LEAVING AIR TEMPERATURE	TSR	SIDE WALL REGISTER
DN	DOWN	LD	LINEAR DIFFUSER	TSTAT	THERMOSTAT
DOAS	DEDICATED OUTDOOR AIR SYSTEM	LF	LINEAR FEET	TD	TEMPERATURE DIFFERENCE
DP	DEWPOINT TEMPERATURE	LRA	LOOKED ROTOR AMPERES	TEMP	TEMPERATURE
DR	DROP	LPR	LOW PRESSURE RETURN	TG	AIR TRANSFER GRILLE
DWVS	DUAL TEMPERATURE WATER SUPPLY	LPS	LOW PRESSURE SUPPLY	TOT	TOTAL
DTWR	DUAL TEMPERATURE WATER RETURN	LVG	LEAVING	TN-HR	TON HOUR REFRIGERATION
DX	DIRECT EXPANSION	LWT	LEAVING WATER TEMPERATURE	TRD	TRANSFER DUCT
EF-#	EXHAUST FAN	MAN	MANUAL	TT	THERMOSTATIC TRAP
EAT	ENTERING AIR TEMPERATURE	MAT	MIXED AIR TEMPERATURE	TYP	TYPICAL
EER	ENERGY EFFICIENCY RATIO	MAX	MAXIMUM	UC	UNDERCUT DOOR
EG	EXHAUST GRILLE	MBH	1000 BTUS	UH-#	UNIT HEATER HOT WATER
EH-#	ELECTRIC HEATING COIL	MCA	MINIMUM CIRCUIT AMPACITY	UV-#	UNIT VENTILATOR
ENT	ENTERING	MD	MOTORIZED DAMPER	VAV-#	VARIABLE AIR VOLUME
HEPA	HIGH EFFICIENCY PARTICULATE FILTER	MER	MECHANICAL EQUIPMENT ROOM	VO	VOLUME DAMPER
ER	EXHAUST REGISTER	MEZZ	MEZZANINE	VE	VOLUME EXTRACTOR
ES	END SUCTION	MFS	MAXIMUM FUSE SIZE	YFD	VARIABLE FREQUENCY DRIVE
ESP	EXTERNAL STATIC PRESSURE	MIN	MINIMUM	VI	VIBRATION ISOLATOR
ET-#	EXPANSION TANK	MOT	MOTOR	VSF	VARIABLE SPEED FAN SWITCH
EUH-#	ELECTRIC UNIT HEATER	MUA	MAKE-UP AIR	W/	WITH
EWT	ENTERING WATER TEMPERATURE	MV	MOTORIZED VALVE	WB	WET BULB
EX	EXTERNAL	NC	NORMALLY CLOSED	WFM	WATER FLOW MEASURING STATION
EXTG	EXISTING	NO	NOISE CRITERIA	WMS	WIRE MESH SCREEN
EXH	EXHAUST	NFA	NET FREE AREA	WPD	WATER PRESSURE DROP
F	DEGREES FAHRENHEIT	NIC	NOT IN THIS CONTRACT	WT	WEIGHT (LBS)
F&B	FACE & BYPASS DAMPER			ZD	ZONE DAMPER

MECHANICAL DRAWING INDEX	
SHEET	DESCRIPTION
M000	MECHANICAL SYMBOLS, NOTES AND ABBREVIATIONS
M011	MECH DUCT DEMO PLANS
M0111	MECH DUCT PLANS
M211	MECH FIRST FLOOR PIPING PLAN
M500	MECH SCHEDULES
M600	MECH DETAILS

COORDINATION NOTES

- COORDINATE INSTALLATION WITH WORK OF ALL TRADES. OFFSETS OF DUCTWORK AND PIPING SYSTEMS MAY BE REQUIRED IN ADDITION TO THOSE SHOWN ON DRAWINGS IN ORDER TO MAINTAIN REQUIRED REFER TO ARCHITECTURAL REFLECTED CEILING PLAN FOR CEILING HEIGHTS, FINISHED CEILING HEIGHTS.
- RELOCATE/REWORK EXISTING SYSTEMS AS REQUIRED TO SUIT INSTALLATION OF NEW WORK.
- REMOVE AND REPLACE CEILING SYSTEMS AS REQUIRED TO PERFORM INSTALLATION OF MECHANICAL SYSTEMS.
- LOCATION OF CEILING GRILLES AND DIFFUSERS IS APPROXIMATE. REFER TO ARCHITECTURAL REFLECTED CEILING PLAN FOR EXACT LOCATIONS.
- PROVIDE DUCT OFFSETS IN ADDITION AS REQUIRED DUE TO FIELD CONDITIONS.

HVAC SHOP DRAWINGS

- CONTRACTOR SHALL PREPARE AND SUBMIT SHEETMETAL FABRICATION DRAWINGS.
- SHEETMETAL SHOP DRAWINGS SHALL INDICATE DUCT SIZES AND ALL FIELD CONDITIONS INCLUDING LOCATION AND ELEVATION OF NEW AND EXISTING DUCTWORK, EQUIPMENT, DIFFUSERS AND GRILLES, AND COORDINATION WITH WORK OF OTHER TRADES INCLUDING PLUMBING, FIRE PROTECTION, STRUCTURAL, LIGHTING AND POWER.

SYMBOL LEGEND					
(NOT ALL SYMBOLS ARE USED)					
	PRESSURE/TEMPERATURE PORT	OR	PIPE UNION		MECHANICAL PLAN NOTE REFERENCE. NUMBER INDICATES PLAN NOTE
	TEMPERATURE GAUGE/TEMPERATURE INDICATOR		AIR VENT, AUTOMATIC		CUBIC FEET PER MINUTE
	PRESSURE GAUGE		AIR VENT, MANUAL		DUCT STATIC PRESSURE
	BUTTERFLY VALVE		PUMP OR FAN		VOLUME DAMPER
	SHUT-OFF VALVE		STRAINER		BACKDRAFT DAMPER
	ANGLE GATE VALVE		STRAINER, BLOW OFF		DUCT STATIC PRESSURE SENSOR
	GLOBE VALVE		1" DOOR UNDERCUT		MOTORIZED DAMPER
	BALL OR BUTTERFLY VALVE		RETURN GRILLE		SUPPLY OR OUTSIDE AIR DUCT UP OR CEILING RETURN SUPPLY DIFFUSER
	ANGLE GLOBE VALVE		THERMOSTAT OR SPACE TEMPERATURE SENSOR		SUPPLY OR OUTSIDE AIR DUCT DOWN
	TWO WAY MOTORIZED CONTROL VALVE		CARBON MONOXIDE DETECTOR		RETURN OR EXHAUST DUCT UP OR CEILING RETURN GRILLE
	THREE WAY MOTORIZED CONTROL VALVE		NITROGEN DIOXIDE DETECTOR		RETURN OR EXHAUST DUCT DOWN
	CHECK VALVE		DIRECTION OF FLOW		FLEXIBLE CONNECTION
	OS & Y		DIA. OR Ø		DUCT TRANSITION
	SAFETY RELIEF VALVE (PRESS. & TEMP.)		THERMOMETER		RECTANGULAR TO ROUND TRANSITION
	DRAIN VALVE W/ HOSE COUPLING WICAP		PIPE TEE, OUTLET UP		DUCT WORK, DIRECTION OF FLOW
	CAP		PIPE ELBOW, TURNED UP		POSITIVE PRESSURE DUCT
	PIPE CONNECTION BOTTOM		PIPE TEE, OUTLET DOWN		NEGATIVE PRESSURE DUCT
	PIPE CONNECTION TOP		HOT WATER SUPPLY		CHANGE OF ELEVATION
	PIPE COUPLING (JOINT)		HOT WATER RETURN		LINED DUCT WORK
	ELBOW, 90°		CHILLED WATER SUPPLY		SINGLE LINE LINED DUCT WORK
	PIPE ELBOW, TURNED DOWN		CHILLED WATER RETURN		DIRECTION OF SUPPLY OR OUTSIDE AIR
	PIPE TEE		POINT OF CONNECTION		DIRECTION OF RETURN OR EXHAUST AIR
	CALIBRATED BALANCING VALVE		RETURN OR EXHAUST DUCT UP		AIR TERMINAL UNIT
	HUMIDISTAT/HUMIDITY SENSOR		SUPPLY OR OUTSIDE AIR DUCT UP		DUCT SMOKE DETECTOR
	DUCT MOUNTED HUMIDITY SENSOR		SMOKE DAMPER		FIRE DAMPER WITH ACCESS DOOR AS REQUIRED
	DUCT MOUNTED CARBON DIOXIDE SENSOR		COMBINATION FIRE AND SMOKE DAMPER		DUCT ACCESS DOOR
	HOT WATER SUPPLY		45°F CHILLED WATER SYSTEM SUPPLY		57°F CHILLED WATER SYSTEM SUPPLY
	HOT WATER RETURN		45°F CHILLED WATER SYSTEM RETURN		57°F CHILLED WATER SYSTEM RETURN
	PIPE ANCHOR		PIPE GUIDE		TURNING VANES

GENERAL NOTES

- THE INTENT OF THESE CONTRACT DOCUMENTS IS FOR THE CONTRACTOR TO FURNISH AND INSTALL COMPLETE MECHANICAL AND ELECTRICAL SYSTEMS. THESE MECHANICAL AND ELECTRICAL SYSTEMS INCLUDE PLUMBING, FIRE PROTECTION, HVAC, ELECTRICAL AND ALL ASSOCIATED SPECIAL SYSTEMS. ALL SYSTEMS SHALL BE COMPLETE IN ALL RESPECTS, OPERATING, TESTED, ADJUSTED, APPROVED BY THE AUTHORITIES HAVING JURISDICTION AND READY FOR BENEFICIAL USE BY THE OWNER.
- THE CONTRACTOR SHALL OBTAIN AND REVIEW ALL CONTRACT DOCUMENTS, INCLUDING PROJECT MANUAL, PLANS AND SPECIFICATIONS OF ALL TRADES BEFORE SUBMITTING BID. REFER TO SPECIFICATIONS, PROJECT MANUAL AND PLANS, INCLUDING ALL EQUIPMENT SCHEDULES FOR MECHANICAL AND ELECTRICAL INFORMATION. CONTRACTOR SHALL WALK THROUGH BUILDING PRIOR TO SUBMITTING BID.
- ALL OF THE CONTRACT DRAWINGS AND SPECIFICATIONS ARE COMPLEMENTARY TO FORM A TOTAL DESIGN PACKAGE. IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR/CONSTRUCTION MANAGER TO DETERMINE WHICH TRADE CONTRACTOR IS RESPONSIBLE FOR VARIOUS PORTIONS OF THE WORK.
- ALL WORK AND ACTION DEPICTED AND DESCRIBED SHALL BE PERFORMED BY THE CONTRACTOR UNLESS SPECIFICALLY NOTED OTHERWISE.
- PROVIDE SUPPORT/BRACING OF EQUIPMENT AND BUILDING SERVICES FOR SEISMIC RESTRAINT AS REQUIRED BY CODE.
- OBTAIN AND PAY FOR ALL REQUIRED PERMITS AND INSPECTIONS.
- ALL EQUIPMENT, MATERIALS AND RELATED SYSTEMS COMPONENTS SHALL BE NEW UNLESS SPECIFICALLY NOTED OTHERWISE.
- REPAIR AND/OR REPLACE AT NO COST TO OWNER ALL EQUIPMENT AND MATERIALS DAMAGED DURING CONSTRUCTION.
- THE DRAWINGS ARE DIAGRAMMATIC AND INDICATE THE GENERAL ARRANGEMENT OF SYSTEMS AND WORK INCLUDED IN THE CONTRACT. THE CONTRACTOR SHALL COORDINATE LOCATIONS OF EQUIPMENT WITH ALL TRADES BEFORE STARTING CONSTRUCTION. ANY MODIFICATIONS TO THE EQUIPMENT LAYOUT REQUIRED FOR INSTALLATION ARE TO BE PERFORMED AT NO ADDITIONAL COST TO THE OWNER.
- REFER TO THE ARCHITECTURAL DRAWINGS FOR THE EXACT LOCATION OF LIGHT FIXTURES AND MOUNTING HEIGHTS OF EQUIPMENT, INCLUSIVE OF RECEPTACLES, SWITCHES, THERMOSTATS, ETC. ALL SUCH EQUIPMENT AND COLORS SHALL BE COORDINATED WITH THE ARCHITECT. CONTACT ARCHITECT FOR CLARIFICATION OF MOUNTING REQUIREMENTS, IF INFORMATION IS NOT CONTAINED IN THE DRAWINGS.
- ALL WORK SHALL BE PERFORMED IN COMPLIANCE WITH THE APPLICABLE CODES IN THE ORDINANCES AND THE REGULATORY AGENCIES HAVING JURISDICTION.
- ALL EQUIPMENT SHALL BE LOCATED IN ACCESSIBLE LOCATIONS. WHEN A PIECE OF EQUIPMENT MUST BE LOCATED ABOVE AN INACCESSIBLE CEILING OR WALL, THEN THE APPROPRIATE ACCESS DOOR SHALL BE PROVIDED. THESE SHALL BE COORDINATED WITH THE ARCHITECT.
- WHEN CONFLICTS OCCUR BETWEEN THE DRAWINGS AND/OR SPECIFICATIONS IT SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER. THE CONTRACTOR SHALL CARRY AS PART OF THE BID THE LARGER QUANTITY AND/OR MORE EXPENSIVE ITEM(S).
- CONTRACTORS SHALL COORDINATE THEIR WORK WITH ALL OWNER-FURNISHED EQUIPMENT, INCLUDING REQUIRED SERVICE CONNECTIONS, RECEPTACLES, ETC. BEFORE INSTALLATION.
- CONTRACTORS SHALL PROVIDE ALL REQUIRED SLEEVES AND SEALS FOR PIPES OR CONDUIT PENETRATING WALLS OR FLOOR SLABS WITH FIRE STOPPING SEALANT WHERE REQUIRED.
- ELECTRICAL CONDUITS & BOXES TO BE CONCEALED IN WALLS OR ABOVE CEILING WHEREVER POSSIBLE.
- COORDINATE ALL PIPING AND CONDUITS LEAVING THE BUILDING WITH THE SITE CONTRACTOR(S) BEFORE INSTALLATION.
- PROVIDE VIBRATION ISOLATION FOR ALL MECHANICAL EQUIPMENT.
- PROVIDE VIBRATION ISOLATORS FOR ALL PIPING SUPPORTS CONNECTED TO AND WITHIN 50 FEET OF ISOLATED EQUIPMENT THROUGHOUT MECHANICAL EQUIPMENT ROOMS.
- LOCATE ALL TEMPERATURE, PRESSURE AND FLOW MEASURING DEVICES IN ACCESSIBLE LOCATIONS WITH STRAIGHT SECTION OF PIPE OR DUCT UPSTREAM AS RECOMMENDED BY THE MANUFACTURER FOR GOOD ACCURACY.
- PROVIDE ACCESS PANELS FOR INSTALLATION IN WALLS AND CEILINGS, WHERE REQUIRED, TO SERVICE DAMPERS, VALVES, SMOKE DETECTORS AND OTHER CONCEALED MECHANICAL EQUIPMENT.
- ALL EQUIPMENT, PIPING, DUCT WORK SHALL BE SUPPORTED AS DETAILED, SPECIFIED AND REQUIRED TO PROVIDE A VIBRATION FREE INSTALLATION.
- LOCATION AND SIZES OF ALL FLOOR, WALL AND ROOF PENETRATIONS SHALL BE COORDINATED WITH ALL OTHER TRADES INVOLVED.
- INSTALL COMPLETE OPERATING SYSTEMS. PROVIDE ALL COMPONENTS, DEVICES, CONTROLS, RELAYS, TRANSFORMERS, ETC., WHETHER INDICATED OR NOT, FOR COMPLETE SYSTEMS AS INTENDED BY THE CONSTRUCTION DOCUMENTS.
- SOME PART OF THE BUILDING WILL BE OCCUPIED DURING CONSTRUCTION. REFER TO PHASING PLAN FOR MORE INFORMATION. MAINTAIN EXISTING SERVICES TO OCCUPIED AREAS. SEAL ALL DUCTWORK AND VENTILATION OPENINGS COMMUNICATING CONSTRUCTION AREAS WITH OCCUPIED AREAS TO PREVENT THE TRANSFER OF AIR CONTAMINATED BY CONSTRUCTION ACTIVITIES.
- ALL PENETRATIONS THRU RATED WALLS, FLOORS & CEILINGS SHALL BE SEALED USING U.L. LISTED METHODS APPROPRIATE FOR ASSEMBLY RATING.

GENERAL NOTES - HVAC

- PIPING AND DUCT WORK LAYOUTS AS INDICATED ON THE DRAWINGS ARE DIAGRAMMATIC. PROVIDE ADDITIONAL TRANSITIONS AND OFFSETS AS REQUIRED FOR COORDINATION WITH BUILDING CONSTRUCTION AND THE WORK OF OTHER TRADES.
- PROVIDE VOLUME DAMPERS, THROTTLING VALVES AND ISOLATION VALVES AS SPECIFIED AND AS INDICATED ON THE DRAWINGS.
- PROVIDE FIRE DAMPERS AT DUCT PENETRATIONS OF FIRE RATED PARTITIONS.
- PROVIDE SMOKE DETECTORS ON THE SUPPLY AND RETURN SIDE OF ALL AIR HANDLING EQUIPMENT 2000 CFM AND OVER.
- ALL MOTORS AND EQUIPMENT SHALL BE OF EFFICIENCIES THAT ARE ELIGIBLE FOR UTILITY COMPANY ENERGY INCENTIVE PROGRAMS.
- THE AUTOMATIC TEMPERATURE CONTROL SYSTEM SHALL BE COMPLETE IN ALL REGARDS, TESTED AND CAPABLE OF ACHIEVING THE SEQUENCES OF OPERATION. ALL DEVICES SHALL BE UNDER SYSTEM CONTROL. ALL ZONES SHALL BE THERMOSTATICALLY CONTROLLED WHETHER OR NOT A THERMOSTAT, SENSOR OR CONTROLLER IS INDICATED.
- MAINTAIN MANUFACTURER'S RECOMMENDED MINIMUM CLEARANCES FOR INSTALLATION OF EQUIPMENT.
- FLEX DUCT RUNS SHALL NOT BE LONGER THAN 10 FT.
- PROVIDE VOLUME DAMPERS AT ALL SUPPLY DIFFUSERS, RETURN GRILLES, AND EXHAUST GRILLES.
- PROVIDE VANDAL RESISTANT THERMOSTATS.
- ALL DUCTWORK DIMENSIONS, AS SHOWN ON THE DRAWINGS, ARE INTERNAL CLEAR DIMENSIONS AND DUCT SIZE SHALL BE INCREASED TO COMPENSATE FOR DUCT LINING THICKNESS.
- PROVIDE ALL 90 DEGREE SQUARE ELBOWS WITH DOUBLE RADIUS TURNING VANES UNLESS OTHERWISE INDICATED. ELBOWS SHALL BE UNWELDED SMOOTH RADIUS CONSTRUCTION WITH A RADIUS EQUAL TO 1-1/2 TIMES THE WIDTH OF THE DUCT. PROVIDE ACCESS DOORS UPSTREAM OF ALL ELBOWS WITH TURNING VANES.
- COORDINATE DIFFUSER, REGISTER AND GRILLE LOCATIONS WITH ARCHITECTURAL REFLECTED CEILING PLANS, LIGHTING AND OTHER CEILING ITEMS.
- PROVIDE FLEXIBLE CONNECTIONS IN ALL DUCTWORK SYSTEMS CONNECTED TO AIR HANDLING UNITS, FANS AND OTHER EQUIPMENT WHICH REQUIRE VIBRATION ISOLATION. FLEXIBLE CONNECTIONS SHALL BE AT THE POINT OF CONNECTION TO THE EQUIPMENT UNLESS OTHERWISE INDICATED.
- ALL DUCTWORK SHALL BE COORDINATED WITH ALL TRADES INVOLVED. OFFSETS IN DUCTS, INCLUDING DIVIDED DUCTS AND TRANSITIONS AROUND OBSTRUCTIONS, SHALL BE PROVIDED AT NO ADDITIONAL COST TO THE OWNER.
- PROVIDE ACCESS DOORS IN DUCTWORK TO PROVIDE ACCESS FOR ALL SMOKE DETECTORS, FIRE DAMPERS, SMOKE DAMPERS, VOLUME DAMPERS, COILS AND OTHER ITEMS LOCATED IN DUCTWORK WHICH REQUIRE SERVICE OR INSPECTION.
- PROVIDE ACCESS DOORS IN DUCTWORK FOR OPERATION, ADJUSTMENT AND MAINTENANCE OF ALL FANS, VALVES AND MECHANICAL EQUIPMENT.
- SUPPLY AND RETURN DUCTS FROM THE MAIN AIR HANDLING UNIT SHALL HAVE ACOUSTICAL LINING, R VALUE OF 5, WITHIN 10' FT OF UNIT. METAL NOSING SHALL BE SECURELY INSTALLED OVER TRANSVERSELY ORIENTED LINER EDGES FACING THE AIR STREAM AT FAN DISCHARGE, AT ACCESS DOORS, AND AT ANY INTERVAL OF LINED DUCT PRECEDED BY UNLINED DUCT. METAL NOSING SHALL BE USED ON UPSTREAM EDGES OF LINER AT EVERY TRANSVERSE JOINT.
- DUCTWORK SHALL BE PRESSURE TESTED AND SEALED FOR LEAKAGE IN ACCORDANCE WITH SMACNA GUIDELINES.
- THE SUPPLY AIR SYSTEM SHALL BE PURGED TO ENSURE ALL FOREIGN PARTICLES ARE REMOVED PRIOR TO FINAL CONNECTION OF SUPPLY AIR DIFFUSERS.
- ALL ELBOWS AND TEES FROM DOWNFLOW ROOF MOUNTED UNITS SHALL BE WRAPPED WITH A SOUND LAGGING MATERIAL, IN ADDITION TO DUCT LINER.
- HANDLING OF REFRIGERANTS TO BE IN COMPLIANCE WITH EPA-608 AND ANY OTHER REGULATIONS IN FORCE.

HVAC CONTROLS COORDINATION

- CONTRACTOR SHALL COORDINATE EQUIPMENT CONTROLS REQUIREMENTS WITH HVAC VENDORS AND TOWNS CONTROL VENDOR PRIOR TO RELEASING EQUIPMENT ORDERS.
- INSTALLED CONTROLS SHALL BE CAPABLE OF THE INDICATED SEQUENCE OF OPERATION AND ALL INDICATED AND AVAILABLE POINTS SHALL BE ADDRESSABLE FROM THE TOWNS FACILITIES MANAGEMENT SYSTEM.


PIPING

- UNLESS OTHERWISE NOTED, ALL PIPING IS OVERHEAD, TIGHT TO UNDERSIDE OF STRUCTURE OR SLAB, WITH SPACE FOR INSULATION.
- INSTALL PIPING SO THAT ALL VALVES, STRAINERS, UNIONS, TRAPS, FLANGES AND OTHER APPURTENANCES REQUIRING NOTED ON THE DRAWINGS. LOCATIONS AND QUANTITIES SHOWN ON THE DEMOLITION ARE APPROXIMATE. CONTRACTOR SHALL VERIFY THE FULL EXTENT OF WORK.
- UNIONS AND/OR FLANGES SHALL BE INSTALLED AT EACH PIECE OF EQUIPMENT, IN BYPASSES AND IN LONG PIPING RUNS (100 FEET OR MORE) TO PERMIT DISASSEMBLY FOR ALTERATION AND REPAIRS.
- ALL PIPING WORK SHALL BE COORDINATED WITH ALL TRADES INVOLVED. OFFSETS IN PIPING AROUND OBSTRUCTIONS SHALL BE PROVIDED AT NO ADDITIONAL COST TO THE OWNER.
- ALL PENETRATIONS THRU RATED WALLS, FLOORS & CEILINGS SHALL BE SEALED USING U.L. LISTED METHODS APPROPRIATE FOR ASSEMBLY RATING.
- PROVIDE SWING JOINTS AT ALL BRANCH CONNECTIONS TO WATER SUPPLY AND RETURN. PROVIDE ISOLATION VALVES AT ALL BRANCH CONNECTIONS.
- PROVIDE AIR VENTS AT ALL HIGH POINTS.
- INSTALL DRAIN VALVES WITH HOSE CONNECTION AT ALL LOW POINTS.
- PROVIDE HOSE END CAPS WITH CHAIN ON ALL DRAIN VALVES.

DEMOLITION GENERAL NOTES



- THE INTENT OF THIS DOCUMENT IS FOR THE CONTRACTOR TO REMOVE ALL EXISTING MECHANICAL EQUIPMENT, SPECIALTIES, AND ALL ASSOCIATED INSULATION AND HANGERS, DUCTWORK AND ASSOCIATED ACCESSORIES AND CONTROLS EXCEPT WHERE NOTED TO REMAIN.
- THE DEMOLITION NOTES ARE FOR DESCRIPTIVE GUIDE ONLY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE REMOVAL OF ALL ITEMS WHETHER OR NOT INDICATED AND/OR NOTED ON THE DRAWINGS. LOCATIONS AND QUANTITIES SHOWN ON THE DEMOLITION ARE APPROXIMATE. CONTRACTOR SHALL VERIFY THE FULL EXTENT OF WORK.
- NO WORK SHALL BE LEFT INCOMPLETE NOT ANY HAZARDOUS SITUATIONS CREATED WHICH WILL AFFECT THE LIFE OR SAFETY OF THE PUBLIC AND/OR BUILDING OCCUPANTS. AT NO TIME SHALL THE WORK INTERFERE WITH OR CUTOFF ANY OF THE EXISTING SERVICES WITHOUT THE OWNER'S WRITTEN PERMISSION.
- WHEN NECESSARY TO TEMPORARILY DISCONNECT ANY EXISTING BUILDING UTILITIES AND PIPING SYSTEM, CONFER WITH THE OWNER AND ARRANGE THE PERIOD OF INTERRUPTION FOR A TIME MUTUALLY AGREED UPON.
- COORDINATE SHUTDOWN OF EXISTING SERVICES AND TAPPING OF EXISTING PIPING WITH OWNER'S MAINTENANCE PERSONNEL. NO WORK SHALL TAKE PLACE UNTIL DOING SO.
- THE CONTRACTOR IS RESPONSIBLE FOR COORDINATING THEIR WORK WITH ALL TRADES.
- INFILL ALL EXISTING FLOOR AND WALL PENETRATIONS THAT ARE NOT GOING TO BE REUSED WITH A MATERIAL WITH THE SAME WALL RATING AS THE EXISTING WALL. REFER TO THE ARCHITECTURAL DRAWINGS.

Project Title: HVAC UPGRADES TO: ADMINISTRATION BUILDING 1325 CHESHIRE STREET CHESHIRE, CONNECTICUT 06410	 SILVER PETRUCELLI + ASSOCIATES 3190 WHITNEY AVENUE HAMDEN CT 06518 311 STATE STREET NEW LONDON CT 06320 203 230 9007 silverpetrucelli.com	Revision: Description: Date: Revised By: _____ _____ _____ _____ _____ _____ _____	Drawing Title: MECH SYMBOLS, NOTES & ABBREVIATIONS Project Phase: DESIGN DOCUMENTS NOT FOR CONSTRUCTION State Project Number: XXX-XXXXXXX	Date: 01/16/2026 Scale: 1/8" = 1'-0" Drawn By: CL Project Number: XX-XXX	M001

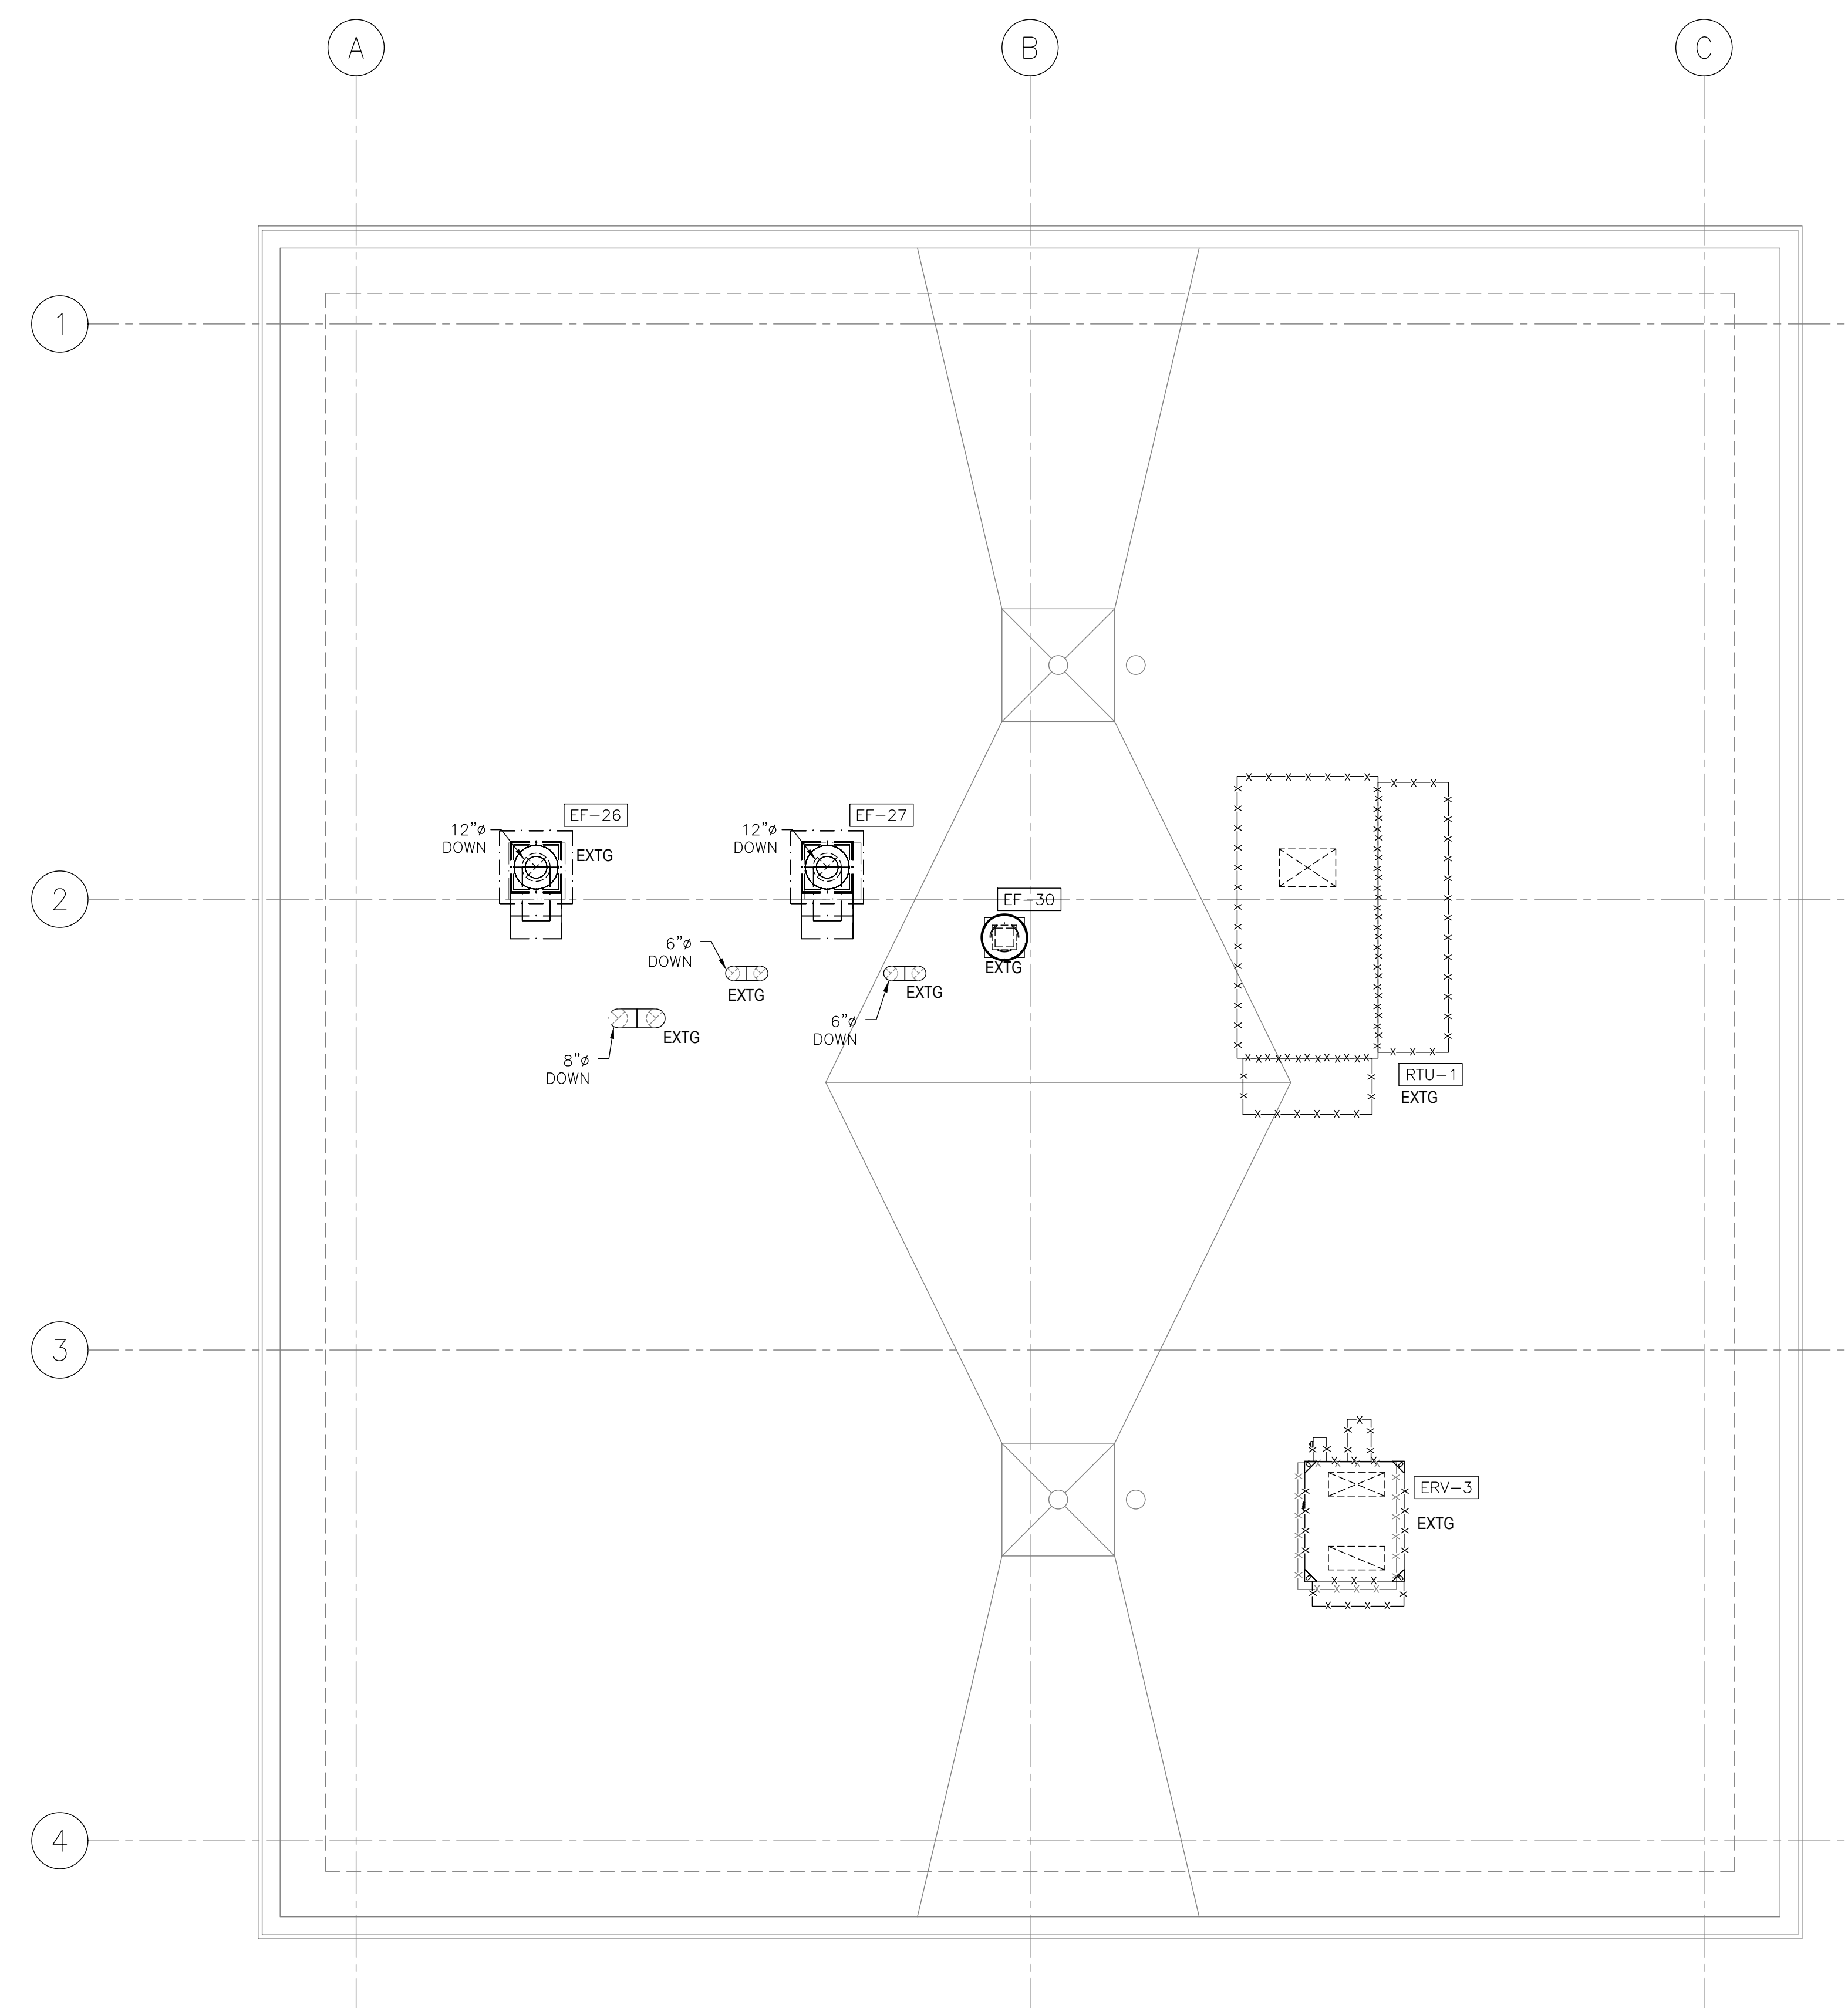

- ① REMOVE EXISTING VRF INDOOR UNIT, REFRIGERANT LINES, FLEXIBLE VENTILATION DUCT AND APPURTENANCES
- ② REMOVE EXISTING RELIEF AIR DIFFUSER AND FLEX DUCT, CAP MAIN DUCT



Project Title: HVAC UPGRADES TO: ADMINISTRATION BUILDING 1325 CHESHIRE STREET CHESHIRE, CONNECTICUT 06410	Project Title: SILVER PETRUCELLI + ASSOCIATES 3190 WHITNEY AVENUE HAMDEN CT 06518 311 STATE STREET NEW LONDON CT 06320 203 230 9007 silverpetrucelli.com	Revision: Description: Date: Revised By:	Drawing Title: MECH DEMO PLANS PHASE 1 Project Phase: DESIGN DOCUMENTS NOT FOR CONSTRUCTION State Project Number: XXX-XXXXXXX	Date: 01/16/2026 Scale: 1/4" = 1'-0" Drawn By: CL Project Number: XX-XXX	Drawing Number: M011-1

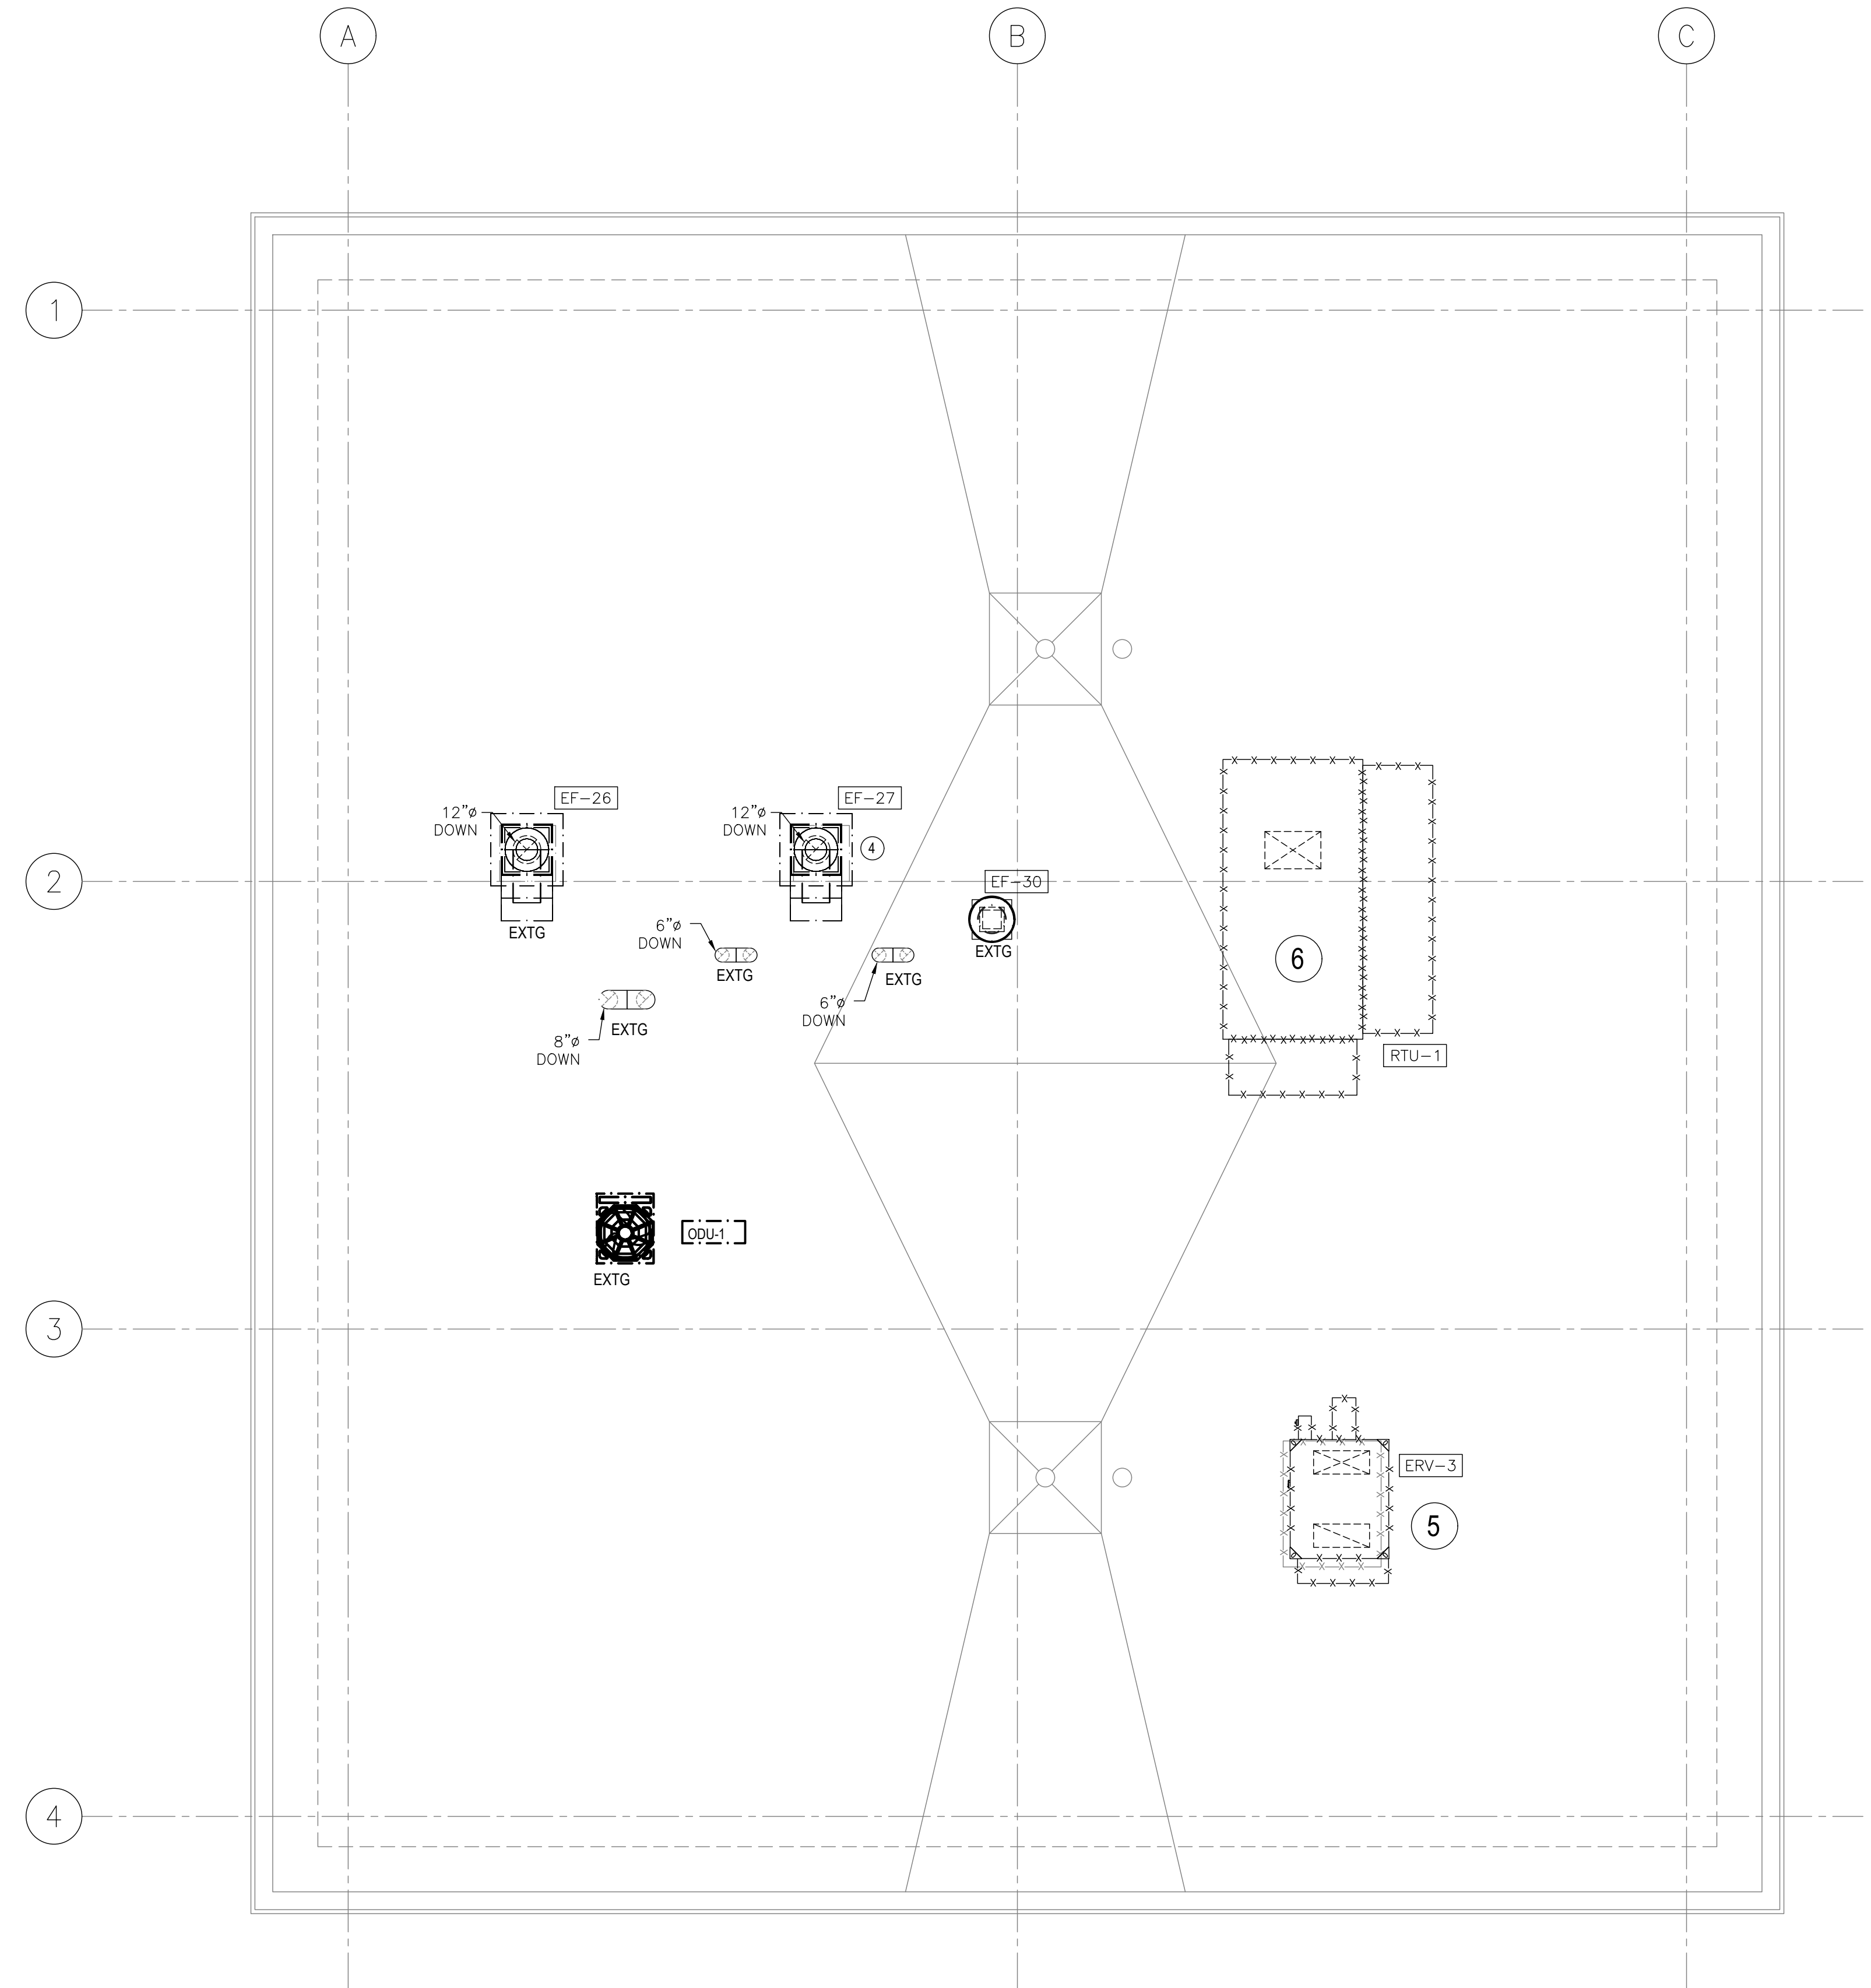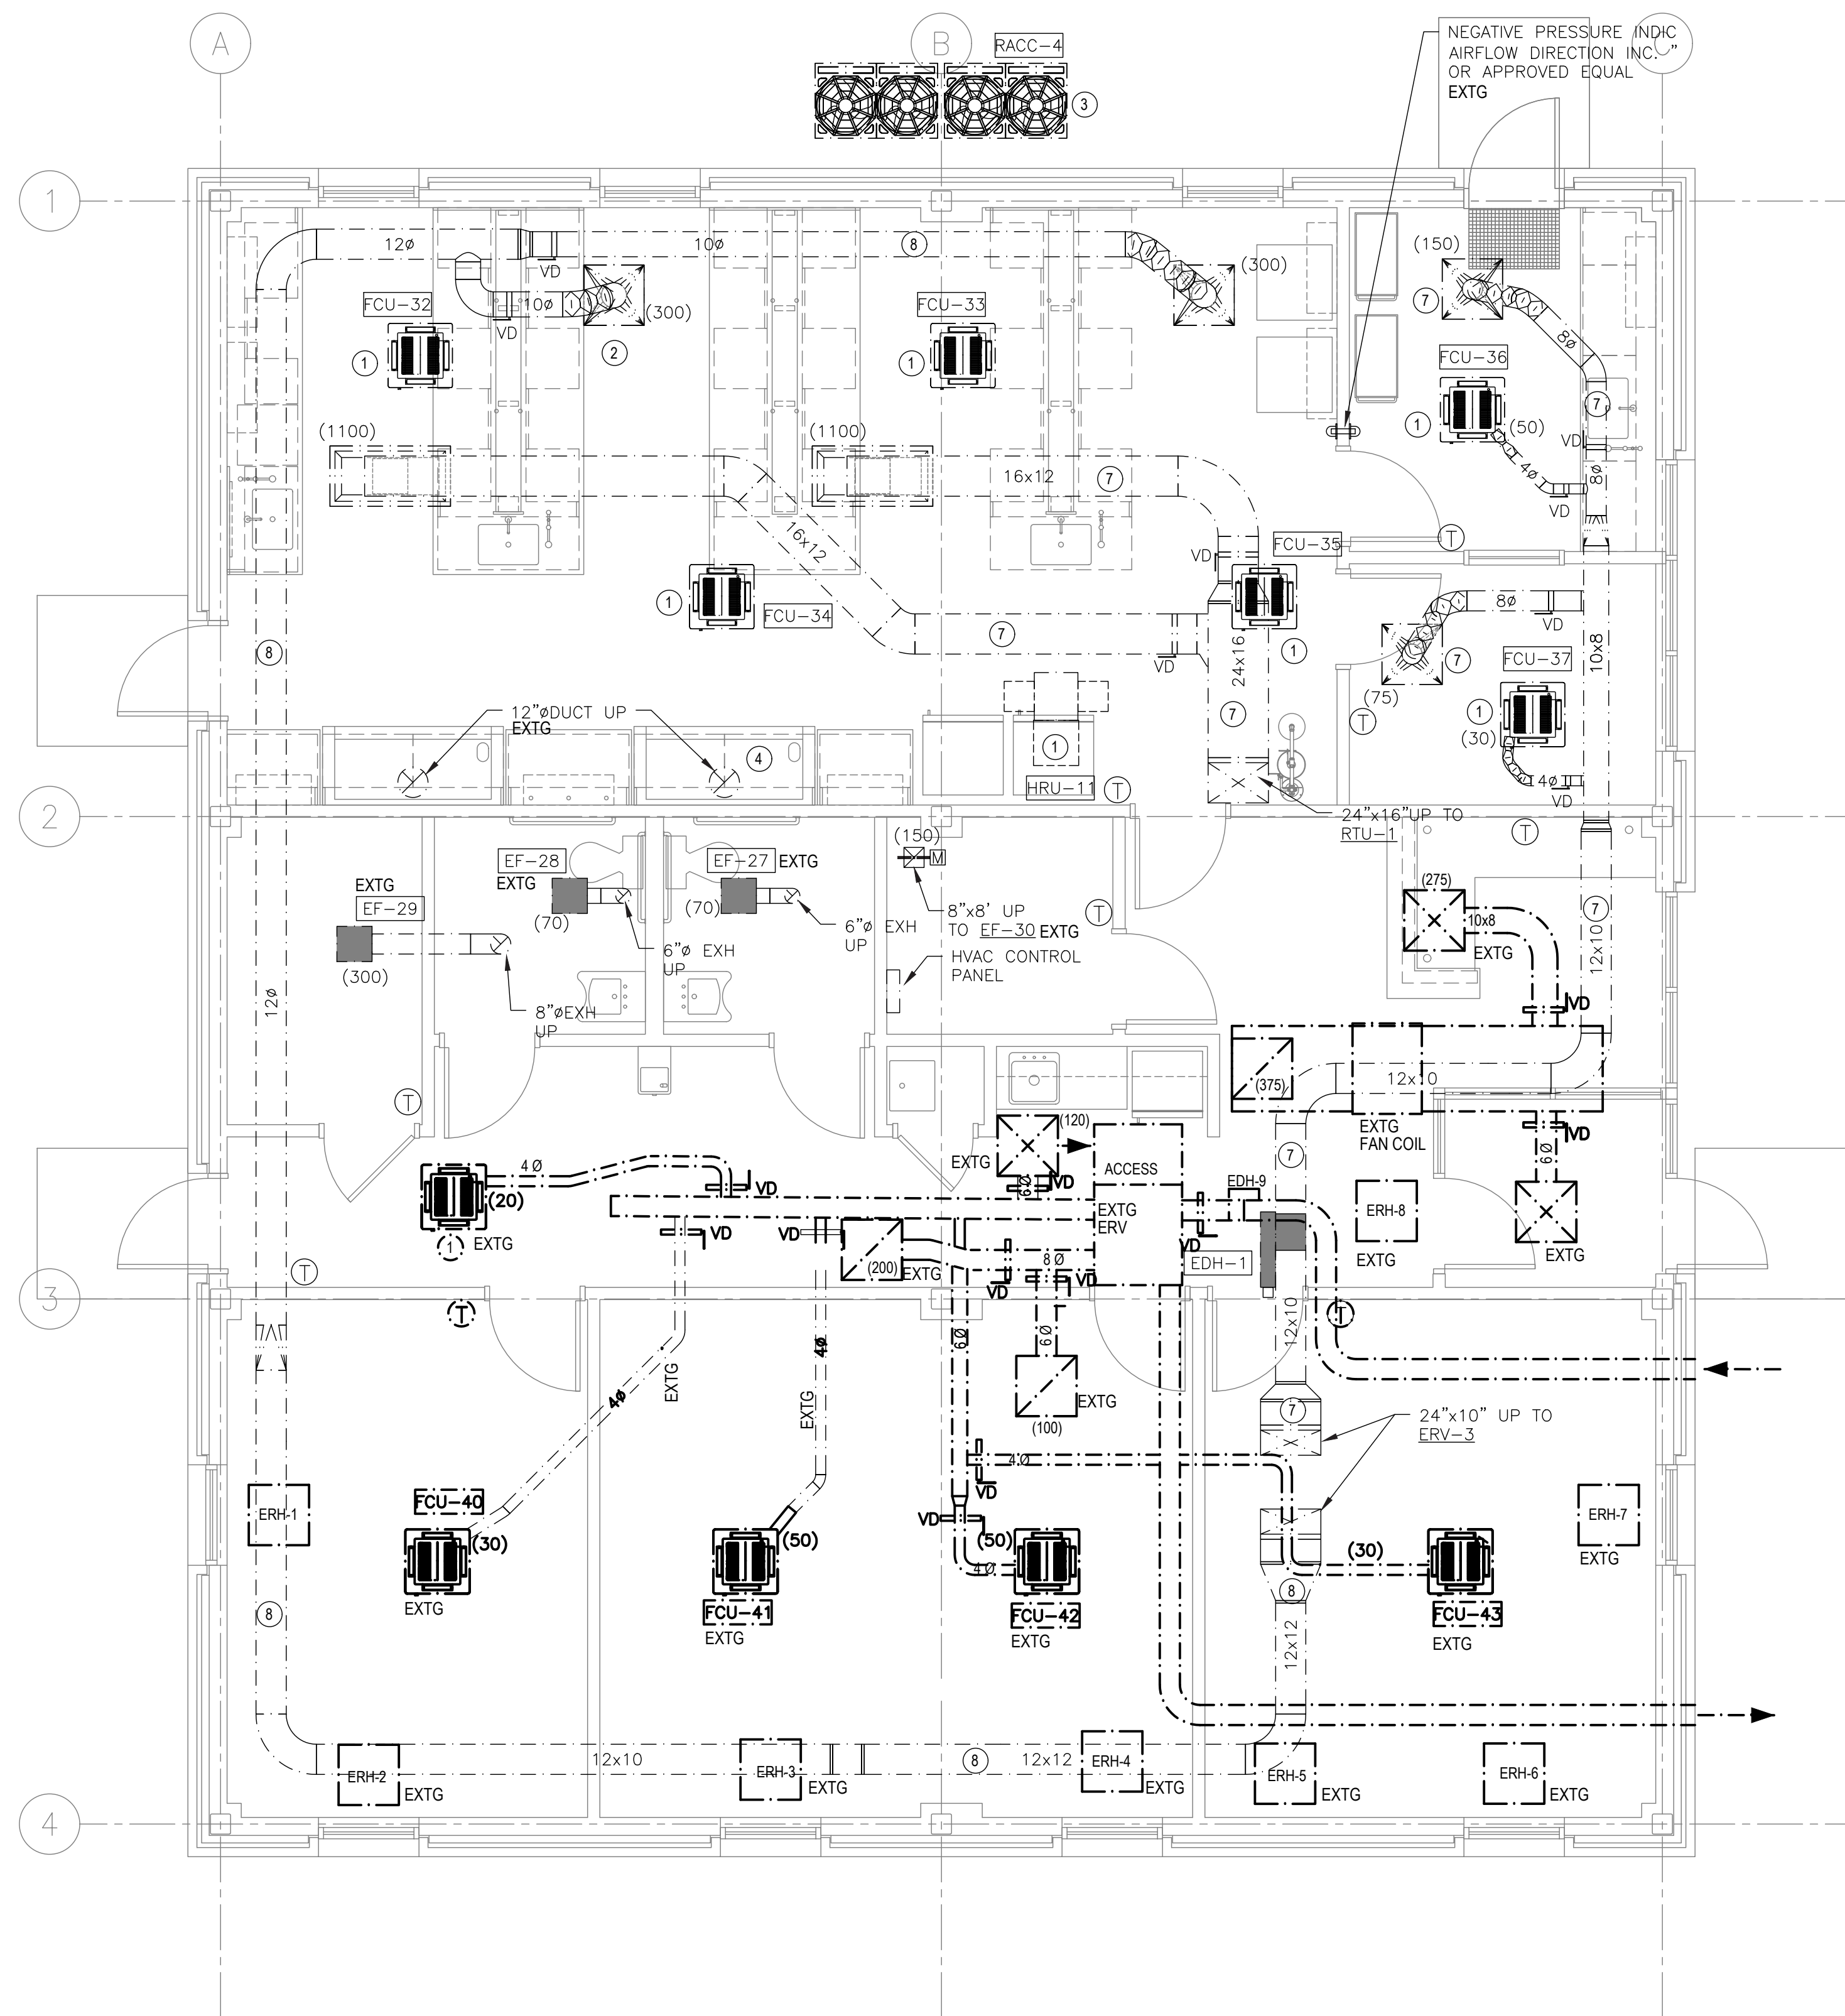

DEMOLITION NOTES

- ① REMOVE EXISTING VRF INDOOR UNIT, REFRIGERANT LINES, FLEXIBLE VENTILATION DUCT AND APPURTENANCES
- ② REMOVE EXISTING RELIEF AIR DIFFUSER AND FLEX DUCT
- ③ REMOVE EXISTING VRF OUTDOOR UNIT, REFRIGERANT LINES AND APPURTENANCES
- ④ REMOVE EXISTING EXHAUST FAN ON ROOF
- ⑤ REMOVE EXISTING ERV AND CURB ON ROOF. INFILL OPENING
- ⑥ REMOVE EXISTING RTU-1 ON ROOF
- ⑦ REMOVE EXISTING MAKE UP AIR DUCT, DIFFUSERS AND APPURTENANCES
- ⑧ REMOVE EXISTING RELIEF AIR DUCT, GRILLES AND APPURTENANCES


PHASE TWO

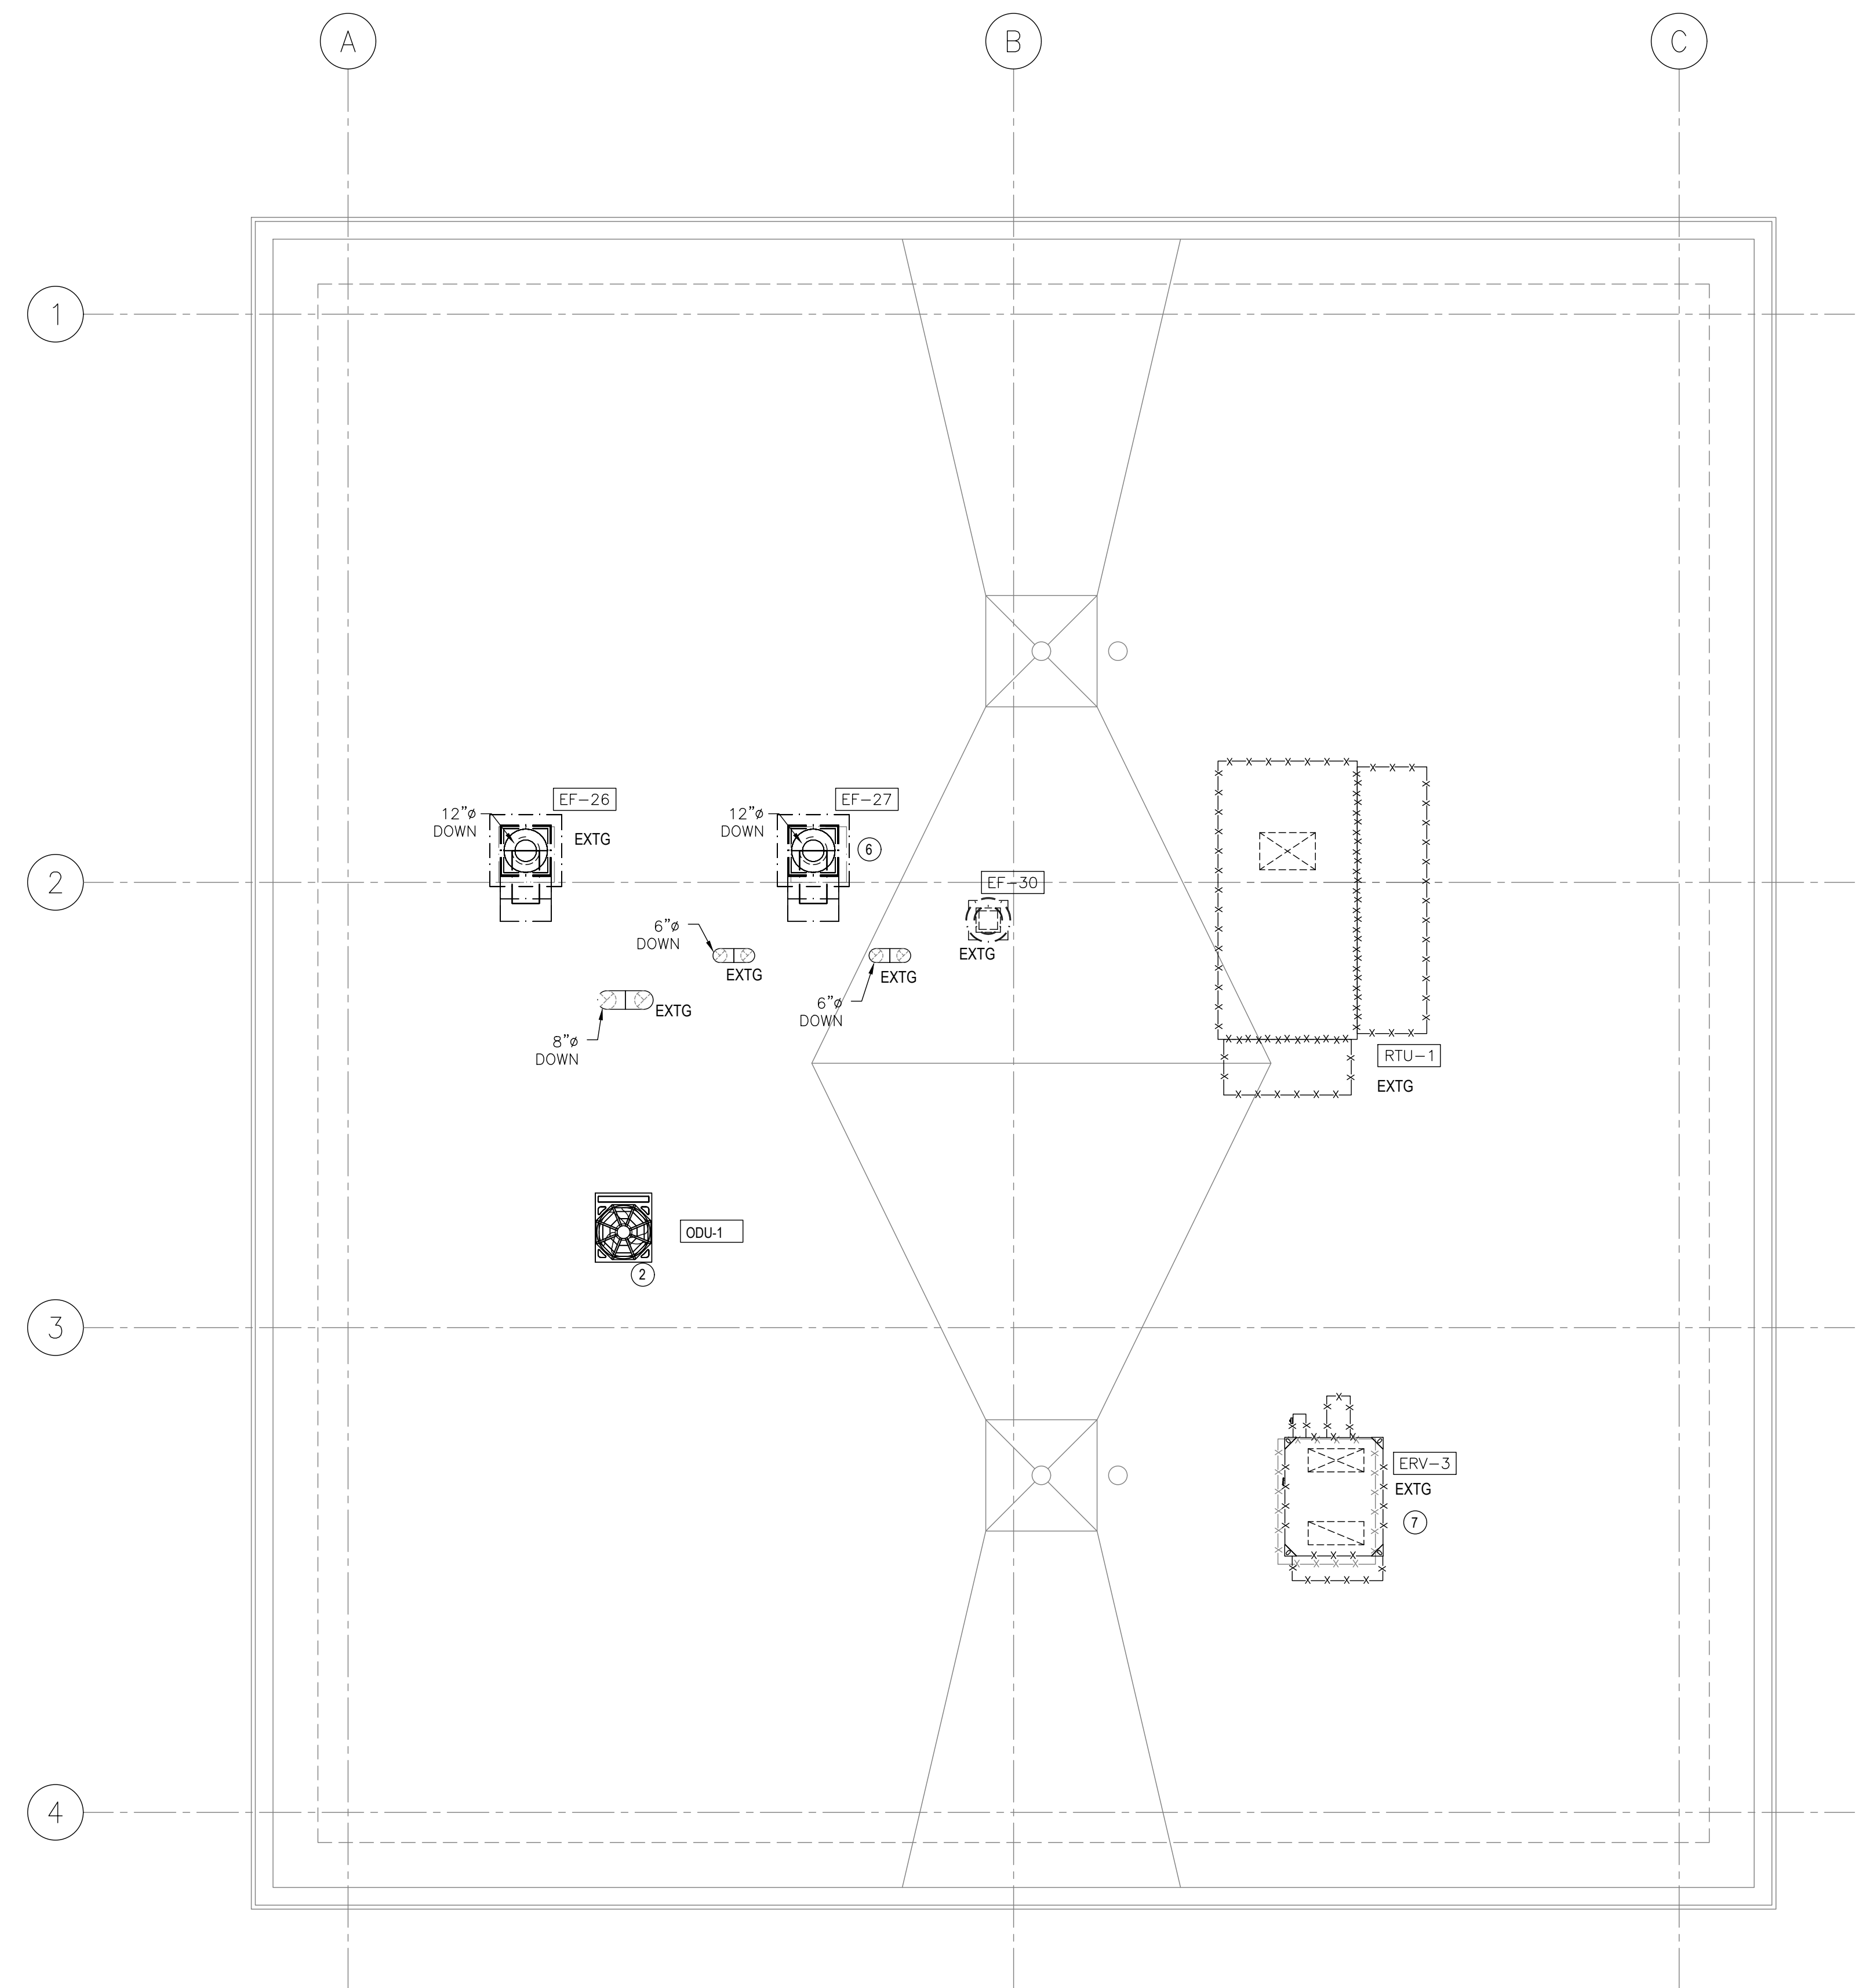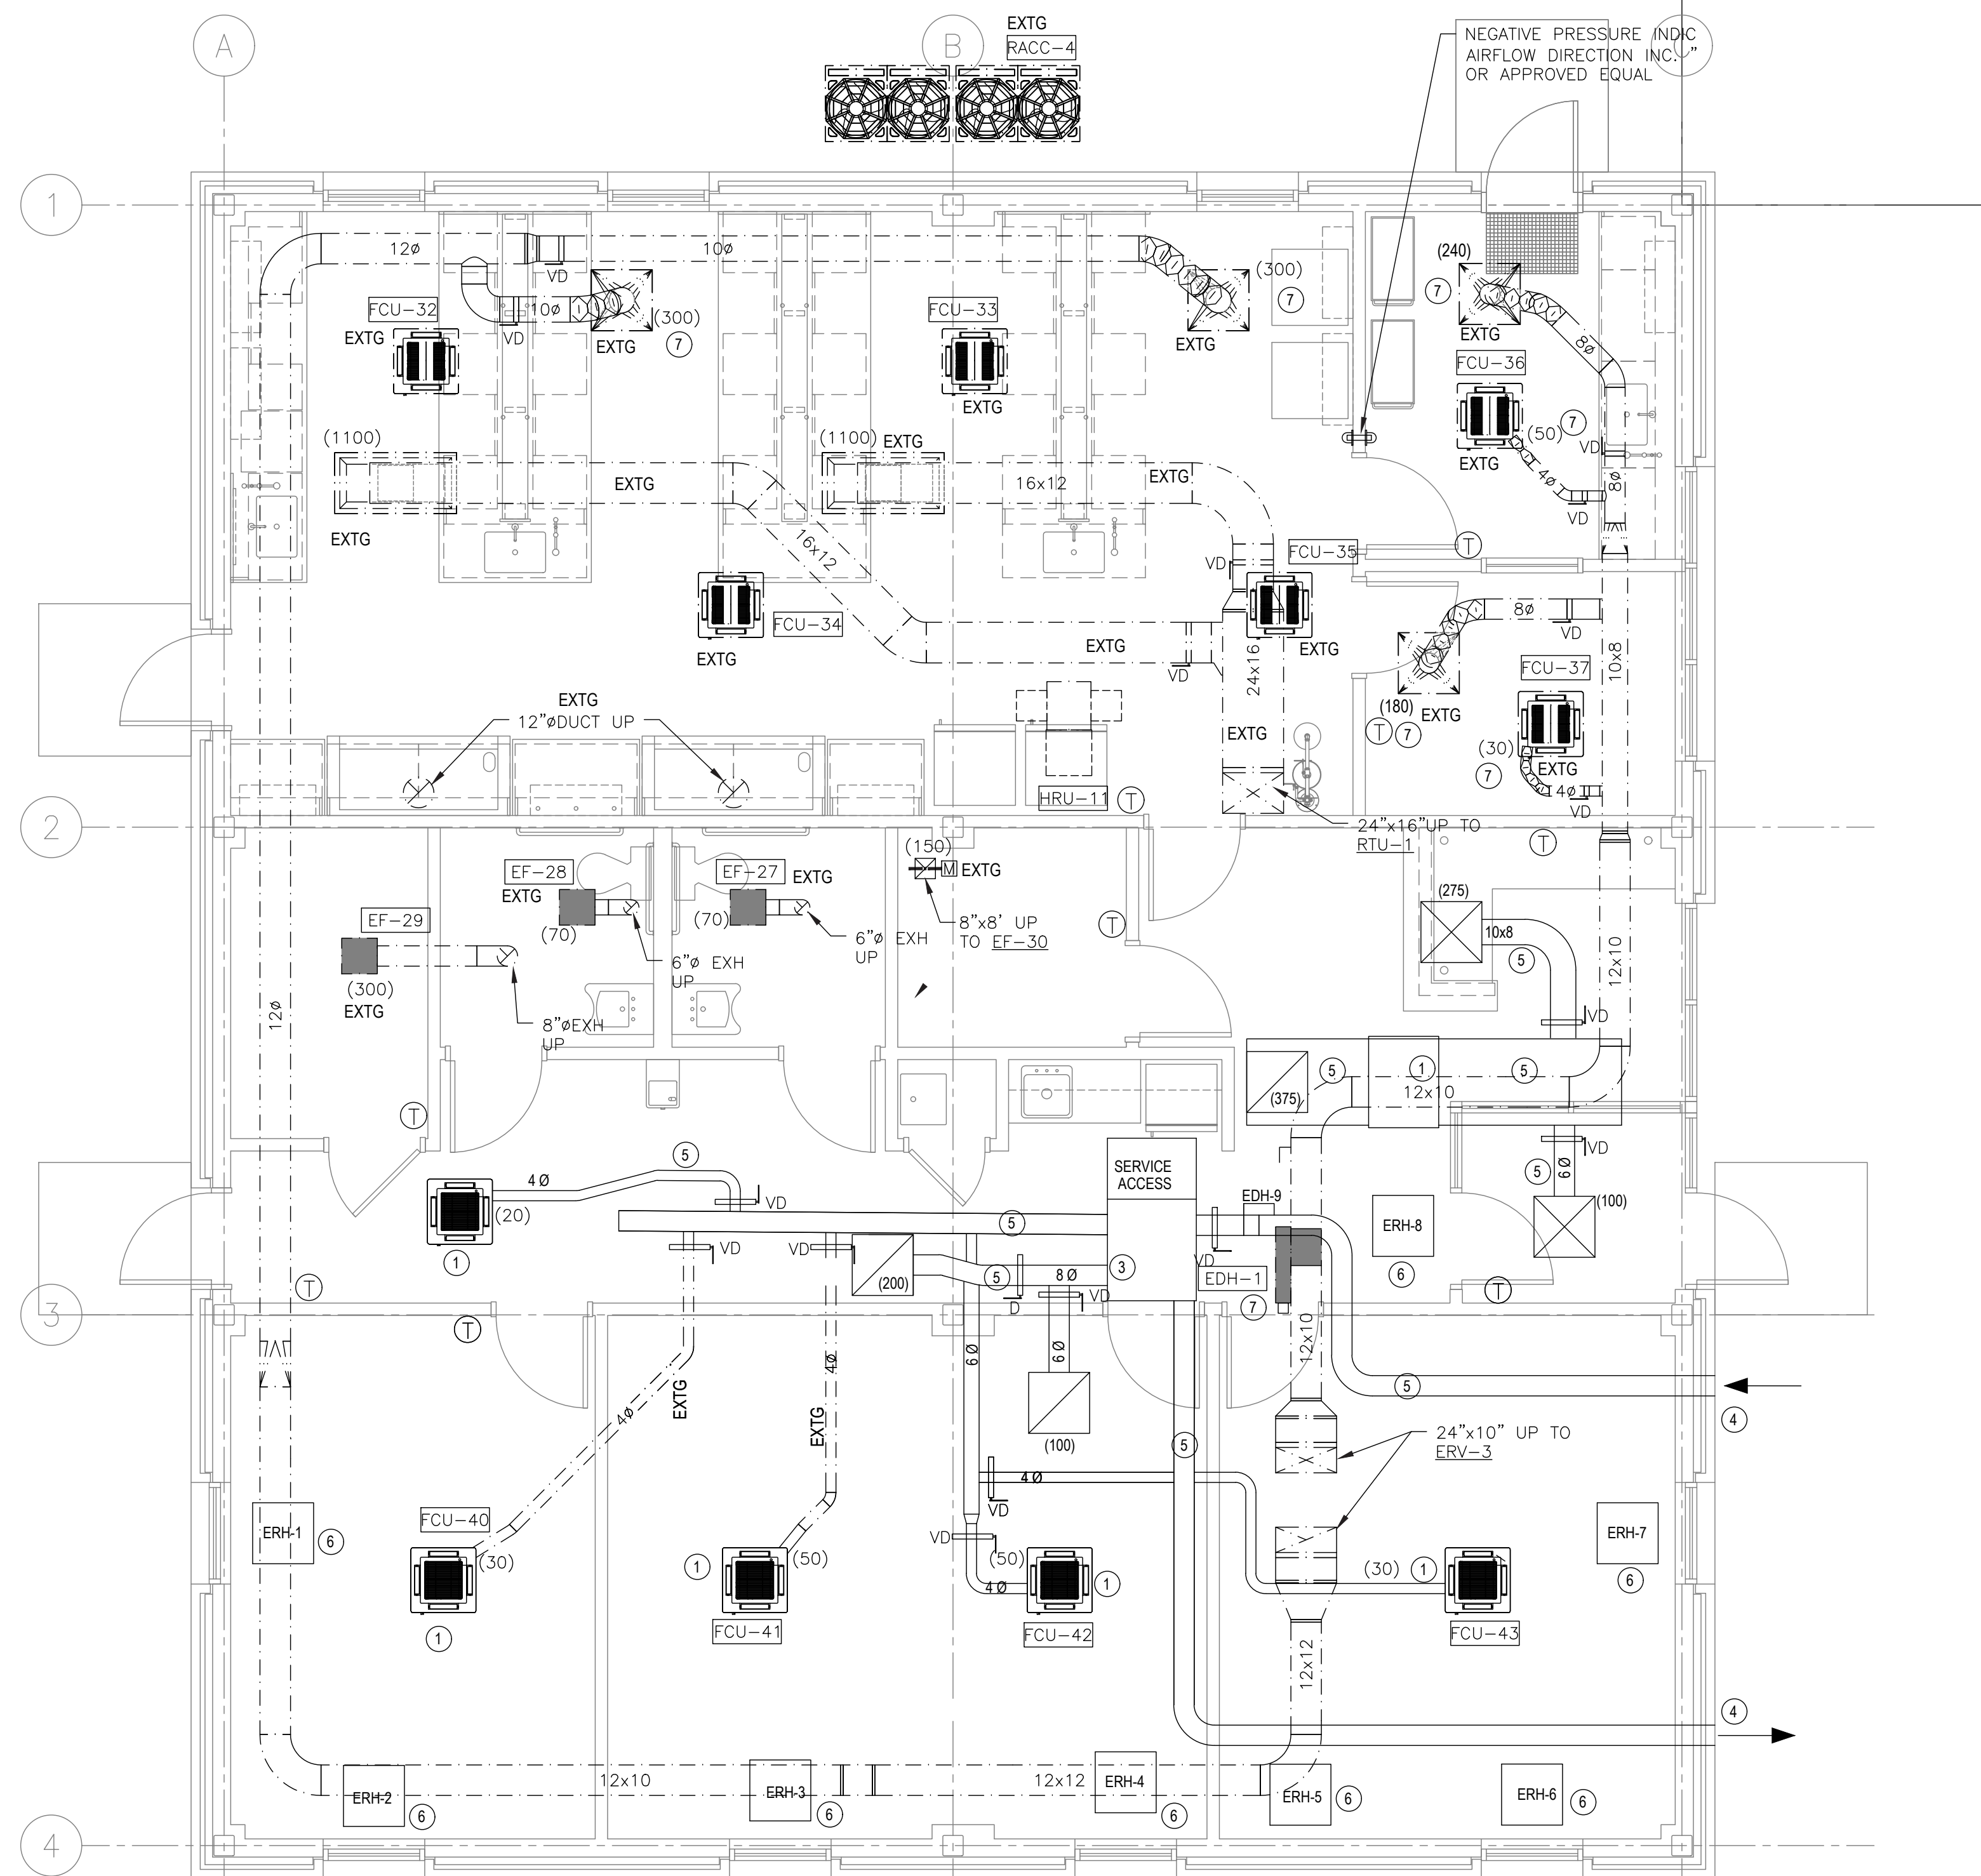

CONSTRUCTION NOTES


- 1 INSTALL VRF SYSTEM INDOOR UNIT, REFRIGERANT LINES AND VENTILATION FLEX DUCT IN ACCORDANCE WITH MANUFACTURER RECOMMENDATIONS AND SERVICE ACCESS REQUIREMENTS
- 2 INSTALL NEW OUTDOOR UNIT AND ASSOCIATED REFRIGERANT LINES
- 3 INSTALL NEW ERV AND DUCTWORK ABOVE CEILING
- 4 INSTALL 18x12 LOUVER, GREENHECK ESD 435 OR EQUIVELANT. MAINTAIN 10' SEPARATION BETWEEN OA AND RELIEF LOUVERS
- 5 INSTALL DUCTWORK ,FLEXIBLE DUCT, GRILLES AND DIFFUSERS IN APPROXIMATE LOCATION AS DRAFTED. EXACT LOCATIONS TO BE VERIFIED IN FIELD.
- 6 INSTALL ELECTRIC RADIANT CEILING PANEL. USE FAN COIL MANUFACTURERS CONTROLS & RELAY TO CONTROL ELECTRIC HEAT.
- 7 REBALANE AIRFLOW OF EXISTING ERV. MAINTAIN MANUFACTURERS MINIMUM AIR VELOCITY (400 FPM) THROUGH EDH-1 AND AIR FLOW THROUGH ERV-3 (500 CFM).

PHASE ONE

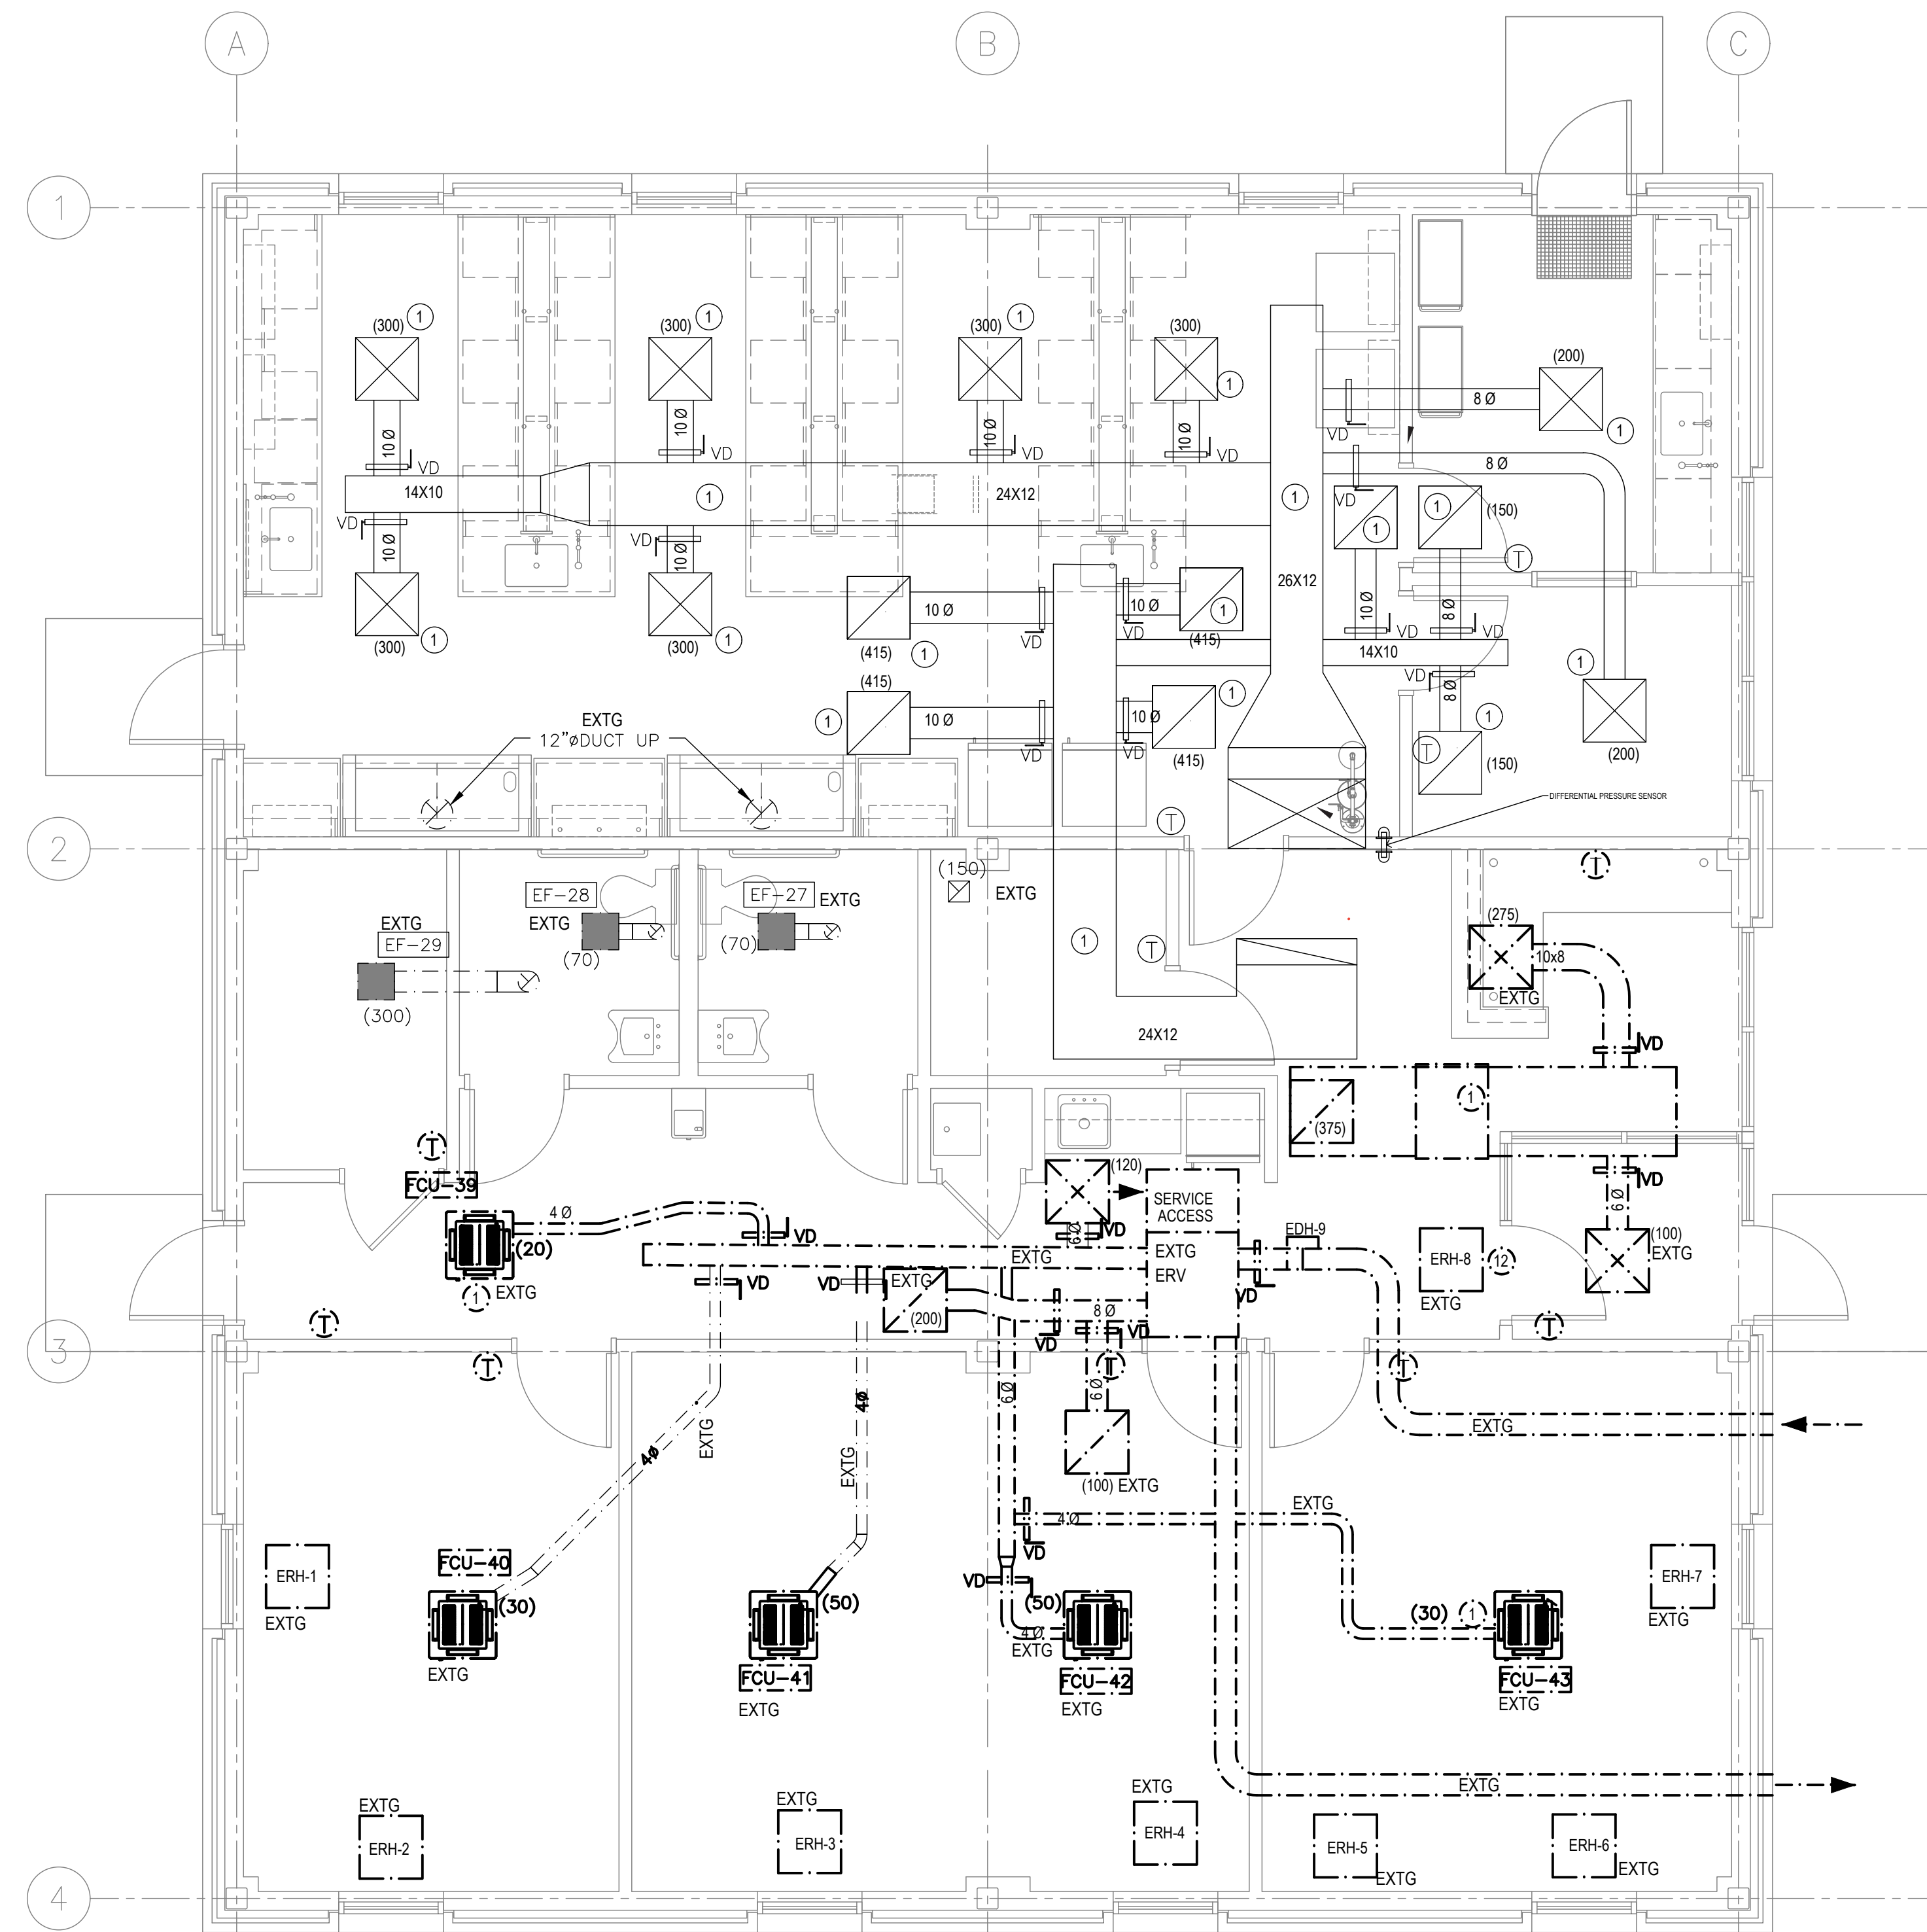

CONSTRUCTION NOTES

- 1 INSTALL DUCTWORK, FLEXIBLE DUCT, GRILLES AND DIFFUSERS IN APPROXIMATE LOCATIONS AS DRAFTED. EXACT LOCATIONS TO BE VERIFIED IN FIELD.
- 2 INSTALL NEW EXHAUST FAN EF-27 ON ROOF
- 3 INSTALL NEW RTU FOR LABORATORY
- 4 INSTALL NEW NATURAL GAS PIPE

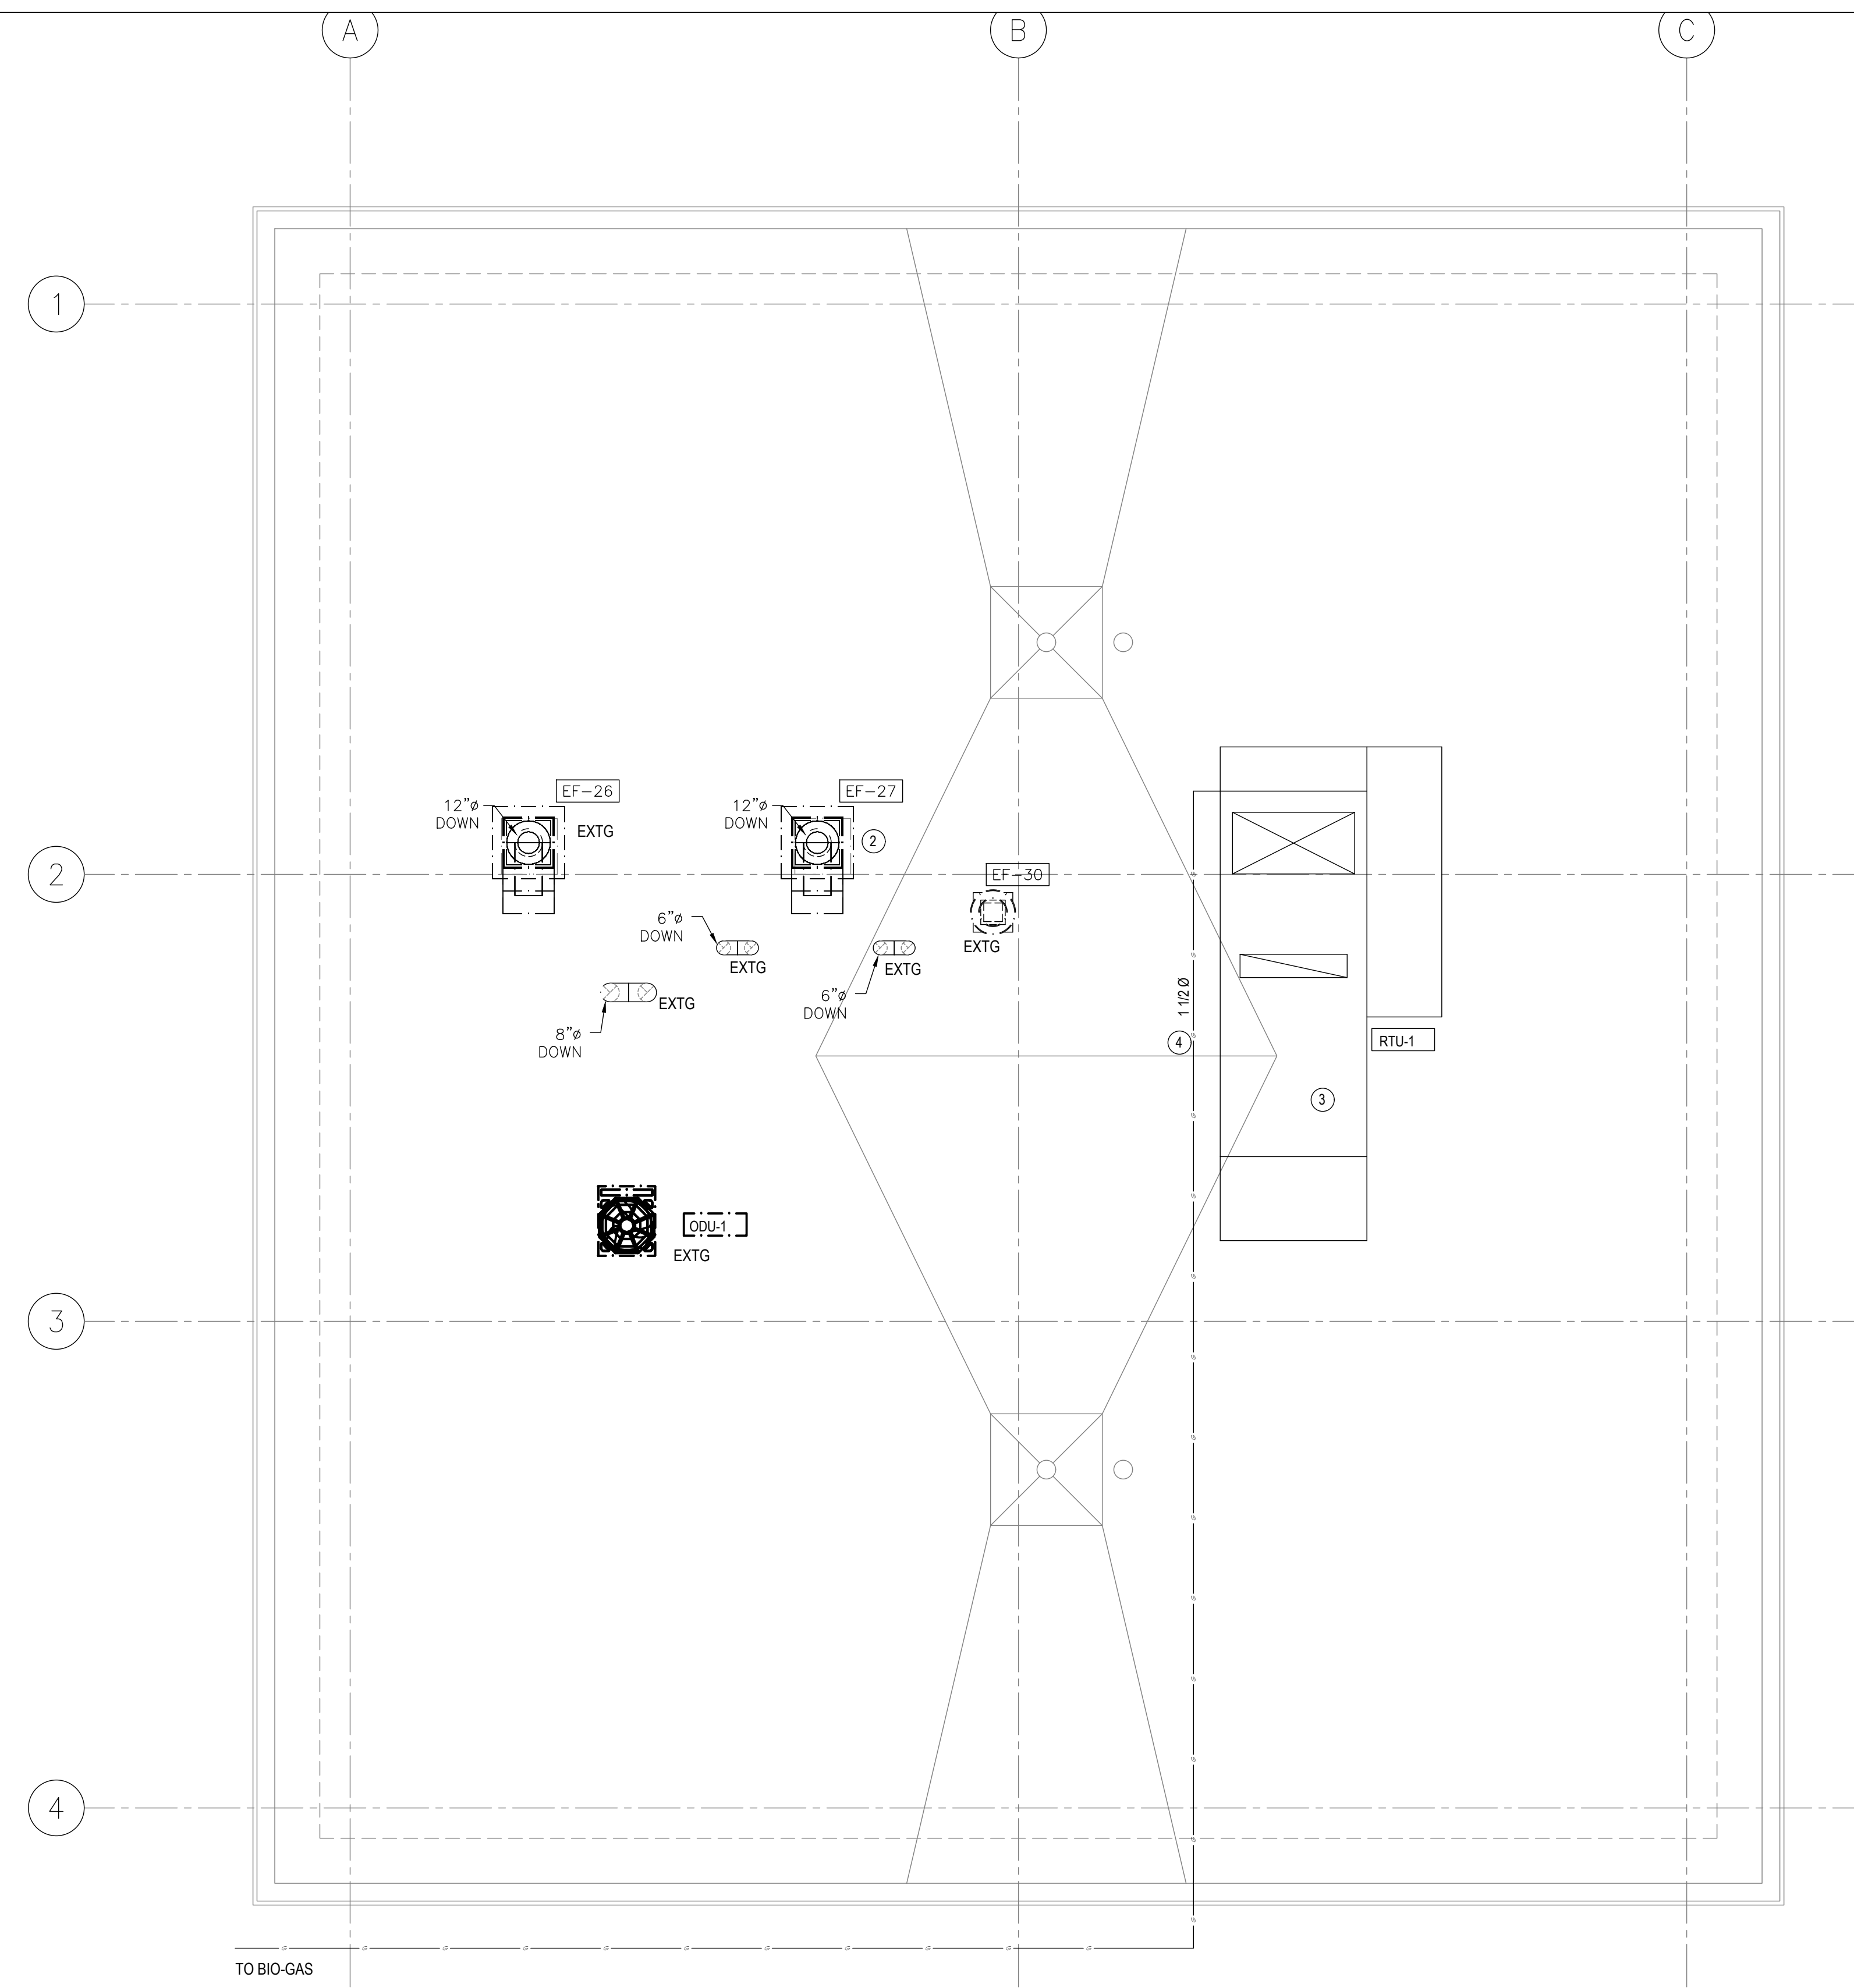

PHASE TWO

FAN COIL UNIT SCHEDULE																					BASED ON MITSUBISHI	
INDOOR UNITS																						NOTES
INDOOR UNITS	MANUFACTURER & MODEL	TYPE	AREA SERVED	SUPPLY FAN			COOLING CAPACITY @ 81DB@WB, 55°AMB		HEATING CAPACITY @ 45° OUTDOOR		ELECTRICAL		REFRIG LINES SIZE LIQ / GAS		FILTERS		NET WEIGHT (LB)	MAX DBA AT FAN SPEED	REFRIGERANT	..		
				PEAK CFM	ESP (IN WG)	DRIVE	NOMINAL (MBH)	SENSIBLE (MBH)	NOMINAL (MBH)	INDOOR (DEG F)	VOLTS/PHS	MCA	MOCP	(INCH)	TYPE	CLEAN ΔP (IN WG)						
FCU-38	SEZ-AD12NL	CEILING CONCEALED	RECEPTION	335	NA	DIRECT	12.0	--	13.5	68	208/230/1	0.29	15	1/4 / 1/2	PP HC0MB	--	31.3	34	R-454B	1,2,3,4,5,6,7,8		
FCU-39	PLFY-P12NFMU-ER1.TH	CASSETTE	CORRIDOR	335	NA	DIRECT	12.0	--	13.5	68	208/230/1	0.29	15	1/4 / 1/2	PP HC0MB	--	31.3	34	R-454B	1,2,3,4,5,6,7		
FCU-40	PLFY-P12NFMU-ER1.TH	CASSETTE	ASST SUPER	335	NA	DIRECT	12.0	--	13.5	68	208/230/1	0.29	15	1/4 / 1/2	PP HC0MB	--	31.3	34	R-454B	1,2,3,4,5,6,7,8		
FCU-41	PLFY-P12NFMU-ER1.TH	CASSETTE	CONFERENCE	335	NA	DIRECT	12.0	--	13.5	68	208/230/1	0.29	15	1/4 / 1/2	PP HC0MB	--	31.3	34	R-454B	1,2,3,4,5,6,7,8		
FCU-42	PLFY-P12NFMU-ER1.TH	CASSETTE	CONFERENCE	335	NA	DIRECT	12.0	--	13.5	68	208/230/1	0.29	15	1/4 / 1/2	PP HC0MB	--	31.3	34	R-454B	1,2,3,4,5,6,7,8		
FCU-43	PLFY-P15NFMU-ER1.TH	CASSETTE	PLANT SUPER	390	NA	DIRECT	15.0	--	17.0	68	208/230/1	0.35	15	1/4 / 1/2	PP HC0MB	--	31.3	39	R-454B	1,2,3,4,5,6,7,8		
																				1,2,3,4,5,6,7,8		
																				1,2,3,4,5,6,7,8		
																				1,2,3,4,5,6,7,8		
																				1,2,3,4,5,6,7,8		

- NOTES:
1. FURNISH WITH DISCONNECT SWITCH.
 2. FURNISH WITH CONDENSATE PUMP. RE-USE EXISTING CONDENSATE DRAINS.
 3. PROVIDE SHUTT OFF VALVES FOR EACH LIQUID AND GAS LINE CONNECTION TO FAN COIL UNITS.
 4. PROVIDE OUTDOOR VENTILATION AIR INDICATED ON DRAWING.
 5. FURNISH EACH SYSTEM WITH MANUFACTURER'S BACNET ZONE CONTROLLERS AND MASTER CONTROLLER CAPABLE OF HEATING / COOLING AUTO-CHANGE-OVER. ALL CONTROL POINTS SHALL BE ADDRESSABLE THROUGH THE BMS.
 6. PIPE SIZES AND SYSTEM CONFIGURATION SHALL BE PER MANUFACTURER'S REQUIREMENTS AND APPROVED SUBMITTAL. SUBMIT PIPING LAYOUT AS PART OF SYSTEM SUBMITTAL INCLUDING PIPE SIZES AND TOTAL REFRIGERANT CHARGE.
 7. PROVIDE MANUFACTURERS RECOMMENDED AXIL MITIGATION VALVE. PROVIDE ASHRAE 15 COMPLIANCE CALCULATIONS.
 8. PROVIDE MANUFACTURERS RELAY TO CONTROL CEILING RADIANT HEAT.

OUTDOOR VRF UNITS										BASED ON MITSUBISHI	
TAG	AREA SERVED	MAKE/MODEL	REFRIGERANT	COOLING CAPACITY (BTU/HR)	HEATING CAPACITY (BTU/HR)	ELECTRICAL		NOTES			
						VOLTS (Ø)	MCAMCOP				
ODU-1	FAN COIL UNITS	MXZ-SM4BNLHZ	R-454B	48,000	54,000	460/3	5196	1,2,3,4,5,6			
								1,2,3,4,5,6			
								1,2,3,4,5,6			
								1,2,3,4,5,6			

- NOTES:
1. NOMINAL COOLING CAPACITIES ARE BASED ON INDOOR COIL EAT OF 80/67°F (DBWB), OUTDOOR OF 95°(DB)
 2. NOMINAL HEATING CAPACITIES ARE BASED ON INDOOR COIL EAT OF 70°F (DB), OUTDOOR OF 47° (WB)
 3. PROVIDE HYPER-HEATING MODEL. COOLING OPERATING RANGE 23-126°F, HEATING OPERATING RANGE -22-80°F
 4. PROVIDE MANUFACTURERS SNOWGUARDS AND STAND
 5. INSTALL AND CHARGE IN ACCORDANCE WITH MANUFACTURERS INSTRUCTIONS AND PIPING LAYOUT
 6. FACTORY REPRESENTATIVES SHALL REVIEW THE PROJECT PRIOR TO AND THROUGHOUT THE INSTALLATION OF CITY MULTI EQUIPMENT

ERV SCHEDULE												
TAG	AREA SERVED	MAKE	MODEL	CFM	ESP (\"WG)	EXCHANGE EFFICIENCY COOLING ENTHALPY	EXCHANGE EFFICIENCY HEATING ENTHALPY	ELECTRICAL		LXWH	WEIGHT (LBS)	NOTES
								V / ØHZ	MCAMCOP			
ERV-1	OFFICES	MITSUBISHI LOSSNAY	LGH-F300RVQ2-E	75-150-225-300	.06-.25-.55-1.0	85.0-90.0-93.5-95.0	81.5-74.0-66.5-60.0	208-230/160	4.3/15	34.5X40X13.1	75	1

- NOTES:
1. FURNISH WITH DISCONNECT SWITCH.

ELECTRIC UNIT HEATER SCHEDULE											
TAG	AREA SERVED	MAKE/MODEL	OUTPUT (WATTS)	LXWH (INCHES)	WEIGHT (LBS)	ELECTRICAL		NOTES			
						V / Ø	-				
ERH-1	ASSISTANT SUPERINTENDENT	INDEECOIAS2424 -375-120	375	24X24X2	15	120 / 1	-				
ERH-2	ASSISTANT SUPERINTENDENT	INDEECOIAS2424 -375-120	375	24X24X2	15	120 / 1	-				
ERH-3	CONFERENCE ROOM	INDEECOIAS2424 -375-120	375	24X24X2	15	120 / 1	-				
ERH-4	CONFERENCE ROOM	INDEECOIAS2424 -375-120	375	24X24X2	15	120 / 1	-				
ERH-5	SUPERINTENDENT	INDEECOIAS2424 -375-120	375	24X24X2	15	120 / 1	-				
ERH-6	SUPERINTENDENT	INDEECOIAS2424 -375-120	375	24X24X2	15	120 / 1	-				
EUH-7	SUPERINTENDENT	INDEECOIAS2424 -375-120	375	24X24X2	15	120 / 1					
EUH-8	RECEPTION/WAITING	INDEECOIAS2424 -375-120	375	24X24X2	15	120 / 1					
EDH-9	ERV/CEILING	INDEECOIQUA-208	3000	-	-	208 / 1					

- NOTES:

Project Title:
HVAC UPGRADES TO:
ADMINISTRATION BUILDING
1325 CHESHIRE STREET CHESHIRE,
CONNECTICUT 06410



SILVER PETRUCELLI + ASSOCIATES
3190 WHITNEY AVENUE HAMDEN CT 06518
311 STATE STREET NEW LONDON CT 06320
203 230 9007 silverpetrucelli.com

Revision:	Description:	Date:	Revised By:
	-	-	

Drawing Title:
MECH SCHEDULES PHASE 1
Project Phase:
DESIGN DOCUMENTS NOT FOR CONSTRUCTION
State Project Number:
XXX-XXXXXXX

Date:
01/16/2026
Scale:
1/8" = 1'-0"
Drawn By:
CL
Project Number:
XX-XXX


M500-1

EXHAUST FAN SCHEDULE									
TAG	AREA SERVED	MAKE/MODEL	CFM	ESP (" WC)	RPM	ELECTRICAL		NOTES	
						V / Ø	MOTOR HP		
EF-27	LABORATORY	GREENHECK VEKTOR-H-9	1250	0.75	3693	480 / 3	2	1,2,3,4	

- NOTES:
1. FURNISH WITH DISCONNECT SWITCH.
 2. FURNISH WITH VARIABLE VOLUME FAN WITH BY-PASS PLENUM AND DAMPER.
 3. PROVIDE EXHAUST DUCT PRESSURE SENSOR AND CONTROLS FOR EXHAUST DUCT PRESSURE CONTROL.
 4. MODULATE BYPASS DAMPER TO MAINTAIN NEGATIVE EXHAUST DUCT PRESSURE OF ____ (ADJUSTABLE).
 5. PROVIDE WITH INSULATED ROOF CURB.


PACKAGED ROOFTOP AIR CONDITIONING UNIT SCHEDULE WITH ENERGY RECOVERY WHEEL (LABORATORY)																																											
SYMBOL	MODEL	SUPPLY FAN				EXHAUST FAN					MIN/MAX OUTSIDE AIR (CFM)	COOLING (DX R-454B)				HEATING (BIOGAS)					ERV DATA SUMMER CONDITIONS								ERV DATA WINTER CONDITIONS								ELECTRICAL				PHYSICAL		NOTES
		TOTAL CFM	MDA CFM	HP	RPM	ESP	TSP	BHP	HP	RPM		ESP	TSP	GROSS CAPACITY TOTAL (MBH)	EAT DB-WB (°F)	AMBIENT (°F)	INPUT MBH	OUTPUT MBH	EAT db-°F	LAT db-°F	AMBIENT (°F)	VENT. SUPPLY CFM/DB/WB/PO (IN-H2O)	OUTSIDE AIR CFM/DB/WB	RETURN SUPPLY CFM/DB/WB/ESP	EXHAUST SUPPLY CFM/DB/WB/ERV PD	VENT. SUPPLY CFM/DB/WB/PO (IN HD)	OUTSIDE AIR CFM/DB/WB	RETURN SUPPLY CFM/DB/WB/ESP	EXHAUST SUPPLY CFM/DB/WB/ERV PD	VOLTSØ	MCA	FLA	MOCP	LXWLH (INCHES)	WEIGHT LBS								
RTU-1	QADG012C3	2500	240	2.0	2346	-	-	-	2.0	1809	-	-	250/2500	134.1	86.5	80.6/87.2	95	150	120	48.6	92.8	-	2500/80.6/67.2/1.13	2712/95/74	2500/75/64/1.0	2712/89.3/71.4/1.12	2500/48.6/44.2/1.13	2712/200	2500/70/58/1.0	2712/21.6/21.5/1.12		460/3	32.1	29.8	40.0	212.61X99.26X69.57	3986	1,2,3,4,5					

1. BASED ON TRANE.
2. FURNISH UNIT WITH ROOF CURB, MODULATING OA/RA DAMPER WITH ECONOMIZER CONTROL, FACTORY FURNISHED DISCONNECT, SINGLE POINT POWER CONNECTION, MODULATING HOT GAS REHEAT, 439 STAINLESS STEEL FURNACE, VARIABLE SPEED DIRECT DRIVE POWERED EXHAUST, 2 INCH WALL CONSTRUCTION, STAINLESS STEEL DRIP PAN.
3. DUCT MOUNTED SUPPLY AND RETURN SMOKE DETECTORS SHALL BE INSTALLED IN ACCORDANCE WITH IMC AND NFPA-72 REQUIREMENTS.
4. PROVIDE ROOM PRESSURE SENSOR AND CONTROL OUTDOOR AIR PERCENTAGE TO MAINTAIN LABORATORY AT A SLIGHT NEGATIVE PRESSURE RELATIVE TO ADJACENT OFFICES. MAINTAIN MINIMUM OUTSIDE AIRFLOW. CONTRACTOR TO PROGRAM RTU's CONTROLLER TO MAINTAIN ROOM PRESSURE.
5. PROVIDE CORROSION RESISTANT COATING FOR UNIT AND COMPONENTS IN OUTDOOR AIR STREAM.

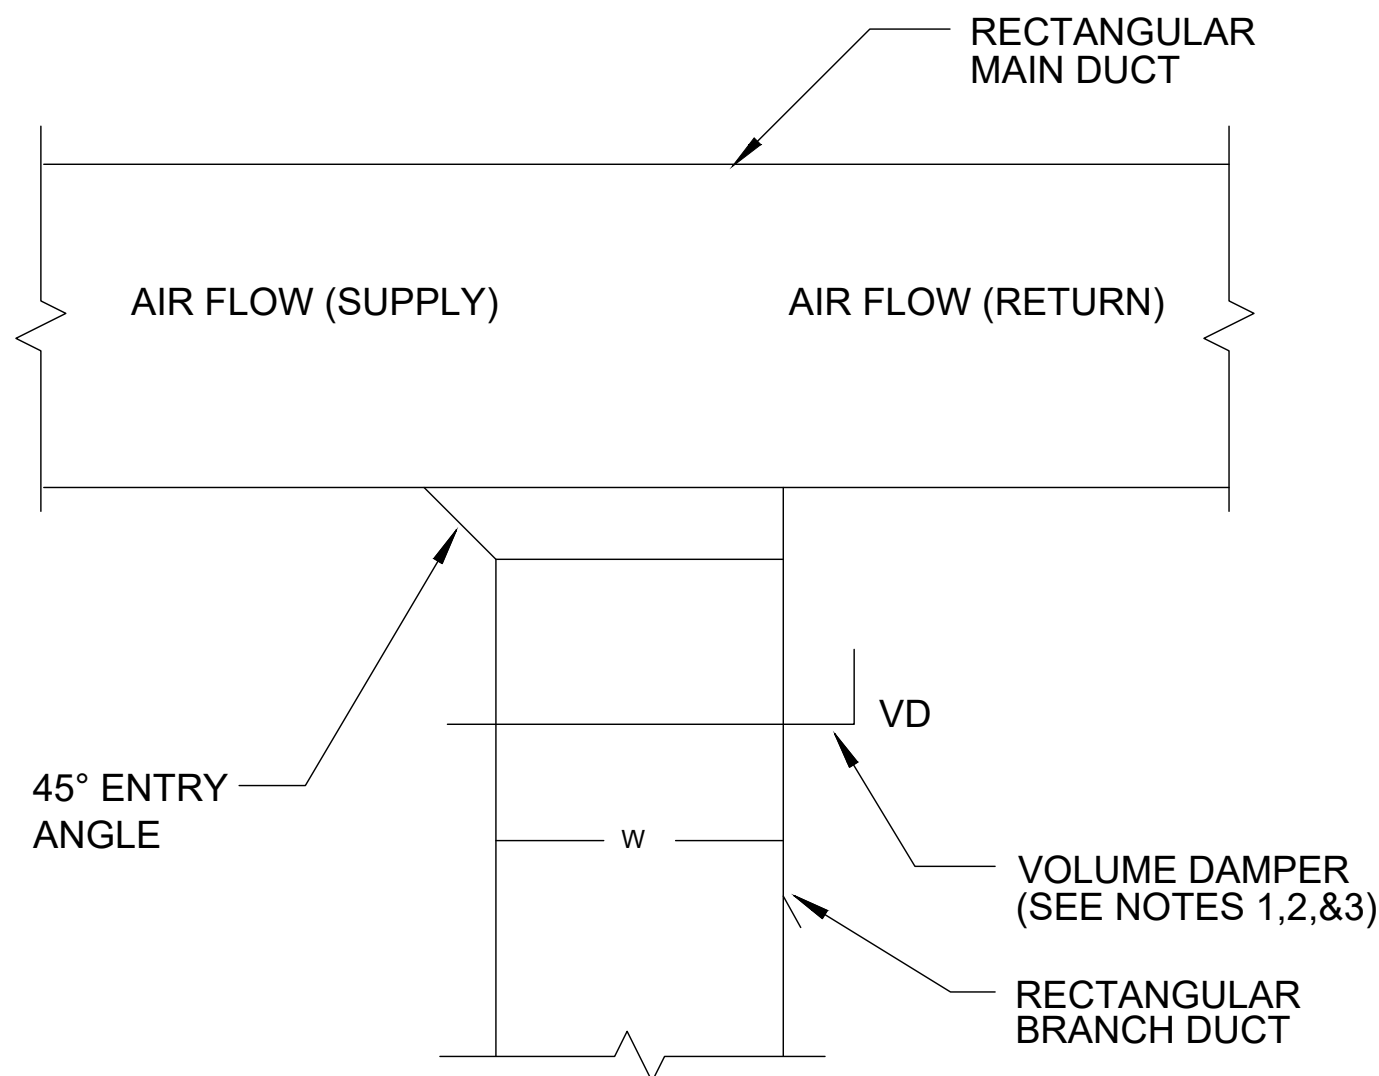


- NOTES:**
- UP TO 1.5 SQ. FT. CROSS SECTIONAL AREA AND NOT EXCEEDING 24" IN WIDTH, USE SINGLE BLADE VOLUME DAMPER.
 - FOR CROSS SECTIONAL AREAS FROM 1.5 TO 3.0 SQ. FT. AND NOT EXCEEDING 24" IN WIDTH, USE 3 SINGLE BLADE VOLUME DAMPERS INDIVIDUALLY OPERATED TO FUNCTION IN AN OPPOSED MANNER.
 - FOR CROSS SECTIONAL AREAS GREATER THAN 3.0 SQ. FT. AND/OR EXCEEDING 24" IN WIDTH, USE GANG OPERATED OPPOSED BLADE VOLUME DAMPER AND FRAME ASSEMBLY.

1 TYPICAL SUPPLY/RETURN DUCT TAKEOFF DETAIL

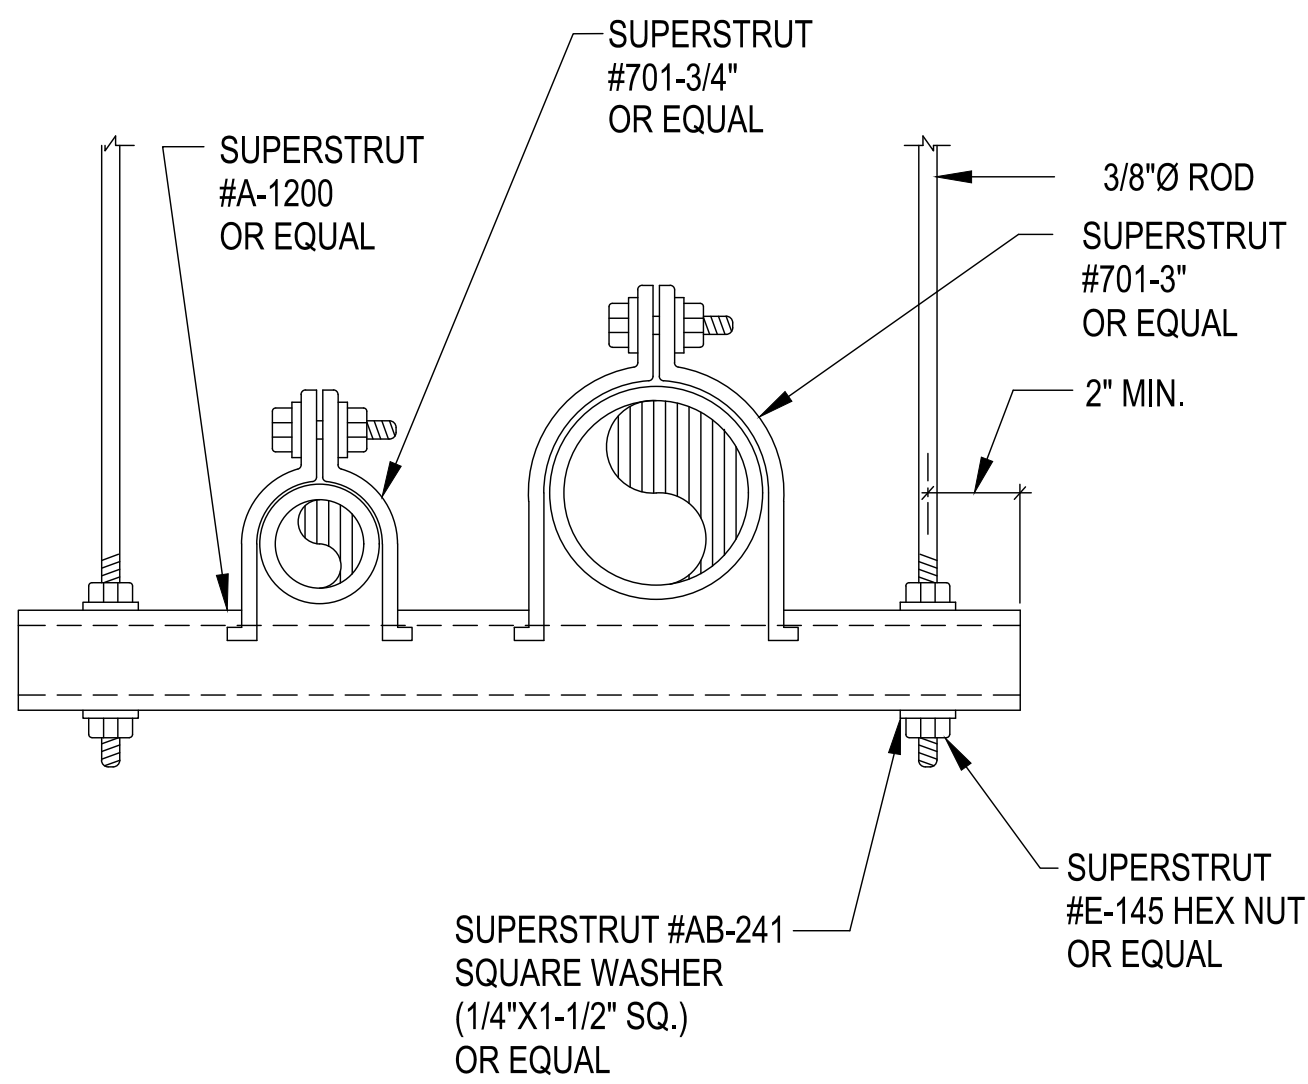


4 TRAPEZE PIPE HANGING DETAIL

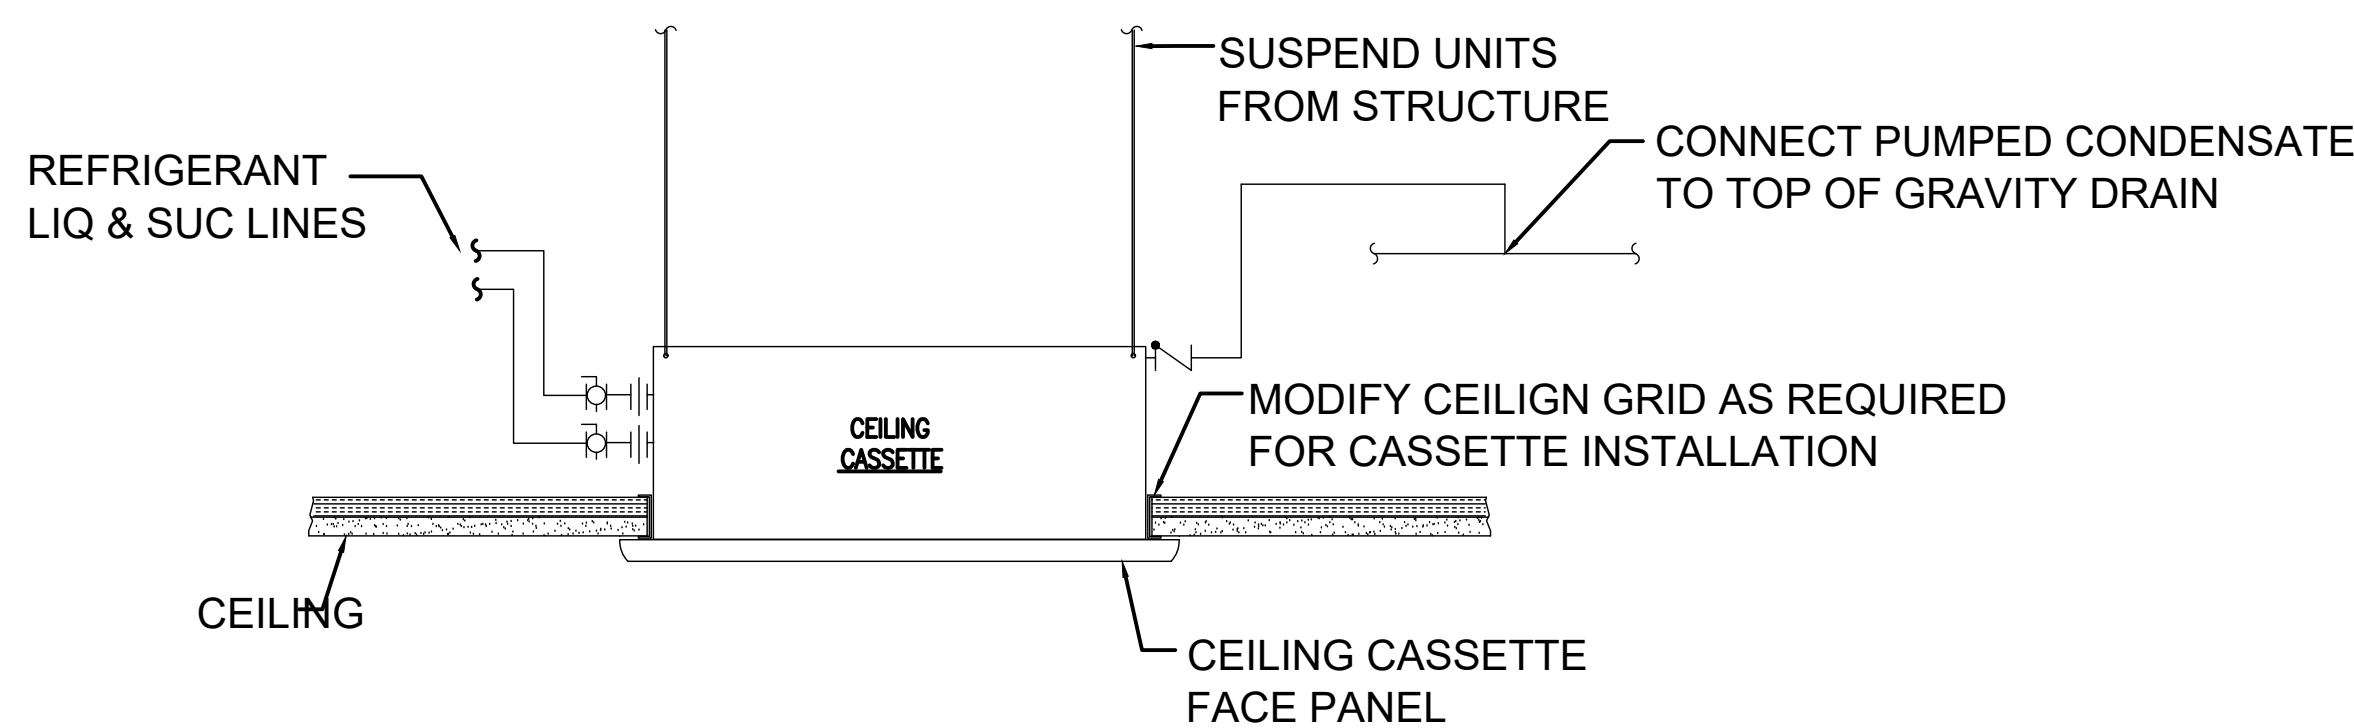


- NOTES:**
- PROVIDE CHECK VALVE AT PUMPED DISCHARGE CONNECT TO CASSETTE.
 - PROVIDE REFRIGERANT LINE ISOLATION VALVES AT CONNECTIONS TO UNIT.


7 VRF CEILING CASSETTE FAN COIL UNIT DETAIL

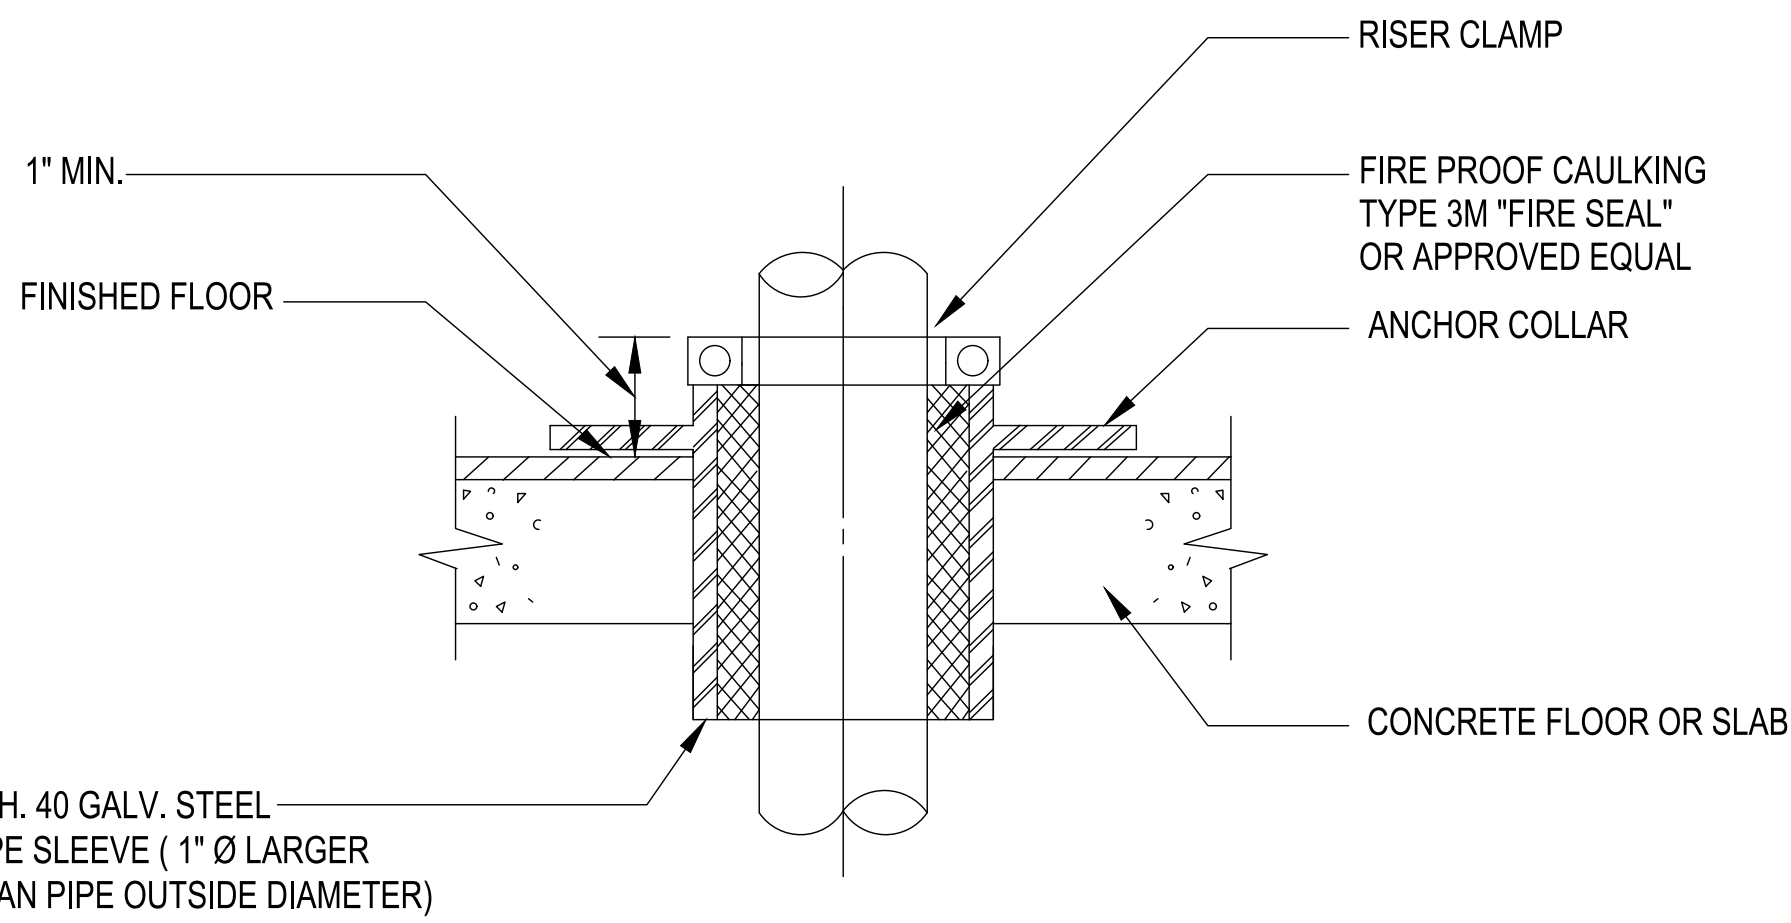


2 PIPE PENETRATION THROUGH FLOOR DETAIL

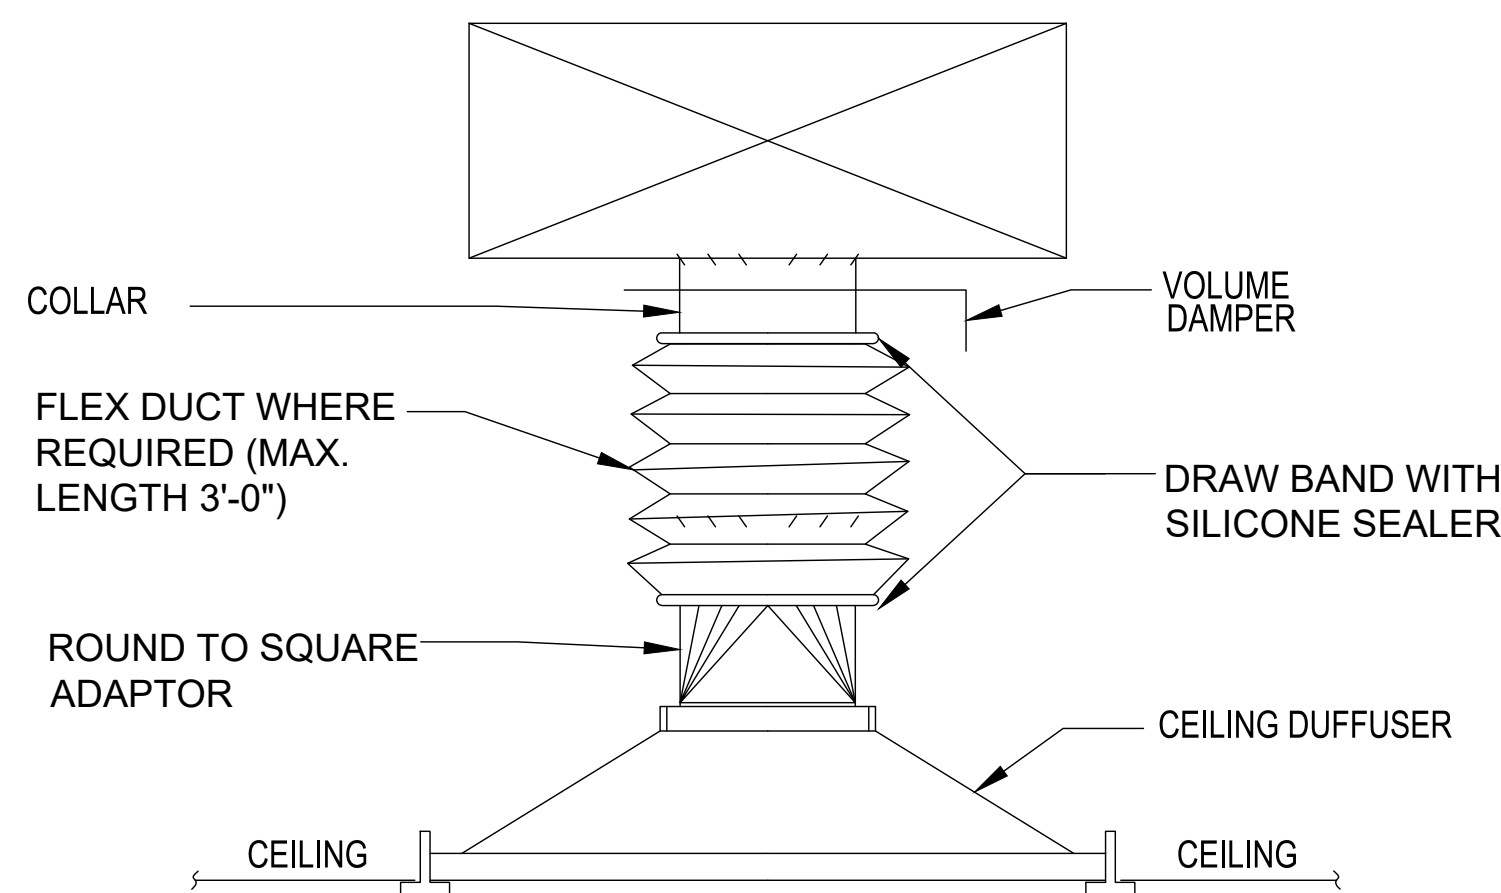


5 TYPICAL DIFFUSER CONNECTION DETAIL

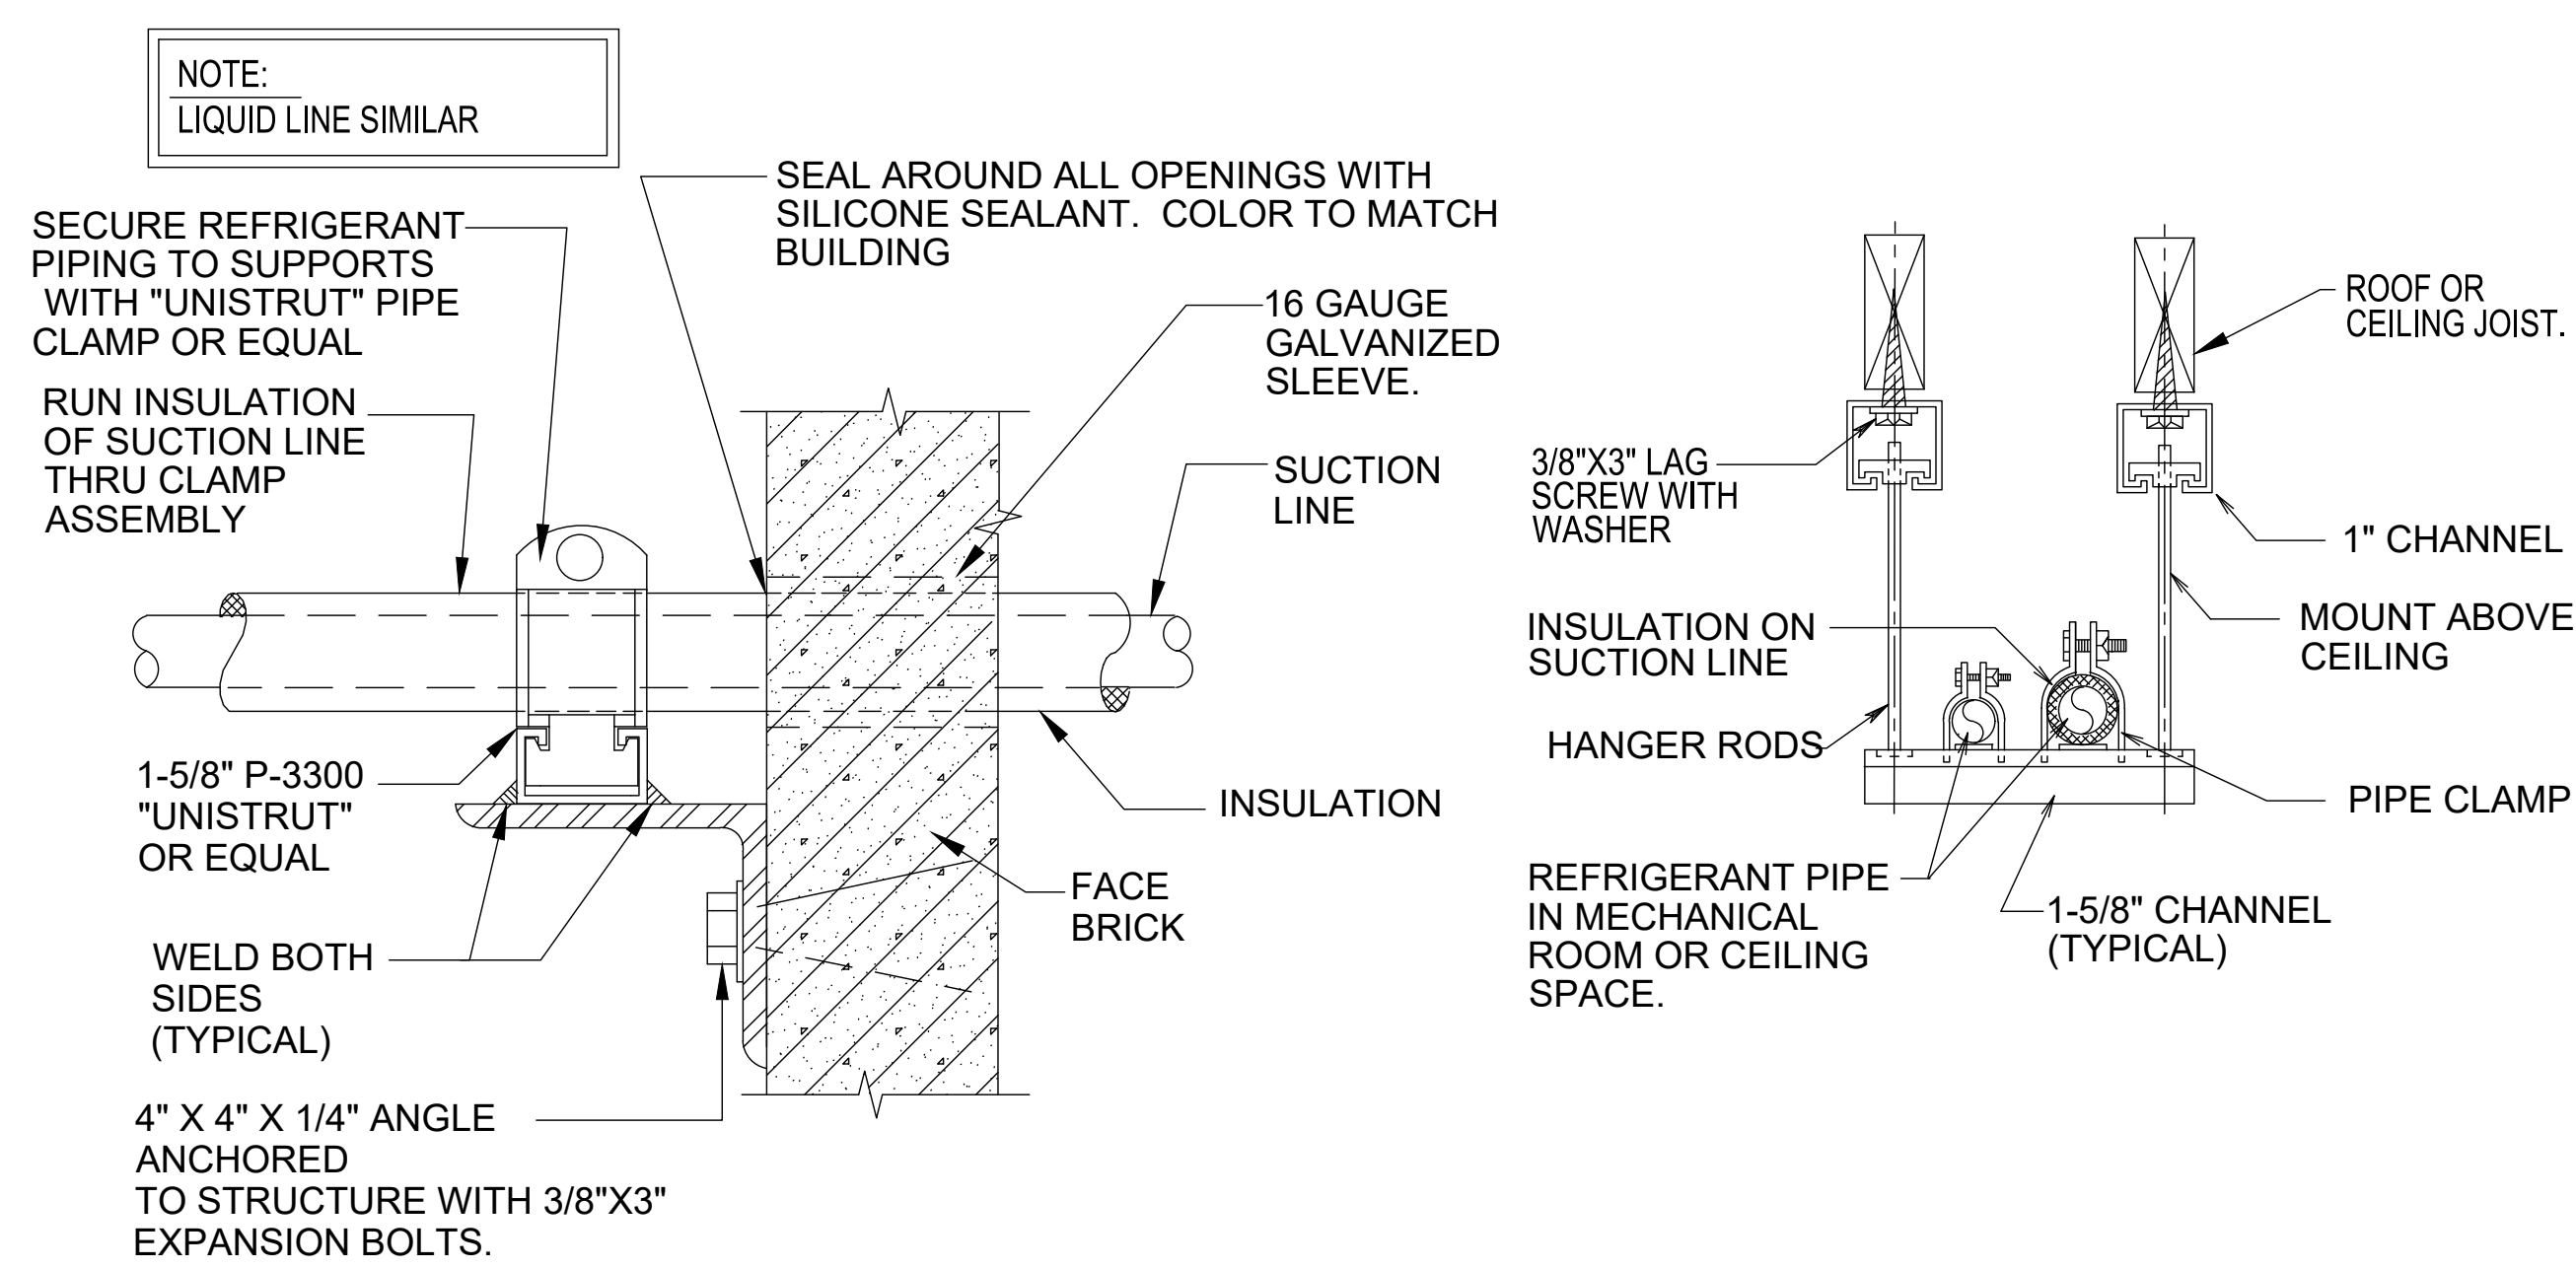

3 REFRIGERANT PIPE SUPPORT DETAIL

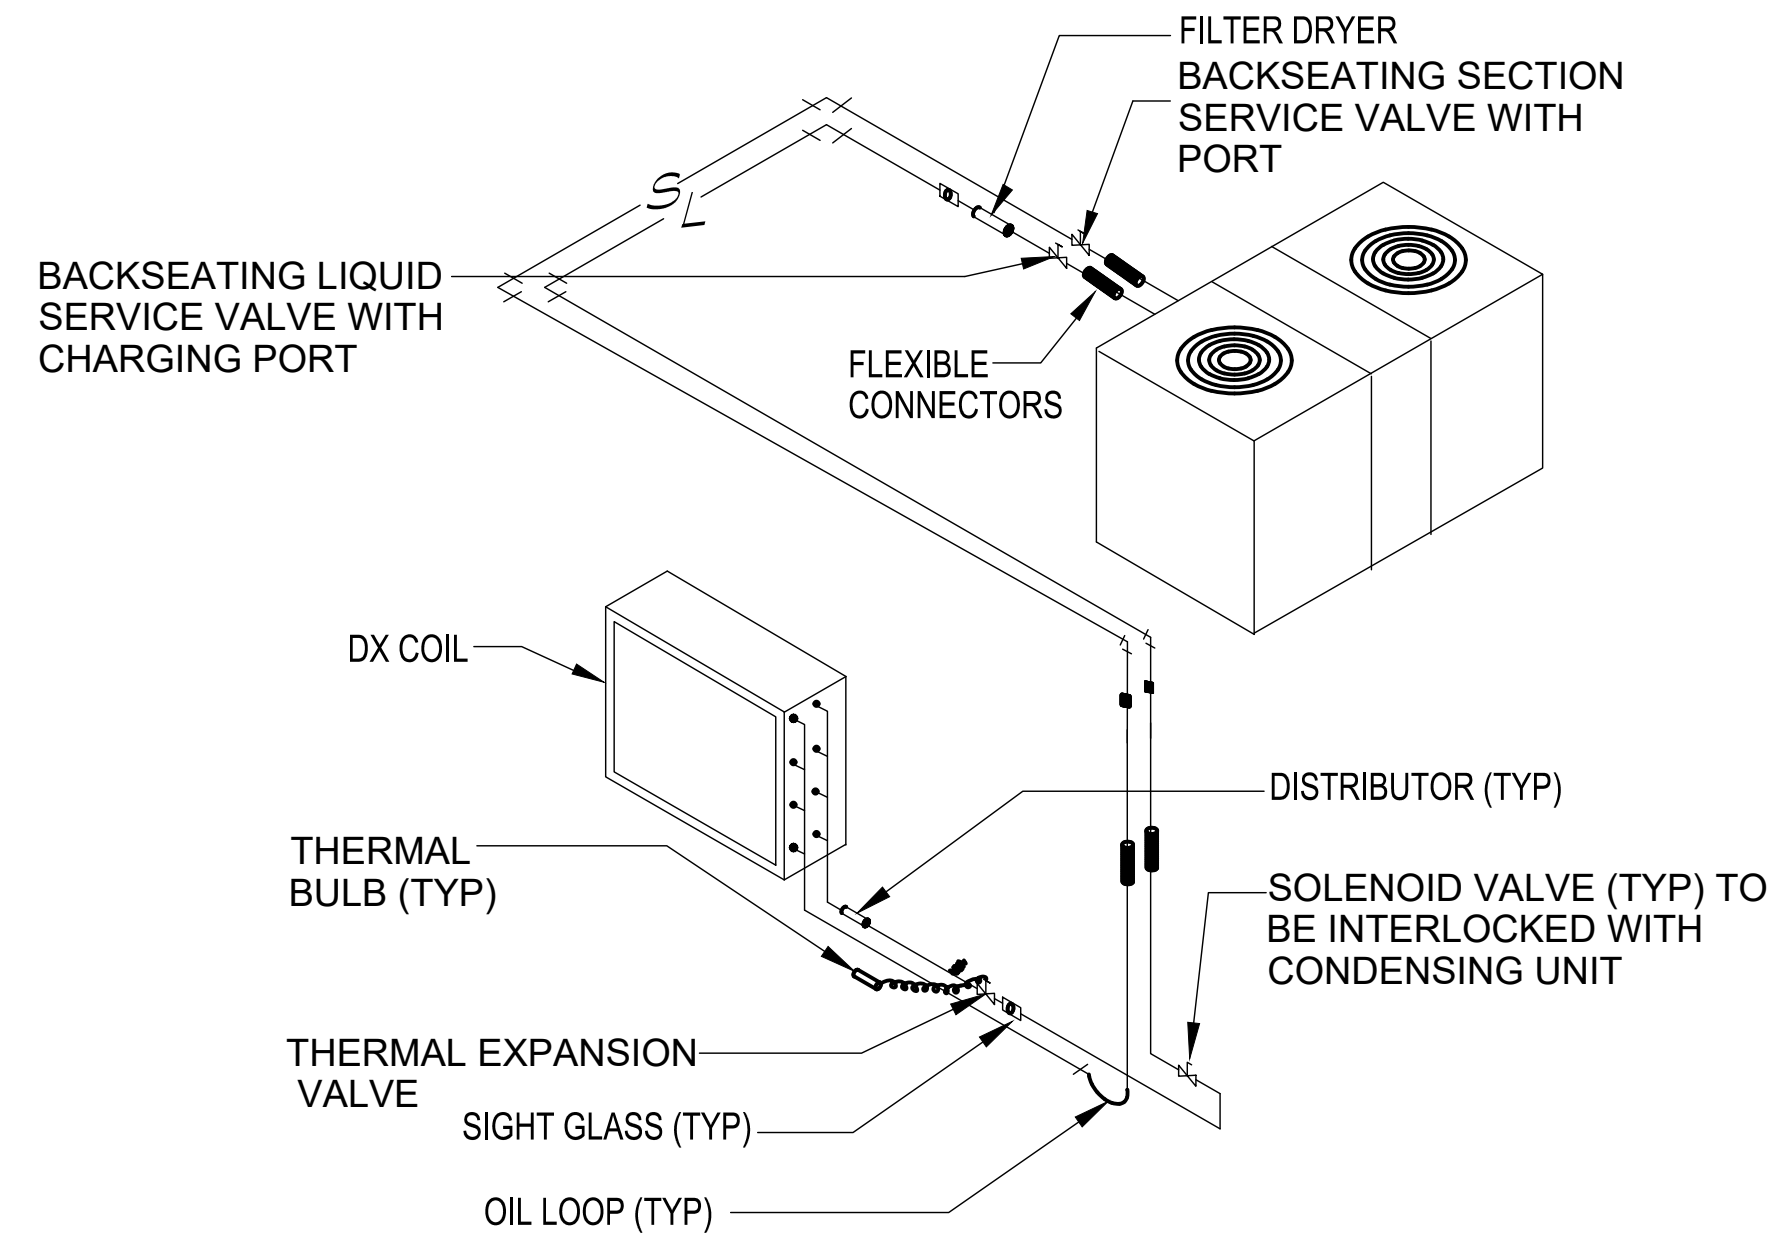

6 REFRIGERANT PIPING DETAIL

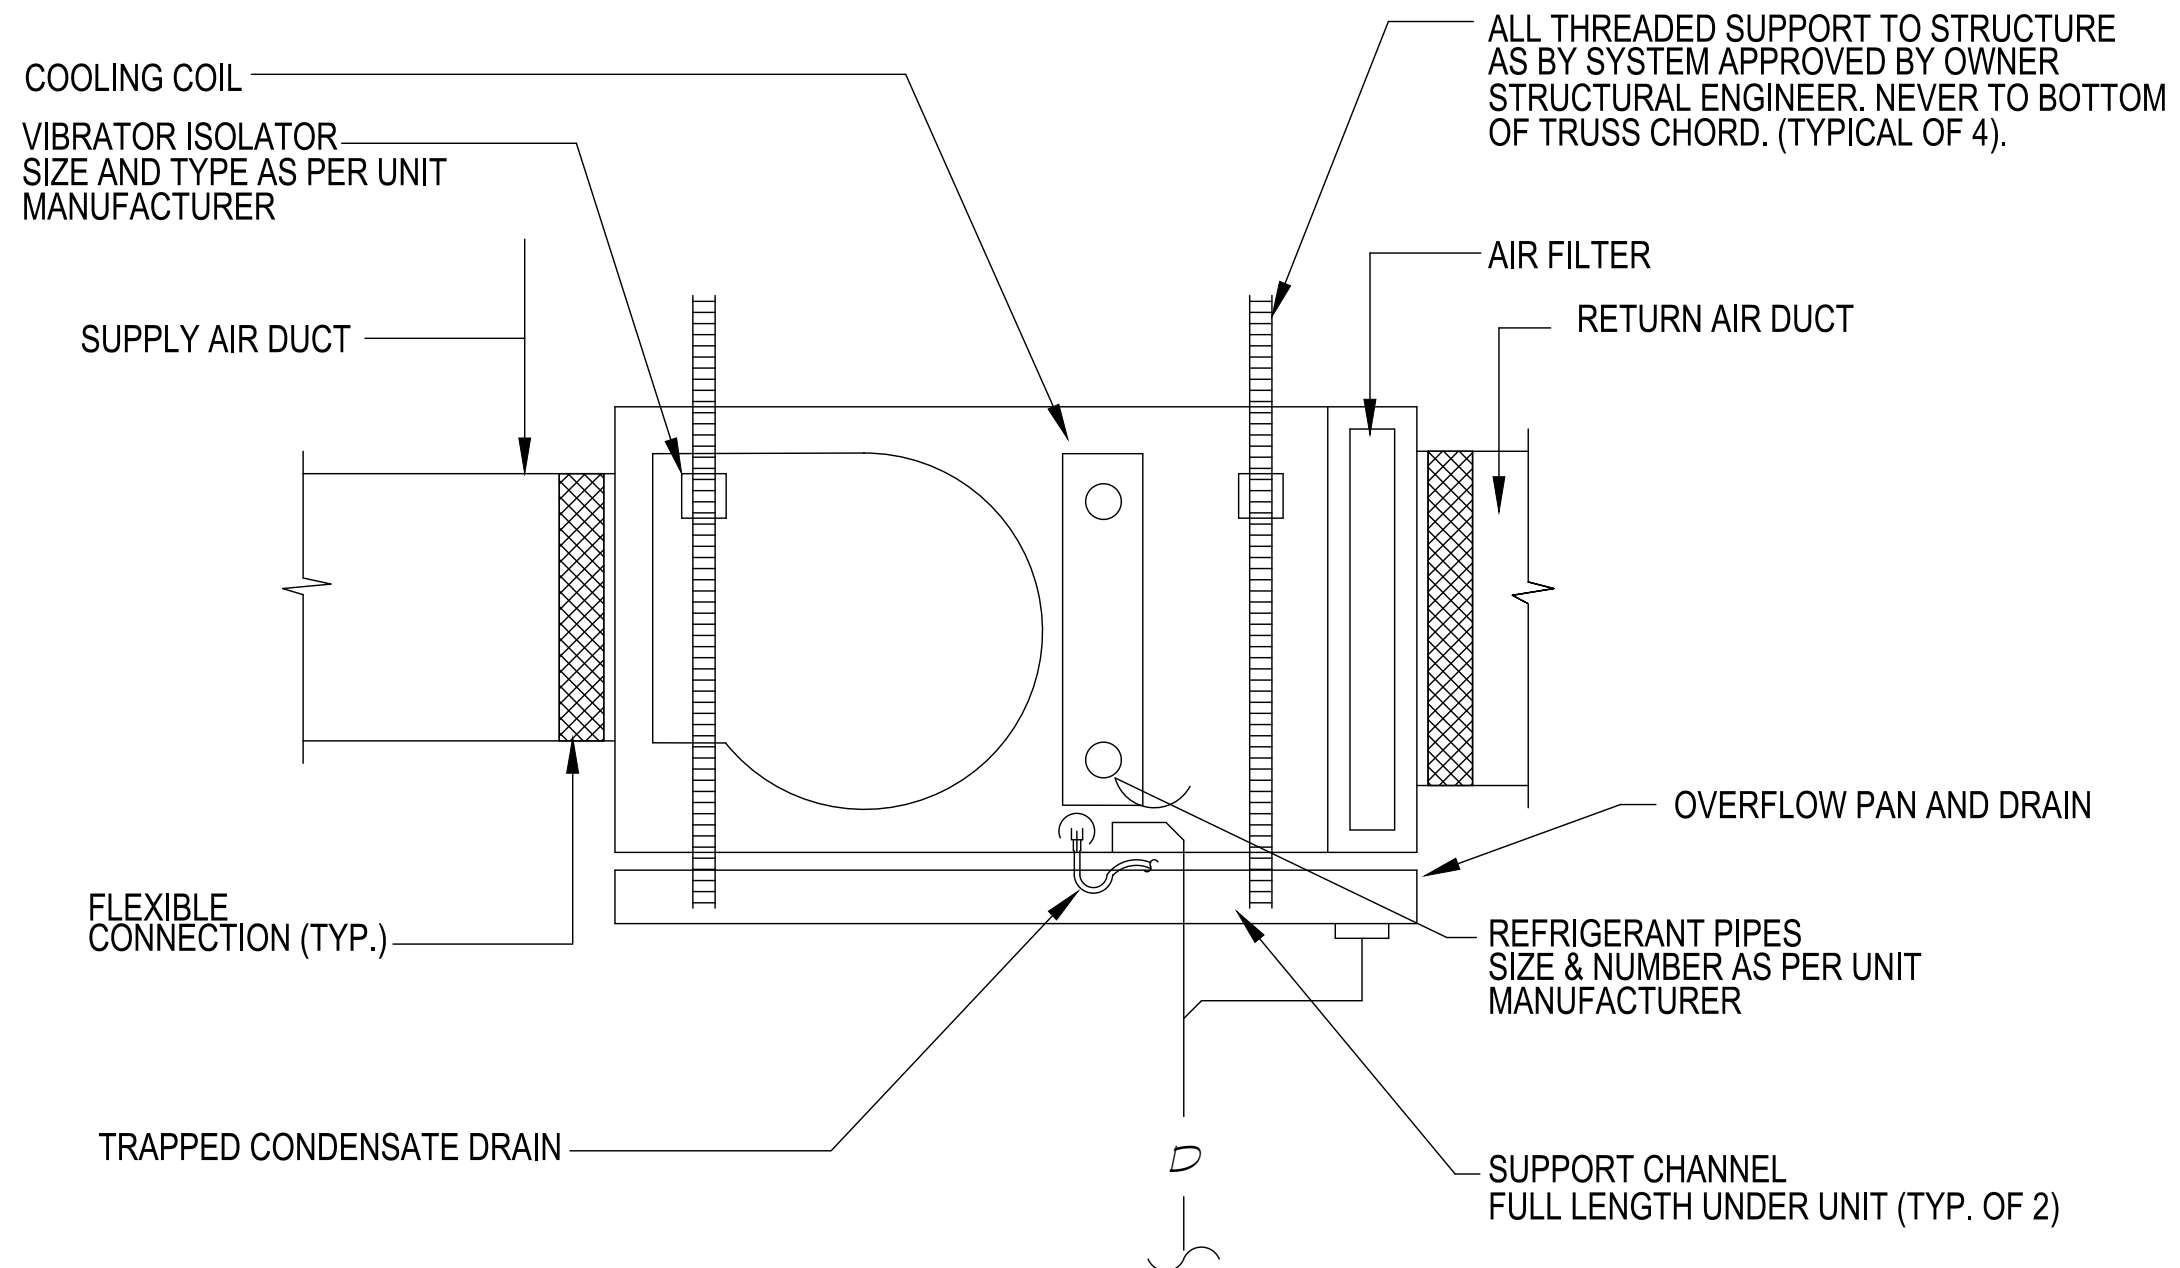

8 VRF DUCTED FAN COIL UNIT DETAIL

Project Title:
HVAC UPGRADES TO:
ADMINISTRATION BUILDING
1325 CHESHIRE STREET CHESHIRE,
CONNECTICUT 06410



SILVER PETRUCELLI + ASSOCIATES
3190 WHITNEY AVENUE HAMDEN CT 06518
311 STATE STREET NEW LONDON CT 06320
203 230 9007 silverpetrucelli.com

Revision	Description	Date	Revised By

Drawing Title:
MECH DETAILS
Project Phase:
DESIGN DOCUMENTS NOT FOR CONSTRUCTION
State Project Number:
XXX-XXXXXX

Date:
01/16/2026
Scale:
1/8" = 1'-0"
Drawn By:
CL
Project Number:
XX-XXX


M600

GENERAL NOTES			
GENERAL:			
1. WHEN A CONFLICT BETWEEN THE DRAWINGS, NOTES AND/OR SPECIFICATIONS OCCUR, THE MORE STRINGENT, AND/OR LARGER QUANTITY AND/OR MORE EXPENSIVE SHALL APPLY. THE REQUIREMENTS LISTED WITHIN NOTES OR SPECIFICATIONS SHALL BE REQUIRED, PROVIDED AND INSTALLED WHETHER SPECIFICALLY INDICATED ON THE DRAWINGS OR NOT.			
2. PROVIDE CONCEALED WIRING & RACEWAY WHERE ABLE, IN EXISTING SPACES WHERE IT IS NOT POSSIBLE TO CONCEAL, THE RACEWAY THEN SURFACE MOUNTED WIREMOLD SHALL BE USED. WIREMOLD COLOR SHALL MATCH THAT OF THE WALLS.			
WIRING & RACEWAY:			
1. THE DRAWINGS SHOW THE GENERAL LAYOUT AND TYPICAL DETAILS. PROVIDE COMPLETE SYSTEMS. DRAWINGS ARE BASED ON THE SPECIFIED EQUIPMENT, RACEWAY LAYOUTS, BOXES, AND WIRING OF THE SYSTEMS ARE SUBJECT TO APPROVED SHOP DRAWINGS.			
2. ENSURE THAT ITEMS TO BE FURNISHED FIT THE SPACE AVAILABLE. MAKE NECESSARY FIELD MEASUREMENTS TO ASCERTAIN SPACE REQUIREMENTS, INCLUDING THOSE FOR CONNECTIONS, AND PROVIDE SUCH SIZES AND SHAPES OF EQUIPMENT THAT FINAL INSTALLATION SHALL SATISFY THE INTENT OF THE DRAWINGS AND SPECIFICATIONS.			
3. LOCATIONS OF OUTLETS, SWITCHES, APPLIANCES, ETC. AS SHOWN ON ELECTRICAL PLANS ARE APPROXIMATE. COORDINATE WITH ARCHITECTURAL AND MECHANICAL PLANS AND DETAILS, AND WITH JOB CONDITIONS. INSTALL SWITCHES WITH "OFF" POSITION DOWN. INSTALL RECEPTACLES WITH GROUNDING POLE IN THE UP POSITION FOR VERTICAL MOUNTING AND AT RIGHT FOR HORIZONTAL MOUNTING.			
4. LOCATE AND INSTALL ELECTRICAL EQUIPMENT, JUNCTION AND PULL BOXES, PANELBOARDS, SWITCHES, CONTROLS, AND OTHER APPARATUS REQUIRING MAINTENANCE, INSPECTION, AND OPERATION SO AS TO BE READILY ACCESSIBLE.			
RACEWAY INSTALLATION:			
1. IN ALL ARCHITECTURALLY FINISHED SPACES, CONDUITS AND CABLES SHALL BE RUN CONCEALED IN HUNG OR FURRED CEILINGS, SLABS, MASONRY, AND PARTITIONS UNLESS OTHERWISE INDICATED. SAW CUTTING AND FINISHED PATCHING SHALL BE REQUIRED IN EXISTING SLABS AND MASONRY WALLS. IN UNFINISHED SPACES, RACEWAYS MAY BE RUN EXPOSED.			
2. UNLESS OTHERWISE INDICATED, EXACT ROUTING OF RACEWAYS SHALL BE DETERMINED BY THE CONTRACTOR TO SUIT PROJECT REQUIREMENTS AND FIELD CONDITIONS.			
3. PROVIDE SEPARATE RACEWAYS, JUNCTION BOXES, PULL BOXES AND WIREWAYS FOR ALL EMERGENCY SYSTEM WIRING.			
WIRING INSTALLATION:			
1. DO NOT USE WIRE SMALLER THAN NO. 12 AWG FOR ANY POWER OR LIGHTING CIRCUIT. USE LARGER SIZES WHERE INDICATED, AS REQUIRED BY CODES, AND AS FOLLOWS:			
30 AMPERE CIRCUIT: NO. 10 40 AMPERE CIRCUIT: NO. 8 50 AMPERE CIRCUIT: NO. 6 60 AMPERE CIRCUIT: NO. 6			
A. MINIMUM HOMERUN AND BRANCH CIRCUIT WIRING SIZES AND MAXIMUM HOMERUN CONDUIT FILL FOR 120 VOLT, 20 AMPERE CIRCUITS SHALL BE AS FOLLOWS:			
LENGTH	CIRCUIT WIRE SIZE	HOMERUN WIRE SIZE	CONDUIT SIZE (8 WIRES/CONDUIT)
0' TO 50'	#12	#12	3/4"
51' TO 100'	#12	#10	3/4"
101' TO 200'	#10	#8	1"
GREATER THAN 200' - REQUEST DIRECTION FROM ARCHITECT.			
NOTE: PROVIDE DERATING PER CODE WHEN INSTALLING MORE THAN 3 CURRENT CARRYING CONDUCTORS IN CONDUIT.			
B. HOMERUNS AND BRANCH CIRCUIT WIRING FOR 277 VOLT, 20 AMPERE CIRCUITS SHALL BE AS FOLLOWS:			
LENGTH	CIRCUIT WIRE SIZE	HOMERUN WIRE SIZE	CONDUIT SIZE (8 WIRES/CONDUIT)
0' TO 100'	#12	#12	3/4"
100' TO 200'	#12	#10	3/4"
GREATER THAN 200' - REQUEST DIRECTION FROM ARCHITECT.			
NOTE: PROVIDE DERATING PER CODE WHEN INSTALLING MORE THAN 3 CURRENT CARRYING CONDUCTORS IN CONDUIT.			
2. DO NOT USE WIRE SMALLER THAN NO. 14 AWG FOR CONTROL CIRCUITS UNLESS OTHERWISE RECOMMENDED BY THE EQUIPMENT OR SYSTEM MANUFACTURER OR WIRING SHOP DRAWINGS, AND SO APPROVED BY THE ARCHITECT.			
3. WHERE GREATER THAN THREE (3) CURRENT-CARRYING CONDUCTORS ARE INSTALLED IN ANY ONE CONDUIT OR CABLE, CONDUCTORS MUST BE DERATED AND SIZES INCREASED, IF NEEDED, TO ACCOMMODATE CONDUCTOR DERATING AS REQUIRED BY NEC ARTICLE 310.			
4. CONDUCTORS SHALL BE COMPLETELY INSTALLED AND CONNECTED. PROVIDE ALL TERMINALS, LUGS, AND CONNECTORS TO SUIT THE APPLICATION, AND IN COMPLIANCE WITH EQUIPMENT MANUFACTURERS' RECOMMENDATIONS.			
5. UNDER NO CIRCUMSTANCES SHALL ANY SWITCH OR CIRCUIT BREAKER BREAK A NEUTRAL CONDUCTOR.			
6. THE CIRCUIT NUMBERS INDICATED ON THE DRAWINGS ARE INTENDED AS A GUIDE FOR PROPER CONNECTION OF CIRCUITS AT PANELS. HOWEVER, IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO ENSURE THAT THE FINAL CIRCUITING WORK FULFILLS THE FOLLOWING CONDITIONS:			
A. LOADS ON PANEL BUSSES SHALL BE PHASE-BALANCED AS EVENLY AS POSSIBLE.			
GROUNDING INSTALLATION:			
1. EQUIPMENT GROUNDING			
A. INSTALL AN INSULATED GROUND CONDUCTOR, RUN IN THE RACEWAY WITH THE PHASE CONDUCTORS, FOR EACH FEEDER SERVING: PANELBOARDS, LIGHTING DIMMER BOARDS, MOTOR CONTROL CENTERS, MOTORS, EQUIPMENT AND APPLIANCES UNLESS OTHERWISE NOTED.			
B. INCLUDE AN INSULATED GROUND CONDUCTOR IN ALL CONDUIT RUNS CONTAINING SECTIONS OF FLEXIBLE CONDUIT UNLESS OTHERWISE NOTED.			
C. INCLUDE AN INSULATED GROUND CONDUCTOR IN ALL BRANCH CIRCUIT RACEWAYS OR CABLES UNLESS OTHERWISE NOTED.			
2. TELECOMMUNICATIONS CLOSET GROUNDING			
A. PROVIDE A #4 AWG GROUND CONDUCTOR RISER IN 1" EMT CONDUIT TO EACH TELECOMMUNICATIONS CLOSET GROUNDING BUSBAR (TGB) FROM THE TELECOMMUNICATIONS MAIN GROUNDING BUSBAR (TMGB), AND TO MAIN SERVICE GROUNDING ELECTRODE SYSTEM.			
B. CONNECT THE GROUND RISER TO TMGB AND TGB'S PER TIA/EIA STANDARD 607 - 1994.			
C. PROVIDE ADDITIONAL #4 AWG GROUND CABLE CONNECTIONS FROM EACH TMGB AND TGB TO THE CLOSEST BUILDING STEEL AND TO THE GROUND BUS IN THE ELECTRIC PANEL FEEDING THE OUTLETS AND EQUIPMENT IN THE ASSOCIATED TELECOMMUNICATIONS ROOM/CLOSET.			
3. GROUND EACH TELECOMMUNICATIONS, FIRE ALARM, SECURITY, AND BMS SYSTEM EQUIPMENT AND CONTROL PANEL WITHIN EACH TELECOMMUNICATIONS ROOM/CLOSET TO THE ASSOCIATED CLOSET TMGB OR TGB WITH A #4 AWG CONDUCTOR PER TIA/EIA STANDARD 607 - 1994.			
MECHANICAL EQUIPMENT WIRING:			
1. UNLESS OTHERWISE INDICATED OR SPECIFIED HEREIN, ALL MOTORS, MOTOR STARTERS, MOTOR CONTROLLERS, VARIABLE SPEED/FREQUENCY DRIVES, AND ASSOCIATED CONTROL DEVICES ARE FURNISHED AND INSTALLED UNDER THIS DIVISION. COORDINATE INSTALLATION AND LOCATIONS WITH OTHER DIVISION CONTRACTORS.			
2. POWER WIRING FROM THE INDICATED SOURCE TO THE STARTER/CONTROLLER/DRIVE UNIT, AND FROM THE STARTER/CONTROLLER/DRIVE UNIT TO THE MOTOR, INCLUDING ANY LOCAL DISCONNECT SWITCHES PROVIDED AND INSTALLED BY THIS DIVISION, AND ALL ASSOCIATED LUGS, TERMINALS, AND CONNECTIONS, IS THE WORK OF THIS DIVISION.			
3. CONTROL CIRCUIT WIRING IS GENERALLY FURNISHED AND INSTALLED UNDER OTHER DIVISIONS, EXCEPT THAT ANY SUCH WIRING SHOWN ON ELECTRICAL DRAWINGS IS WORK OF THIS DIVISION.			
4. PROVIDE 120 VOLT POWER TO ALL TEMPERATURE CONTROL PANELS (TCP'S) SUPPLIED AND INSTALLED BY HVAC CONTRACTOR. USE EMERGENCY POWER SOURCES WHEN AVAILABLE. COORDINATE ALL POWER REQUIREMENTS AND PANEL LOCATIONS WITH TEMPERATURE CONTROLS CONTRACTOR.			
5. COOPERATE AND COORDINATE WITH THE OTHER TRADES IN THE INSTALLATION, CONNECTION, AND TESTING OF MECHANICAL EQUIPMENT. PERFORM WORK OF THIS SECTION IN ACCORDANCE WITH EQUIPMENT MANUFACTURERS' INSTRUCTIONS.			
COORDINATION DRAWINGS:			
1. DEVELOP AND SUBMIT COORDINATION DRAWINGS AS OUTLINED.			
A. SHEET METAL, PLUMBING AND FIRE PROTECTION SHOP DRAWINGS THAT HAVE BEEN COORDINATED WITH ARCHITECTURAL AND STRUCTURAL DRAWINGS SHALL BE SUBMITTED TO ENGINEER FOR REVIEW. DRAWINGS MUST BE RETURNED FROM ENGINEER EITHER "REVIEWED" OR "FURNISH AS CORRECTED" PRIOR TO BEING USED AS BASIS FOR COORDINATION DRAWINGS.			
B. AFTER SHEET METAL AND PIPING DRAWINGS HAVE BEEN REVISED PER ENGINEERS COMMENTS, REPRODUCIBLE COPIES SHALL BE SENT TO THE TRADES IN THE FOLLOWING SEQUENCE FOR THE INCLUSION OF THEIR WORK:			
-MECHANICAL SHEET METAL -PLUMBING PIPING -MECHANICAL PIPING -SPRINKLER PIPING -ELECTRICAL WORK			
2. AFTER ALL TRADES HAVE INCLUDED THEIR WORK ON THE COORDINATION DRAWING AND NOTED CONFLICTS, ALL TRADES SHALL MEET TO RESOLVE CONFLICTS AND AGREE TO ACCEPTABLE SOLUTIONS. EACH TRADE SHALL SIGN COORDINATION DRAWINGS. ITEMS NOT SHOWN ON COORDINATION DRAWING IS RESPONSIBILITY OF OMITTING CONTRACTOR AND CONTRACTOR IS SUBJECT TO ADDITIONAL COSTS INCURRED BY OTHER TRADES.			
3. THE ARCHITECT AND ENGINEER ARE NOT PART OF THE COORDINATION DRAWING PROCESS. THE ENGINEER WILL PROVIDE ASSISTANCE FOR NOTED CONFLICTS ONLY. COORDINATION DRAWINGS ARE NOT TO BE CONSIDERED PIPING OR DUCT SHOP DRAWINGS. THE CONTRACTOR IS REQUIRED TO SUBMIT INDIVIDUAL PIPING AND DUCTWORK SHOP DRAWINGS FOR REVIEW BY THE ENGINEER. PIPING AND DUCTWORK SHOP DRAWINGS SHALL FOLLOW THE DESIGN INTENT OF THE CONTRACT DOCUMENTS.			
4. SUBMIT FINAL SIGNED COORDINATION DRAWING TO ENGINEER FOR REVIEW. ENGINEER WILL REVIEW COORDINATION DRAWINGS FOR GENERAL ARRANGEMENT AND FOR NOTED CONFLICTS ONLY. SPECIFIC INSTALLATION REQUIREMENTS WILL BE REVIEWED ONLY IN INDIVIDUAL TRADE SHOP DRAWINGS.			
5. ANY WORK FABRICATED OR INSTALLED PRIOR TO SIGN OFF BY ALL TRADES WHICH IS DEEMED TO BE IN CONFLICT WITH COORDINATION DRAWINGS SHALL BE REMOVED AND RE-INSTALLED IN CONFORMANCE WITH COORDINATION DRAWINGS.			
6. EACH CONTRACTOR (MENTIONED ABOVE) IS RESPONSIBLE FOR THE COORDINATION OF HIS SUB-CONTRACTORS.			
7. THE OVERALL COORDINATION OF THE COORDINATION PROCESS IS THE RESPONSIBILITY OF THE CONTRACTOR. THE ENGINEER IS NOT RESPONSIBLE FOR THE COORDINATION PROCESS. THE ENGINEER WILL RESPOND TO QUESTIONS THAT ARISE FROM THE COORDINATION PROCESS. DRAWINGS SUBMITTED WILL BE REVIEWED FOR CLEARLY IDENTIFIED CONFLICTS ONLY. SOLUTIONS TO CONFLICTS WILL NOT BEAR ADDITIONAL COST.			
AS-BUILT DRAWINGS			
1. PROVIDE A COMPLETE SET OF AS-BUILT DRAWINGS REFLECTING AS INSTALLED CONDITIONS. AS-BUILT DRAWINGS SHALL INDICATE ALL INSTALLED CONDITIONS OF SYSTEMS WITHIN THIS DISCIPLINE. DRAWINGS SHALL BE OF SIMILAR SCALE AS THE CONSTRUCTION DOCUMENTS AND INCLUDE DETAILS AS NECESSARY TO CLEARLY REFLECT THE INSTALLED CONDITION. DRAWINGS SHALL BE BOUND IN A COMPLETE AND CONSECUTIVE SET. SUPPLEMENTAL SKETCHES AND LOOSE PAPERWORK WILL NOT BE ACCEPTABLE AND WILL BE RETURNED FOR REVISION. THE CONTRACTOR SHALL COMPLY WITH THE ENGINEERS COMMENTS TO PRODUCE A CLEAR AND CONCISE SET OF DRAWINGS. DRAWINGS SHALL BE SUBMITTED IN BOTH HARD COPY AND ELECTRONIC (AUTO-CAD VERSION AS REQUIRED BY THE OWNER) VERSION. NUMBER OF COPIES OF EACH AS REQUESTED BY THE OWNER.			
2. PROVIDE "AS-BUILT DRAWINGS" INDICATING IN A NEAT AND ACCURATE MANNER A COMPLETE RECORD OF ALL REVISIONS OF THE ORIGINAL DESIGN OF THE WORK. INDICATE THE FOLLOWING INSTALLED CONDITIONS:			
A. INCLUDE ALL CHANGES AND AN ACCURATE RECORD, ON REPRODUCTIONS OF THE CONTRACT DRAWINGS OR APPROPRIATE SHOP			
B. DRAWINGS, OF ALL DEVIATIONS, BETWEEN THE WORK SHOWN AND WORK INSTALLED.			
C. EQUIPMENT LOCATIONS (EXPOSED AND CONCEALED), DIMENSIONED FROM PROMINENT BUILDING LINES.			
D. APPROVED SUBSTITUTIONS, CONTRACT MODIFICATIONS, AND ACTUAL EQUIPMENT AND MATERIALS INSTALLED.			
E. CONTRACT MODIFICATIONS, ACTUAL EQUIPMENT AND MATERIALS INSTALLED.			
ADA SYMBOLS:			
1. ALL HANDICAP SIGNAGE IN PROJECT TO USE DYNAMIC PICTOGRAM SYMBOL OF ACCESSIBILITY AS ADOPTED BY CONNECTICUT PUBLIC ACT 16-78. ALL REFERENCES TO OTHER SYMBOLS ON DRAWINGS ARE FOR REFERENCE ONLY.			

DEMOLITION AND REMOVALS	
1. WHEN NECESSARY TO TEMPORARILY DISCONNECT ANY EXISTING FEEDER OR BRANCH CIRCUIT SUPPLYING OCCUPIED FACILITIES, CONFER WITH THE OWNER, AND SCHEDULE A MUTUALLY AGREEABLE PERIOD OF INTERRUPTION. 2. WHERE REPLACEMENT, RELOCATION OR MODIFICATION OF EXISTING EQUIPMENT IS INDICATED, PROVIDE AND MAINTAIN ALL TEMPORARY FEEDERS, CONNECTIONS, CIRCUIT PROTECTION, AND ANY OTHER MATERIALS AND APURTENANCES REQUIRED TO MAINTAIN SERVICES TO OCCUPIED AREAS. 3. NO WORK SHALL BE LEFT INCOMPLETE, NOR ANY HAZARDOUS SITUATION CREATED, WHICH WILL AFFECT THE LIFE OR SAFETY OF THE PUBLIC AND/OR BUILDING OCCUPANTS. AT NO TIME SHALL THE WORK INTERFERE WITH OR CUT OFF ANY OF THE EXISTING SERVICES WITHOUT THE OWNER'S PRIOR WRITTEN PERMISSION. 4. THE OWNER RESERVES THE RIGHT TO OPERATE ALL EXISTING ELECTRICAL AND MECHANICAL EQUIPMENT NOT INCLUDED IN THIS WORK, AND TO PERFORM ALL REQUIRED SERVICING AND REPAIRS TO SAME, AT ALL TIMES. 5. IT IS REQUIRED THAT THE WORK INDICATED AND/OR SPECIFIED SHALL BE CARRIED OUT WITH A MINIMUM OF INTERFERENCE TO THE ESTABLISHED OPERATIONS OF THE BUILDING. 6. REMOVE, ABANDON, REROUTE, OR RELOCATE ANY CONDUIT, WIRING, LIGHTING FIXTURES, OUTLETS, AND OTHER ELECTRICAL ITEMS, WHICH ARE LAID BARE IN THE COURSE OF, OR INTERFERE WITH, THE ALTERATIONS. REMOVE ALL EXPOSED OUTLETS, CONDUIT, AND BRANCH CIRCUIT WORK, WHICH INTERFERE WITH THE ALTERATIONS. 7. IT IS THE INTENTION OF THESE SPECIFICATIONS TO PROVIDE FOR THE CONTINUANCE OF ALL ELECTRICAL SERVICES PRESENTLY INSTALLED IN THE UNALTERED AREAS. PROVIDE ALL CONDUIT, WIRING, AND DEVICES NECESSARY TO MAINTAIN SERVICES TO THESE AREAS. 8. COMPARE THE PLANS WITH THE EXISTING CONDITIONS TO DETERMINE THE AMOUNT OF WORK AFFECTED. REMOVE ALL UNUSED EXPOSED CIRCUIT WORK, OUTLETS, FIXTURES AND THE LIKE NOT REQUIRED BY THE ALTERATIONS. 9. ALL MATERIALS REQUIRED TO BE REMOVED AND NOT REINSTALLED UNDER THIS DIVISION OF THE WORK, UNLESS OTHERWISE INDICATED, SHALL BECOME THE PROPERTY OF THE CONTRACTOR, AND SHALL BE REMOVED FROM THE SITE. 10. WHERE FEEDERS AND BRANCH CIRCUITS OR DEVICES AND EQUIPMENT ARE INDICATED TO BE REMOVED, CONDUCTORS AND CABLES SHALL BE COMPLETELY REMOVED BACK TO THEIR SOURCE. EXPOSED OR ACCESSIBLE CONDUITS SHALL BE REMOVED COMPLETELY, CONDUITS EMBEDDED IN CONCRETE OR MASONRY SHALL BE CUT OFF FLUSH AND THE SURFACE PATCHED SMOOTH AND LEVEL. 11. REMOVED MATERIALS SHALL BE DISPOSED OF USING LICENSED CARTING SERVICE. 12. HAZARDOUS MATERIALS - CONTAINING PCB'S (BALLASTS), AND THE LIKE SHALL BE DISPOSED OF BY AN EPA APPROVED, LICENSED DISPOSAL SERVICE. CONTRACTOR SHALL OBTAIN AND HAVE ON FILE, AFFIDAVIT, AND RECEIPTS STATING HOW AND WHERE THE WASTE WAS DISPOSED OF OR CONVERTED.	13. CONTRACTOR SHALL REMOVE ALL ELECTRICAL EQUIPMENT IN OR ON WALLS THAT ARE TO BE REMOVED - MAINTAIN CONTINUITY OF ALL EXISTING BRANCH CIRCUITRY TO EXISTING ROOMS NOT BEING RENOVATED. REWIRE ALL EXISTING BRANCH CIRCUITS (THAT ARE TO REMAIN) AS REQUIRED. REFER TO ARCHITECTURAL DEMOLITION DRAWINGS FOR WALLS BEING REMOVED - REFER TO CONSTRUCTION SCHEDULE FOR TIME DELAY. 14. CONDUIT IN EXISTING OR NEW CEILINGS THAT IS NOT INTENDED FOR REUSE SHALL BE REMOVED BACK TO THE PANEL, FROM WHICH IT ORIGINATES. 15. CONDUCTORS THAT ARE NOT DEEMED REUSABLE SHALL BE REMOVED BACK TO THE NEAREST JUNCTION BOX, WHERE THE ENTIRE CIRCUIT IS TO BE REMOVED, THE CONDUCTORS SHALL BE REMOVED BACK TO THE PANELBOARD FROM WHICH THEY ORIGINATE. 16. OUTAGES OF EXISTING ELECTRICAL (LIGHTING, POWER, AND SIGNAL) SYSTEMS NECESSITATED BY WORK OF ALL TRADES SHALL BE IN ACCORDANCE WITH FIELD SCHEDULES BY THE GENERAL CONTRACTOR AND OWNER - INCLUDE ALL ELECTRIC WORK OVERTIME AND SUPERVISION TO COMPLY - CONTRACTOR SHALL OBTAIN OWNER'S GENERAL CONTRACTORS' APPROVAL, PRIOR TO DISRUPTING OF EXISTING ELECTRICAL SYSTEM. 17. CONTRACTOR TO MAINTAIN CONTINUITY AND ACCESSIBILITY OF ALL EXISTING SYSTEMS AND SYSTEM EQUIPMENT FEEDERS WHICH MAY BE DISRUPTED FOR WORK OF ANY TRADE. 18. CONTRACTOR TO MAINTAIN CONTINUITY AND ACCESSIBILITY OF ALL EXISTING ELECTRICAL (POWER, LIGHTING, AND SIGNAL) SYSTEMS, EQUIPMENT FEEDERS AND BRANCH CIRCUITS ON FLOORS OR AREAS THAT ARE NOT AFFECTED BY DEMOLITION OR NEW CONSTRUCTION - REFER TO CONSTRUCTION SCHEDULE FOR ADDITIONAL INFORMATION. 19. ANY EXISTING ELECTRICAL WORK WHICH IS PULLED OUT OR CUT AWAY SHALL BE REMOVED FROM THE SITE AS DIRECTED BY THE GENERAL CONTRACTOR AND THE OWNER. 20. EXISTING ELECTRICAL EQUIPMENTS WHICH IS NOT TO BE REUSED SHALL BE REMOVED FROM DRYWALL PARTITIONS. ANY OPENING IN EXISTING PARTITIONS LEFT BY REMOVAL OF EXISTING ELECTRICAL EQUIPMENT SHALL BE PATCHED BY THIS CONTRACTOR WITH MATERIALS TO MATCH EXISTING. 21. FOR PURPOSES OF THE CONTRACT, WHAT IS NOTED OR SHOWN ON DRAWINGS INDICATES THE SCOPE OF WORK REQUIRED AND QUALITY OF MATERIALS REQUIRED) 22. CONTRACTOR TO EXAMINE ALL CONTRACT DOCUMENTS AND PERFORM ALL DEMOLITION BOTH FOR AREAS BEING RENOVATED AND FOR AREAS WHICH MUST BE REWORKED TO PERMIT THE INSTALLATION OF WORK BY THE VARIOUS TRADES. 23. CONTRACTOR SHALL VISIT THE SITE AND VERIFY THE EXTENT OF DEMOLITION AND REMOVALS PRIOR TO THE SUBMISSION OF BIDS. NO CONSIDERATION SHALL BE GIVEN FOR FAILURE TO VISIT THE SITE.

ABBREVIATIONS	
A	AMPERES
AFF	ABOVE FINISHED FLOOR
C	CONDUIT
CB	CIRCUIT BREAKER
CKT	CIRCUIT
EC	ELECTRICAL CONTRACTOR
EM	EMERGENCY (WIRED TO INVERTER)
EWV	ELECTRIC WATER COOLER
EWVH	ELECTRIC WATER HEATER
FAA	FIRE ALARM ANNUNCIATOR
FACP	FIRE ALARM CONTROL PANEL
HD	HAND DRYER
HT	HEAT TRACE
JB	JUNCTION BOX
LSS	LOCAL SOUND SYSTEM RACK
MCB	MAIN CIRCUIT BREAKER
MLO	MAIN LUG ONLY
MON	MONITOR
MTD	MOUNTED
PNL	PANELBOARD
SB	SMARTBOARD
SM	SECURITY SPOT MONITOR & PC
TR	TAMPER RESISTANT
U.O.N.	UNLESS OTHERWISE NOTED
UR	UNRAL
WC	WATER CLOSET
WG	WIRE GUARD
WP	WEATHERPROOF

ELECTRICAL LEGEND	
(NOT ALL SYMBOLS ARE USED)	
	PANELBOARD SURFACE MOUNTED, 120/208 V
	PANELBOARD FLUSH MOUNTED, 120/208V
	NON-FUSED DISCONNECT SWITCH
	FUSED DISCONNECT SWITCH
	WALL MOUNTED JUNCTION BOX, ACCORDING TO NEC REQUIREMENTS
	CEILING MOUNTED JUNCTION BOX, ACCORDING TO NEC REQUIREMENTS
	RECESSED LIGHT FIXTURE; LETTER INDICATES FIXTURE TYPE
	SINGLE SHOEBOX LIGHT FIXTURE; LETTER INDICATES FIXTURE TYPE
	DOUBLE SHOEBOX LIGHT FIXTURE; LETTER INDICATES FIXTURE TYPE
	POST TOP LIGHT FIXTURE; LETTER INDICATES FIXTURE TYPE
	WALL MOUNTED LIGHT FIXTURE; LETTER INDICATES FIXTURE TYPE
	TYPICAL RECESSED LED TROFFER
	LED LIGHT FIXTURE CONNECTED TO THE INVERTER
	TYPICAL PENDANT/CAN HUNG LED FIXTURE; LETTER INDICATES FIXTURE TYPE
	TYPICAL SURFACE MOUNTED FIXTURE; LETTER INDICATES FIXTURE TYPE
	WALL MOUNTED FIXTURE; LETTER INDICATES FIXTURE TYPE
	WALL MOUNTED SINGLE HEAD FIXTURE/EMERGENCY; LETTER INDICATES FIXTURE TYPE
	TRACK LIGHTING; LETTER INDICATES FIXTURE TYPE
	IN-GROUND LANDSCAPE FIXTURE; LETTER INDICATES FIXTURE TYPE
	WALL MOUNTED BARE BULB; LETTER INDICATES FIXTURE TYPE
	WALL SCONCE; LETTER INDICATES FIXTURE TYPE
	CEILING MOUNTED TWINHEAD EMERGENCY FIXTURE; LETTER INDICATES FIXTURE TYPE
	WALL MOUNTED TWINHEAD EMERGENCY FIXTURE; LETTER INDICATES FIXTURE TYPE
	CEILING MOUNTED EXIT SIGN, SHADING INDICATES DIRECTION OF FIXTURE FACE, ARROW INDICATES DIRECTION OF CHEVRON, PROVIDE UNSWITCHED POWER FROM AREA LIGHTING CIRCUIT
	DOUBLE FACE EXIT SIGN
	SINGLE POLE SWITCH OR DISCONNECT, MOUNT AT 48" AFF, OR AT EQUIPMENT
	3-WAY SWITCH; MOUNT AT 48" AFF
	4-WAY SWITCH; MOUNT AT 48" AFF
	DUAL TECHNOLOGY, OCCUPANCY SENSOR SWITCH; MOUNT AT 48" AFF
	DIMMING SWITCH; MOUNT AT 48" AFF, COMPATIBLE WITH LOAD CONTROLLED
	3-WAY DIMMING SWITCH; MOUNT AT 48" AFF, COMPATIBLE WITH LOAD CONTROLLED
	KEYED SINGLE POLE SWITCH; MOUNT AT 48" AFF
	KEYED 3-WAY SWITCH; MOUNT AT 48" AFF
	SINGLE POLE SWITCH WITH PILOT LIGHT; MOUNT AT 48" AFF
	SINGLE POLE DISCONNECT FOR FAN; MOUNT AT 48" AFF
	SINGLE POLE DISCONNECT FOR BASKETBALL HOOP; MOUNT AT 48" AFF
	DUPLEX RECEPTACLE; MOUNT AT 18" AFF UNLESS OTHERWISE SPECIFIED
	SINGLE RECEPTACLE; MOUNT AT 18" AFF UNLESS OTHERWISE SPECIFIED
	QUAD RECEPTACLE; MOUNT AT 18" AFF UNLESS OTHERWISE SPECIFIED
	GROUND FAULT INTERRUPTING DUPLEX RECEPTACLE; MOUNT AT 18" AFF UNLESS OTHERWISE SPECIFIED
	RECEPTACLE WITH OUTDOOR RATED COVER PLATE, PROVIDE FLUSH MOUNTED BOX
	SPECIAL OUTLET CONFIGURATION, REFER TO MANUFACTURERS MANUAL FOR NEMA#
	CEILING MOUNTED DUPLEX RECEPTACLE; PROVIDE FLUSH MOUNTED BOX
	FLOOR MOUNTED RECEPTACLE; SEE FLOOR PLANS FOR DETAILS
	HAND DRYER
	ELECTRICAL ALARM BELL, FOR DRY AND WET CONDITIONS
	CALL-FOR-AID CORRIDOR LIGHT/BUZZER, MOUNT AT 7'-6" AFF
	CALL-FOR-AID SWITCH, MOUNT AT 36" AFF WITH PULL CORD HANGING DOWN TO 6" AFF
	BRANCH CIRCUIT HOMERUN (VOLTAGE, BRANCH CIRCUIT POLES)
	CEILING MOUNTED OCCUPANCY SENSOR (INFRARED/ULTRASONIC) WITH 360° COVERAGE
	WALL MOUNTED OCCUPANCY SENSOR (INFRARED/ULTRASONIC) WITH 360° COVERAGE
	FIRE ALARM MANUAL PULL STATION - 48" AFF U.O.N.
	FIRE ALARM SPEAKER/STROBE - 80" AFF U.O.N.
	FIRE ALARM STROBE LIGHT - 80" AFF U.O.N.
	SMOKE DETECTOR
	CARBON MONOXIDE DETECTOR
	HEAT DETECTOR
	DUCT MOUNTED IONIZATION SMOKE DETECTOR
	TAMPER SWITCH
	LOW PRESSURE SWITCH
	PRESSURE SWITCH
	MAGNETIC HOLD OPEN
	TV CONNECTION
	WALL MOUNTED WIRELESS ACCESS POINT
	CEILING MOUNTED WIRELESS ACCESS POINT
	CEILING MOUNTED DATA JACK: #0 DEPICTS # OF JACKS NEEDED, PROVIDE CONDUIT FROM BOX TO ACCESSIBLE CEILING SPACE.
	DATA/VOICE JACK: #0/0V DEPICTS # OF JACKS NEEDED, PROVIDE CONDUIT FROM BOX TO ACCESSIBLE CEILING SPACE.
	FLOOR MOUNTED DATA/VOICE JACK: #0/0V DEPICTS # OF JACKS NEEDED, PROVIDE CONDUIT FROM BOX TO ACCESSIBLE CEILING SPACE.
	VOICE JACK: #0/0V DEPICTS # OF JACKS NEEDED, PROVIDE CONDUIT FROM BOX TO ACCESSIBLE CEILING SPACE.
	CEILINGS MOUNTED SPEAKER: INCLUDE WIRING & RACEWAY FOR COMPLETE SYSTEM
	WALL MOUNTED SPEAKER: INCLUDE WIRING & RACEWAY FOR COMPLETE SYSTEM
	WALL MOUNTED CLOCK: INCLUDE WIRING & RACEWAY FOR COMPLETE SYSTEM
	VOLUME CONTROL SWITCH; MOUNT AT 48" A.F.F
	EMERGENCY POWER OFF SWITCH (EPO)
	KEY FOB: INCLUDE WIRING & RACEWAY FOR COMPLETE SYSTEM
	DOOR CONTACT: INCLUDE WIRING & RACEWAY FOR COMPLETE SYSTEM
	KEYPAD: INCLUDE WIRING & RACEWAY FOR COMPLETE SYSTEM
	CEILING MOUNTED SECURITY CAMERA: INCLUDE WIRING & RACEWAY FOR COMPLETE SYSTEM
	WALL MOUNTED SECURITY CAMERA: INCLUDE WIRING & RACEWAY FOR COMPLETE SYSTEM

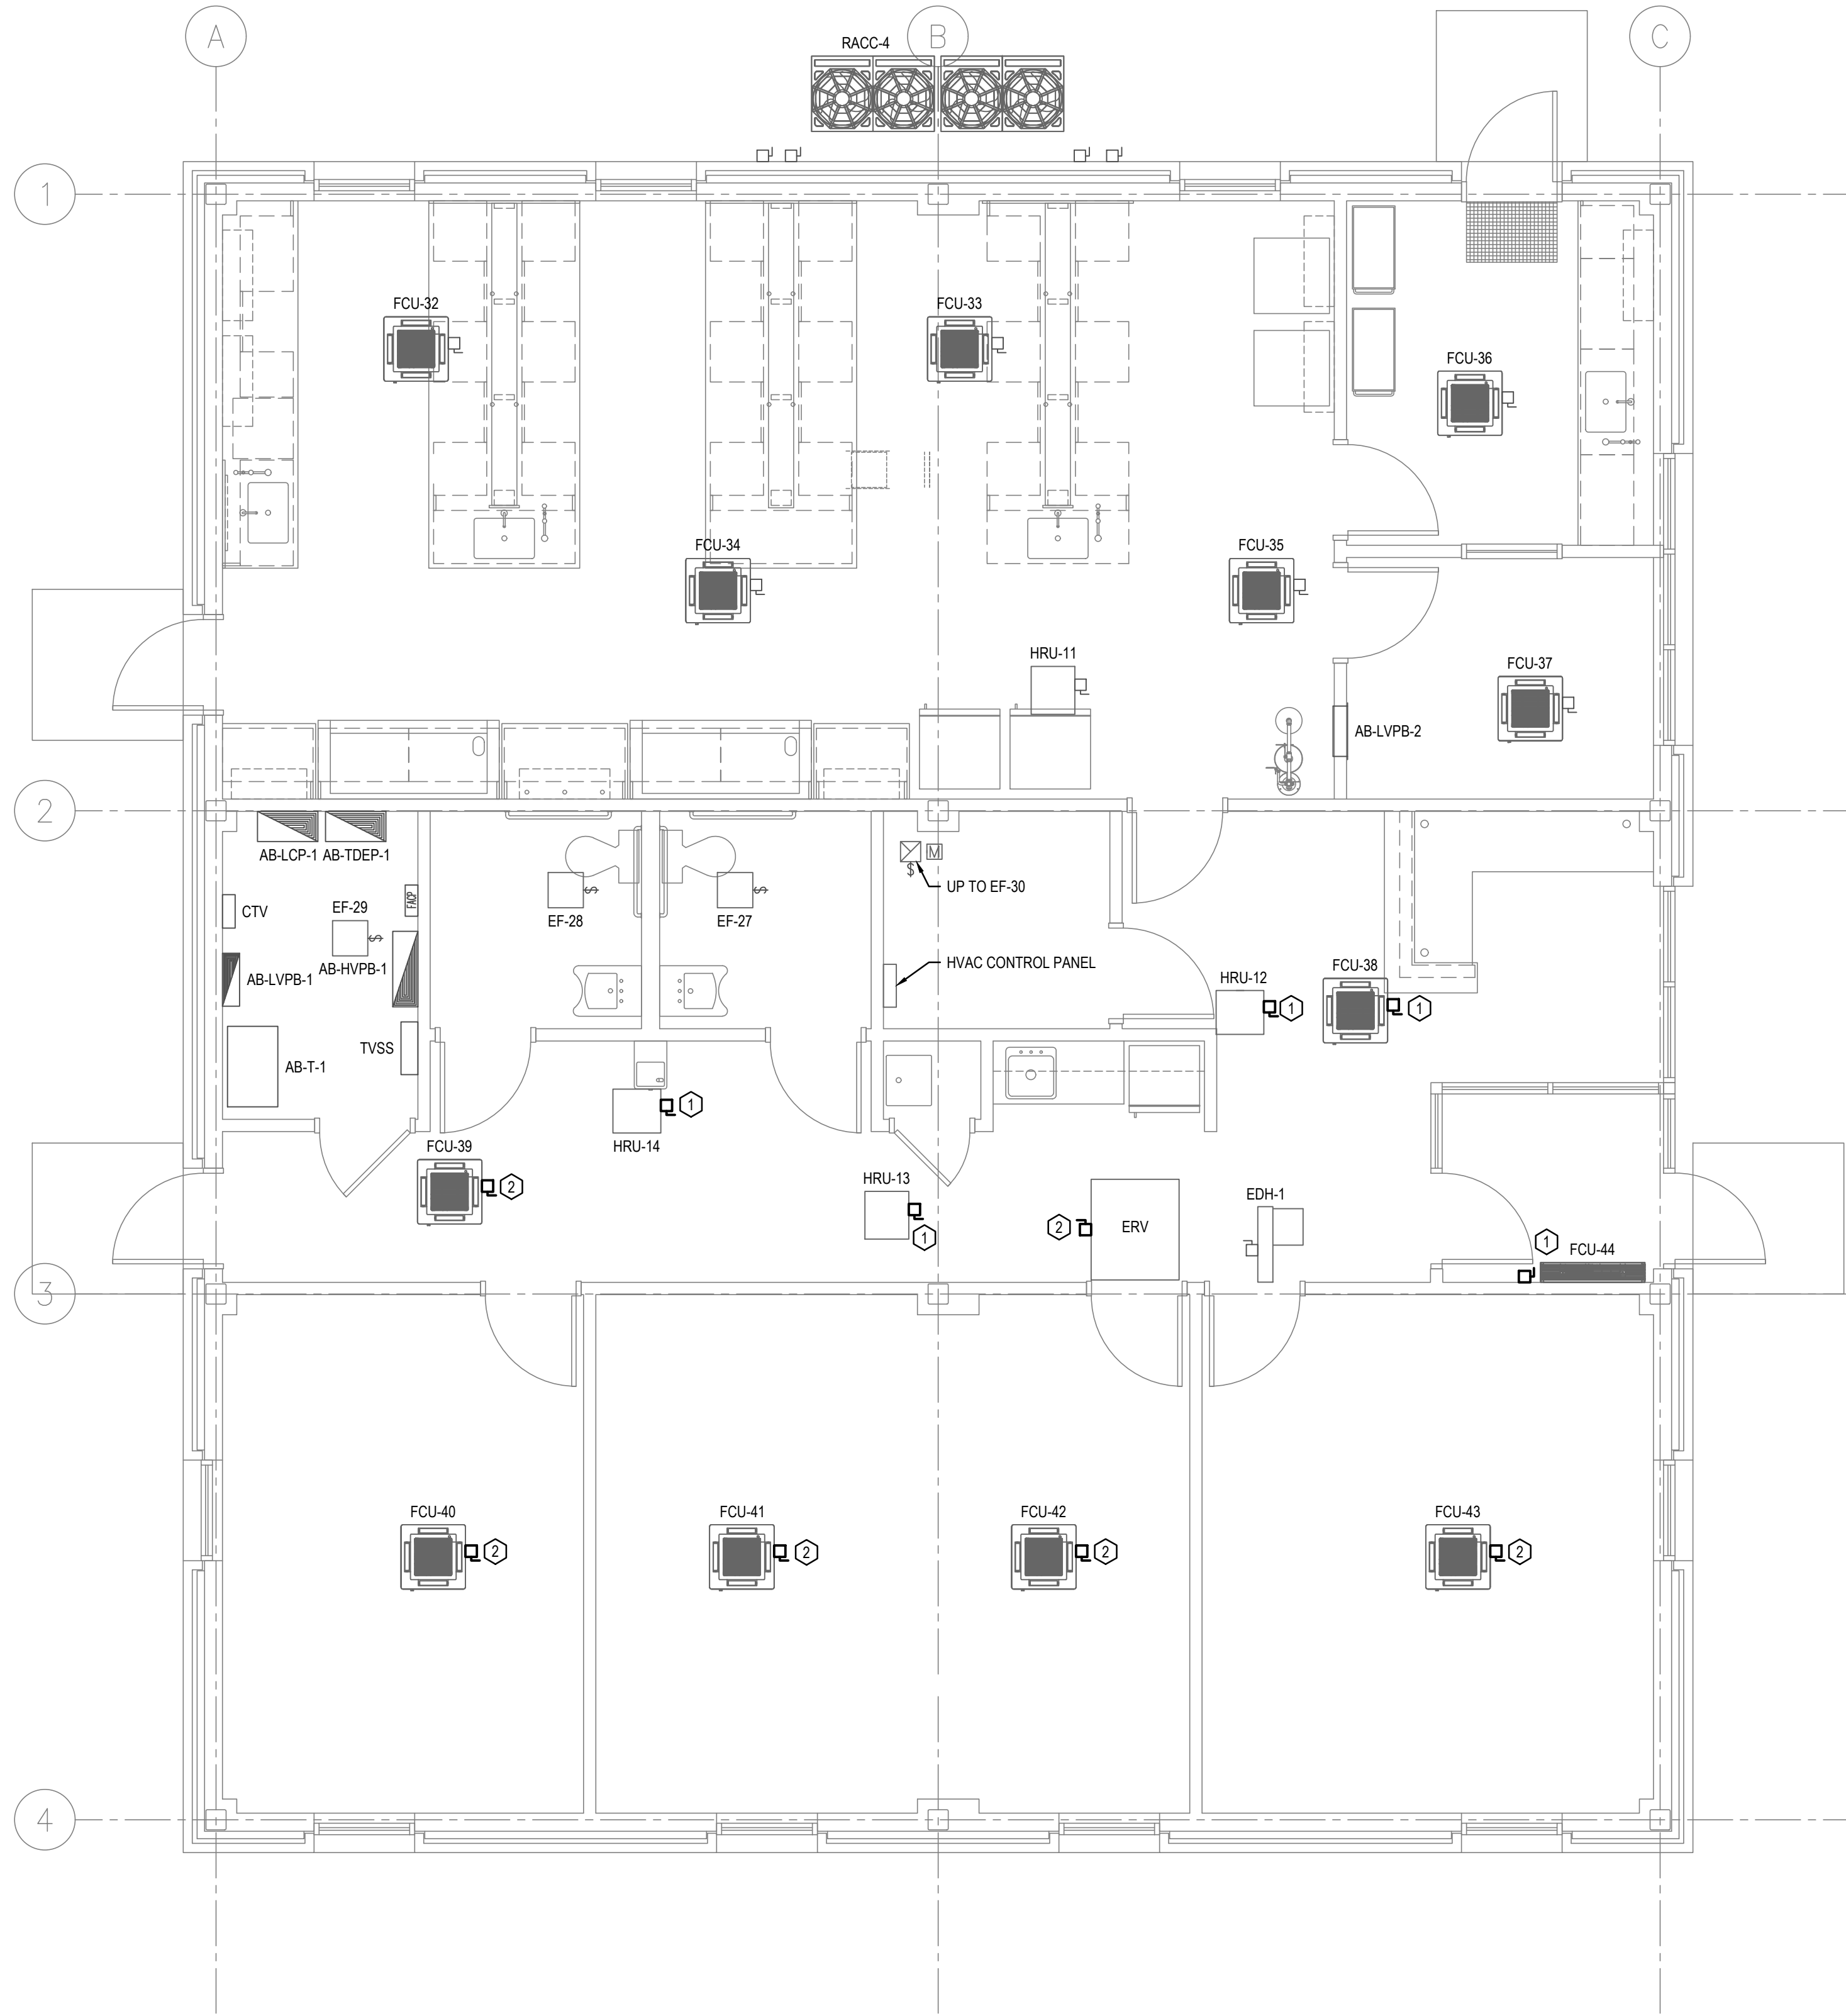


DEMOLITION NOTES

- ① DISCONNECT POWER TO EQUIPMENT PRIOR TO REMOVAL. ALL ASSOCIATED DISCONNECTS, RACEWAY, WIRING, ETC. SHALL BE REMOVED BACK TO THE POINT OF ORIGIN. FOR EQUIPMENT WITH DEDICATED CIRCUITS THE POINT OF ORIGIN SHALL BE BACK TO THE PANELBOARD SERVING IT. FOR EQUIPMENT SUCH AS FCU'S & HRU'S WHICH HAVE MULTIPLE UNITS ON THE SAME CIRCUIT THE POINT OF ORIGIN SHALL BE THE NEAREST JUNCTION BOX OR OTHER PIECE OF EQUIPMENT ON THE SAME CIRCUIT.
- ② DISCONNECT POWER TO EQUIPMENT PRIOR TO REMOVAL. ANY ASSOCIATED DISCONNECT SWITCH SHALL BE REMOVED & DISPOSED OF. THE ASSOCIATED WIRING/RACEWAY SHALL BE LEFT IN A SAFE/ACCESSIBLE LOCATION TO BE EXTENDED & CONNECTED TO NEW EQUIPMENT DURING CONSTRUCTION.

1 ADMINISTRATION BUILDING POWER DEMO PLANS PHASE 1

1/4" = 1'-0"

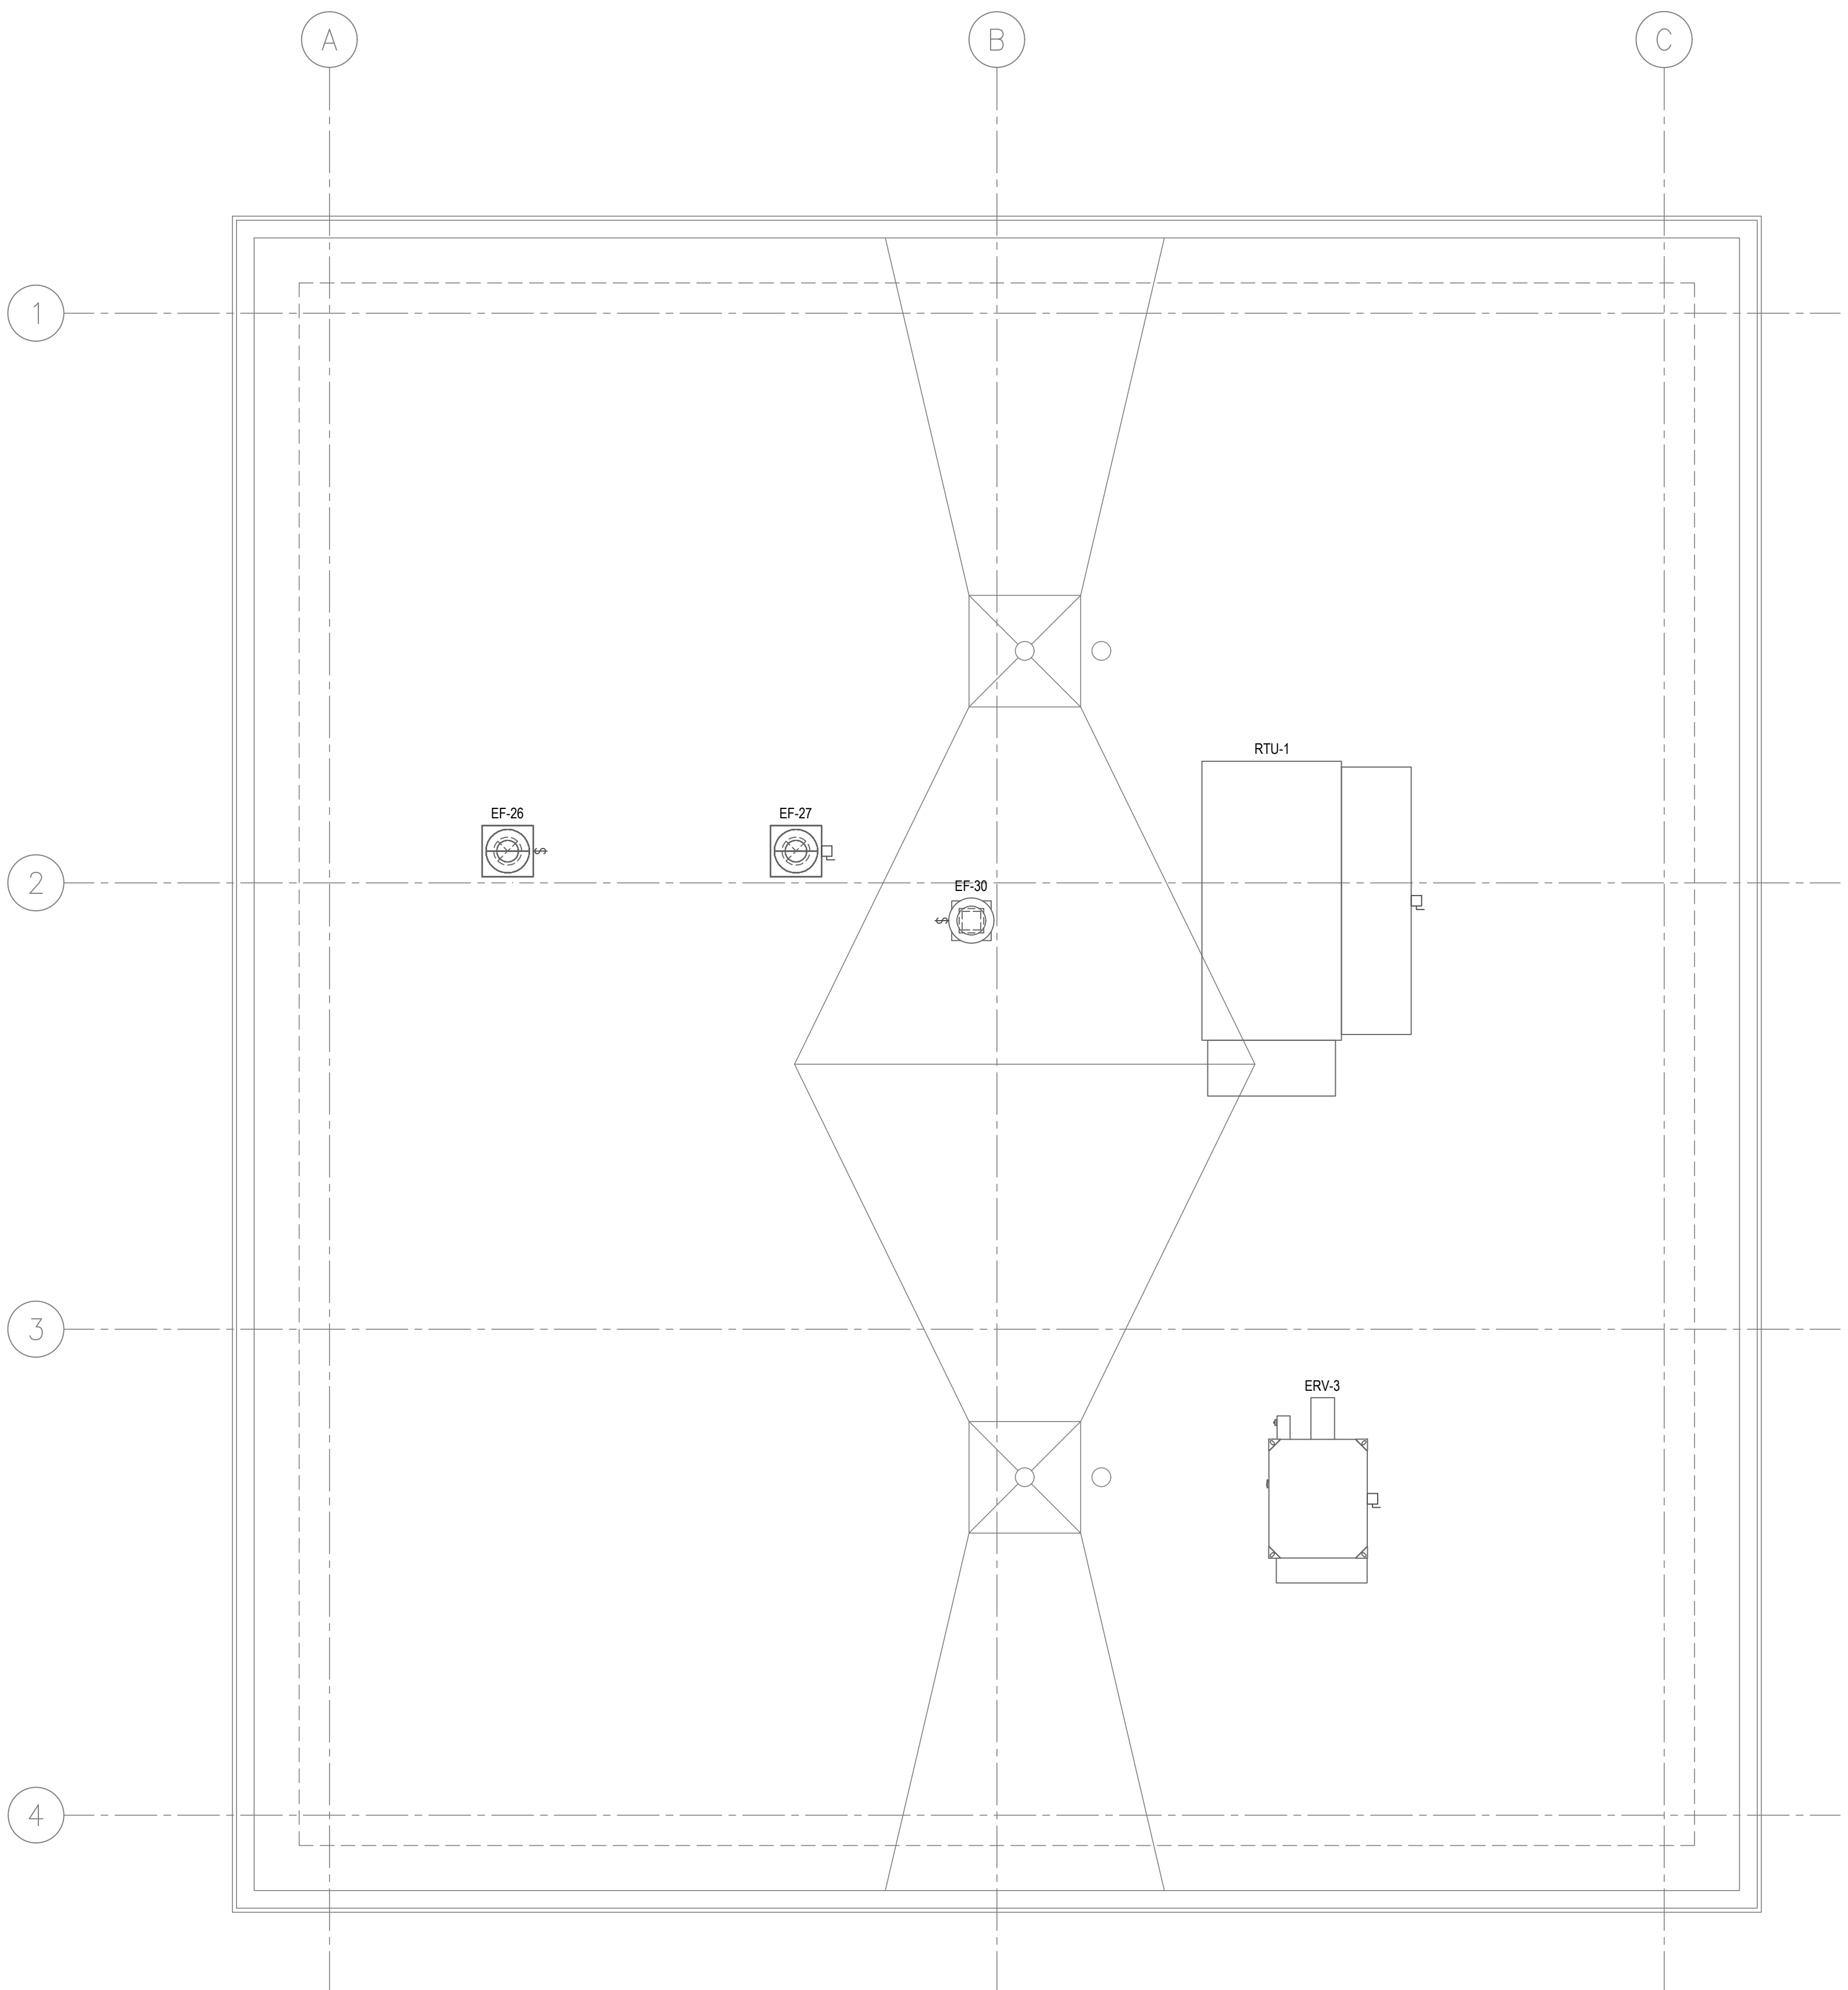

Project Title:
HVAC UPGRADES TO:
ADMINISTRATION BUILDING
1325 CHESHIRE STREET CHESHIRE,
CONNECTICUT 06410




SILVER PETRUCCELLI + ASSOCIATES
3190 WHITNEY AVENUE HAMDEN CT 06518
311 STATE STREET NEW LONDON CT 06320
203 230 9007 silverpetrucelli.com

Revision:	Description:	Date:	Revised By:

Drawing Title:
**ADMINISTRATION BUILDING
POWER DEMO PLANS PHASE 1**
Project Phase:
DESIGN DOCUMENTS NOT FOR CONSTRUCTION
State Project Number:
XXX-XXXXXXX

Date:
01/28/2026
Scale:
1/4" = 1'-0"
Drawn By:
MTC
Project Number:
25-172


E011

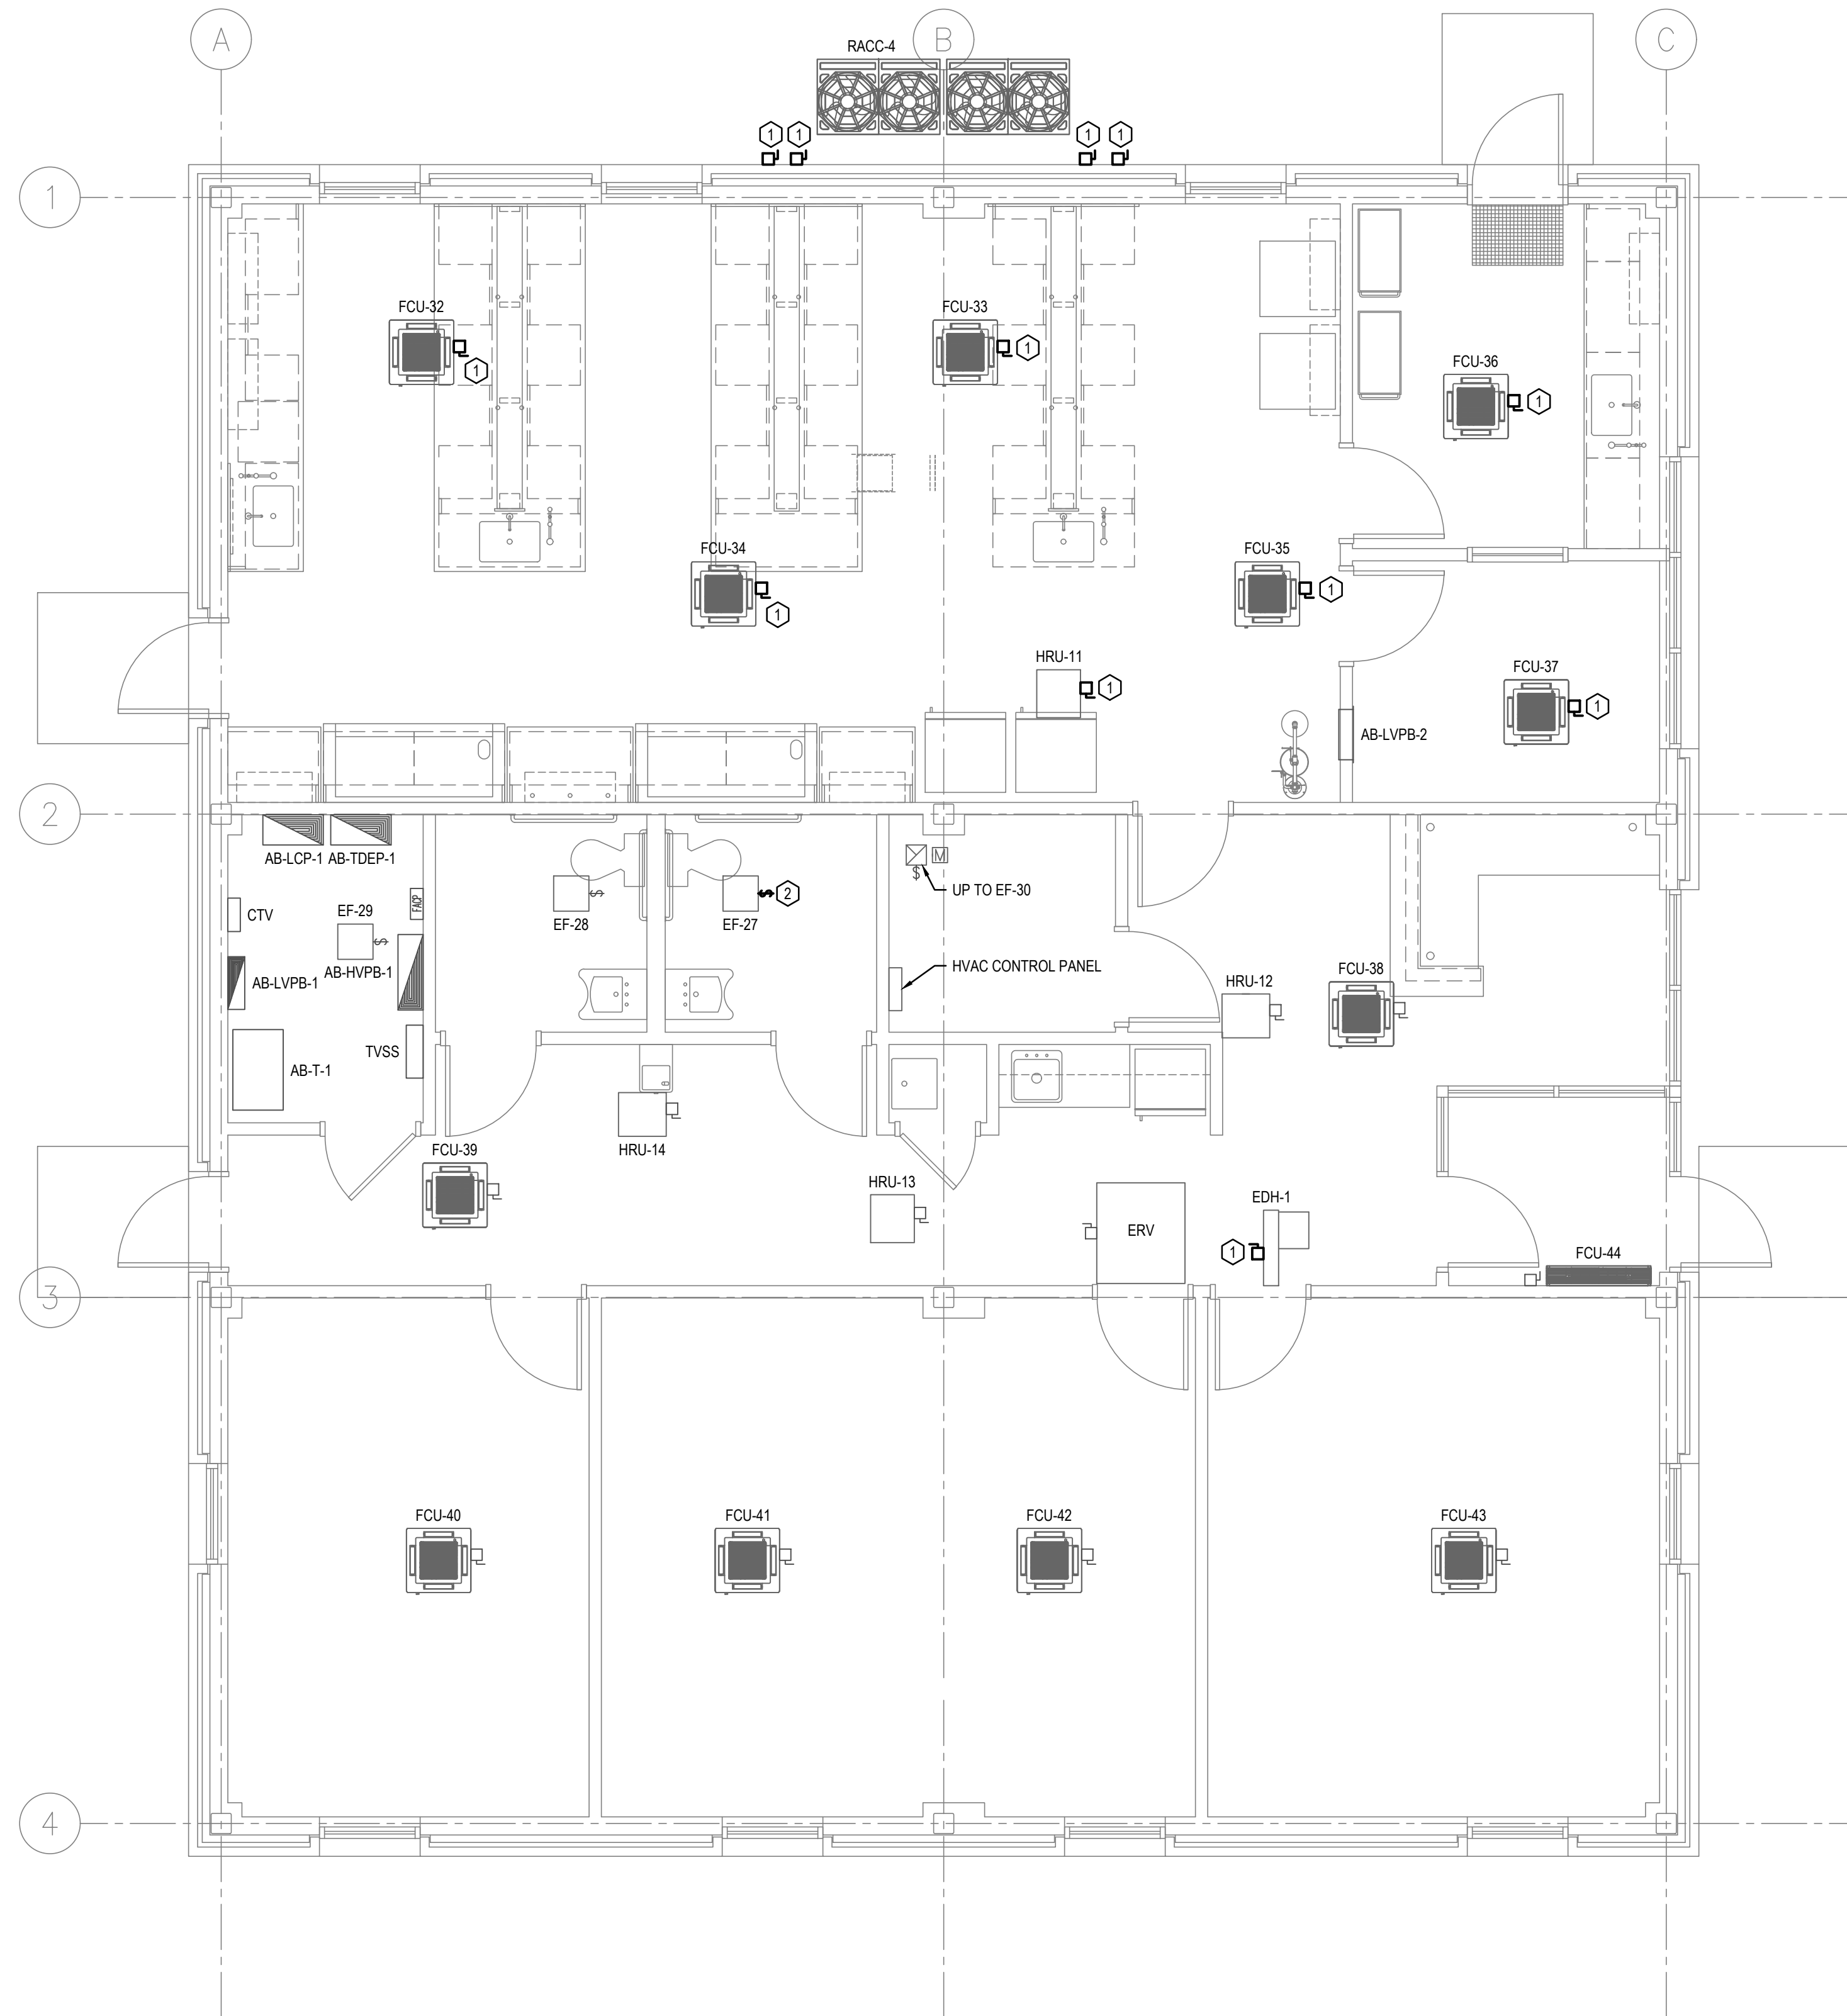


DEMOLITION NOTES

- ① DISCONNECT POWER TO EQUIPMENT PRIOR TO REMOVAL. ALL ASSOCIATED DISCONNECTS, RACEWAY, WIRING, ETC. SHALL BE REMOVED BACK TO THE POINT OF ORIGIN. FOR EQUIPMENT WITH DEDICATED CIRCUITS THE POINT OF ORIGIN SHALL BE BACK TO THE PANELBOARD SERVING IT. FOR EQUIPMENT SUCH AS FCU'S & HRU'S WHICH HAVE MULTIPLE UNITS ON THE SAME CIRCUIT THE POINT OF ORIGIN SHALL BE THE NEAREST JUNCTION BOX OR OTHER PIECE OF EQUIPMENT ON THE SAME CIRCUIT.
- ② DISCONNECT POWER TO EQUIPMENT PRIOR TO REMOVAL. ANY ASSOCIATED DISCONNECT SWITCH SHALL BE REMOVED & DISPOSED OF. THE ASSOCIATED WIRING/RACEWAY SHALL BE LEFT IN A SAFE/ACCESSIBLE LOCATION TO BE EXTENDED & CONNECTED TO NEW EQUIPMENT DURING CONSTRUCTION.

1 ADMINISTRATION BUILDING POWER DEMO PLANS PHASE 2
1/4" = 1'-0"

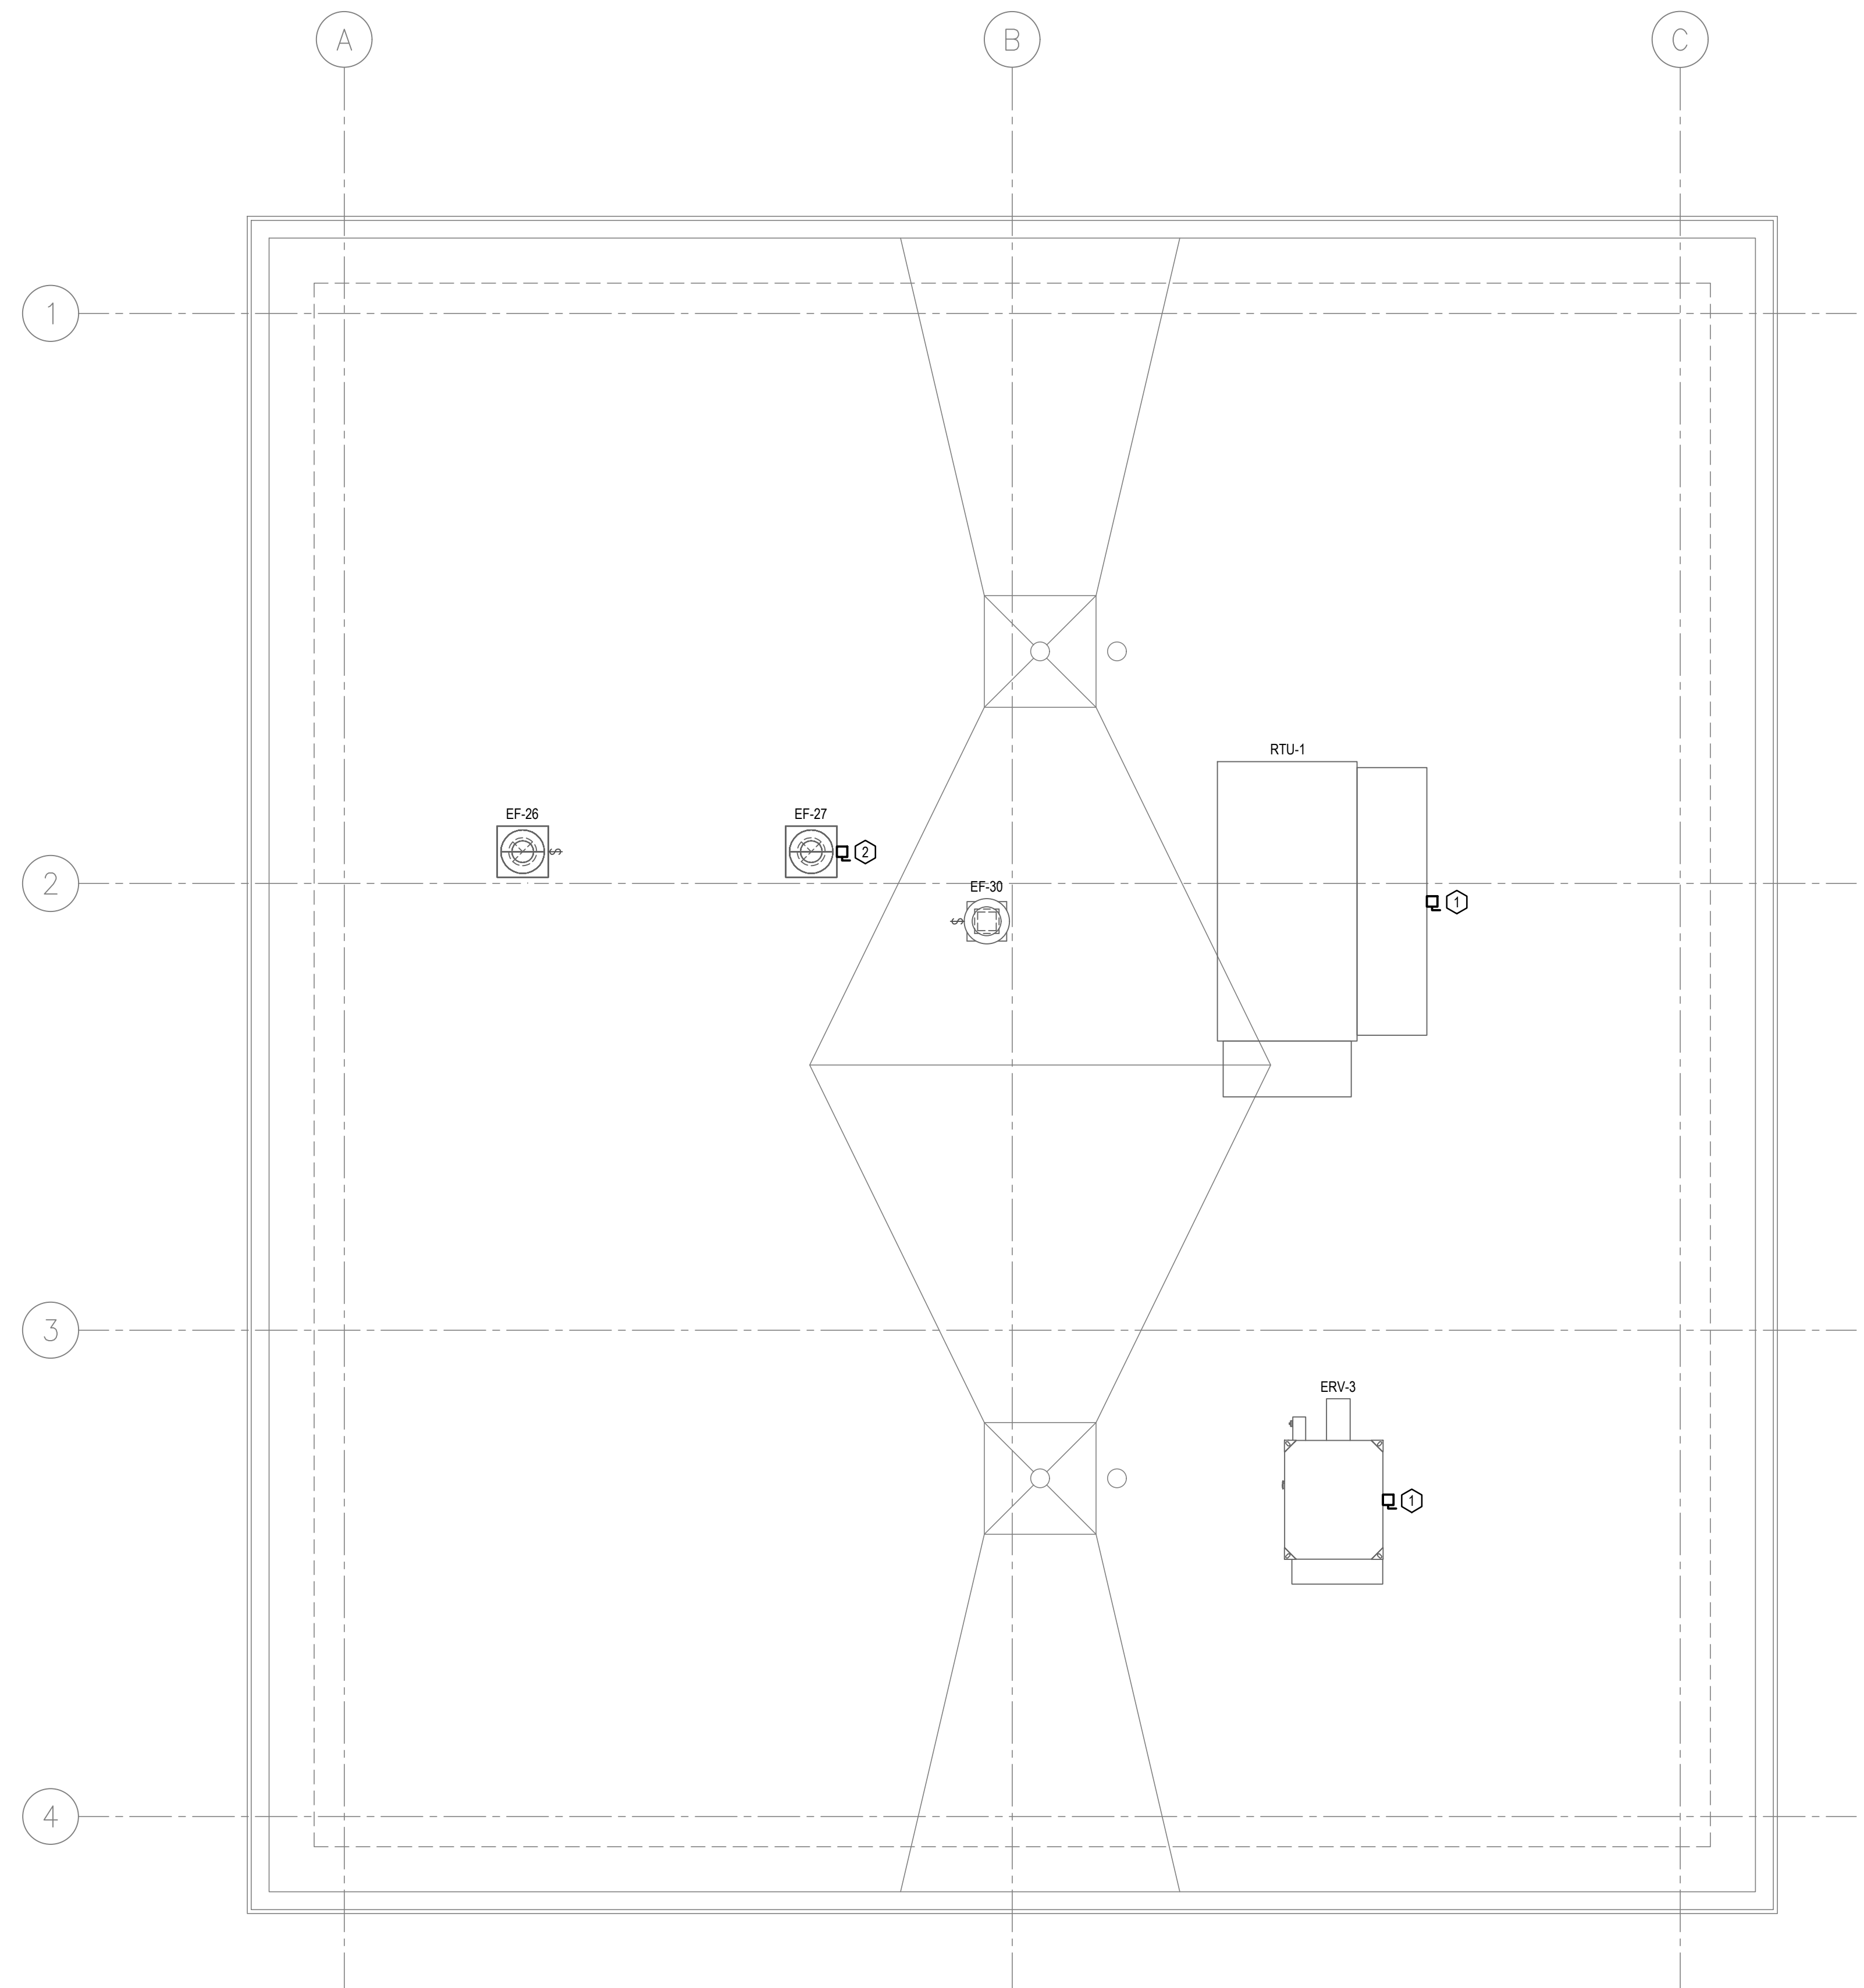


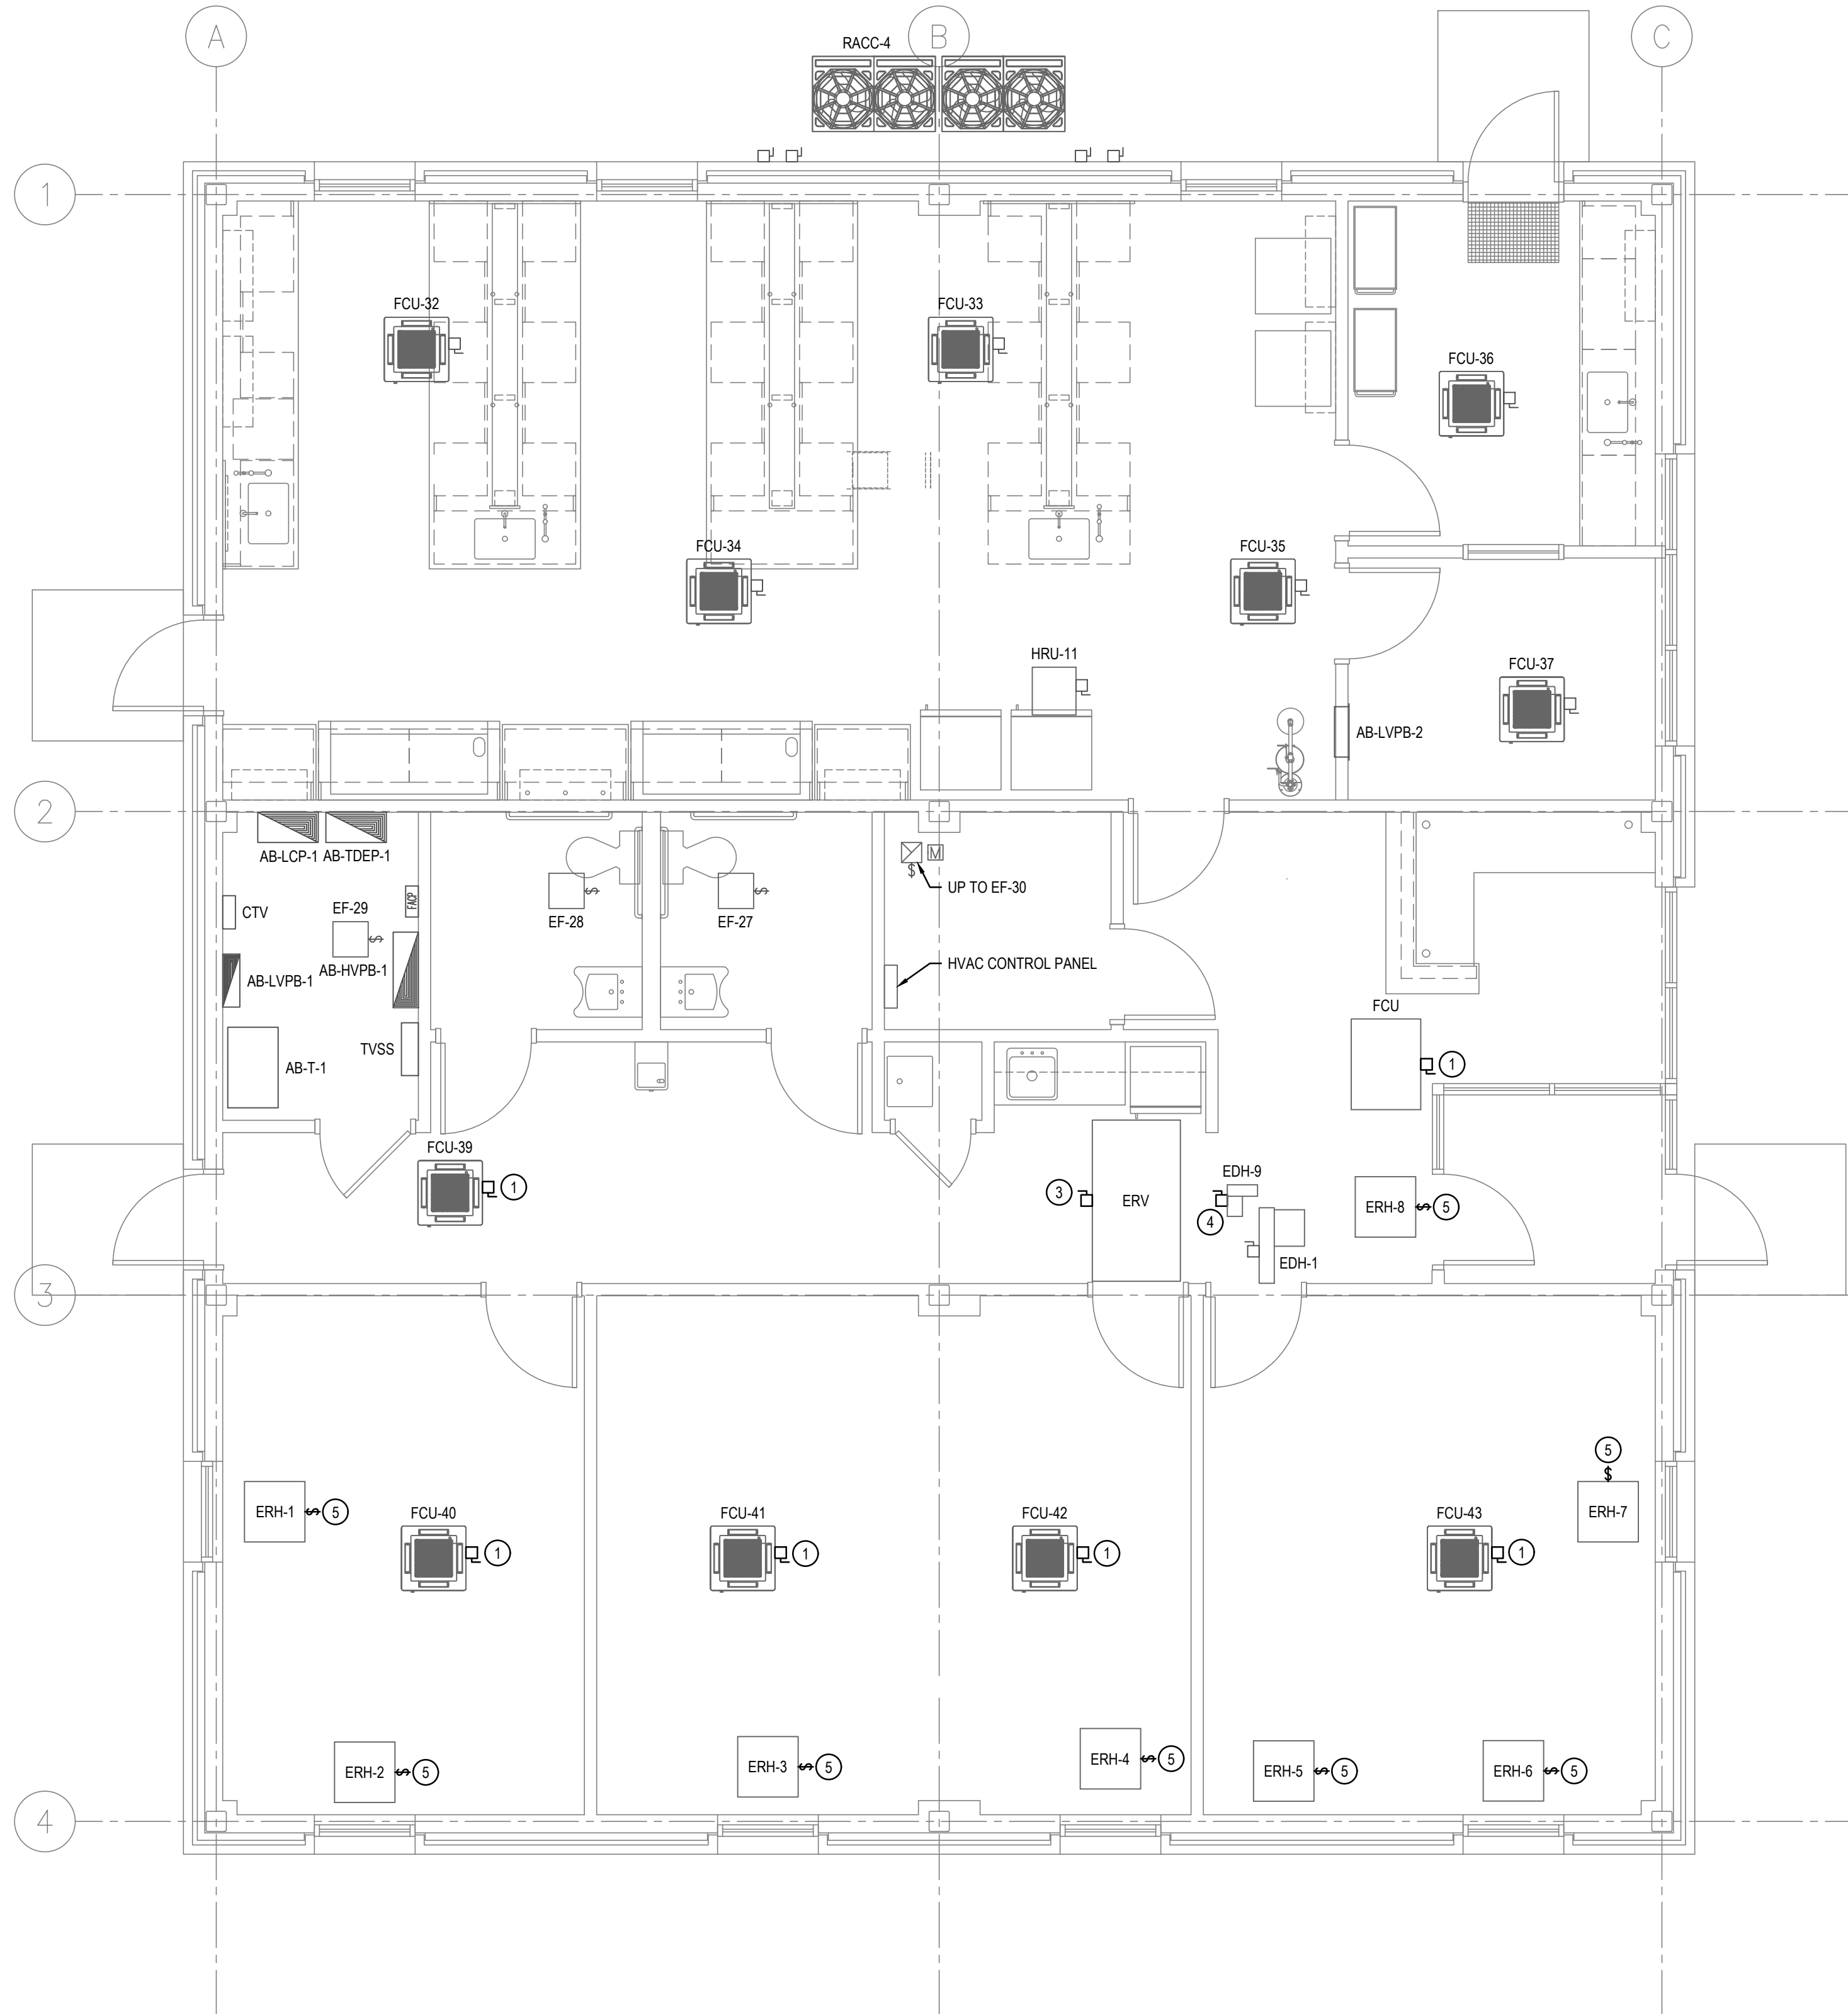

CONSTRUCTION NOTES

- ① PROVIDE & INSTALL NEW DISCONNECT SWITCH FOR EQUIPMENT SHOWN. RECONNECT POWER TO EQUIPMENT AFTER IT IS INSTALLED FROM WIRINGRACEWAY THAT WAS LEFT IN PLACE. EXTEND ANY WIRINGRACEWAY AS NECESSARY TO REACH THE NEW EQUIPMENT.
- ② PROVIDE & INSTALL NEW DISCONNECT SWITCH & DEDICATED CIRCUIT TO ODU-1 IN LOCATION SHOWN. POWER SHALL COME FROM PANEL AB-HVPB-1. REUSE EXISTING 80A 3-POLE CIRCUIT BREAKER IN PANEL TO SERVE THE NEW EQUIPMENT. WIRINGRACEWAY TO UNIT SHALL BE (3) #6 AWG + (1) #8 AWG GROUND IN 1" METAL CONDUIT.
- ③ PROVIDE & INSTALL NEW DISCONNECT SWITCH & DEDICATED CIRCUIT TO ERV-1 IN LOCATION SHOWN. POWER SHALL COME FROM PANEL AB-LVPB-1. REUSE EXISTING 20A 2-POLE CIRCUIT BREAKER IN PANEL WHICH FED THE HRU'S TO SERVE THE NEW EQUIPMENT. WIRINGRACEWAY TO UNIT SHALL BE (2) #12 AWG + (1) #12 AWG GROUND IN 3/4" METAL CONDUIT.
- ④ PROVIDE & INSTALL NEW DISCONNECT SWITCH & DEDICATED CIRCUIT TO EDH-9 IN LOCATION SHOWN. POWER SHALL COME FROM PANEL AB-LVPB-1. REUSE EXISTING 20A 2-POLE CIRCUIT BREAKER IN PANEL WHICH FED THE HRU'S TO SERVE THE NEW EQUIPMENT. WIRINGRACEWAY TO UNIT SHALL BE (2) #12 AWG + (1) #12 AWG GROUND IN 3/4" METAL CONDUIT.
- ⑤ PROVIDE & INSTALL NEW DISCONNECT SWITCH & DEDICATED CIRCUIT TO ERH'S IN LOCATION SHOWN. POWER SHALL COME FROM PANEL AB-LVPB-1. REUSE EXISTING 20A 1-POLE CIRCUIT BREAKERS IN PANEL WHICH ARE SPARES. WIRINGRACEWAY TO UNIT SHALL BE (2) #12 AWG + (1) #12 AWG GROUND IN 3/4" METAL CONDUIT. THERE SHOULD BE A MAX OF (3) ERH'S PER CIRCUIT. (3) CIRCUIT BREAKERS SHALL BE USED FROM AB-LVPB-1. CONFIRM BREAKERS ARE SPARES PRIOR TO WIRING.

1 ADMINISTRATION BUILDING POWER PLANS PHASE 1
1/4" = 1'-0"

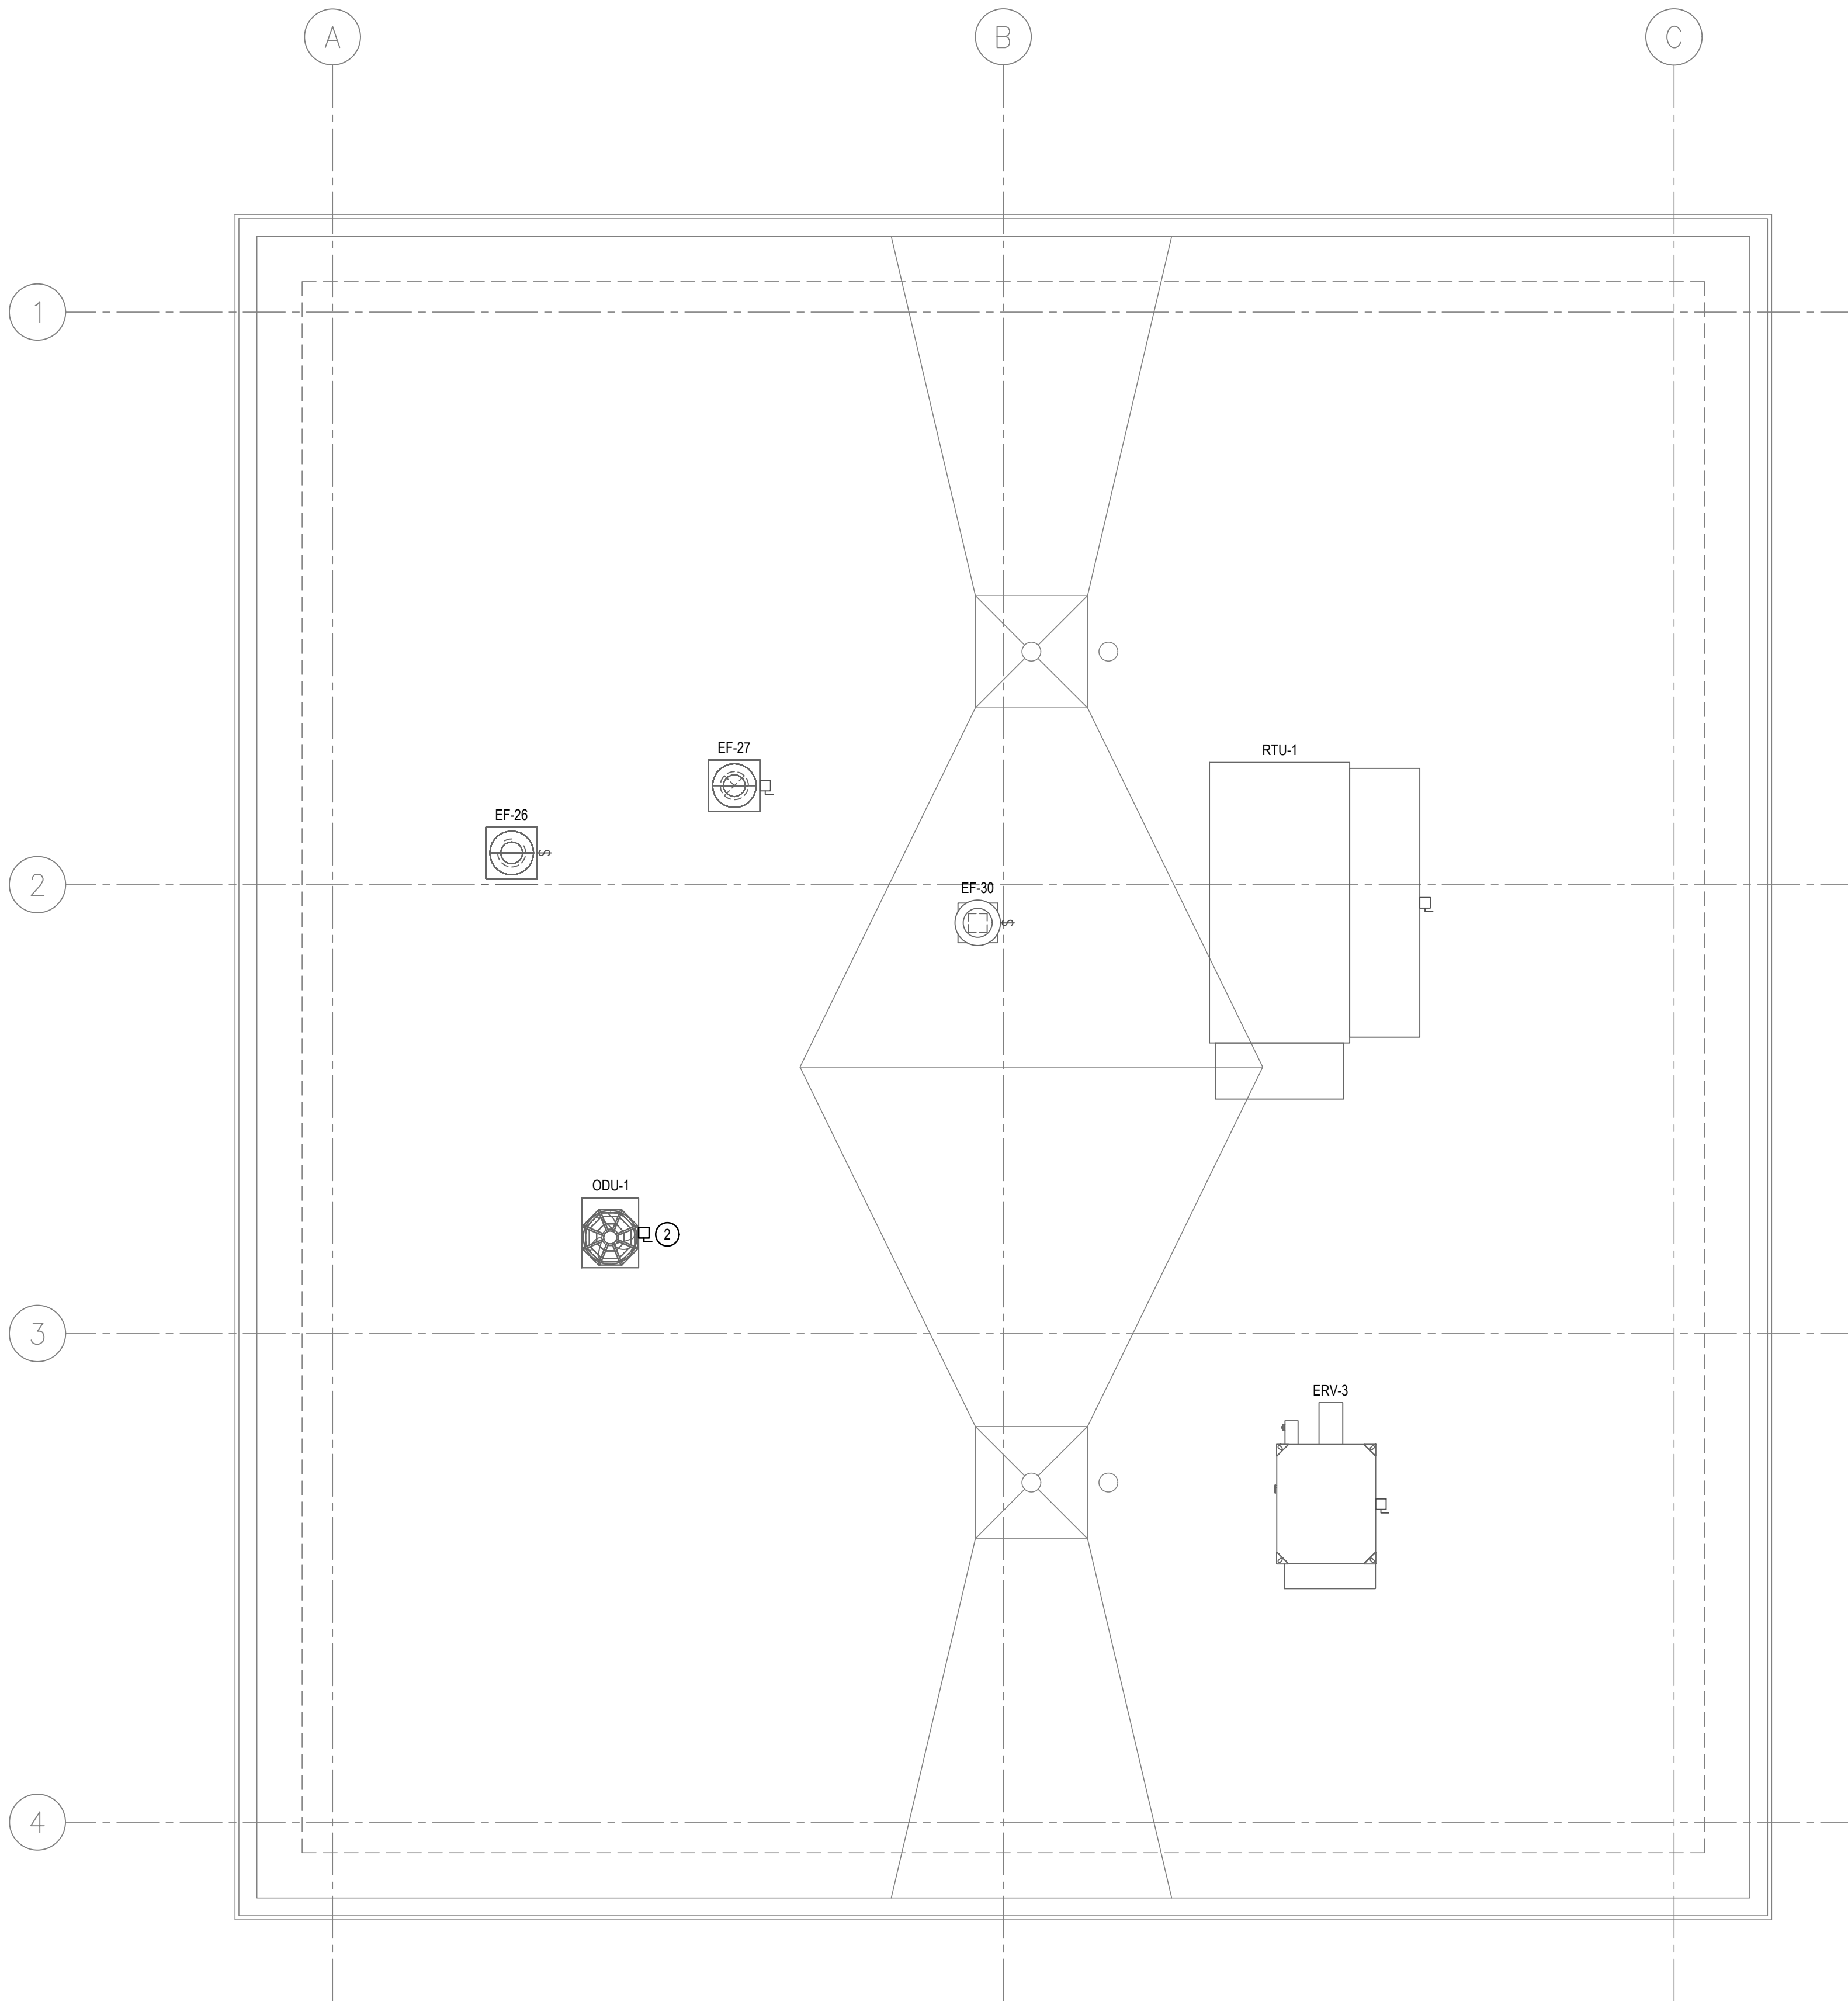

Project Title:
HVAC UPGRADES TO:
ADMINISTRATION BUILDING
1325 CHESHIRE STREET CHESHIRE,
CONNECTICUT 06410




SILVER PETRUCCELLI + ASSOCIATES
3190 WHITNEY AVENUE HAMDEN CT 06518
311 STATE STREET NEW LONDON CT 06320
203 230 9007 silverpetrucelli.com

Revision:	Description:	Date:	Revised By:

Drawing Title:
**ADMINISTRATION BUILDING
POWER PLANS PHASE 1**
Project Phase:
DESIGN DOCUMENTS NOT FOR CONSTRUCTION
State Project Number:
XXX-XXXXXXX

Date:
01/28/2026
Scale:
1/4" = 1'-0"
Drawn By:
MTC
Project Number:
25-172


E111

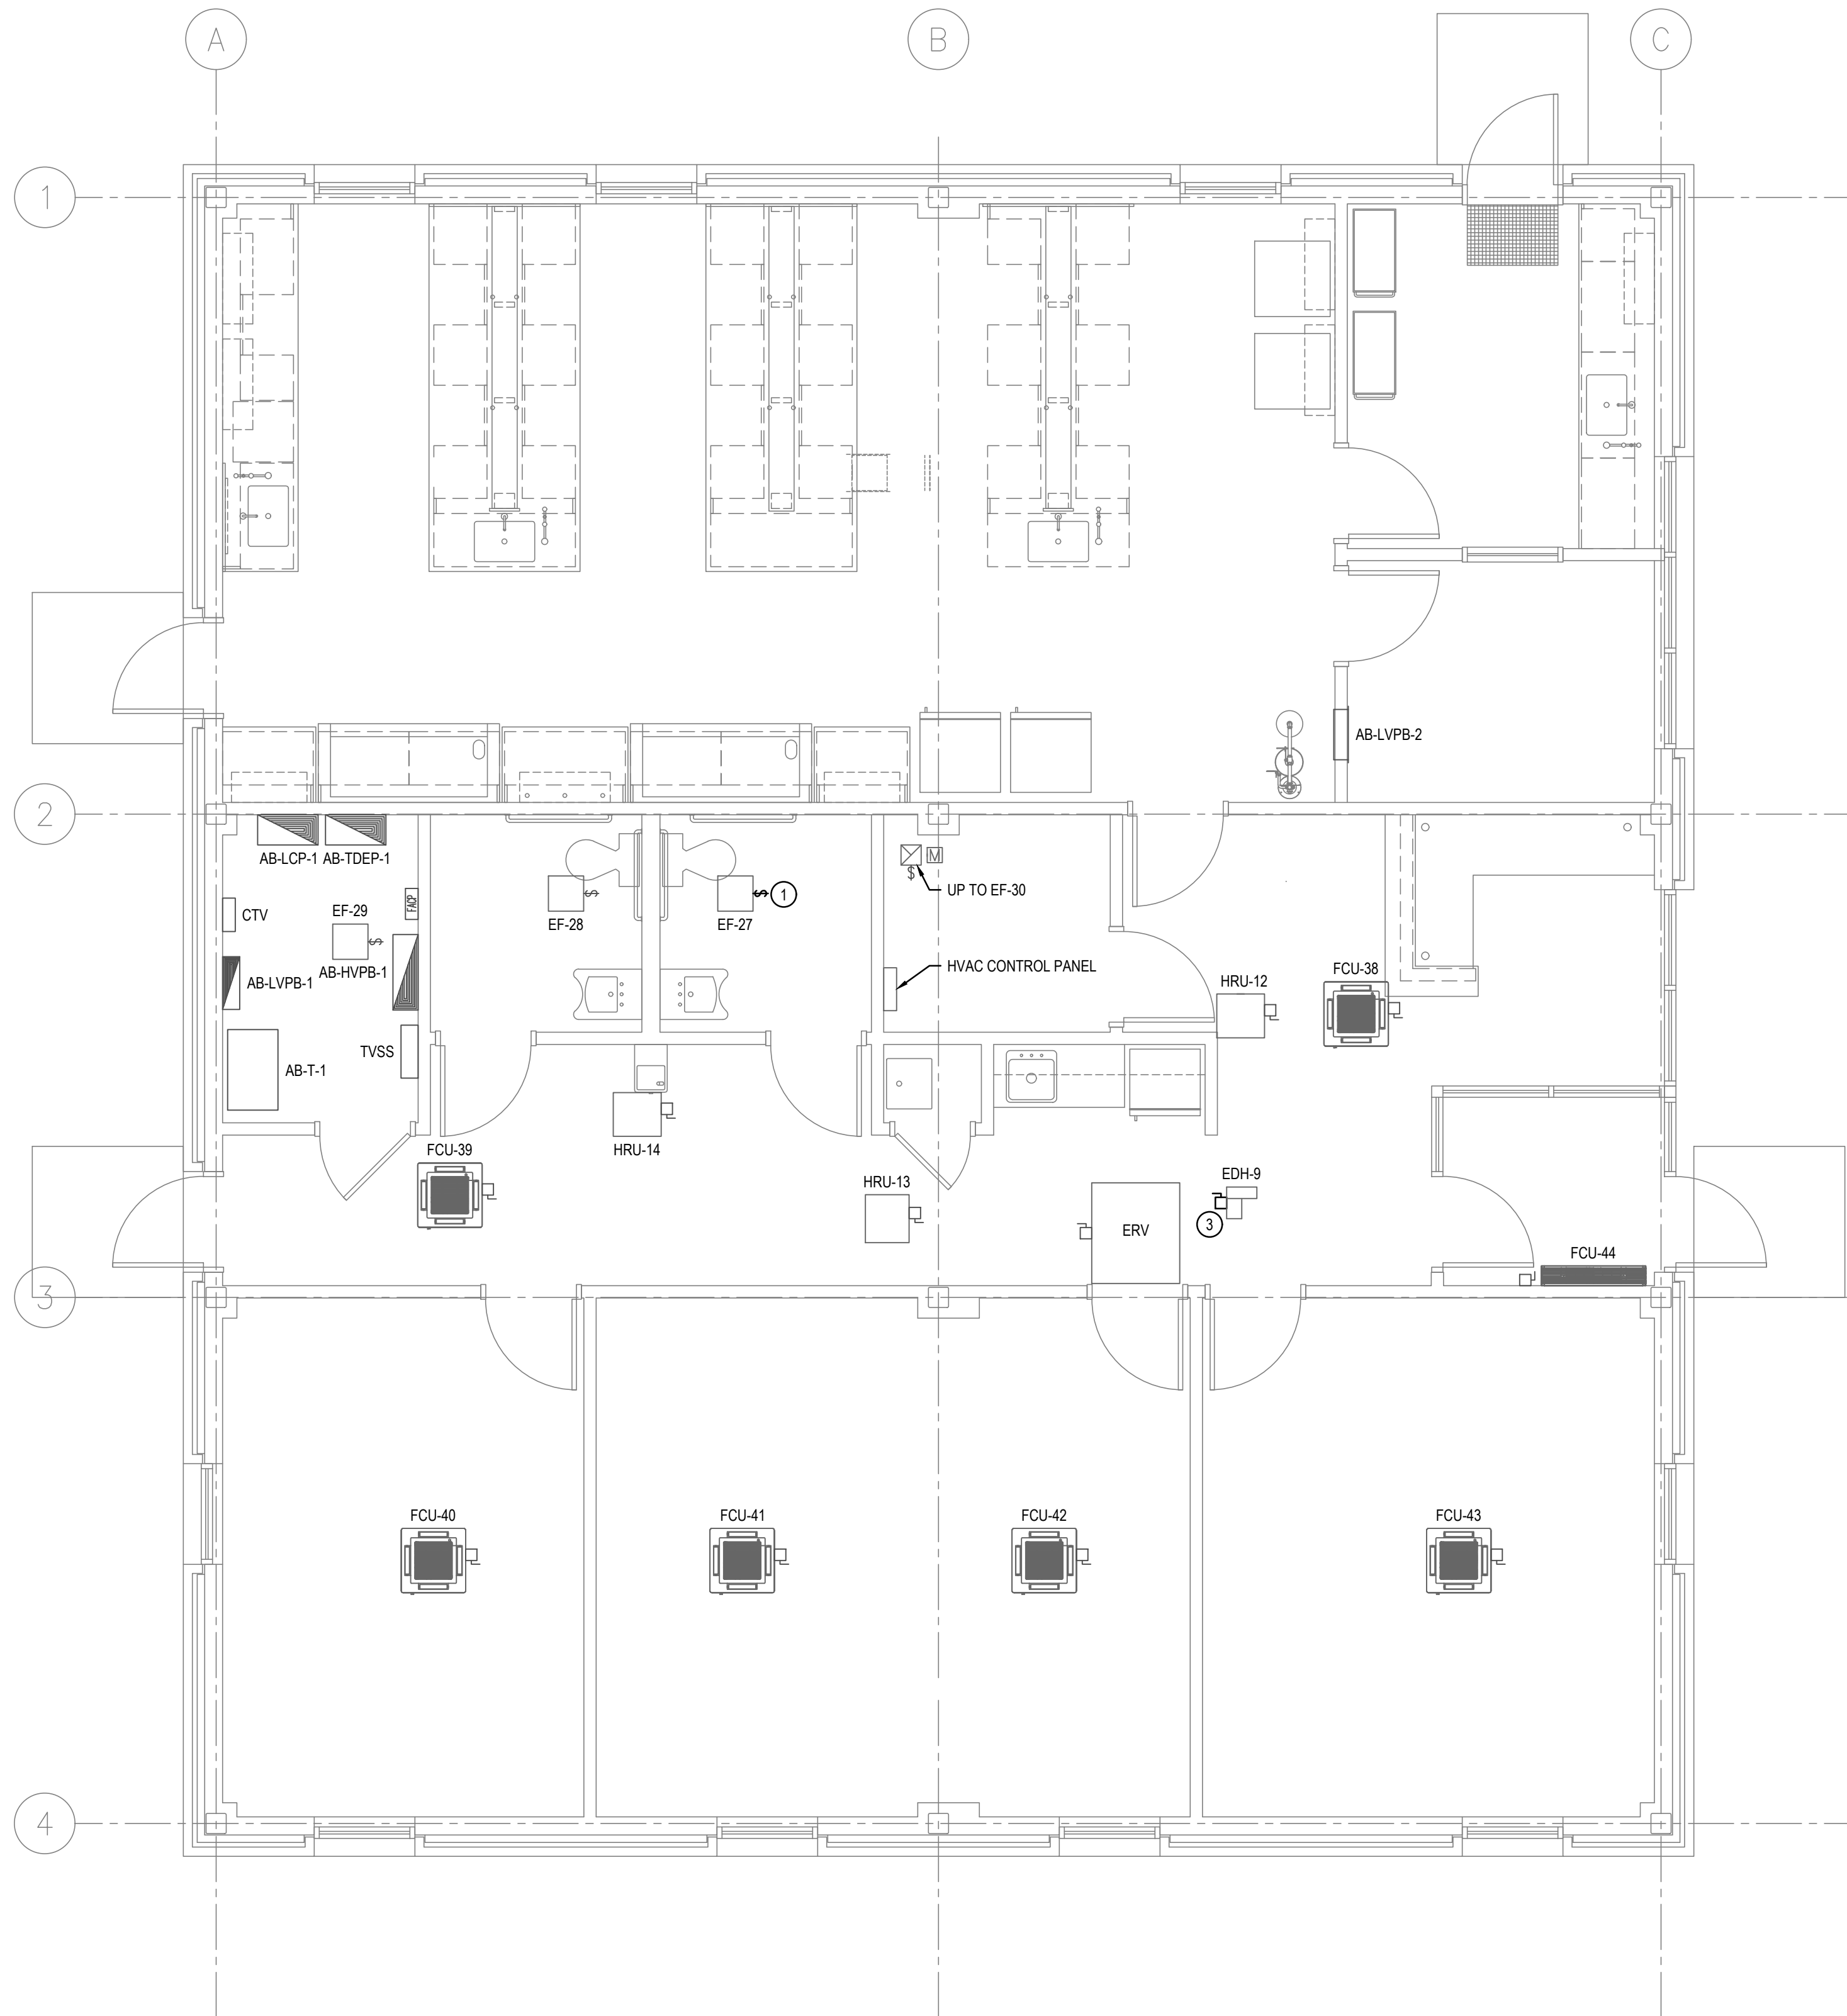

CONSTRUCTION NOTES

- 1 PROVIDE & INSTALL NEW DISCONNECT SWITCH FOR EQUIPMENT SHOWN. RECONNECT POWER TO EQUIPMENT AFTER IT IS INSTALLED FROM WIRINGRACEWAY THAT WAS LEFT IN PLACE. EXTEND ANY WIRINGRACEWAY AS NECESSARY TO REACH THE NEW EQUIPMENT.
- 2 PROVIDE & INSTALL NEW DISCONNECT SWITCH & DEDICATED CIRCUIT TO RTU-1 IN LOCATION SHOWN. POWER SHALL COME FROM PANEL AB-HVPB-1. REMOVE (1) OF THE 50A, 3-POLE CIRCUIT BREAKERS IN THE PANEL & REPLACE WITH A 40A, 3-POLE CIRCUIT BREAKER. WIRINGRACEWAY TO UNIT SHALL BE (3) #6 AWG + (1) #10 AWG GROUND IN 3/4" METAL CONDUIT.
- 3 PROVIDE & INSTALL NEW DISCONNECT SWITCH & DEDICATED CIRCUIT TO EDH-9 IN LOCATION SHOWN. POWER SHALL COME FROM PANEL AB-LVPB-1. REUSE EXISTING 20A 2-POLE CIRCUIT BREAKER IN PANEL WHICH FED THE HRU'S TO SERVE THE NEW EQUIPMENT. WIRINGRACEWAY TO UNIT SHALL BE (2) #12 AWG + (1) #12 AWG GROUND IN 3/4" METAL CONDUIT.
- 4 DUCT SMOKE DETECTORS FOR MECHANICAL UNITS. PROVIDE & INSTALL 1 FOR SUPPLY & 1 FOR RETURN. DETECTOR SHALL BE COMPATIBLE W/EXISTING FACP. COORDINATE EXACT LOCATIONS IN FIELD.

1 ADMINISTRATION BUILDING POWER PLANS PHASE 2
1/4" = 1'-0"

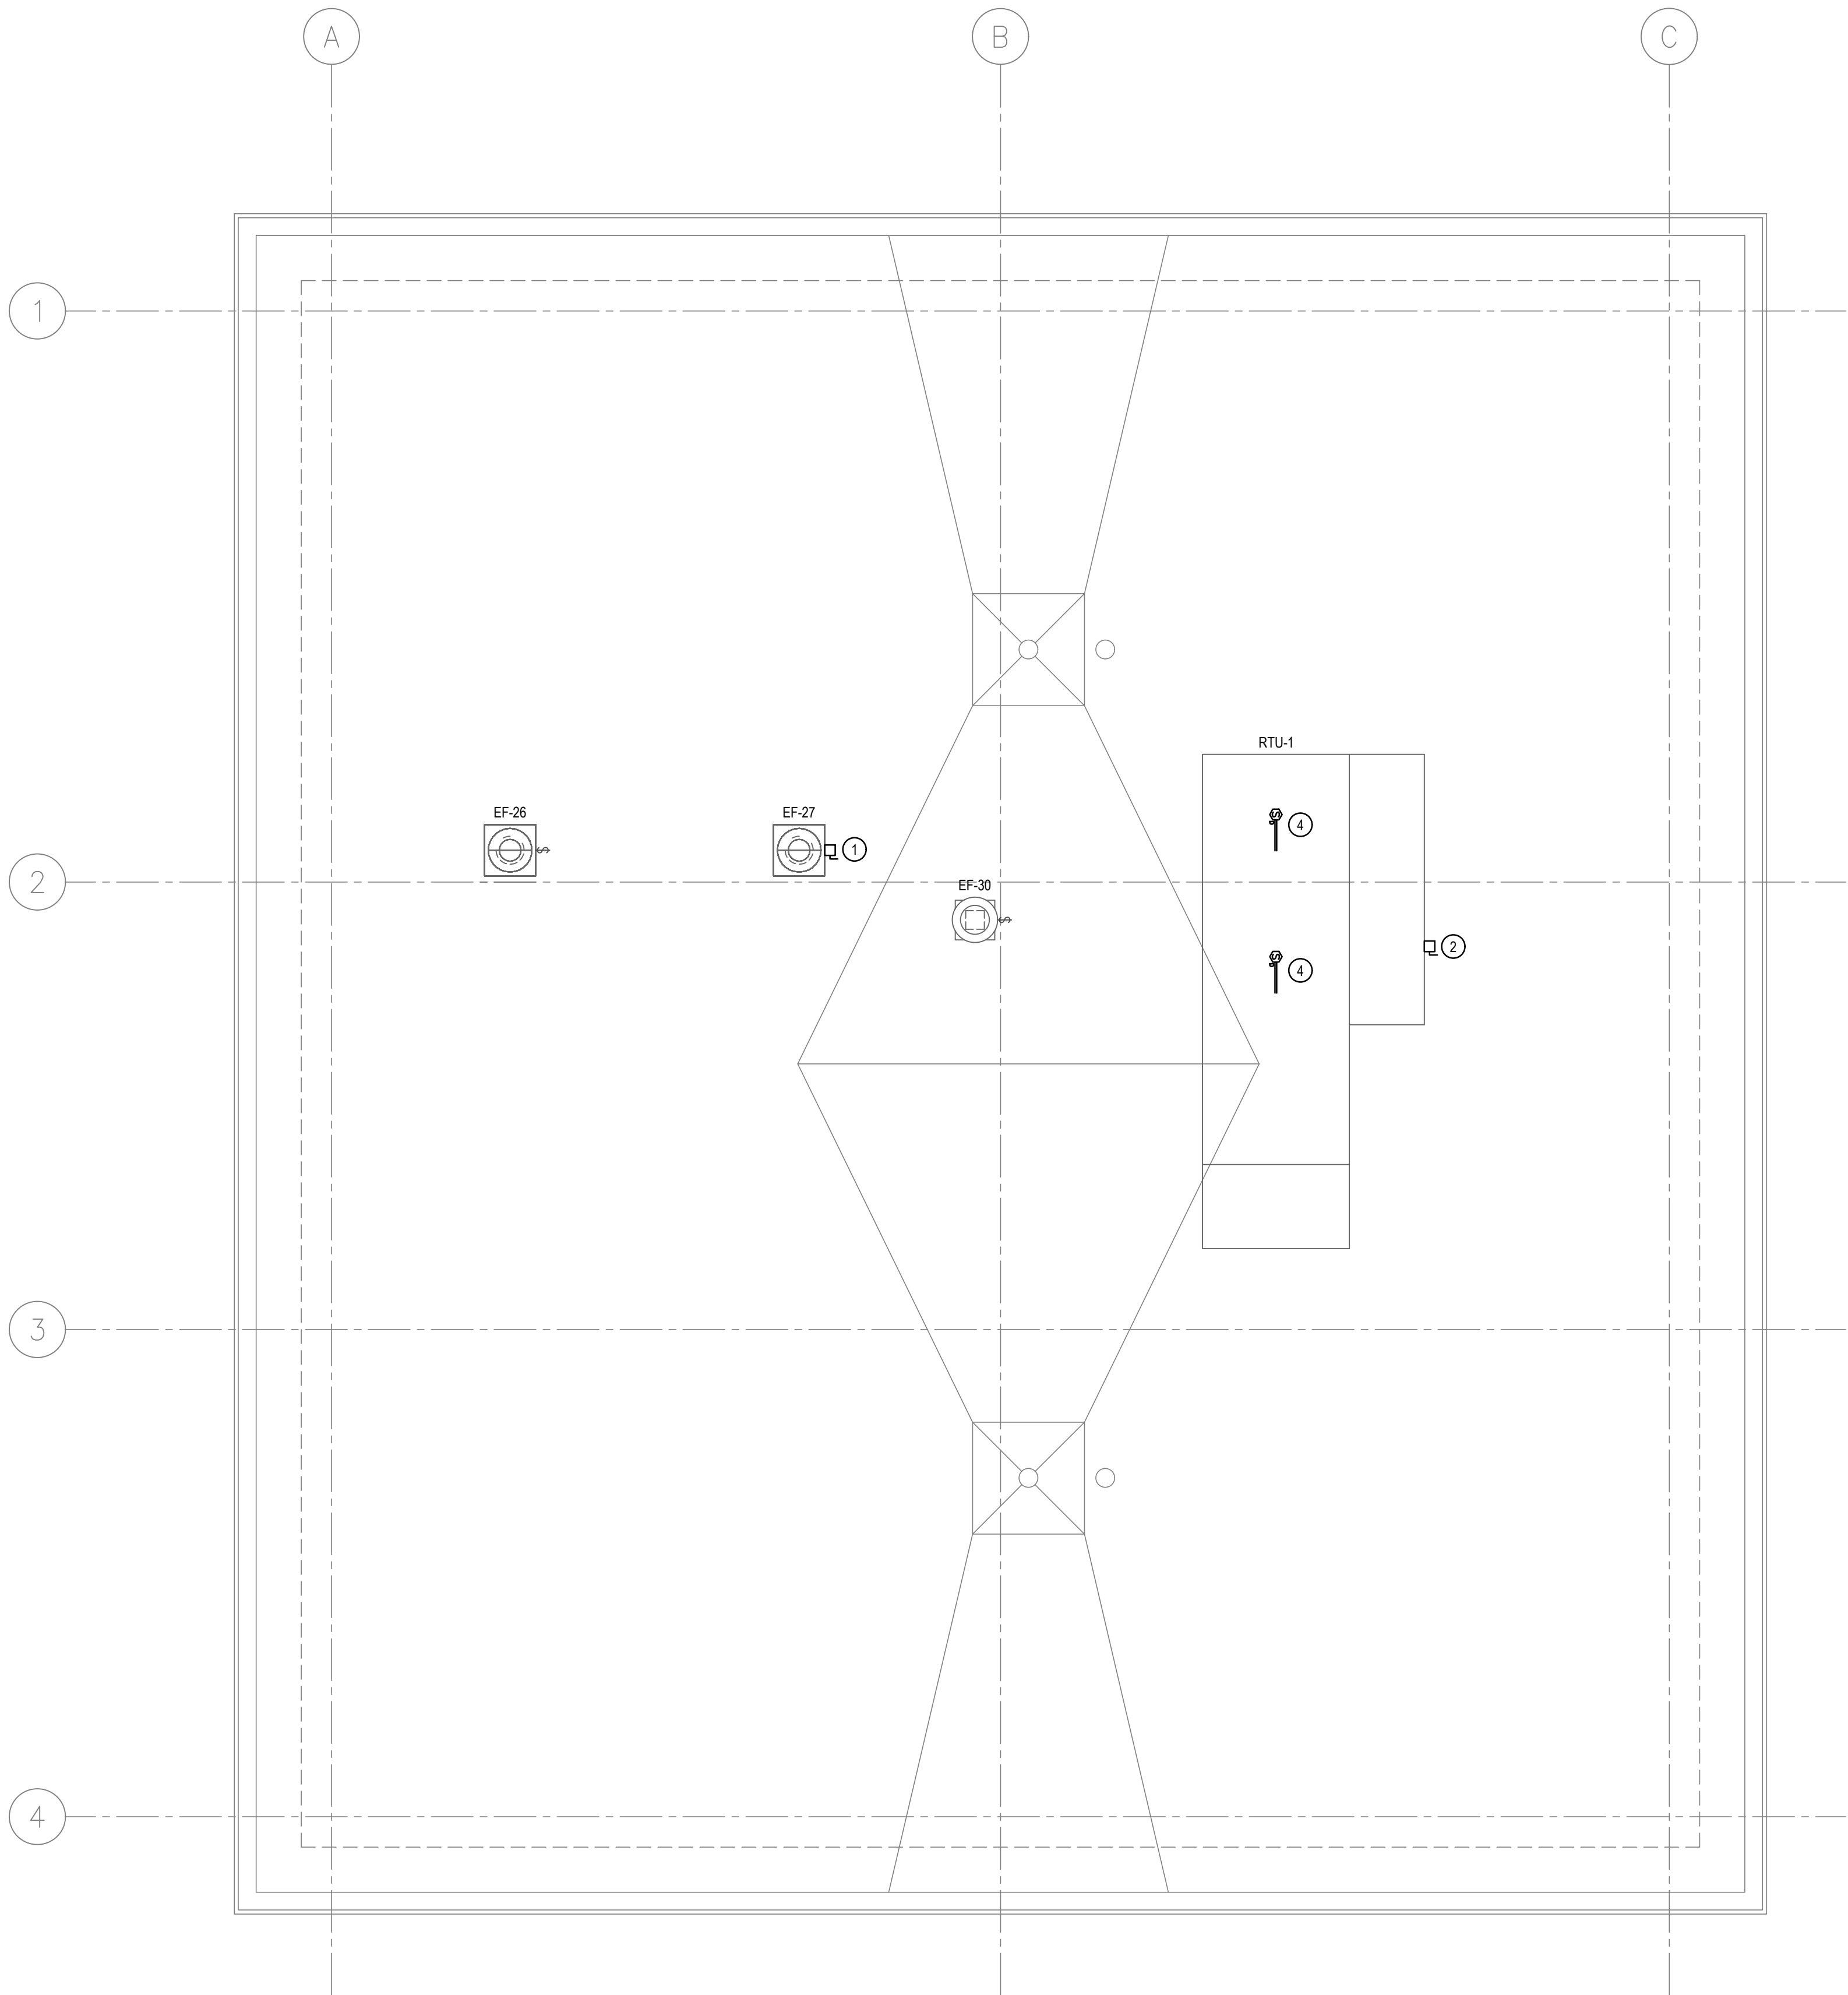

Project Title:
HVAC UPGRADES TO:
ADMINISTRATION BUILDING
1325 CHESHIRE STREET CHESHIRE,
CONNECTICUT 06410



SILVER PETRUCCELLI + ASSOCIATES
3190 WHITNEY AVENUE HAMDEN CT 06518
311 STATE STREET NEW LONDON CT 06320
203 230 9007 silverpetrucelli.com

Revision:	Description:	Date:	Revised By:

Drawing Title:
**ADMINISTRATION BUILDING
POWER PLANS PHASE 2**
Project Phase:
DESIGN DOCUMENTS NOT FOR CONSTRUCTION
State Project Number:
XXX-XXXXXXX

Date:
01/28/2026
Scale:
1/4" = 1'-0"
Drawn By:
MTC
Project Number:
25-172

E111